


**Mississippi Department of Transportation
Clearing and Pruning Limits for Parallel Above
Ground Utility Lines for Electric Power Lines**

Application and Plan for Proposed _____
 on Highway No. _____ in _____ County, as
 submitted by _____ of _____

Sheet No. _____ of _____
 Project No. _____
 Permit No. _____

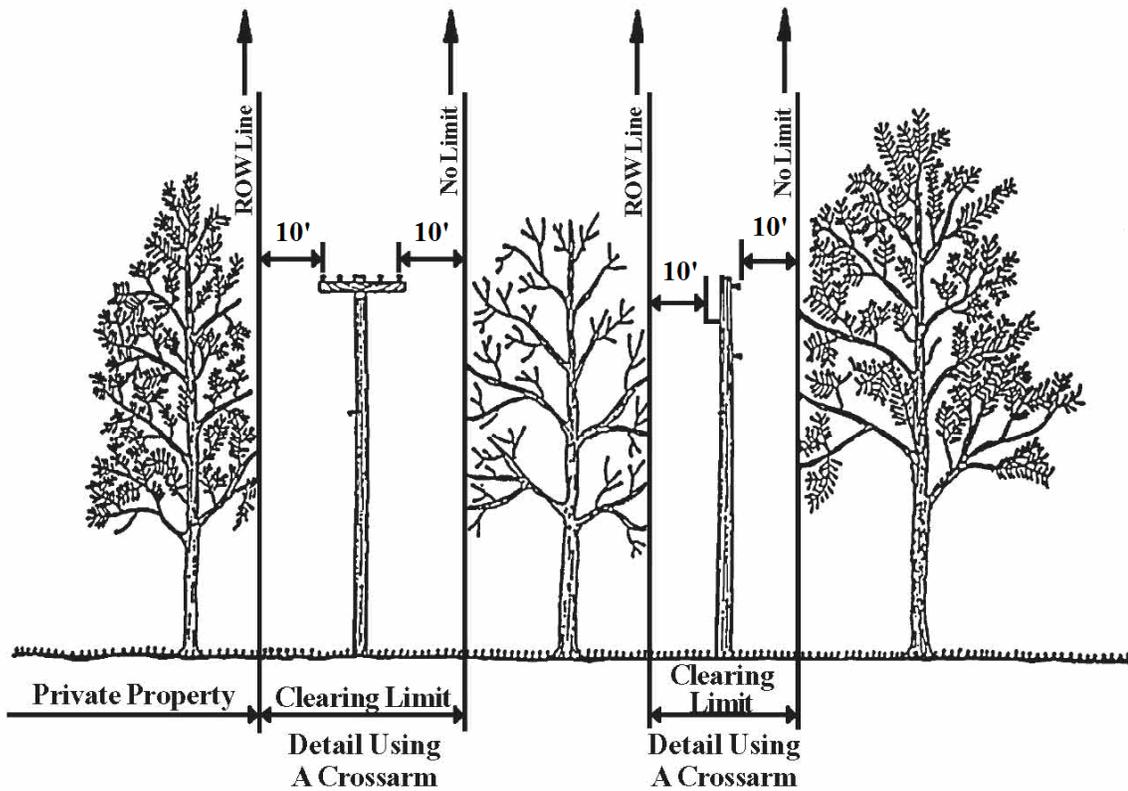

NOTE: Pruning will be permitted within approximately 10' of any wire. Where pruning is so extensive that it impairs the appearance or the future development of a tree the applicant may be granted a permit to remove the tree.

In case of a utility line to be located near the tree(s) such that the limbs would have to be trimmed back to the main tree trunk, the tree(s) shall be removed and the stump cut flush with the ground.

The clearing and pruning limits indicated on this form are the maximum widths of trees and other vegetation allowed to be removed. However, special cases may arise where additional clearing and pruning would be necessary to better fit field conditions. If so, the District Engineer or his/her authorized designee may allow an adjustment in the subject limits on a case by case basis. Any modification of the limits must be noted on the appropriate permit form(s).