MDOT Use Only
Checked _____
Loaded _____
Keyed _____

03 -

SM No. CNHPP0009020862

PROPOSAL AND CONTRACT DOCUMENTS

FOR THE CONSTRUCTION OF

03
Mill & Overlay approximately 11 miles of US 61 from 0.5 miles North of US 80/SR27 Intersection to 0.36 miles North of SR 465 at Redwood & Reconstruction of Retaining Wall on US 61 South of Redwood, known as Federal Aid Project Nos. NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301 in Warren County.

Project Completion: 171 Working Days

(STATE DELEGATED)

NOTICE

BIDDERS MUST COMPLETE AN ONLINE REQUEST FOR PERMISSION TO BID THIS PROJECT.

Electronic addendum updates will be posted on www.gomdot.com

SECTION 900

OF THE CURRENT 2017 STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION

JACKSON, MISSISSIPPI

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
TABLE OF CONTENTS

PROJECT: NHPP-0009-02(086)/108212301 - Warren
STBG-0009-02(094)/109575301 - Warren

Section 901 - Advertisement

Section 904 - Notice to Bidders

#1	Governing Specification, w/ Supplement
#2	Status of ROW, w/ Attachments
#3	Final Cleanup
#13	Safety Edge
#14	Railway-Highway Provision, w/Supplement
#296	Reduced Speed Limit Signs
#445	Mississippi Agent or Qualified Nonresident Agent
#447	Traffic on Milled Surface in Rural Areas
#516	Errata and Modifications to the 2017 Standard Specifications
#1225	Early Notice to Proceed
#1226	Material Storage Under Bridges
#1241	Fuel and Material Adjustments
#1963	Guardrail Pads
#2206	MASH Compliant Devices
#2273	Mississippi Special Fuel Tax Law
#2812	Traffic Signal and ITS Components
#2954	Reflective Sheeting for Signs
#3676	Asphalt Gyratory Compactor Internal Angle Calibration
#4113	Unique Entity ID Requirement For Federal Funded Projects
#4702	App for Traffic Control Report
#5551	Federal Bridge Formula
#5570	Special Provisions Related to Concrete
#7409	Canadian Pacific Kansas City (CPKC) Construction Requirements
#7624	Standard Drawings w/Supplement
#8076	Contract Time
#8077	Specialty Items
#8078	Cooperation Between Contractors
#8079	Scope of Work
#8080	Lane Closure Restrictions
#8081	Milestone Date
#8191	Obligation Date

906	Required Federal Contract Provisions -- FHWA 1273, w/Supplements

Section 907 - Special Provisions

907-101-1	Definitions and Terms
907-102-2	Bidding Requirements and Conditions
907-104-2	Minor Alterations to the Contract
907-105-3	Control of Work
907-106-5	Control of Materials
907-108-4	Subletting of Contract

907-108-6	Default and Termination of Contract
907-109-5	Measurement and Payment
907-234-1	Silt Fence
907-401-4	Asphalt Pavements - General
907-403-4	Asphalt Pavements
907-407-1	Tack Coat
907-413-2	Cleaning and Sealing Joints and Cracks
907-420-1	Undersealing
907-503-1	Replacement of Concrete Pavement
907-603-2	Cured-In-Place Pipe
907-618-12	Traffic Control Management
907-619-5	Traffic Control for Construction Zones
907-619-6	Temporary Portable Rumble Strips
907-626-12	Thermoplastic Traffic Markings
907-627-1	Raised Pavement Markings
907-631-1	Traffic Signal Systems - General, w/Supplement
907-632-1	Traffic Signal Cabinet Assemblies
907-643-5	Video Vehicle Detection
907-650-5	On-Street Video Equipment
907-662-2	Radio Interconnect System
907-663-6	Networking Equipment
907-700-3	Materials and Tests w/Attachment
907-701-4	Hydraulic Cement, w/ Supplement
907-702-4	Bituminous Materials
907-703-2	Gradation
907-705-1	Stone Riprap
907-707-3	Joint Materials
907-708-4	Concrete Pipe
907-711-2	Plain Steel Wire
907-712-1	Fence and Guardrail
907-714-4	Miscellaneous Materials
907-718-1	Timber and Dimension Lumber
907-720-4	Pavement Marking Materials
907-721-4	Materials for Signing
907-722-1	Materials for Traffic Signal Installation
907-799-1	Hydraulic Cement Concrete Mixtures, w/Supplement
907-899-1	Railway-Highway Provisions

Section 905 - Proposal, Proposal Bid Items, Combination Bid Proposal
Certification of Performance - Prior Federal-Aid Contracts
Certification Regarding Non-Collusion, Debarment and Suspension
SAM.GOV Registration and Unique Entity ID
Section 902 - Contract Form
Section 903 - Contract Bond Forms

Pile and Driving Equipment Data Form
Progress Schedule

PROJECT: **NHPP-0009-02(086)/108212301 - Warren**
STBG-0009-02(094)/109575301 - Warren

(REVISIONS TO THE ABOVE WILL BE INDICATED ON THE SECOND SHEET OF SECTION 905 AS ADDENDA)

07/29/2026 04:21 PM

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 901 - ADVERTISEMENT

Electronic bids will be received by the Mississippi Transportation Commission at 10:00 o'clock A.M., Tuesday, August 25, 2026, from the Bid Express Service and shorty thereafter publicly read on the Sixth Floor For:

Mill & Overlay approximately 11 miles of US 61 from 0.5 miles North of US 80/SR27 Intersection to 0.36 miles North of SR 465 at Redwood & Reconstruction of Retaining Wall on US 61 South of Redwood, known as Federal Aid Project Nos. NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301 in Warren County.

The attention of bidders is directed to the Contract Provisions governing selection and employment of labor. Minimum wage rates have been predetermined by the Secretary of Labor and are subject to Public Law 87-581, Work Hours Act of 1962, as set forth in the Contract Provisions.

The specifications are on file in the offices of the Mississippi Department of Transportation.

Contractors may request permission to bid online at http://shop.mdot.ms.gov at no cost. Upon approval, Contractors shall be eligible to submit a bid using Bid Express at http://bidx.com. Specimen proposals may be viewed and downloaded online at no cost at http://mdot.ms.gov or purchased online at http://shop.mdot.ms.gov at a cost of Ten Dollars ($10.00) per proposal plus a small convenience fee. Cash or checks will not be accepted as payment.

Bid bond, signed or countersigned by a Mississippi Agent or Qualified Nonresident Agent, with Power of Attorney attached, a Cashier's check or Certified Check for five (5%) percent of bid, payable to STATE OF MISSISSIPPI, must accompany each proposal.

The attention of bidders is directed to the provisions of Subsection 102.07 pertaining to irregular proposals and rejection of bids.

BRAD WHITE
EXECUTIVE DIRECTOR

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO NOTICE TO BIDDERS NO. 1

DATE: **06/08/2021**

SUBJECT: **Governing Specifications**

Change the web address at the end of the first paragraph to the following.

https://shop.mdot.ms.gov/default.aspx?StoreIndex=1

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 1 **CODE: (IS)**

DATE: 03/01/2017

SUBJECT: Governing Specifications

The current (2017) Edition of the Standard Specifications for Road and Bridge Construction adopted by the Mississippi Transportation Commission is made a part hereof fully and completely as if it were attached hereto, except where superseded by special provisions, or amended by revisions of the Specifications contained within this proposal. Copies of the specification book may be purchased from the MDOT Construction Division, or online at shopmdot/default.aspx?StoreIndex=1.

A reference in any contract document to controlling requirements in another portion of the contract documents shall be understood to apply equally to any revision or amendment thereof included in the contract.

In the event the plans or proposal contain references to the 2004 Edition of the Standard Specifications for Road and Bridge Construction, it is to be understood that such references shall mean the comparable provisions of the 2017 Edition of the Standard Specifications.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 2 **CODE: (IS)**

DATE: 03/01/2017

SUBJECT: Status of Right-of-Way

Although it is desirable to have acquired all rights-of-way and completed all railroad agreements, utility adjustments and work to be performed by others prior to receiving bids, sometimes it is not considered to be in the public interest to wait until each and every such clearance has been obtained. The bidder is hereby advised of possible unacquired rights-of-way, relocates, railroad agreements and utilities adjustments which have not been completed.

The status of right-of-way acquisition, utility adjustments, encroachments, potentially contaminated sites, railroad facilities, improvements, and asbestos contamination are set forth in the following attachments.

In the event right of entry is not available to ALL parcels of right-of-way and/or all work that is to be accomplished by others on the date set forth in the contract for the Notice to Proceed is not complete, the Department will issue a restricted Notice to Proceed.

STATUS OF RIGHT-OF-WAY
NHPP-0009-02(086)
108212/301000
Warren County

All rights of way and legal rights of entry have been acquired **except:**

None.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

Inter-Departmental Memorandum

To:	Right of Way Division Don Drake	**Date:**	May 4, 2026
From:	Pre-Construction Engineer District 3 Adam Boggan	**Project No:**	108212/301000 NHPP-0009-02(086)
		County:	Warren

DISTRICT STATUS REPORT

1. **STATUS OF RIGHT OF WAY:** All work to be done within existing ROW.
2. **RIGHT OF WAY CLEARANCE:** There are no encroachments.
3. **STATUS OF AFFECTED RAILROAD OPERATING FACILITIES:** None affected.
4. **STATUS OF REQUIRED UTILITY RELOCATIONS:** No utility conflicts.
5. **STATUS OF CONSTRUCTION AGREEMENT:** None required.

AB:ab

pc: Joel Bellipanni (District Three)
James Burks (District Three)
Alex Zivic (Construction Division)
Sir Johnathan Rucker (Construction Utility & Permitting)
Don Drake (Right of Way)
File

ASBESTOS ABATEMENT STATUS REPORT

NHPP-0009-02(086) 108212-301000

Warren County

May 5, 2026

Reference is made to notices to bidders entitled "Asbestos National Emission Standards for Hazardous Air Pollutants (NESHAP)" and "Removal of Obstructions".

The following pertinent information is furnished concerning asbestos-containing materials (ACMs), if any, found in buildings to be removed by the Contractor.

There is no right-of-way required for this project, and the contractor will not need to remove any buildings.

STATUS OF POTENTIALLY CONTAMINATED SITES REPORT

NHPP-0009-02(086) 108212-301000

Warren County

May 5, 2026

THERE IS NO RIGHT-OF-WAY REQUIRED FOR THIS PROJECT. NO INITIAL SITE ASSESSMENT WILL BE PERFORMED. IF CONTAMINATION ON THE EXISTING RIGHT-OF-WAY IS DISCOVERED, IT WILL BE HANDLED BY THE DEPARTMENT.

IMPROVEMENTS STATUS REPORT

Improvements to be included in the Notice to Bidders to be removed by the Construction Contractor

FMS Construction Project No: 108212-301000

FMS ROW Project No:

External ROW No: NHPP-0009-02(086)

Parcel No:
Station No:
Property Owner:
Description/Pictures:

STATUS OF RIGHT-OF-WAY
STBG-0009-02(094)
109575/301000
Warren County

All rights of way and legal rights of entry have been acquired **except:**

None.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

Inter-Departmental Memorandum

To:	Right of Way Division Don Drake	**Date:**	April 17, 2026
From:	Pre-Construction Engineer District 3 Adam Boggan	**Project No:**	109575/301000 STBG-0009-02(094)
		County:	Warren

DISTRICT STATUS REPORT

1. **STATUS OF RIGHT OF WAY:** All work to be done within existing ROW.
2. **RIGHT OF WAY CLEARANCE:** There are no encroachments.
3. **STATUS OF AFFECTED RAILROAD OPERATING FACILITIES:** None affected.
4. **STATUS OF REQUIRED UTILITY RELOCATIONS:** No utility conflicts.
5. **STATUS OF CONSTRUCTION AGREEMENT:** None required.

AB:ab

pc: Joel Bellipanni (District Three)
James Burks (District Three)
Alex Zivic (Construction Division)
Sir Johnathan Rucker (Construction Utility & Permitting)
Don Drake (Right of Way)
File

ASBESTOS CONTAMINATION STATUS OF BUILDINGS
TO BE REMOVED BY THE CONTRACTOR
STBG-0009-02(094)
109575/301000
Warren County
April 17, 2026

Reference is made to notices to bidders entitled "Asbestos National Emission Standards for Hazardous Air Pollutants (NESHAP)" and "Removal of Obstructions".

The following pertinent information is furnished concerning asbestos containing materials (ACMs), if any, found in buildings to be removed by the Contractor.

There is no Right of Way required for this project. There are no buildings to be removed by the contractor.

STATUS OF POTENTIALLY CONTAMINATED SITES

STBG-0009-02(094)
109575/301000
Warren County
April 17, 2026

THERE IS NO RIGHT OF WAY REQUIRED FOR THIS PROJECT. NO INITIAL SITE ASSESSMENT WILL BE PERFORMED. IF CONTAMINATION ON EXISTING RIGHT OF WAY IS DISCOVERED, IT WILL BE HANDLED BY THE DEPARTMENT.

Improvements to be included in Notice to Bidders to be removed by the Construction Contractor

FMS Construction Project No: 109575/301000

External ROW No: STBG-0009-02(094)

Parcel No:

Station No:

Property Owner:

Description/Pictures:

NA

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 3 **CODE: (SP)**

DATE: 01/17/2017

SUBJECT: Final Clean-Up

Immediately prior to final inspection for release of maintenance, the Contractor shall pick up, load, transport and properly dispose of all litter from the entire highway right-of-way that is within the termini of the project.

Litter shall include, but not be limited to, solid wastes such a glass, paper products, tires, wood products, metal, synthetic materials and other miscellaneous debris.

Litter removal is considered incidental to other items of work and will not be measured for separate payment.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 13 **CODE: (IS)**

DATE: 03/01/2017

SUBJECT: Safety Edge

Bidders are hereby advised that the Shoulder Wedge (Safety Edge) specified in Section 401, Asphalt Pavements, shall only apply to the top two (2) lifts of asphalt. Open Graded Friction Courses (OGFC) are not to be considered a lift as it pertains to safety edge. Attached is a drawing showing the safety edge. Note that the shoulder dimensions in the bottom two drawings will be less than three feet (3').

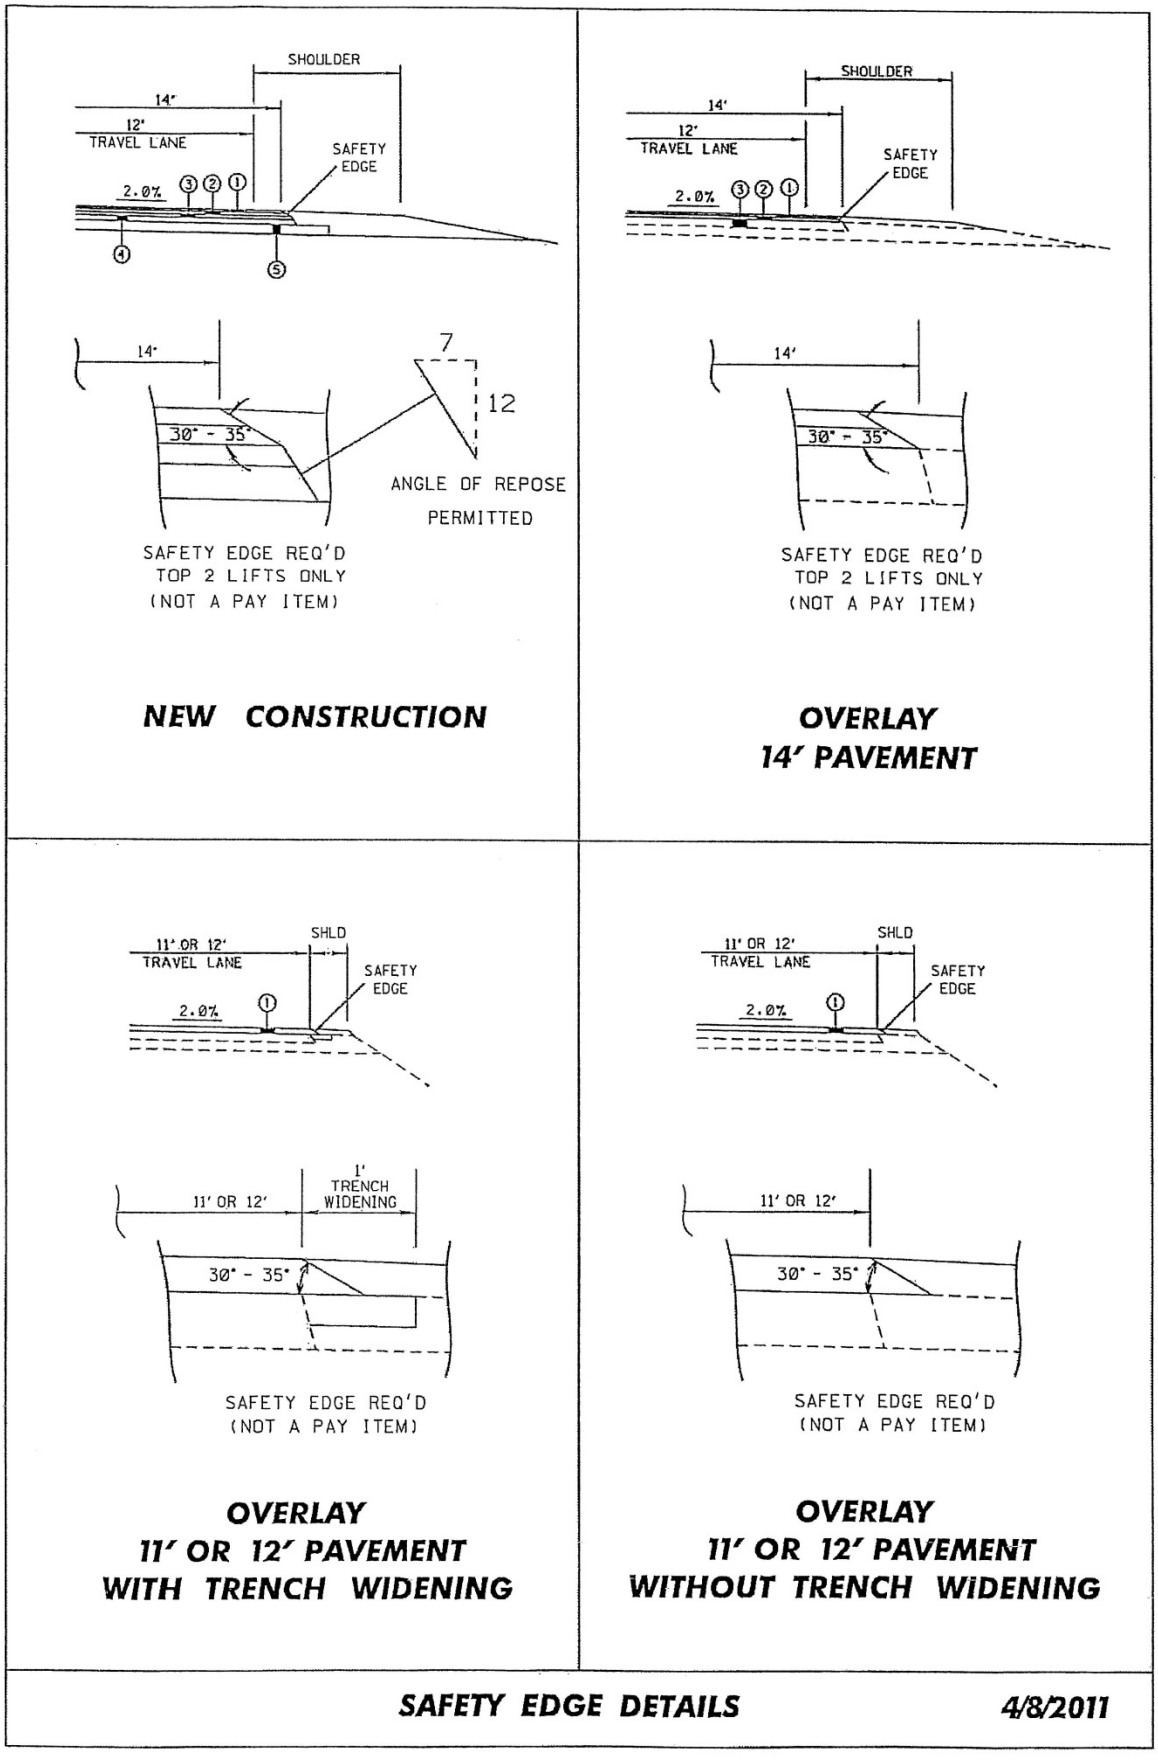
SHOULDER
14'
12'
TRAVEL LANE
SAFETY EDGE
2.0%
30° - 35°
7
12
ANGLE OF REPOSE PERMITTED
SAFETY EDGE REQ'D TOP 2 LIFTS ONLY (NOT A PAY ITEM)
NEW CONSTRUCTION
OVERLAY 14' PAVEMENT
11' OR 12'
SHLD
1' TRENCH WIDENING
SAFETY EDGE REQ'D (NOT A PAY ITEM)
OVERLAY 11' OR 12' PAVEMENT WITH TRENCH WIDENING
OVERLAY 11' OR 12' PAVEMENT WITHOUT TRENCH WIDENING
SAFETY EDGE DETAILS
4/8/2011

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO NOTICE TO BIDDERS NO. 14

DATE: 7/8/2026

PROJECT: NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301
Warren County

After the second paragraph on page 1, add the following:

Name Insured: *Vicksburg Southern Railroad (VSOR)*

Description and Designation: *Right-of-Way adjacent to US 61, between Old HWY 61 and SR 3, Warren County, MS*

After the fourth paragraph on page 1, add the following:

Vicksburg Southern Railroad
Operations
2105 Levee St
Vicksburg, MS 39180
769.259.9692 (Office)

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 14 **CODE: (SP)**

DATE: 01/17/2017

SUBJECT: Railway-Highway Provisions

Prior to bidding, the Contractor shall contact the Railroad concerning insurance coverage required for this project. In case the railroad requires coverage over and above that required by the Standard Specifications, the railroad requirements shall be met.

The name insured, description of the work and designation of the job site to be shown on the Policy are as follows:

Notice of starting to work, completion of any required forms, and correspondence pertaining to railroad liability insurance shall be directed to the person below.

The Contractor shall not commence, or carry on, any work for installation, maintenance, repair, changing or renewal of any FACILITY, under, over or on RAILROAD property at any location without giving at least ten (10) working days prior notice to the RAILROAD authorized representative at the RAILROAD's office(s) below.

If in the opinion of the RAILROAD, the presence of an authorized representative of the RAILROAD is required to supervise the same, the RAILROAD shall render bills to the Contractor for all expenses incurred by it for such supervision. This includes all labor costs for flagmen or cable locate supplied by the RAILROAD to protect RAILROAD operation, and for the full cost of furnishing, installation and later removal of any temporary supports for said tracks, as the RAILROAD's Chief Engineer's Office may deem necessary.

It will be the Contractor's responsibility to pay all bills associated with railroad flagging and cable locating. Generally, the flagging rate is $700.00 per day (1 to 8 hours) plus overtime at $125.00 per hour, however, the Contractor shall contact the RAILROAD to verify all rates.

A flagman is required anytime a Contractor does any work on or near RAILROAD property within twenty-five (25) feet horizontally of the centerline or any work over any railroad track. The RAILROAD, however, also reserves the right to require a flagman for work on RAILROAD property, which is more than twenty-five (25) feet from the centerline of a railroad track when there are other conditions or considerations that would dictate the need for a flagman to safeguard the RAILROAD's operations, property and safety of working personnel.

A cable locate of RAILROAD owned facilities may be required to identify and protect Signal & Communication cables that have been installed to provide power, signal control, wayside communications. These cables are vital to a safe and reliable railway operation. The cable locate will be performed by a qualified RAILROAD employee.

Outside Contractors are prohibited from driving on, along, or across any track that does not have a RAILROAD installed crossing. They may utilize an existing public crossing. The practice of allowing rubber tired equipment to operate over track with no crossing has been banned.

Exceptions to this rule will require the express approval from the RAILROAD Engineers.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 296 **CODE: (SP)**

DATE: 07/25/2017

SUBJECT: Reduced Speed Limit Signs

Bidders are advised that when the plans or contract documents require the speed limit on a project to be reduced, the Contractor shall begin work within 48 hours of installing the reduced speed limit signs. Should the Contractor not start work or have no plans to start work within 48 hours of installing the signs, the reduced speed limit signs shall be covered and existing speed limit signs uncovered.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 445 **CODE: (SP)**

DATE: 10/10/2017

SUBJECT: Mississippi Agent or Qualified Nonresident Agent

Bidders are hereby advised of the requirements of Subsections 102.08, 103.05.2, and 107.14.2.1 of the *2017 Standard Specifications for Road and Bridge Construction* as it refers to bonding agents. Proposal guaranties, bonds, and liability insurance policies must be signed by a **Mississippi Agent or Qualified Nonresident Agent.**

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 447 **CODE: (SP)**

DATE: 10/18/2017

SUBJECT: Traffic on Milled Surface in Rural Areas

Bidders are hereby advised that when the main lanes of a roadway are fine milled, traffic will be allowed to run on a milled surfaces for up to seven (7) calendar days. The Contractor will be assessed a penalty of **$5,000 per calendar day** afterwards until the milled surfaces are covered with the next lift of asphalt. It shall be the Contractor's responsibility to ensure that the milling operations do not commence until such time as forecasted weather conditions are suitable enough to allow the placement of the asphalt pavement after the milling operations.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 516 **CODE: (IS)**

DATE: 11/28/2017

SUBJECT: Errata and Modifications to the 2017 Standard Specifications

Page	Subsection	Change
16	102.06	In the seventh full paragraph, change "Engineer" to "Director."
33	105.05.1	In the sixth sentence, change "Contract Administration Engineer" to "Contract Administration Director."
34	105.05.2.1	In subparagraph 2, change "SWPPP, ECP" to "SWPPP and the ECP"
35	105.05.2.2	In subparagraphs 2, add " and" to the end of the sentence. In subparagraph 3, remove ", and" and add ".".
90	109.04.2	In the last paragraph of subparagraph (a), place a period "." at the end of the sentence.
93	109.04.2	In the last paragraph of subparagraph (g), place a period "." at the end of the sentence. Also, in the first paragraph of subparagraph (h), place a period "." at the end of the sentence.
97	109.07	Under ADJUSTMENT CODE, subparagraph (A1), change "HMA mixture" to "Asphalt mixtures."
98	109.11	In the third sentence, change "Engineer" to "Director."
219	308.04	In the last sentence of the last paragraph, change "Contractor's decision" to "Engineer's decision."
300	405.02.5.9	In the first sentence of the second paragraph, change "Hot Mix Asphalt" to "Asphalt Mixtures."
502	630.01.1	In the first paragraph, change "AASHTO" to "AASHTO's LRFD".
636	646.05	Change "each" to "per each" for the pay item units of payment.
640	656.02.6.2	In item 7), change "down stream" to "downstream".
688	630.03.2	Change the subsection number from "630.03.2" to "680.03.2."

725	702.08.3	In the second sentence of the first paragraph, change "hot-mix" to "asphalt."
954	804.02.13.1.6	In the definition for "M" in the % Reduction formulas, change "paragraph 7.3" to "paragraph 5.3."

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 1225 **CODE: (SP)**

DATE: 11/13/2018

SUBJECT: Early Notice to Proceed

Bidders are advised that if an early notice to proceed is allowed by the Department and the Contractor experiences problems or delays between the early notice to proceed date and the original notice to proceed date, this shall not be justification for any monetary compensation or an extension of contract time.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 1226 **CODE: (IS)**

DATE: 11/16/2018

SUBJECT: Material Storage Under Bridges

Bidders are advised that Subsection 106.08 of the Standard Specifications allows the Contractor to store materials and equipment on portions of the right-of-way. However, the Contractor will not be allowed to store or stockpile materials under bridges without written permission from the Project Engineer. The Contractor shall submit a detailed request of all proposed materials to be stored under bridges to the Engineer a minimum of 14 calendar days prior to anticipated storage. This detail shall include, but not limited to, bridge location, material type, material quantity, and duration of storage. The Project Engineer and any other needed Division will review this information and determine whether to grant approval. The Contractor shall not store any material under any bridge without written approval from the Project Engineer.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 1241 **CODE: (IS)**

DATE: 11/27/2018

SUBJECT: Fuel and Material Adjustments

Bidder's attention is brought to the last paragraph of Subsection 109.07 of the Standard Specifications which states that no fuel or material adjustment will be made after the completion of contract time. Any fuels consumed or materials incorporated into the work during the monthly estimate period falling wholly after the expiration of contract time will not be subject a fuel or material adjustment.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 1963 **CODE: (SP)**

DATE: 9/23/2019

SUBJECT: Guardrail Pads

Bidders are hereby advised that prior to construction of the guardrail pads, the Contractor shall coordinate with the guardrail Subcontractor to determine the guardrail pad dimensions necessary to meet MASH compliance.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 2206 **CODE: (IS)**

DATE: 01/14/2020

SUBJECT: MASH Compliant Devices

Bidders are hereby advised that compliance associated with the requirements of meeting either the National Cooperative Highway Research Program (NCHRP) Report 350 or the Manual for Assessing Safety Hardware (MASH) for installations of certain traffic control devices and permanent safety hardware devices (guardrails, guardrail terminals, permanent portable barriers, cast-in-place barriers, all other permanent longitudinal barriers, crash cushions, cable barriers, cable barrier terminals, bridge rails, bridge rail transitions, all other terminals, sign supports, and all other breakaway hardware) as listed throughout the Standard Specifications and/or the Standard Drawings, or both, is now replaced with the requirements of meeting the 2016 version of MASH after December 31, 2019. This change applies to new permanent installations and to full replacements of existing installations.

At the preconstruction conference or prior to starting any work on the project, the Contractor shall submit a letter stating that the traffic control devices and permanent safety hardware devices as outlined within the paragraph above that are to be used on the project are certified to meet MASH 2016.

When a MASH 2016-compliant device does not exist for the new permanent installations and/or full replacement installations of permanent safety hardware devices, as listed above, a MASH 2009-compliant or a NCHRP 350-compliant device may be proposed by the Contractor for the project. A written request for such instances must be submitted by the Contractor either at the preconstruction conference or prior to starting any work on the project. The Contractor shall submit the following items to the Project Engineer: (1) a detailed list of the proposed devices and locations thereof; and (2) certification letters indicating that the proposed devices are compliant with either MASH 2009 or NCHRP 350.

When a MASH 2016-compliant device does not exist for the temporary work zone traffic control devices (Category 1, Category 2, and Category 3 devices) , a MASH 2009-compliant or a NCHRP 350-compliant device may be proposed by the Contractor for the project. Temporary work zone traffic control devices (Category 1, Category 2, and Category 3 devices) that are MASH 2009-compliant or NCHRP 350–compliant that have been in use prior to December 31, 2019, and that have a remaining service life may be proposed for use throughout their normal service life on the project by the Contractor. For either of these scenarios for temporary work zone traffic control devices, a written request must be submitted by the Contractor either at the preconstruction conference or prior to starting any work on the project. The Contractor shall submit the following items to the Project Engineer: (1) a detailed list of the proposed devices and locations thereof; and (2) certification letters indicating that the proposed devices are compliant with either MASH 2009 or NCHRP 350.

Work will only be allowed to proceed after the Department has granted written concurrence(s) with the proposed request(s) as listed above.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 2273 **CODE: (SP)**

DATE: 02/12/2020

SUBJECT: Mississippi Special Fuel Tax Law

Bidder's attention is brought to the second paragraph of Subsection 107.02 of the Standard Specifications which states that all Contractors and Subcontractors must comply with all requirements contained in the Mississippi Special Fuel Tax Law, Section 27-55-501, *et seq*. Attached are two Fact Sheets provided by the Mississippi Department of Revenue (MDOR) with additional information.

DEPARTMENT OF REVENUE
STATE OF MISSISSIPPI

Gasoline and Dyed Diesel Used for Non-Highway Purposes

Mississippi provides a reduced rate for gasoline and dyed diesel used for non-highway purposes. The reduced rates are 6.44 cents per gallon and 5.75 cents per gallon of gasoline or dyed diesel. These fuels are generally taxed at 18 cents per gallon if for on road use.

Gasoline Used for Non-Highway Purposes

You may be entitled to a refund of 11.56 cents per gallon (making this an equivalent to a tax rate of 6.44 cents per gallon) if you desire to purchase gasoline to be used off road. The gasoline must be used for agricultural, maritime, industrial, manufacturing, domestic or non-highway purposes only.

Examples of non-highway include gasoline used in boats, golf carts, machinery used for manufacturing or farm equipment used exclusively in plowing, planting or harvesting farm products.

Refund Gasoline User

The refund is based on the amount of gallons used. Before a refund is issued, you are required to…

1. Obtain a refund gasoline user's permit and a certificate for refund booklet from the Department of Revenue;
2. Have a storage tank marked "REFUND GASOLINE"; and,
3. Purchase the gasoline from someone who holds a refund gasoline dealer's permit.

No refund will be allowed for gasoline used in motor vehicles owned or operated by a government entity or used in Mississippi government contracts.

Refund Gasoline Dealer

You must obtain a refund gasoline dealer's permit from the Department of Revenue before selling refund gasoline. At no time should the gasoline be delivered to a tank that is not properly marked. The gasoline must be dyed a distinctive mahogany color at the time of delivery.

The Department of Revenue may waive the dye requirement if the dye may cause damage to the equipment. The refund gasoline user is required to obtain the waiver from the Department of Revenue.

Dyed Diesel Used for Non-Highway Purposes

Unlike gasoline, you are not required to apply for a refund if you desire to purchase dyed diesel to be used off road. Mississippi provides a reduced rate of 5.75 cents per gallon on dyed diesel used off road. Diesel used on road is subjected to 18 cents per gallon. Dyed diesel used in motor vehicles owned or operated by a government entity or used in Mississippi government contracts will be subjected to 18 cents per gallon.

Dyed Diesel Used on the Highway

Any person who purchases, receives, acquires or uses dyed diesel for highway use will be liable to pay 18 cents per gallon and subject to a penalty in the amount of $1000.

Identifying Dyed Diesel

Storage facilities for dyed diesel must be plainly marked "NONHIGHWAY DIESEL FUEL" or "NONHIGHWAY KEROSENE". Retailers are also required to mark all pumps or dispensing equipment.

This fact sheet is intended to help you become more familiar with Mississippi tax laws and your rights and responsibilities under the laws. Nothing in this fact sheet supersedes, alters, or otherwise changes any provisions of the tax law, regulations, court decisions, or notices.

Petroleum Tax Bureau
P. O. Box 1033
Jackson, MS 39215-1033
Phone: (601) 923-7150

DEPARTMENT OF REVENUE
STATE OF MISSISSIPPI

Special Fuel Used on Government Contracts

State and Local Government Contracts

Special fuel purchased, acquired or used in performing contracts with the State of Mississippi, counties, municipalities or any political subdivision is taxed at a rate of 18 cents per gallon. Special fuel includes but is not limited to the following:

- Dyed diesel fuel;
- Kerosene;
- Undyed diesel fuel; and,
- Fuel oil.

State and local government contracts include construction, reconstruction and maintenance or repairs of projects such as roads, bridges, water systems, sewer systems, buildings, drainage canals and recreational facilities. The Department of Revenue may require contractors to remit the excise tax directly to the state in lieu of paying the tax to a distributor.

Special Fuel Direct Pay Permit

Contractors that remit the excise tax to the state will be issued a Special Fuel Direct Pay Permit. This permit relieves the distributor from collecting the tax and requires the contractor to file a monthly special fuel return. The distributor should include the contractor's permit number on all invoices that are related to tax-free sales.

The contractor is required to furnish a surety or cash bond guaranteeing the payment of the excise tax prior to receiving the Special Fuel Direct Pay Permit. The Department of Revenue may accept a contractors tax bond if the bond covers the excise tax levied on special fuel.

Special Fuel Distributors

If the contractor does not have a Special Fuel Direct Pay Permit, distributors are required to collect the 18 cents excise tax and remit the tax to the Department of Revenue. The additional 12.25 cents levied on special fuel (excluding undyed diesel) should be reported on schedules 5F and 5G of the special fuel return.

Environmental Protection Fee

Special fuel distributors are required to collect the environmental protection fee even if the contractor has a Special Fuel Direct Pay Permit. The fee is levied at 4/10^{ths} of a cent per gallon. The fee is suspended or reinstated when the trust fund has exceeded or fallen below the obligatory balance.

Penalties

Any person who knowingly and willfully purchases untaxed fuel for use in equipment utilized on a road or highway construction site in this state is guilty of a misdemeanor and, upon conviction, shall be fined not less than $1,000 or more than $100,000, or imprisoned in the county jail for not more than one year, or both.

This fact sheet is intended to help you become more familiar with Mississippi tax laws and your rights and responsibilities under the laws. Nothing in this fact sheet supersedes, alters, or otherwise changes any provisions of the tax law, regulations, court decisions, or notices.

Petroleum Tax Bureau
P. O. Box 1033
Jackson, MS 39215-1033
Phone: (601) 923-7150

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 2812 **CODE; (SP)**

DATE: 09/01/2020

SUBJECT: Traffic Signal and ITS Components

Bidders are hereby advised that all products selected for use on this project shall be in compliance with 2 CFR 200.216. No telecommunication and video surveillance equipment or services shall be manufactured by the following companies: Huawei Technologies Company, ZTE Corporation, Hytera Communications Corporation, Hangzhou Hikvision Digital Technology Company, Dahua Technology Company, and any subsidiary or affiliate of these entities.

The Contractor shall provide a Certification Statement that the referenced product(s) is not manufactured by any of the following: Huawei Technologies Company, ZTE Corporation, Hytera Communications Corporation, Hangzhou Hikvision Digital Technology Company, Dahua Technology Company, and any subsidiary or affiliate of these entities. (as per 2 CFR 200.216)

.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 2954 **CODE: (IS)**

DATE: **12/01/2020**

SUBJECT: **Reflective Sheeting for Signs**

Bidders are hereby advised that the retroreflective sign sheeting used for signs on this project shall be as listed below and shall meet the requirements of Subsection 721.06.

Temporary Construction Signs

Temporary traffic control (orange) sign sheeting shall be a minimum Type IX Fluorescent Orange sheeting as shown in Special Provision 907-721.

Permanent Signs

Permanent signs, except signs on traffic signal poles/mast arms, shall be as follows:

- Brown background sheeting on guide signs shall be a minimum Type VIII sheeting,
- Green and blue background sheeting on guide signs shall be a minimum Type IX sheeting, and
- All white, yellow, red, fluorescent yellow, and fluorescent yellow/green sheeting shall be Type XI sheeting.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 3676 **CODE: (SP)**

DATE: 09/21/2021

SUBJECT: Asphalt Gyratory Compactor Internal Angle Calibration

Bidders are advised that by March 1, 2022, all asphalt gyratory compactors shall be calibrated to an internal angle of 1.16° ±0.02°. This requirement will be reflected in updates made to MT-78, MT-80, and MT-83. This calibration requirement also extends to all QC/QA testing.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 4113 **CODE: (SP)**

DATE: **03/23/2022**

SUBJECT: **Unique Entity ID (SAM) Requirement for Federal Funded Projects**

Bidders are advised that the Prime Contractor must register and maintain a current registration in the System for Award Management (http://sam.gov) at all times during this project. Upon registration, the Contractor will be assigned a SAM Unique Entity ID.

Bidders are also advised that prior to the award of this contract, they MUST be registered, active, and have no active exclusions in the System for Award Management.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 4702 **CODE: (SP)**

DATE: 11/22/2022

SUBJECT: App for Traffic Control Reports

Bidders are advised that the Department has created a smart phone App for completing and submitting traffic control reports (Form CSD-762) required on this project. The Contractor who monitors traffic control activities and completes traffic control reports will be required to download and use this App when completing and submitting traffic control reports. The reports will then be readily available to all persons who need access to the forms. The App is free and is available for downloading at the following location.

https://extacctmgmt.mdot.state.ms.us/

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 5551 **CODE: (IS)**

DATE: **12/06/2023**

SUBJECT: **Federal Bridge Formula**

Bidders are hereby advised that the latest revision of Federal Highway Administration Publication No. FHWA-HOP-06-105, **BRIDGE FORMULA WEIGHTS**, dated August 2006, is made a part of this contract when applicable.

Prior to the preconstruction conference, the Contractor shall advise the Engineer, in writing, what materials, if any, will be delivered to the jobsite via Interstate route(s).

Copies of the **BRIDGE FORMULA WEIGHTS** publication may be obtained by contacting:

Federal Highway Administration
400 7th Street, SW
Washington, DC 20590
(202) 366-2212

or

https://ops.fhwa.dot.gov/freight/publications/brdg_frm_wghts/

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 – NOTICE TO BIDDERS NO. 5570 **CODE: (SP)**

DATE: 07/28/2025

SUBJECT: Special Provisions Related to Concrete

Bidders are hereby advised that this contract contains one or more of the following **new** Special Provisions related to concrete:

Special Provision No. 907-501-1, Subject: Concrete Pavement
Special Provision No. 907-502-1, Subject: Concrete Bridge End Pavement
Special Provision No. 907-503-1, Subject: Replacement of Concrete Pavement
Special Provision No. 907-504-4, Subject: Fiber-reinforced Concrete Pavement
Special Provision No. 907-601-1, Subject: Structural Concrete
Special Provision No. 907-605-1, Subject: Underdrains
Special Provision No. 907-701-4, Subject: Hydraulic Cement
Special Provision No. 907-799-1, Subject: Hydraulic Cement Concrete Mixtures
Special Provision No. 907-803-6, Subject: Deep Foundations
Special Provision No. 907-804-13, Subject: Concrete Bridges and Structures
Special Provision No. 907-804-14, Subject: Bridge Deck Overlay

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 7409 **CODE: (SP)**

DATE: 09/23/2025

SUBJECT: Canadian Pacific Kansas City (CPKC) Construction Requirements

Bidders are hereby advised that provisions which are required as per the Notice to Bidders entitled "Railway-Highway Provisions" shall also include the following.

The Contractor shall submit to the Project Engineer and the Railroad detailed plans and design data for temporary construction clearances, stages of construction, erection plans, demolition plans, false-work plans, excavation plans, and temporary shoring plans and calculations, as required, and shall be sealed by a Mississippi Registered Professional Engineer. All submittals must be approved by the Railroad before excavation or construction can begin within Railroad Right-of-Way. All construction submittals for work performed within the CPKC right-of-way shall be made per the CPKC approved "Guidelines for the Design and Construction of Railroad Overpasses and Underpasses" as updated in May 2008.

Prior to beginning any work on the CPKC right-of-way, the Contractor shall obtain a Right of Entry Permit. To request a permit application, the Contractor should contact Denise Case. Mrs. Case's contact information is as follows.

Denise Case
Transaction Manager
Jones Lang LaSalle (JLL)
4200 Buckingham, Suite 110
Fort Worth, Texas 76155
817-230-2614
denise.case@jll.com

The Contractor shall be responsible for payment of all application fees.

This project will require construction activities on the right-of-way of active railroad tracks which are currently owned and/or operated by CPKC. When work requires that equipment or personnel be within the CPKC right-of-way or the "foul zone" adjacent to the right-of-way, a qualified "Employee-in-Charge" (EIC) must be present for the purpose of providing on-track safety and flagging protection for the work crews. The EIC shall also be responsible for the coordination of the Contractor's activities within the CPKC right-of-way with the operation of the Railroad. The EIC must be certified under the CPKC General Code of Operation Rules (GCOR) and must be approved by the local CPKC Roadmaster prior to beginning work on the CPKC right-of-way. The Contractor will be required to provide radios for the EIC, all equipment operators, supervisors, and foremen in charge of employees working within the KCS right-of-way. All personnel who must enter upon the CPKC right-of-way must check in and out with the EIC and be logged in and out of the site.

All personnel who must work within the CPKC right-of-way at any time shall be trained and certified as a CPKC "Roadway Worker" and must at all times have their certification card with them and available for random inspection. The Contractor will be responsible for providing this training for Contractor employees or any subcontractor(s) employees. The Contractor shall contact Ms. Susan Dunshee of RailPros @ 904-416-3059 (susan.dunshee@railpros.com) for approximate fees and scheduling the necessary training sessions. The Contractor shall also contact the MDOT Project Engineer to see if any MDOT employees need this training. If so, the Contractor shall include the MDOT employees in the list of participates for training. The Contractor shall bear the cost of training the MDOT employees. Costs for training the MDOT employees will be reimbursed to the Contractor by supplemental agreement.

Prior to commencing work, the Contractor shall provide to the Railroad Engineer or the Railroad Engineer's designated representative, with copies to the Project Engineer, a detailed construction schedule for its work on Railroad's right-of-way, including the proposed temporary horizontal and vertical clearances and construction sequence for all work to be performed on Railroad right-of-way. This schedule shall also include the anticipated dates when the milestone events listed below will occur. The Contractor shall update the schedule for these milestone events as necessary, but at least monthly, and shall provide a copy of all updates to the Railroad so that site visits may be scheduled.

- Preconstruction meetings.
- Excavations, shoring placement/removal, pile driving, drilling of caissons or drilled shafts adjacent to tracks.
- Reinforcement and concrete placement for near track piers.
- Erection of precast concrete or steel overpass bridge superstructure.
- Reinforcement and concrete placement of overpass bridge decks.
- Completion of the bridge structure.

The Contractor shall so arrange and conduct construction operations in such a manner that there will be no interference with Railroad operations, including train, signal, telephone and telegraphic services, or damage to the property of the Railroad or to poles, cables or wires (whether overhead or underground) and other facilities or tenants on the rights-of-way of the Railroad. Before undertaking any work within Railroad right-of-way and before placing any obstruction over any track, the Contractor shall:

- Notify the Railroad's representative at least 72 hours in advance of the work.
- Provide assurance to the Railroad's representative that arrangements have been made for any required flagging service.
- Receive permission from the Railroad Engineer to proceed with the work.
- Ascertain that the Project Engineer has received copies of notice to the Railroad and the Railroad's response.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO NOTICE TO BIDDERS NO. 7624

DATE: **01/26/2026**

After the last drawing on page 33, add the following.

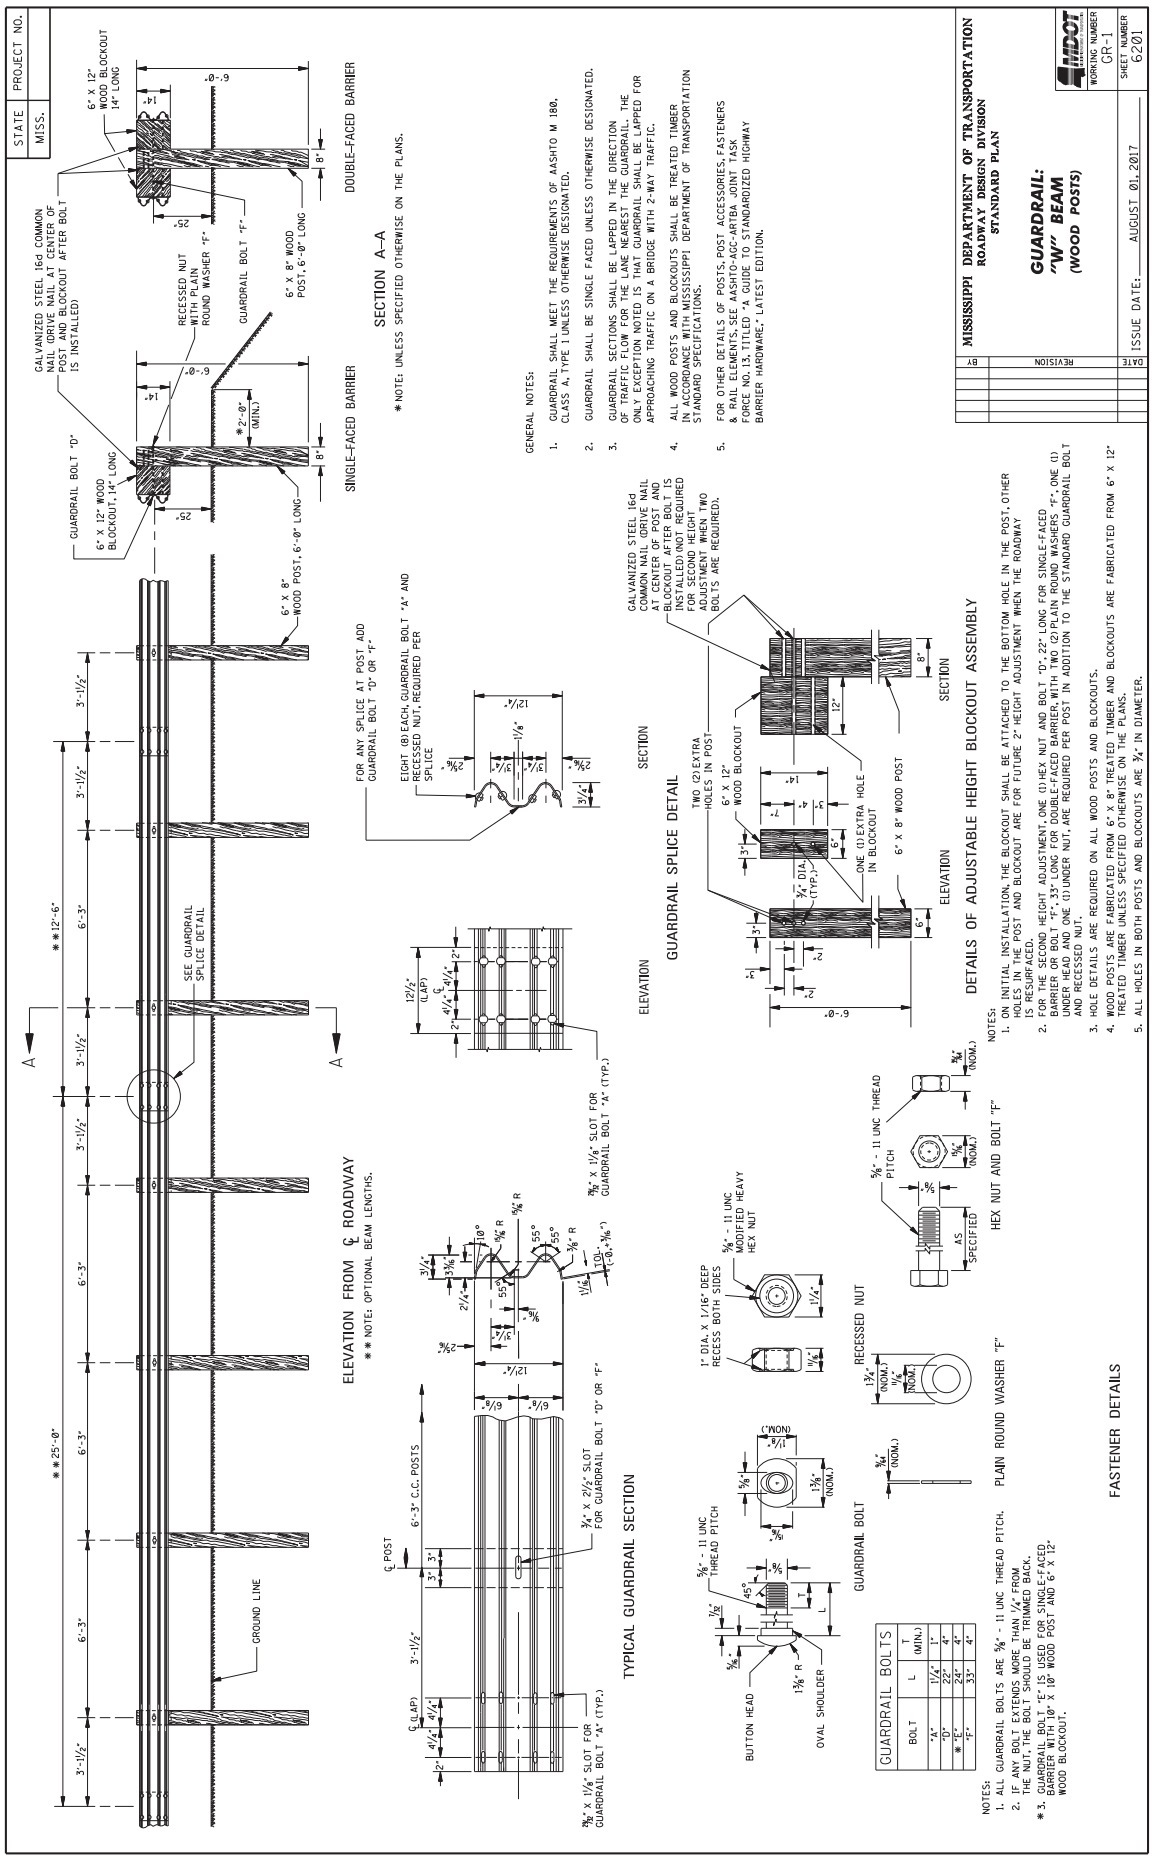
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL: "W" BEAM (WOOD POSTS)
WORKING NUMBER GR-1
SHEET NUMBER 6201
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
GENERAL NOTES:
1. GUARDRAIL SHALL MEET THE REQUIREMENTS OF AASHTO M 180, CLASS A, TYPE I UNLESS OTHERWISE DESIGNATED.
2. GUARDRAIL SHALL BE SINGLE FACED UNLESS OTHERWISE DESIGNATED.
3. GUARDRAIL SECTIONS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW FOR THE LANE NEAREST THE GUARDRAIL. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
4. ALL WOOD POSTS AND BLOCKOUTS SHALL BE TREATED TIMBER IN ACCORDANCE WITH MISSISSIPPI DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS.
5. FOR OTHER DETAILS OF POSTS, POST ACCESSORIES, FASTENERS & RAIL ELEMENTS, SEE AASHTO-AGC-ARTBA JOINT TASK FORCE NO. 13, TITLED "A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE," LATEST EDITION.
SINGLE-FACED BARRIER
DOUBLE-FACED BARRIER
SECTION A-A
*NOTE: UNLESS SPECIFIED OTHERWISE ON THE PLANS.
GALVANIZED STEEL 16d COMMON NAIL (DRIVE NAIL AT CENTER OF POST AND BLOCKOUT AFTER BOLT IS INSTALLED)
RECESSED NUT WITH PLAIN ROUND WASHER "F"
GUARDRAIL BOLT "F"
6" X 12" WOOD BLOCKOUT 14" LONG
6" X 8" WOOD POST, 6'-0" LONG
GUARDRAIL BOLT "D"
6" X 12" WOOD BLOCKOUT, 14" LONG
*2'-0" (MIN.)
GROUND LINE
SEE GUARDRAIL SPLICE DETAIL
ELEVATION FROM ℄ ROADWAY
** NOTE: OPTIONAL BEAM LENGTHS.
TYPICAL GUARDRAIL SECTION
℄ POST
6'-3" C.C. POSTS
3/4" X 2 1/2" SLOT FOR GUARDRAIL BOLT "D" OR "F"
3/4" X 1 1/4" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
FOR ANY SPLICE AT POST ADD GUARDRAIL BOLT "D" OR "F".
EIGHT (8) EACH GUARDRAIL BOLT "A" AND RECESSED NUT, REQUIRED PER SPLICE
3/4" X 1 1/8" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
ELEVATION
SECTION
GUARDRAIL SPLICE DETAIL
GALVANIZED STEEL 16d COMMON NAIL (DRIVE NAIL AT CENTER OF POST AND BLOCKOUT AFTER BOLT IS INSTALLED) NOT REQUIRED FOR SECOND HEIGHT ADJUSTMENT WHEN TWO BOLTS ARE REQUIRED.
TWO (2) EXTRA HOLES IN POST
6" X 12" WOOD BLOCKOUT
ONE (1) EXTRA HOLE IN BLOCKOUT
6" X 8" WOOD POST
ELEVATION
SECTION
DETAILS OF ADJUSTABLE HEIGHT BLOCKOUT ASSEMBLY
NOTES:
1. ON INITIAL INSTALLATION, THE BLOCKOUT SHALL BE ATTACHED TO THE BOTTOM HOLE IN THE POST. OTHER HOLES IN THE POST AND BLOCKOUT ARE FOR FUTURE 2" HEIGHT ADJUSTMENT WHEN THE ROADWAY IS RESURFACED.
2. FOR THE SECOND HEIGHT ADJUSTMENT, ONE (1) HEX NUT AND BOLT "D", 22" LONG FOR SINGLE-FACED BARRIER OR BOLT "F", 33" LONG FOR DOUBLE-FACED BARRIER, WITH TWO (2) PLAIN ROUND WASHERS "F", ONE (1) UNDER HEAD AND ONE (1) UNDER NUT, ARE REQUIRED PER POST IN ADDITION TO THE STANDARD GUARDRAIL BOLT AND RECESSED NUT.
3. HOLE DETAILS ARE REQUIRED ON ALL WOOD POSTS AND BLOCKOUTS.
4. WOOD POSTS ARE FABRICATED FROM 6" X 8" TREATED TIMBER AND BLOCKOUTS ARE FABRICATED FROM 6" X 12" TREATED TIMBER UNLESS SPECIFIED OTHERWISE ON THE PLANS.
5. ALL HOLES IN BOTH POSTS AND BLOCKOUTS ARE 3/4" IN DIAMETER.
GUARDRAIL BOLTS
BOLT | L | T (MIN.)
"A" | 11 1/2" | 1"
"D" | 22" | 4"
* "E" | 24" | 4"
"F" | 33" | 4"
NOTES:
1. ALL GUARDRAIL BOLTS ARE 5/8" - 11 UNC THREAD PITCH.
2. IF ANY BOLT EXTENDS MORE THAN 1/4" FROM THE NUT, THE BOLT SHOULD BE TRIMMED BACK.
* 3. GUARDRAIL BOLT "E" IS USED FOR SINGLE-FACED BARRIER WITH 10' X 10" WOOD POST AND 6" X 12" WOOD BLOCKOUT.
FASTENER DETAILS
BUTTON HEAD
OVAL SHOULDER
5/8" - 11 UNC THREAD PITCH
GUARDRAIL BOLT
1" DIA. X 1/16" DEEP RECESS BOTH SIDES
3/4" - 11 UNC MODIFIED HEAVY HEX NUT
RECESSED NUT
PLAIN ROUND WASHER "F"
5/8" - 11 UNC THREAD PITCH
HEX NUT AND BOLT "F"

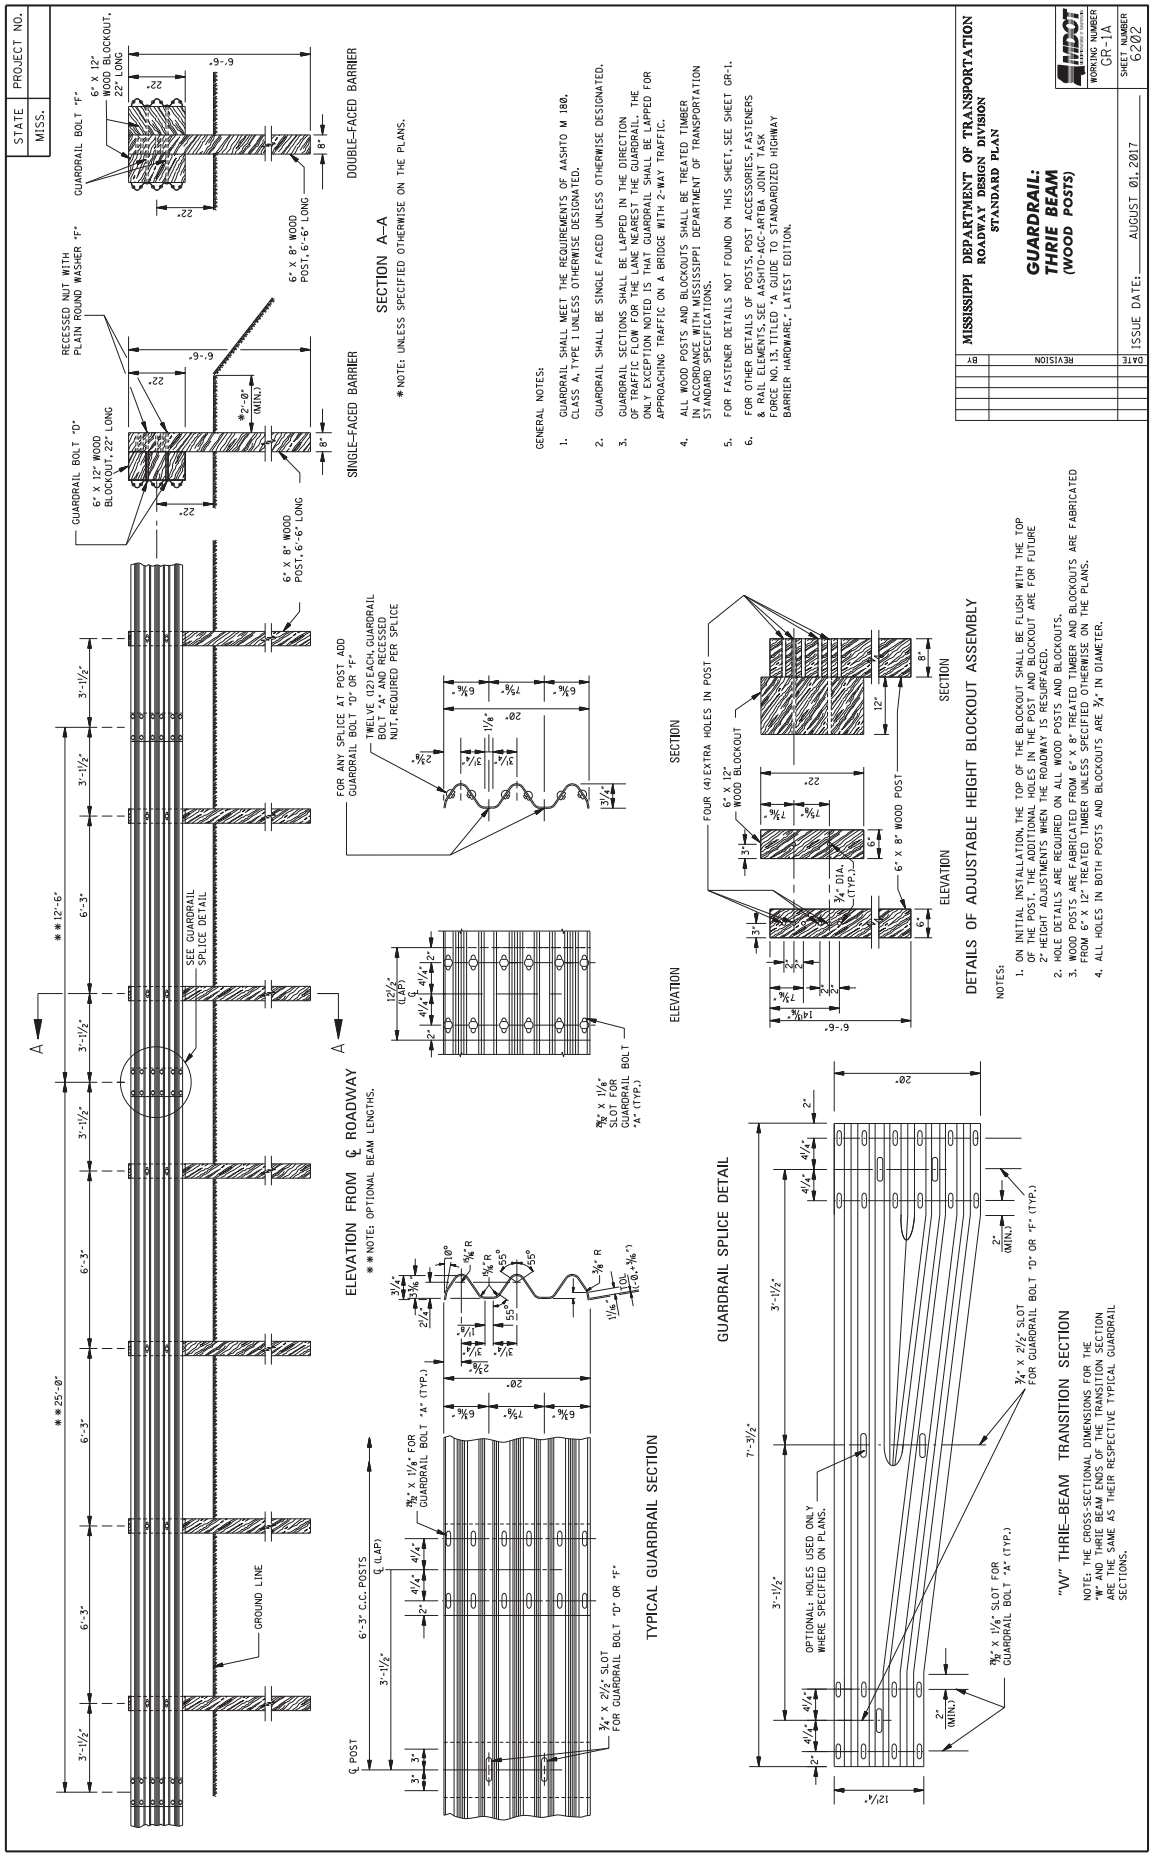
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL: THRIE BEAM (WOOD POSTS)
WORKING NUMBER GR-1A
SHEET NUMBER 6202
ISSUE DATE: AUGUST 01, 2017
REVISION
BY
DATE
GENERAL NOTES:
1. GUARDRAIL SHALL MEET THE REQUIREMENTS OF AASHTO M 180, CLASS A, TYPE 1 UNLESS OTHERWISE DESIGNATED.
2. GUARDRAIL SHALL BE SINGLE FACED UNLESS OTHERWISE DESIGNATED.
3. GUARDRAIL SECTIONS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW FOR THE LANE NEAREST THE GUARDRAIL. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
4. ALL WOOD POSTS AND BLOCKOUTS SHALL BE TREATED TIMBER IN ACCORDANCE WITH MISSISSIPPI DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS.
5. FOR FASTENER DETAILS NOT FOUND ON THIS SHEET, SEE SHEET GR-1.
6. FOR OTHER DETAILS OF POSTS, POST ACCESSORIES, FASTENERS & RAIL ELEMENTS, SEE AASHTO-AGC-ARTBA JOINT TASK FORCE NO. 13, TITLED "A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE," LATEST EDITION.
SECTION A–A
* NOTE: UNLESS SPECIFIED OTHERWISE ON THE PLANS.
SINGLE-FACED BARRIER
DOUBLE-FACED BARRIER
GUARDRAIL BOLT "D"
6" X 12" WOOD BLOCKOUT, 22" LONG
RECESSED NUT WITH PLAIN ROUND WASHER "F"
GUARDRAIL BOLT "F"
6" X 8" WOOD POST, 6'-6" LONG
SEE GUARDRAIL SPLICE DETAIL
GROUND LINE
ELEVATION FROM ℄ ROADWAY
** NOTE: OPTIONAL BEAM LENGTHS.
TYPICAL GUARDRAIL SECTION
℄ POST
6'-3" C.C. POSTS
℄ (LAP)
GUARDRAIL BOLT "A" (TYP.)
FOR ANY SPLICE AT POST ADD GUARDRAIL BOLT "D" OR "F"
TWELVE (12) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT, REQUIRED PER SPLICE
SLOT FOR GUARDRAIL BOLT "A" (TYP.)
ELEVATION
SECTION
FOUR (4) EXTRA HOLES IN POST
6" X 12" WOOD BLOCKOUT
6" X 8" WOOD POST
DETAILS OF ADJUSTABLE HEIGHT BLOCKOUT ASSEMBLY
NOTES:
1. ON INITIAL INSTALLATION, THE TOP OF THE BLOCKOUT SHALL BE FLUSH WITH THE TOP OF THE POST. THE ADDITIONAL HOLES IN THE POST AND BLOCKOUT ARE FOR FUTURE 2" HEIGHT ADJUSTMENTS WHEN THE ROADWAY IS RESURFACED.
2. HOLE DETAILS ARE REQUIRED ON ALL WOOD POSTS AND BLOCKOUTS.
3. WOOD POSTS ARE FABRICATED FROM 6" X 8" TREATED TIMBER AND BLOCKOUTS ARE FABRICATED FROM 6" X 12" TREATED TIMBER UNLESS SPECIFIED OTHERWISE ON THE PLANS.
4. ALL HOLES IN BOTH POSTS AND BLOCKOUTS ARE ¾" IN DIAMETER.
GUARDRAIL SPLICE DETAIL
OPTIONAL HOLES USED ONLY WHERE SPECIFIED ON PLANS.
¾" X 2½" SLOT FOR GUARDRAIL BOLT "D" OR "F" (TYP.)
⅞" X 1⅛" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
"W" THRIE-BEAM TRANSITION SECTION
NOTE: THE CROSS-SECTIONAL DIMENSIONS FOR THE "W" AND THRIE BEAM ENDS OF THE TRANSITION SECTION ARE THE SAME AS THEIR RESPECTIVE TYPICAL GUARDRAIL SECTIONS.

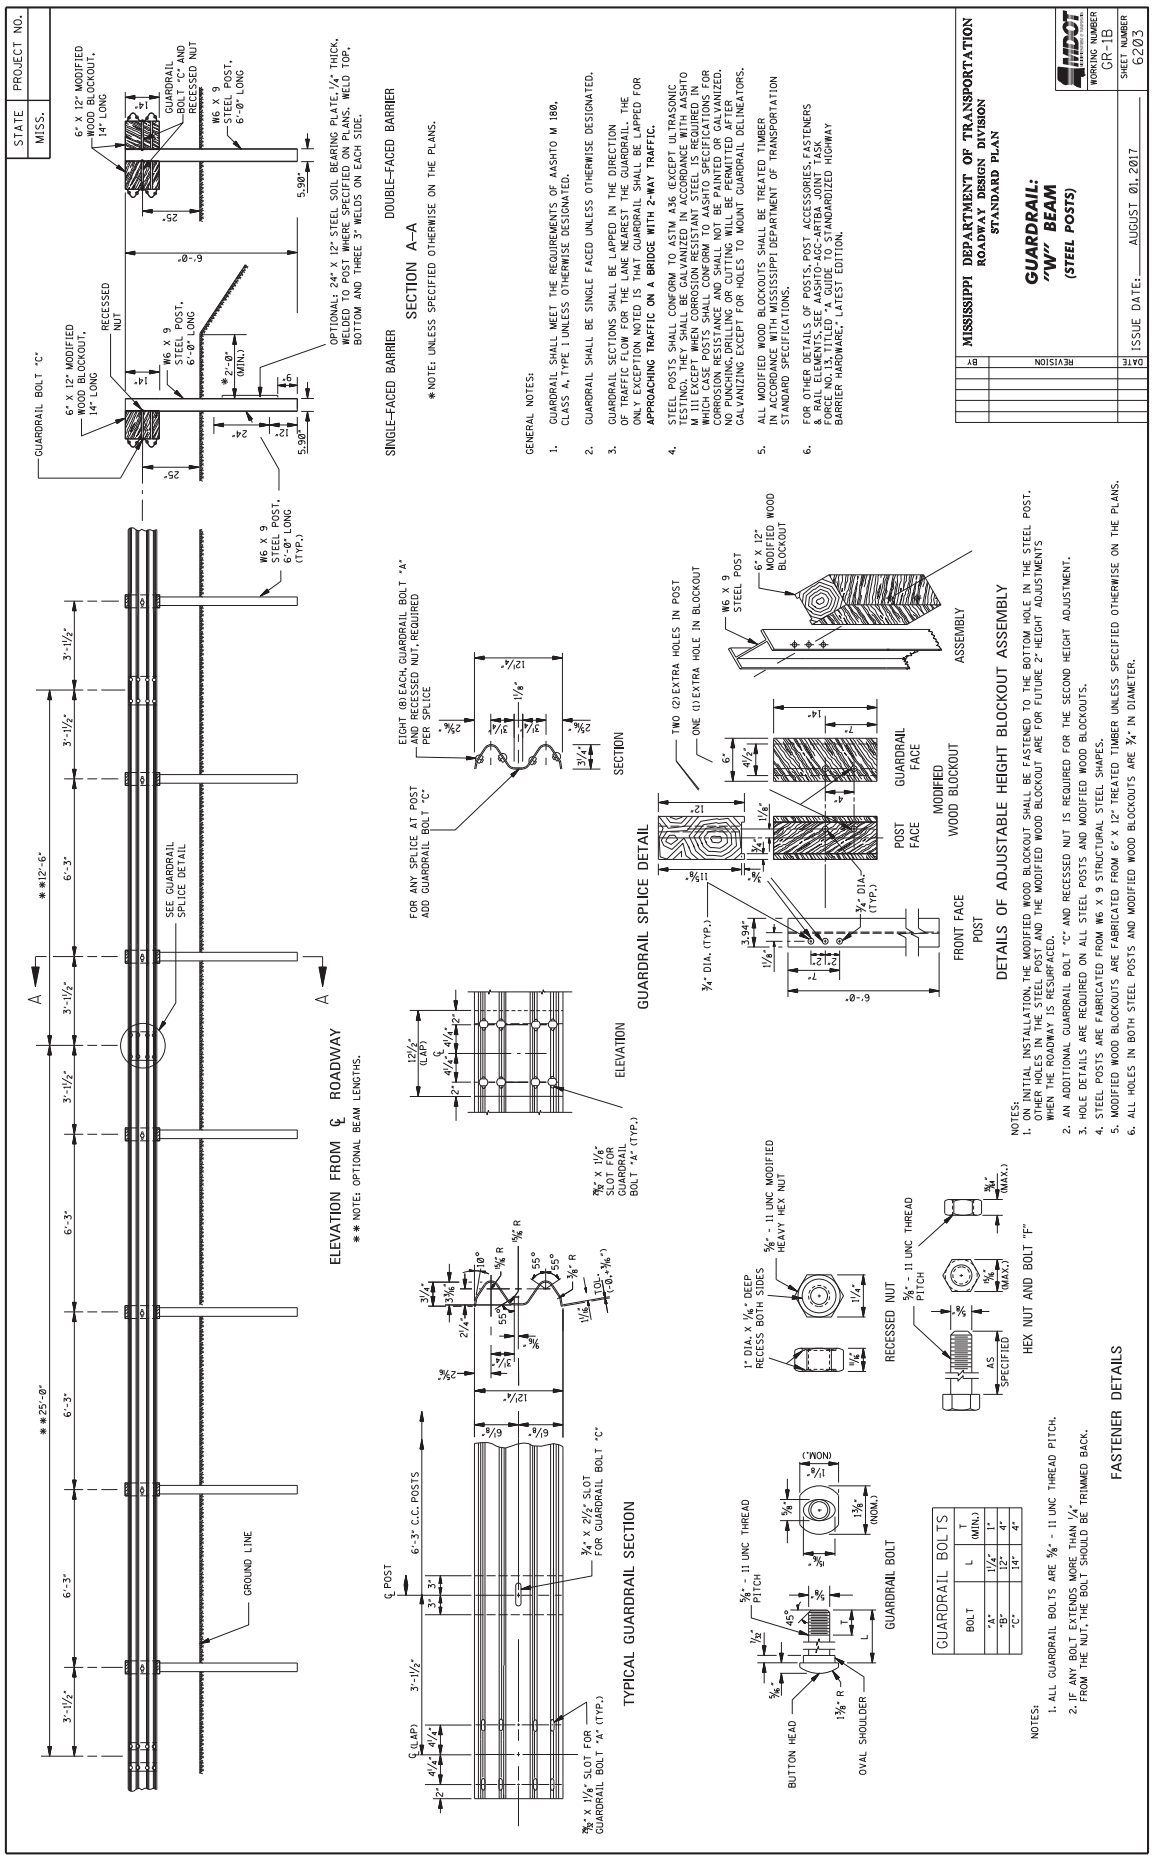
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL: "W" BEAM (STEEL POSTS)
WORKING NUMBER GR-1B
SHEET NUMBER 6203
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
SINGLE-FACED BARRIER
DOUBLE-FACED BARRIER
SECTION A-A
*NOTE: UNLESS SPECIFIED OTHERWISE ON THE PLANS.
GENERAL NOTES:
1. GUARDRAIL SHALL MEET THE REQUIREMENTS OF AASHTO M 180, CLASS A, TYPE 1 UNLESS OTHERWISE DESIGNATED.
2. GUARDRAIL SHALL BE SINGLE FACED UNLESS OTHERWISE DESIGNATED.
3. GUARDRAIL SECTIONS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW FOR THE LANE NEAREST THE GUARDRAIL. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
4. STEEL POSTS SHALL CONFORM TO ASTM A36 (EXCEPT ULTRASONIC TESTING) AND SHALL BE GALVANIZED IN ACCORDANCE WITH AASHTO M 111 EXCEPT WHEN CORROSION RESISTANT STEEL IS REQUIRED IN WHICH CASE POSTS SHALL CONFORM TO AASHTO SPECIFICATIONS FOR CORROSION RESISTANCE AND SHALL NOT BE PAINTED OR GALVANIZED. NO PUNCHING, DRILLING OR CUTTING WILL BE PERMITTED AFTER GALVANIZING EXCEPT FOR HOLES TO MOUNT GUARDRAIL DELINEATORS.
5. ALL MODIFIED WOOD BLOCKOUTS SHALL BE TREATED TIMBER IN ACCORDANCE WITH MISSISSIPPI DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS.
6. FOR OTHER DETAILS OF POSTS, POST ACCESSORIES, FASTENERS & RAIL ELEMENTS, SEE AASHTO-AGC-ARTBA JOINT TASK FORCE NO. 13, TITLED "A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE," LATEST EDITION.
GUARDRAIL BOLT "C"
6" X 12" MODIFIED WOOD BLOCKOUT, 14" LONG
RECESSED NUT
W6 X 9 STEEL POST, 6'-0" LONG
GUARDRAIL BOLT "A" AND RECESSED NUT
OPTIONAL: 24" X 12" STEEL SOIL BEARING PLATE, 1/4" THICK, WELDED TO POST WHERE SPECIFIED ON PLANS. WELD TOP, BOTTOM AND THREE 3" WELDS ON EACH SIDE.
ELEVATION FROM ℄ ROADWAY
** NOTE: OPTIONAL BEAM LENGTHS.
SEE GUARDRAIL SPLICE DETAIL
GROUND LINE
TYPICAL GUARDRAIL SECTION
6'-3" C.C. POSTS
3/4" X 2 1/2" SLOT FOR GUARDRAIL BOLT "C"
3/4" X 1 1/8" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
NOTES:
1. ALL GUARDRAIL BOLTS ARE 5/8" - 11 UNC THREAD PITCH.
2. IF ANY BOLT EXTENDS MORE THAN 1/4" FROM THE NUT, THE BOLT SHOULD BE TRIMMED BACK.
GUARDRAIL BOLTS
BOLT L T (MIN.)
"A" 1 1/4" 1"
"B" 12" 4"
"C" 14" 4"
FASTENER DETAILS
EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT, REQUIRED PER SPLICE
FOR ANY SPLICE AT POST ADD GUARDRAIL BOLT "C"
SECTION
ELEVATION
GUARDRAIL SPLICE DETAIL
TWO (2) EXTRA HOLES IN POST
ONE (1) EXTRA HOLE IN BLOCKOUT
3/4" DIA. (TYP.)
POST FACE
GUARDRAIL FACE
MODIFIED WOOD BLOCKOUT
FRONT FACE POST
ASSEMBLY
DETAILS OF ADJUSTABLE HEIGHT BLOCKOUT ASSEMBLY
NOTES:
1. ON INITIAL INSTALLATION, THE MODIFIED WOOD BLOCKOUT SHALL BE FASTENED TO THE BOTTOM HOLE IN THE STEEL POST. OTHER HOLES IN THE STEEL POST AND THE MODIFIED WOOD BLOCKOUT ARE FOR FUTURE 2" HEIGHT ADJUSTMENTS WHEN THE ROADWAY IS RESURFACED.
2. AN ADDITIONAL GUARDRAIL BOLT "C" AND RECESSED NUT IS REQUIRED FOR THE SECOND HEIGHT ADJUSTMENT.
3. HOLE DETAILS ARE REQUIRED ON ALL STEEL POSTS AND MODIFIED WOOD BLOCKOUTS.
4. STEEL POSTS ARE FABRICATED FROM W6 X 9 STRUCTURAL STEEL SHAPES.
5. MODIFIED WOOD BLOCKOUTS ARE FABRICATED FROM 6" X 12" TREATED TIMBER UNLESS SPECIFIED OTHERWISE ON THE PLANS.
6. ALL HOLES IN BOTH STEEL POSTS AND MODIFIED WOOD BLOCKOUTS ARE 3/4" IN DIAMETER.
5/8" - 11 UNC MODIFIED HEAVY HEX NUT
1" DIA. X 1/8" DEEP RECESS BOTH SIDES
RECESSED NUT
5/8" - 11 UNC THREAD PITCH
HEX NUT AND BOLT "F"
5/8" - 11 UNC THREAD PITCH
BUTTON HEAD
OVAL SHOULDER
GUARDRAIL BOLT

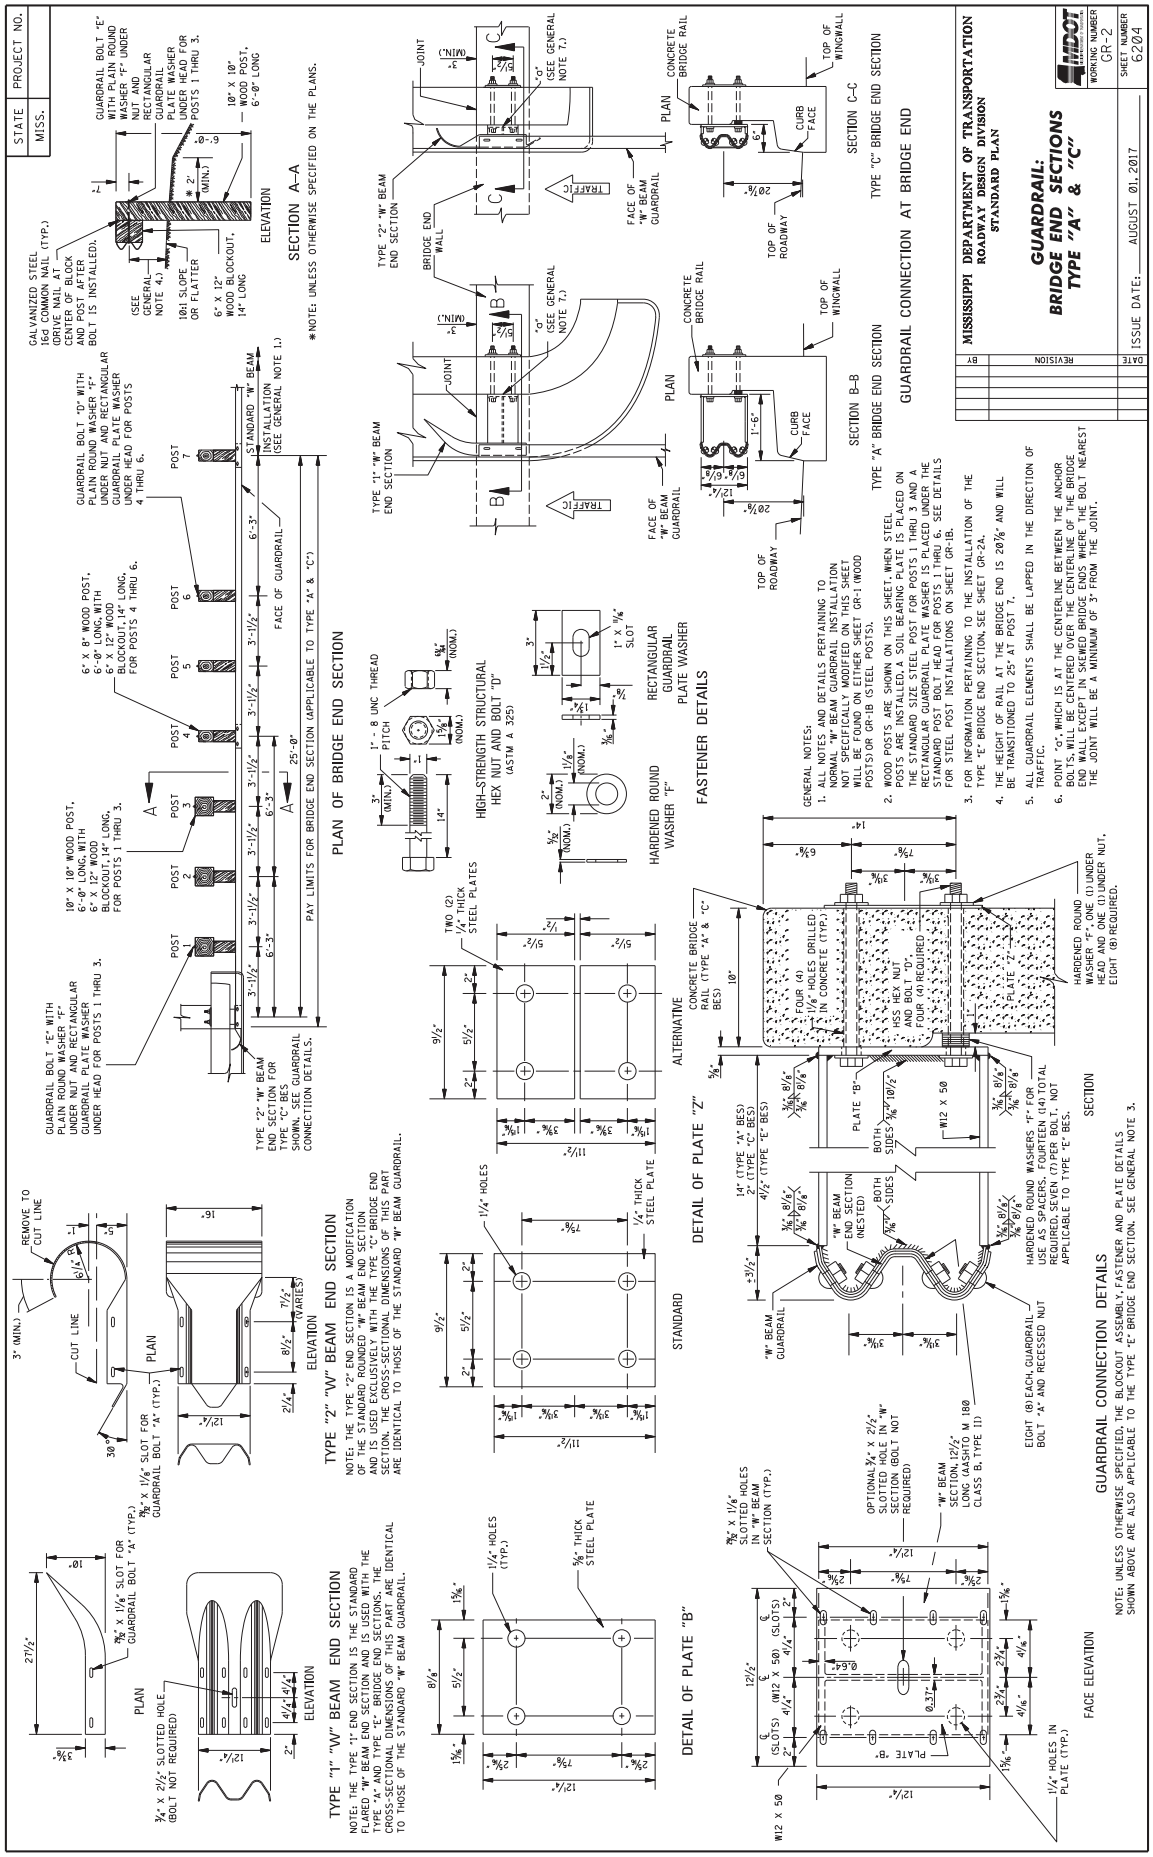
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTIONS
TYPE "A" & "C"
WORKING NUMBER GR-2
SHEET NUMBER 6204
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
PLAN OF BRIDGE END SECTION
SECTION A–A
ELEVATION
TYPE "2" "W" BEAM END SECTION
TYPE "1" "W" BEAM END SECTION
DETAIL OF PLATE "B"
DETAIL OF PLATE "Z"
FASTENER DETAILS
GUARDRAIL CONNECTION DETAILS
TYPE "A" BRIDGE END SECTION
GUARDRAIL CONNECTION AT BRIDGE END
TYPE "C" BRIDGE END SECTION
SECTION B–B
SECTION C–C
GENERAL NOTES:
1. ALL NOTES AND DETAILS PERTAINING TO NORMAL "W" BEAM GUARDRAIL INSTALLATION NOT SPECIFICALLY MODIFIED ON THIS SHEET WILL BE FOUND ON EITHER SHEET GR-1 (WOOD POSTS) OR GR-1B (STEEL POSTS).
2. WOOD POSTS ARE SHOWN ON THIS SHEET. WHEN STEEL POSTS ARE INSTALLED, A SOIL BEARING PLATE IS PLACED ON THE STANDARD SIZE STEEL POST FOR POSTS 1 THRU 3 AND A RECTANGULAR GUARDRAIL PLATE WASHER IS PLACED UNDER THE STANDARD POST BOLT HEAD FOR POSTS 4 THRU 6. SEE DETAILS FOR STEEL POST INSTALLATIONS ON SHEET GR-1B.
3. FOR INFORMATION PERTAINING TO THE INSTALLATION OF THE TYPE "E" BRIDGE END SECTION, SEE SHEET GR-2A.
4. THE HEIGHT OF RAIL AT THE BRIDGE END IS 20⅞" AND WILL BE TRANSITIONED TO 25" AT POST 7.
5. ALL GUARDRAIL ELEMENTS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC.
6. POINT "O", WHICH IS AT THE CENTERLINE BETWEEN THE ANCHOR BOLTS, WILL BE CENTERED OVER THE CENTERLINE OF THE BRIDGE END WALL EXCEPT IN SKEWED BRIDGE ENDS WHERE THE BOLT NEAREST THE JOINT WILL BE A MINIMUM OF 3" FROM THE JOINT.

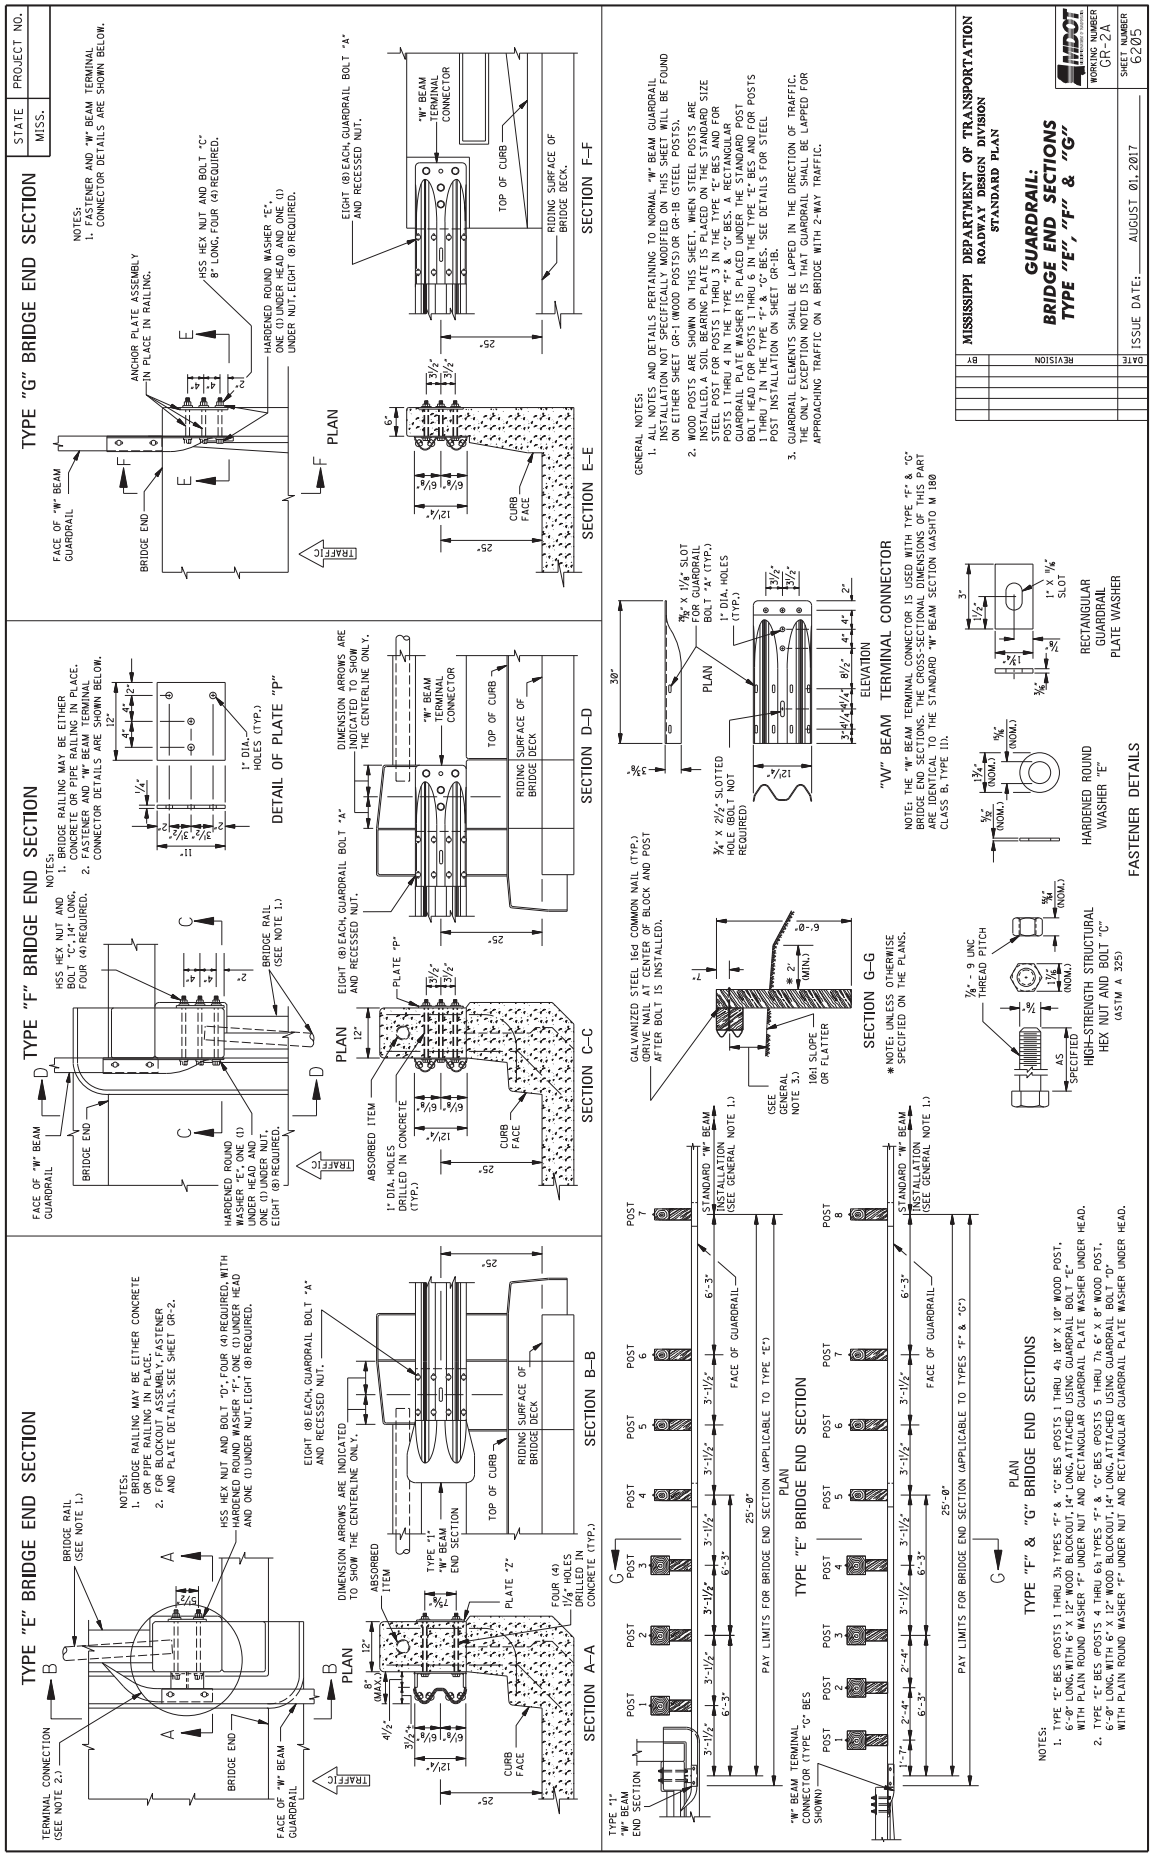
TYPE "E" BRIDGE END SECTION
TYPE "F" BRIDGE END SECTION
TYPE "G" BRIDGE END SECTION
DETAIL OF PLATE "P"
SECTION A–A
SECTION B–B
SECTION C–C
SECTION D–D
SECTION E–E
SECTION F–F
SECTION G–G
"W" BEAM TERMINAL CONNECTOR
FASTENER DETAILS
TYPE "E" BRIDGE END SECTION
TYPE "F" & "G" BRIDGE END SECTIONS
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTIONS
TYPE "E", "F" & "G"
WORKING NUMBER GR-2A
SHEET NUMBER 6205
ISSUE DATE: AUGUST 01, 2017
STATE MISS.
PROJECT NO.

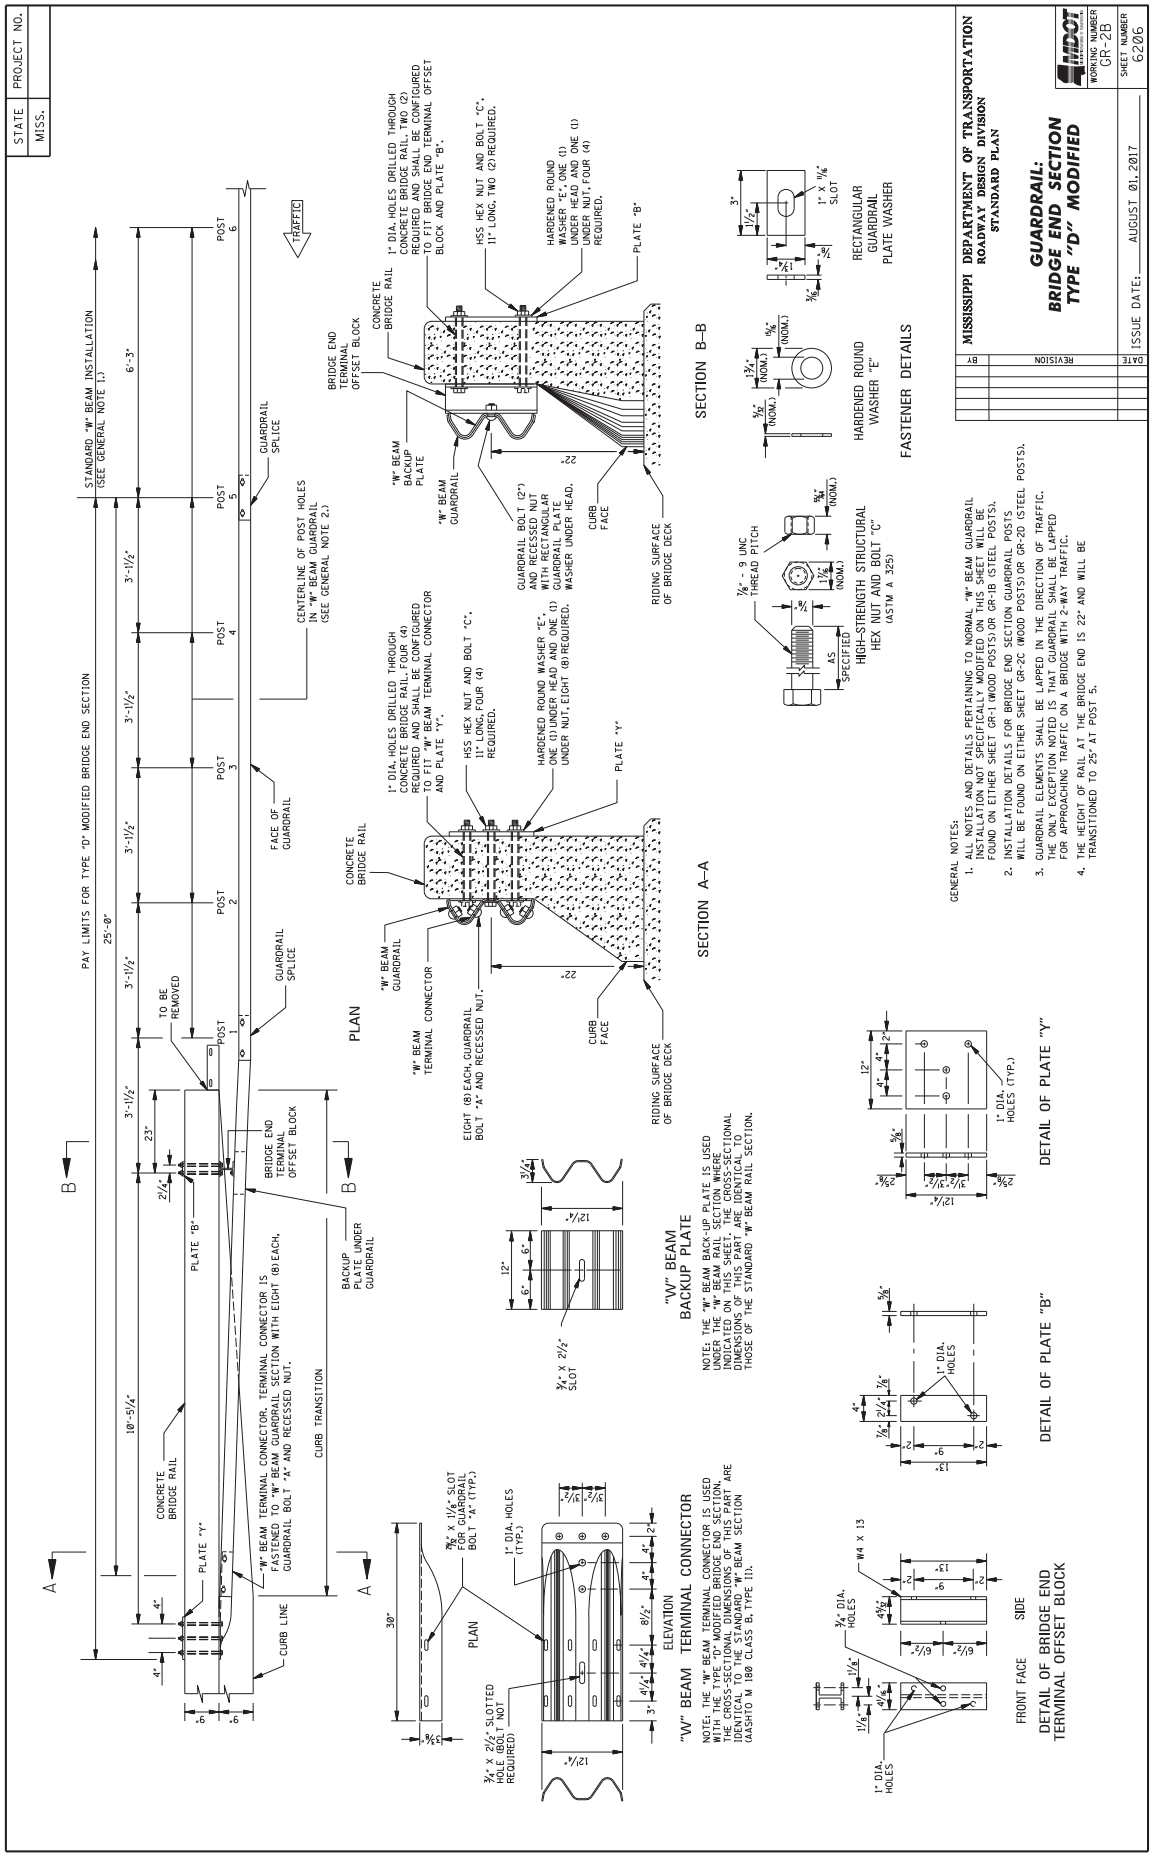
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTION
TYPE "D" MODIFIED
WORKING NUMBER GR-2B
SHEET NUMBER 6206
ISSUE DATE: AUGUST 01, 2017
REVISION
DATE
BY
PLAN
SECTION A–A
SECTION B–B
FASTENER DETAILS
HARDENED ROUND WASHER "E"
RECTANGULAR GUARDRAIL PLATE WASHER
HIGH-STRENGTH STRUCTURAL HEX NUT AND BOLT "C" (ASTM A 325)
GENERAL NOTES:
1. ALL NOTES AND DETAILS PERTAINING TO NORMAL "W" BEAM GUARDRAIL INSTALLATION NOT SPECIFICALLY MODIFIED ON THIS SHEET WILL BE FOUND ON EITHER SHEET GR-1 (WOOD POSTS) OR GR-1A (STEEL POSTS).
2. INSTALLATION DETAILS FOR BRIDGE END SECTION GUARDRAIL POSTS WILL BE FOUND ON EITHER SHEET GR-2C (WOOD POSTS) OR GR-2D (STEEL POSTS).
3. GUARDRAIL ELEMENTS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
4. THE HEIGHT OF RAIL AT THE BRIDGE END IS 22" AND WILL BE TRANSITIONED TO 25" AT POST 5.
"W" BEAM BACKUP PLATE
NOTE: THE "W" BEAM BACK-UP PLATE IS USED UNDER THE "W" BEAM RAIL SECTION WHERE INDICATED ON THIS SHEET. CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THOSE OF THE STANDARD "W" BEAM RAIL SECTION.
"W" BEAM TERMINAL CONNECTOR
NOTE: THE "W" BEAM TERMINAL CONNECTOR IS USED WITH THE TYPE "D" MODIFIED BRIDGE END SECTION. THE CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THE STANDARD "W" BEAM SECTION (AASHTO M 180 CLASS B, TYPE II).
DETAIL OF PLATE "B"
DETAIL OF PLATE "Y"
DETAIL OF BRIDGE END TERMINAL OFFSET BLOCK
STANDARD "W" BEAM INSTALLATION (SEE GENERAL NOTE 1.)
PAY LIMITS FOR TYPE "D" MODIFIED BRIDGE END SECTION
CENTERLINE OF POST HOLES IN "W" BEAM GUARDRAIL (SEE GENERAL NOTE 2.)
TRAFFIC
CONCRETE BRIDGE RAIL
"W" BEAM GUARDRAIL
"W" BEAM TERMINAL CONNECTOR
BRIDGE END TERMINAL OFFSET BLOCK
"W" BEAM BACKUP PLATE
GUARDRAIL SPLICE
TO BE REMOVED
PLATE "B"
PLATE "Y"
BACKUP PLATE UNDER GUARDRAIL
CURB TRANSITION
CURB LINE
FACE OF GUARDRAIL
EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
HSS HEX NUT AND BOLT "C", 11" LONG, FOUR (4) REQUIRED.
HARDENED ROUND WASHER "E", ONE (1) UNDER HEAD AND ONE (1) UNDER NUT, EIGHT (8) REQUIRED.
1" DIA. HOLES DRILLED THROUGH CONCRETE BRIDGE RAIL, FOUR (4) REQUIRED AND SHALL BE CONFIGURED TO FIT "W" BEAM TERMINAL CONNECTOR AND PLATE "Y".
1" DIA. HOLES DRILLED THROUGH CONCRETE BRIDGE RAIL, TWO (2) REQUIRED AND SHALL BE CONFIGURED TO FIT BRIDGE END TERMINAL OFFSET BLOCK AND PLATE "B".
HSS HEX NUT AND BOLT "C", 11" LONG, TWO (2) REQUIRED.
HARDENED ROUND WASHER "E", ONE (1) UNDER HEAD AND ONE (1) UNDER NUT, FOUR (4) REQUIRED.
GUARDRAIL BOLT (2") AND RECESSED NUT WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD.
CURB FACE
RIDING SURFACE OF BRIDGE DECK
POST 1
POST 2
POST 3
POST 4
POST 5
POST 6
25'-0"
10'-5¼"
6'-3"
3'-1½"
23"
4"
2¼"
30"
12'-6"
22"

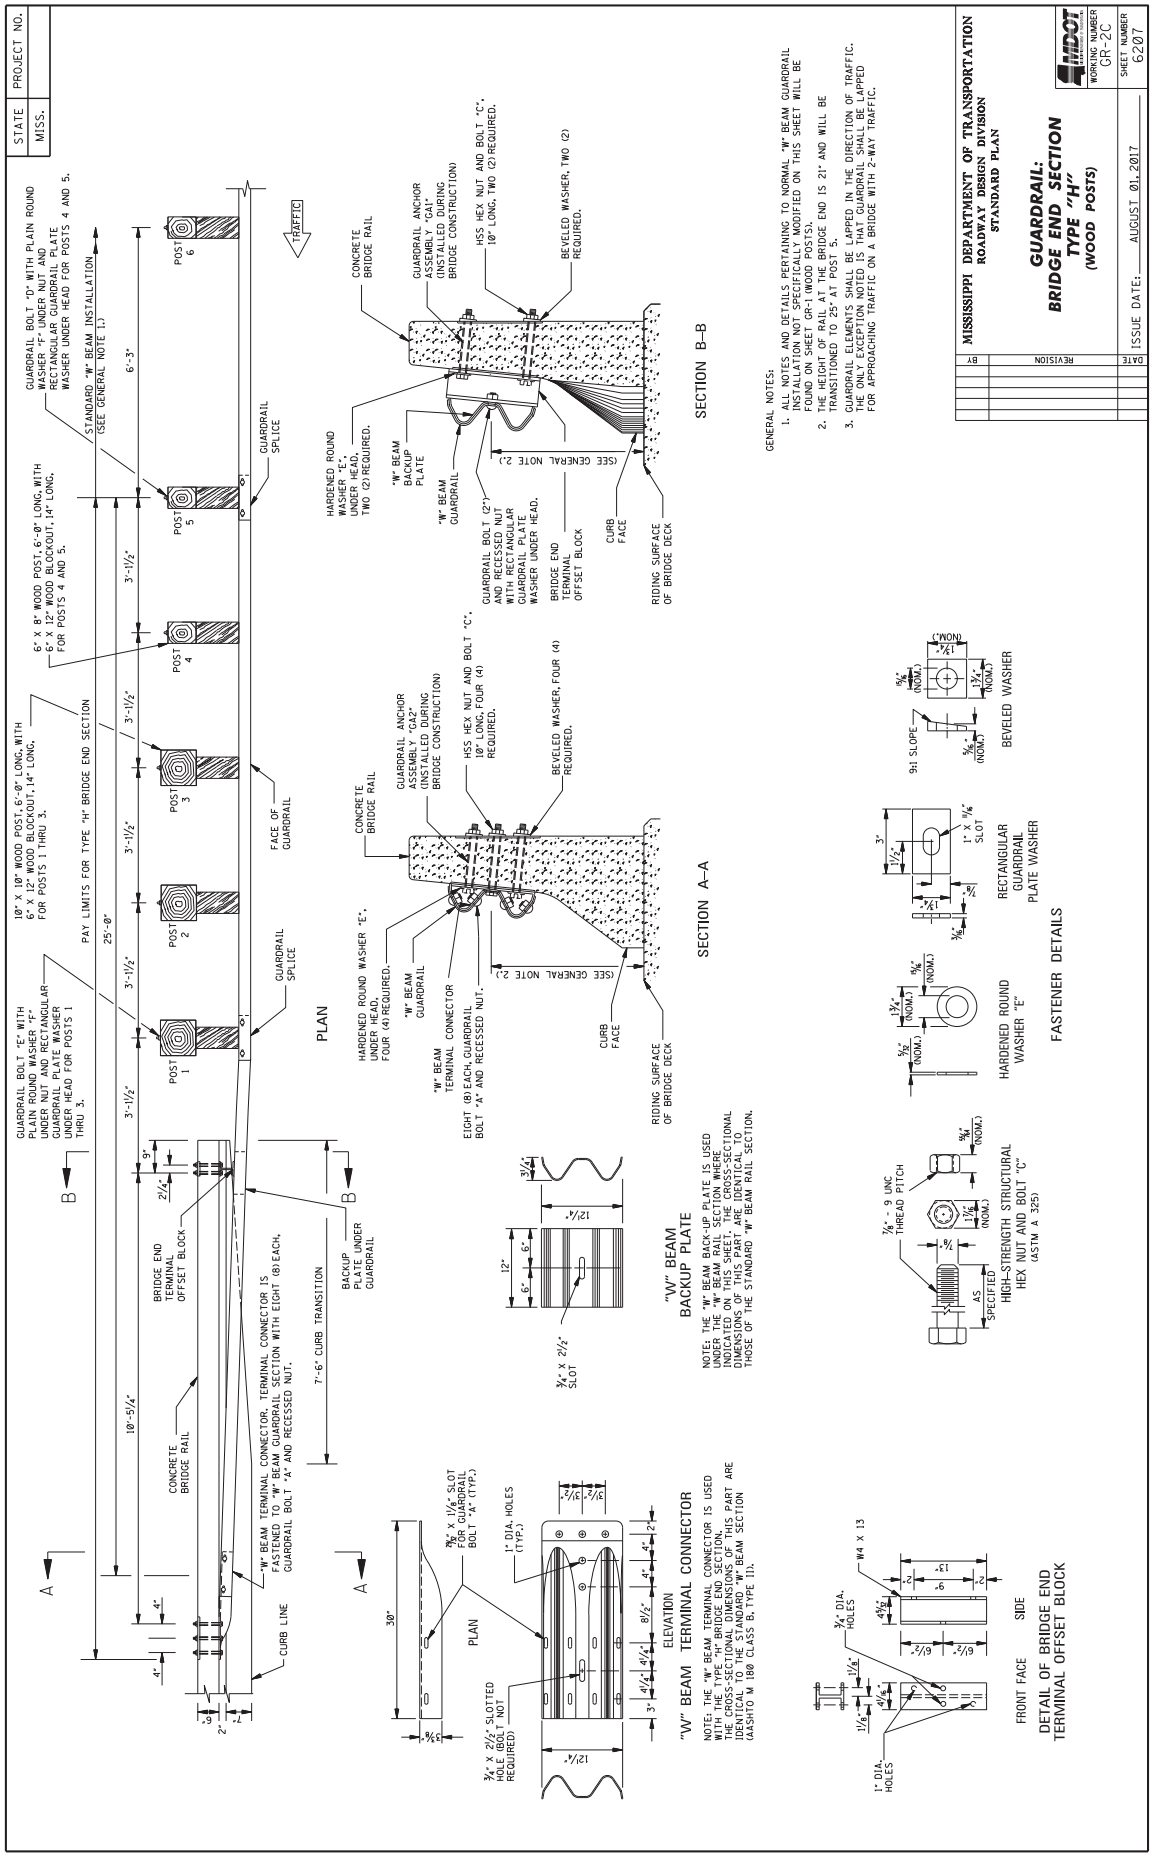
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTION
TYPE "H"
(WOOD POSTS)
WORKING NUMBER GR-2C
SHEET NUMBER 6207
ISSUE DATE: AUGUST 01, 2017
REVISION
DATE
BY
GENERAL NOTES:
1. ALL NOTES AND DETAILS PERTAINING TO NORMAL "W" BEAM GUARDRAIL INSTALLATION NOT SPECIFICALLY MODIFIED ON THIS SHEET WILL BE FOUND ON SHEET GR-1 (WOOD POSTS).
2. THE HEIGHT OF RAIL AT THE BRIDGE END IS 21" AND WILL BE TRANSITIONED TO 25" AT POST 5.
3. GUARDRAIL ELEMENTS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
PLAN
SECTION A–A
SECTION B–B
"W" BEAM TERMINAL CONNECTOR
"W" BEAM BACKUP PLATE
FASTENER DETAILS
DETAIL OF BRIDGE END TERMINAL OFFSET BLOCK
TRAFFIC
PAY LIMITS FOR TYPE "H" BRIDGE END SECTION
STANDARD "W" BEAM INSTALLATION (SEE GENERAL NOTE 1.)
CONCRETE BRIDGE RAIL
BRIDGE END TERMINAL OFFSET BLOCK
BACKUP PLATE UNDER GUARDRAIL
GUARDRAIL SPLICE
FACE OF GUARDRAIL
CURB LINE
7'-6" CURB TRANSITION
GUARDRAIL ANCHOR ASSEMBLY "GA1" (INSTALLED DURING BRIDGE CONSTRUCTION)
GUARDRAIL ANCHOR ASSEMBLY "GA2" (INSTALLED DURING BRIDGE CONSTRUCTION)
HSS HEX NUT AND BOLT "C", 10" LONG, TWO (2) REQUIRED.
BEVELED WASHER, TWO (2) REQUIRED.
HSS HEX NUT AND BOLT "C", 10" LONG, FOUR (4) REQUIRED.
BEVELED WASHER, FOUR (4) REQUIRED.
HARDENED ROUND WASHER "E", UNDER HEAD, TWO (2) REQUIRED.
HARDENED ROUND WASHER "E", UNDER HEAD, FOUR (4) REQUIRED.
"W" BEAM BACKUP PLATE
"W" BEAM GUARDRAIL
"W" BEAM TERMINAL CONNECTOR
GUARDRAIL BOLT (2") AND RECESSED NUT WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD.
EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
(SEE GENERAL NOTE 2.)
CURB FACE
RIDING SURFACE OF BRIDGE DECK
9:1 SLOPE
BEVELED WASHER
RECTANGULAR GUARDRAIL PLATE WASHER
HARDENED ROUND WASHER "E"
HIGH-STRENGTH STRUCTURAL HEX NUT AND BOLT "C" (ASTM A 325)
POST 1
POST 2
POST 3
POST 4
POST 5
POST 6
10" X 10" WOOD POST, 6'-0" LONG, WITH 6" X 12" WOOD BLOCKOUT, 14" LONG, FOR POSTS 1 THRU 3.
6" X 8" WOOD POST, 6'-0" LONG, WITH 6" X 12" WOOD BLOCKOUT, 14" LONG, FOR POSTS 4 AND 5.
GUARDRAIL BOLT "D" WITH PLAIN ROUND WASHER UNDER NUT AND RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD FOR POSTS 4 AND 5.
GUARDRAIL BOLT "E" WITH PLAIN ROUND WASHER "F" UNDER NUT AND RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD FOR POSTS 1 THRU 3.
"W" BEAM TERMINAL CONNECTOR, TERMINAL CONNECTOR IS FASTENED TO "W" BEAM GUARDRAIL SECTION WITH EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
NOTE: THE "W" BEAM BACK-UP PLATE IS USED UNDER THE "W" BEAM RAIL SECTION WHERE INDICATED ON THIS SHEET. FOR CROSS-SECTIONAL DIMENSIONS OF THIS PART, REFER TO THOSE OF THE STANDARD "W" BEAM RAIL SECTION.
NOTE: THE "W" BEAM TERMINAL CONNECTOR IS USED WITH THE TYPE "H" BRIDGE END SECTION. THE CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THE STANDARD "W" BEAM SECTION (AASHTO M 180 CLASS B, TYPE II).
W4 X 13
FRONT FACE
SIDE

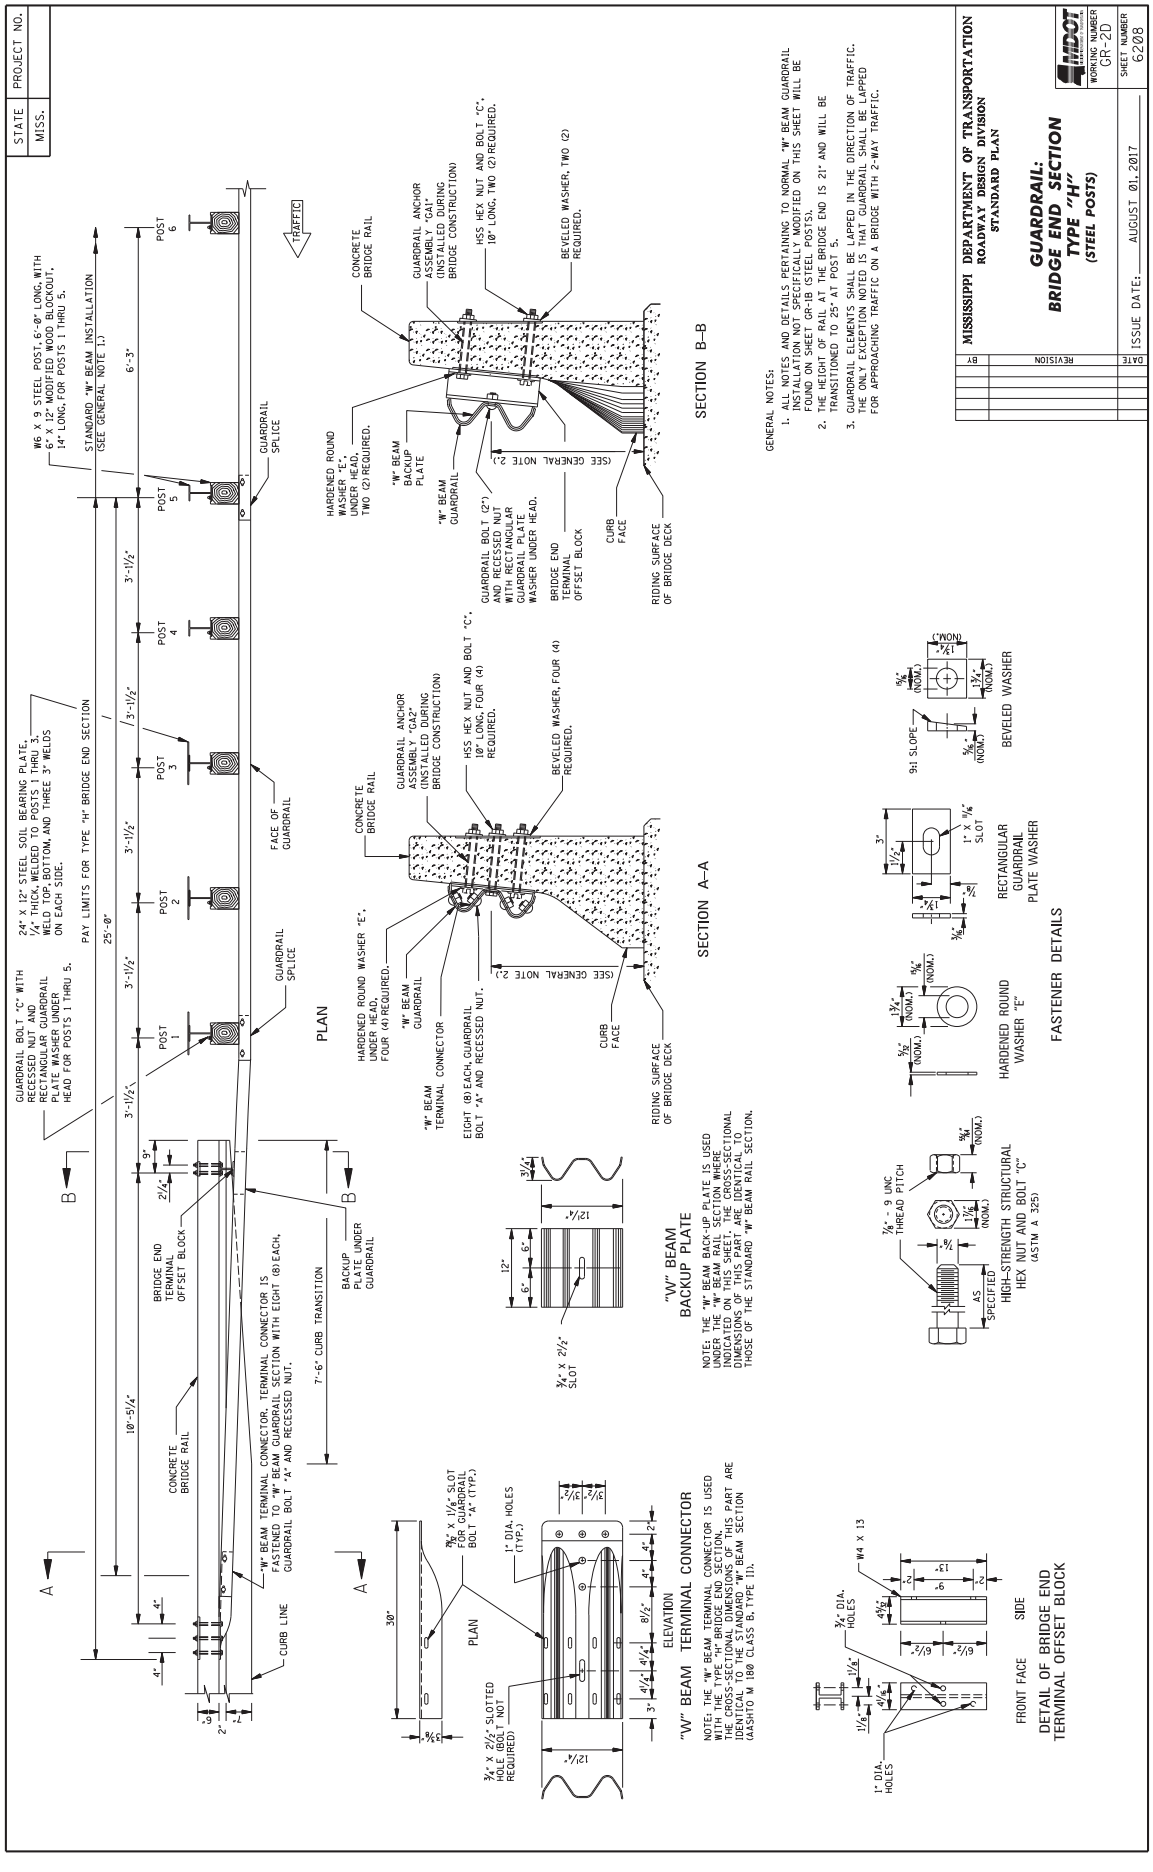
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL: BRIDGE END SECTION TYPE "H" (STEEL POSTS)
WORKING NUMBER GR-2D
SHEET NUMBER 6208
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
GENERAL NOTES:
1. ALL NOTES AND DETAILS PERTAINING TO NORMAL "W" BEAM GUARDRAIL INSTALLATION NOT SPECIFICALLY MODIFIED ON THIS SHEET WILL BE FOUND ON SHEET GR-1B (STEEL POSTS).
2. THE HEIGHT OF RAIL AT THE BRIDGE END IS 21" AND WILL BE TRANSITIONED TO 25" AT POST 5.
3. GUARDRAIL ELEMENTS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
PLAN
SECTION A–A
SECTION B–B
"W" BEAM BACKUP PLATE
"W" BEAM TERMINAL CONNECTOR
FASTENER DETAILS
DETAIL OF BRIDGE END TERMINAL OFFSET BLOCK
TRAFFIC
STANDARD "W" BEAM INSTALLATION (SEE GENERAL NOTE 1.)
PAY LIMITS FOR TYPE "H" BRIDGE END SECTION
CONCRETE BRIDGE RAIL
GUARDRAIL ANCHOR ASSEMBLY "GA1" (INSTALLED DURING BRIDGE CONSTRUCTION)
GUARDRAIL ANCHOR ASSEMBLY "GA2" (INSTALLED DURING BRIDGE CONSTRUCTION)
HSS HEX NUT AND BOLT "C", 10" LONG, TWO (2) REQUIRED.
HSS HEX NUT AND BOLT "C", 10" LONG, FOUR (4) REQUIRED.
BEVELED WASHER, TWO (2) REQUIRED.
BEVELED WASHER, FOUR (4) REQUIRED.
HARDENED ROUND WASHER "E", UNDER HEAD, TWO (2) REQUIRED.
HARDENED ROUND WASHER "E", UNDER HEAD, FOUR (4) REQUIRED.
"W" BEAM BACKUP PLATE
"W" BEAM GUARDRAIL
"W" BEAM TERMINAL CONNECTOR
GUARDRAIL BOLT (2") AND RECESSED NUT WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD.
EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
BRIDGE END TERMINAL OFFSET BLOCK
CURB FACE
RIDING SURFACE OF BRIDGE DECK
FACE OF GUARDRAIL
GUARDRAIL SPLICE
BACKUP PLATE UNDER GUARDRAIL
7'-6" CURB TRANSITION
CURB LINE
(SEE GENERAL NOTE 2.)
POST 1
POST 2
POST 3
POST 4
POST 5
POST 6
W6 X 9 STEEL POST, 6'-0" LONG, WITH 6" X 12" MODIFIED WOOD BLOCKOUT, 14" LONG, FOR POSTS 1 THRU 5.
24" X 12" STEEL SOIL BEARING PLATE, 1/4" THICK, WELDED TO POSTS 1 THRU 3, WELD TOP, BOTTOM, AND THREE 3" WELDS ON EACH SIDE.
GUARDRAIL BOLT "C" WITH RECESSED NUT AND RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD FOR POSTS 1 THRU 5.
"W" BEAM TERMINAL CONNECTOR. TERMINAL CONNECTOR IS FASTENED TO "W" BEAM GUARDRAIL SECTION WITH EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
3/4" X 2 1/2" SLOTTED HOLE (BOLT NOT REQUIRED)
1" DIA. HOLES (TYP.)
7/8" X 1 1/4" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
NOTE: THE "W" BEAM TERMINAL CONNECTOR IS USED WITH THE TYPE "H" BRIDGE END SECTION. THE CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THE STANDARD "W" BEAM SECTION (AASHTO M 180 CLASS B, TYPE II).
NOTE: THE "W" BEAM BACK-UP PLATE IS USED UNDER THE "W" BEAM RAIL SECTION WHERE INDICATED ON THIS SHEET. CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THOSE OF THE STANDARD "W" BEAM RAIL SECTION.
3/4" X 2 1/2" SLOT
7/8" - 9 UNC THREAD PITCH
HIGH-STRENGTH STRUCTURAL HEX NUT AND BOLT "C" (ASTM A 325)
HARDENED ROUND WASHER "E"
RECTANGULAR GUARDRAIL PLATE WASHER
BEVELED WASHER
9:1 SLOPE
1" X 1 1/8" SLOT
W4 X 13
FRONT FACE
SIDE
1" DIA. HOLES
3/4" DIA. HOLES

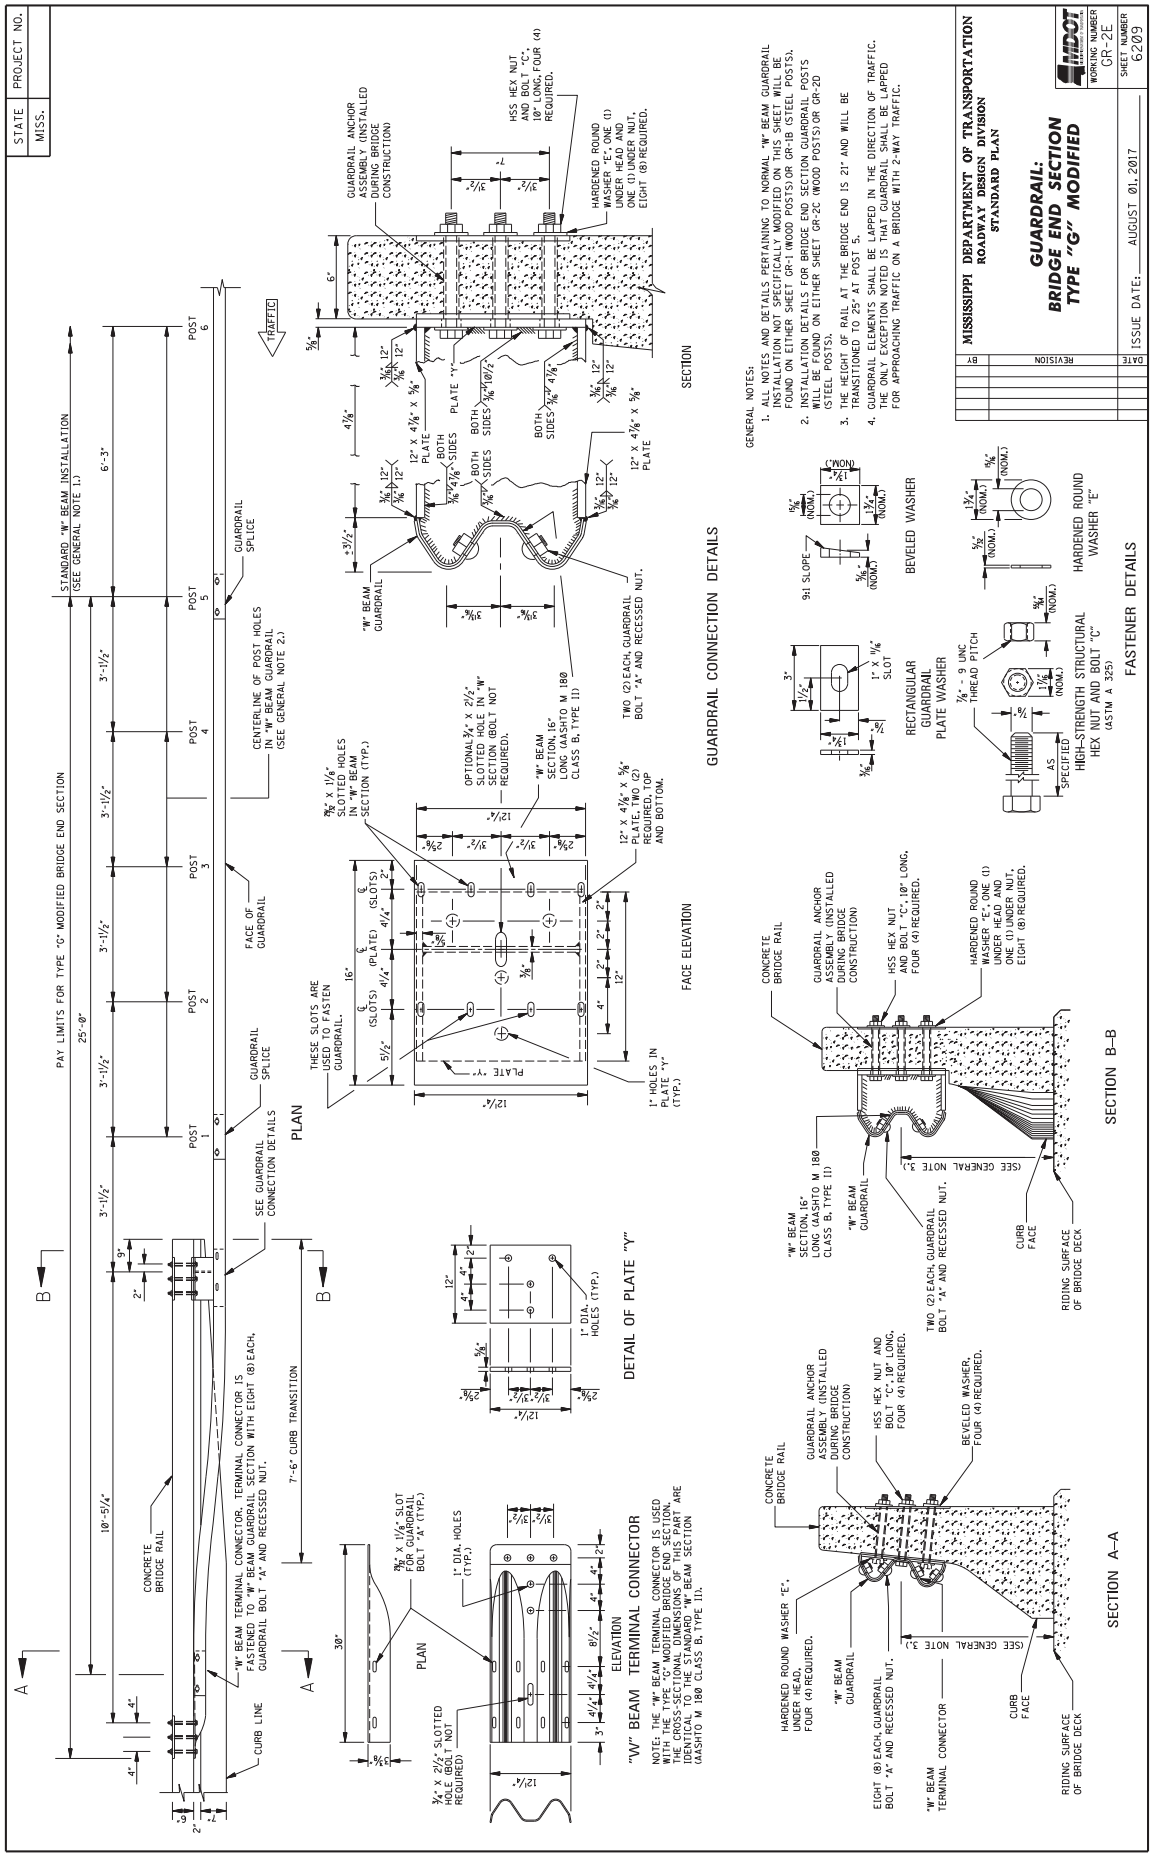
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTION
TYPE "G" MODIFIED
WORKING NUMBER GR-2E
SHEET NUMBER 6209
ISSUE DATE: AUGUST 01, 2017
BY REVISION DATE
GENERAL NOTES:
1. ALL NOTES AND DETAILS PERTAINING TO NORMAL "W" BEAM GUARDRAIL INSTALLATION NOT SPECIFICALLY MODIFIED ON THIS SHEET WILL BE FOUND ON EITHER SHEET GR-1 (WOOD POSTS) OR GR-1B (STEEL POSTS).
2. INSTALLATION DETAILS FOR BRIDGE END SECTION GUARDRAIL POSTS WILL BE FOUND ON EITHER SHEET GR-2C (WOOD POSTS) OR GR-2D (STEEL POSTS).
3. THE HEIGHT OF RAIL AT THE BRIDGE END IS 21" AND WILL BE TRANSITIONED TO 25" AT POST 5.
4. GUARDRAIL ELEMENTS SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC. THE ONLY EXCEPTION NOTED IS THAT GUARDRAIL SHALL BE LAPPED FOR APPROACHING TRAFFIC ON A BRIDGE WITH 2-WAY TRAFFIC.
PLAN
PAY LIMITS FOR TYPE "G" MODIFIED BRIDGE END SECTION
STANDARD "W" BEAM INSTALLATION (SEE GENERAL NOTE 1.)
25'-0"
10'-5¼"
6'-3"
3'-1½"
POST 1
POST 2
POST 3
POST 4
POST 5
POST 6
GUARDRAIL SPLICE
CENTERLINE OF POST HOLES IN "W" BEAM GUARDRAIL (SEE GENERAL NOTE 2.)
FACE OF GUARDRAIL
SEE GUARDRAIL CONNECTION DETAILS
7'-6" CURB TRANSITION
CONCRETE BRIDGE RAIL
CURB LINE
"W" BEAM TERMINAL CONNECTOR, TERMINAL CONNECTOR IS FASTENED TO THE GUARDRAIL SECTION WITH EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
TRAFFIC
SECTION
GUARDRAIL ANCHOR ASSEMBLY (INSTALLED DURING BRIDGE CONSTRUCTION)
HSS HEX NUT AND BOLT "C", 10" LONG, FOUR (4) REQUIRED.
HARDENED ROUND WASHER "E", ONE (1) UNDER NUT, ONE (1) UNDER HEAD AND EIGHT (8) REQUIRED.
"W" BEAM GUARDRAIL
PLATE "Y"
12" X 4⅛" X ⅝" PLATE
BOTH SIDES
TWO (2) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
GUARDRAIL CONNECTION DETAILS
FACE ELEVATION
⅞" X 1⅛" SLOTTED HOLES IN "W" BEAM SECTION (TYP.)
OPTIONAL ¾" X 2½" SLOTTED HOLE IN "W" SECTION (BOLT NOT REQUIRED).
"W" BEAM SECTION, 16' LONG (AASHTO M 180 CLASS B, TYPE II)
12" X 4⅛" X ⅝" PLATE, TWO (2) REQUIRED, TOP AND BOTTOM.
THESE SLOTS ARE USED TO FASTEN GUARDRAIL.
1" HOLES IN PLATE "Y" (TYP.)
DETAIL OF PLATE "Y"
"W" BEAM TERMINAL CONNECTOR
NOTE: THE "W" BEAM TERMINAL CONNECTOR IS USED WITH THE TYPE "G" MODIFIED BRIDGE END SECTION. THE CROSS-SECTIONAL DIMENSIONS OF THIS PART ARE IDENTICAL TO THE STANDARD "W" BEAM SECTION (AASHTO M 180 CLASS B, TYPE II).
ELEVATION
PLAN
¾" X 2½" SLOTTED HOLE (BOLT NOT REQUIRED)
⅞" X 1⅛" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
1" DIA. HOLES (TYP.)
SECTION A–A
HARDENED ROUND WASHER "E", UNDER HEAD, FOUR (4) REQUIRED.
EIGHT (8) EACH, GUARDRAIL BOLT "A" AND RECESSED NUT.
BEVELED WASHER, FOUR (4) REQUIRED.
HSS HEX NUT AND BOLT "C", 10" LONG, FOUR (4) REQUIRED.
CONCRETE BRIDGE RAIL
CURB FACE
RIDING SURFACE OF BRIDGE DECK
(SEE GENERAL NOTE 3.)
SECTION B–B
9:1 SLOPE
BEVELED WASHER
RECTANGULAR GUARDRAIL PLATE WASHER
1" X 1⅛" SLOT
¾" - 9 UNC THREAD PITCH
HIGH-STRENGTH STRUCTURAL HEX NUT AND BOLT "C" (ASTM A 325)
HARDENED ROUND WASHER "E"
FASTENER DETAILS

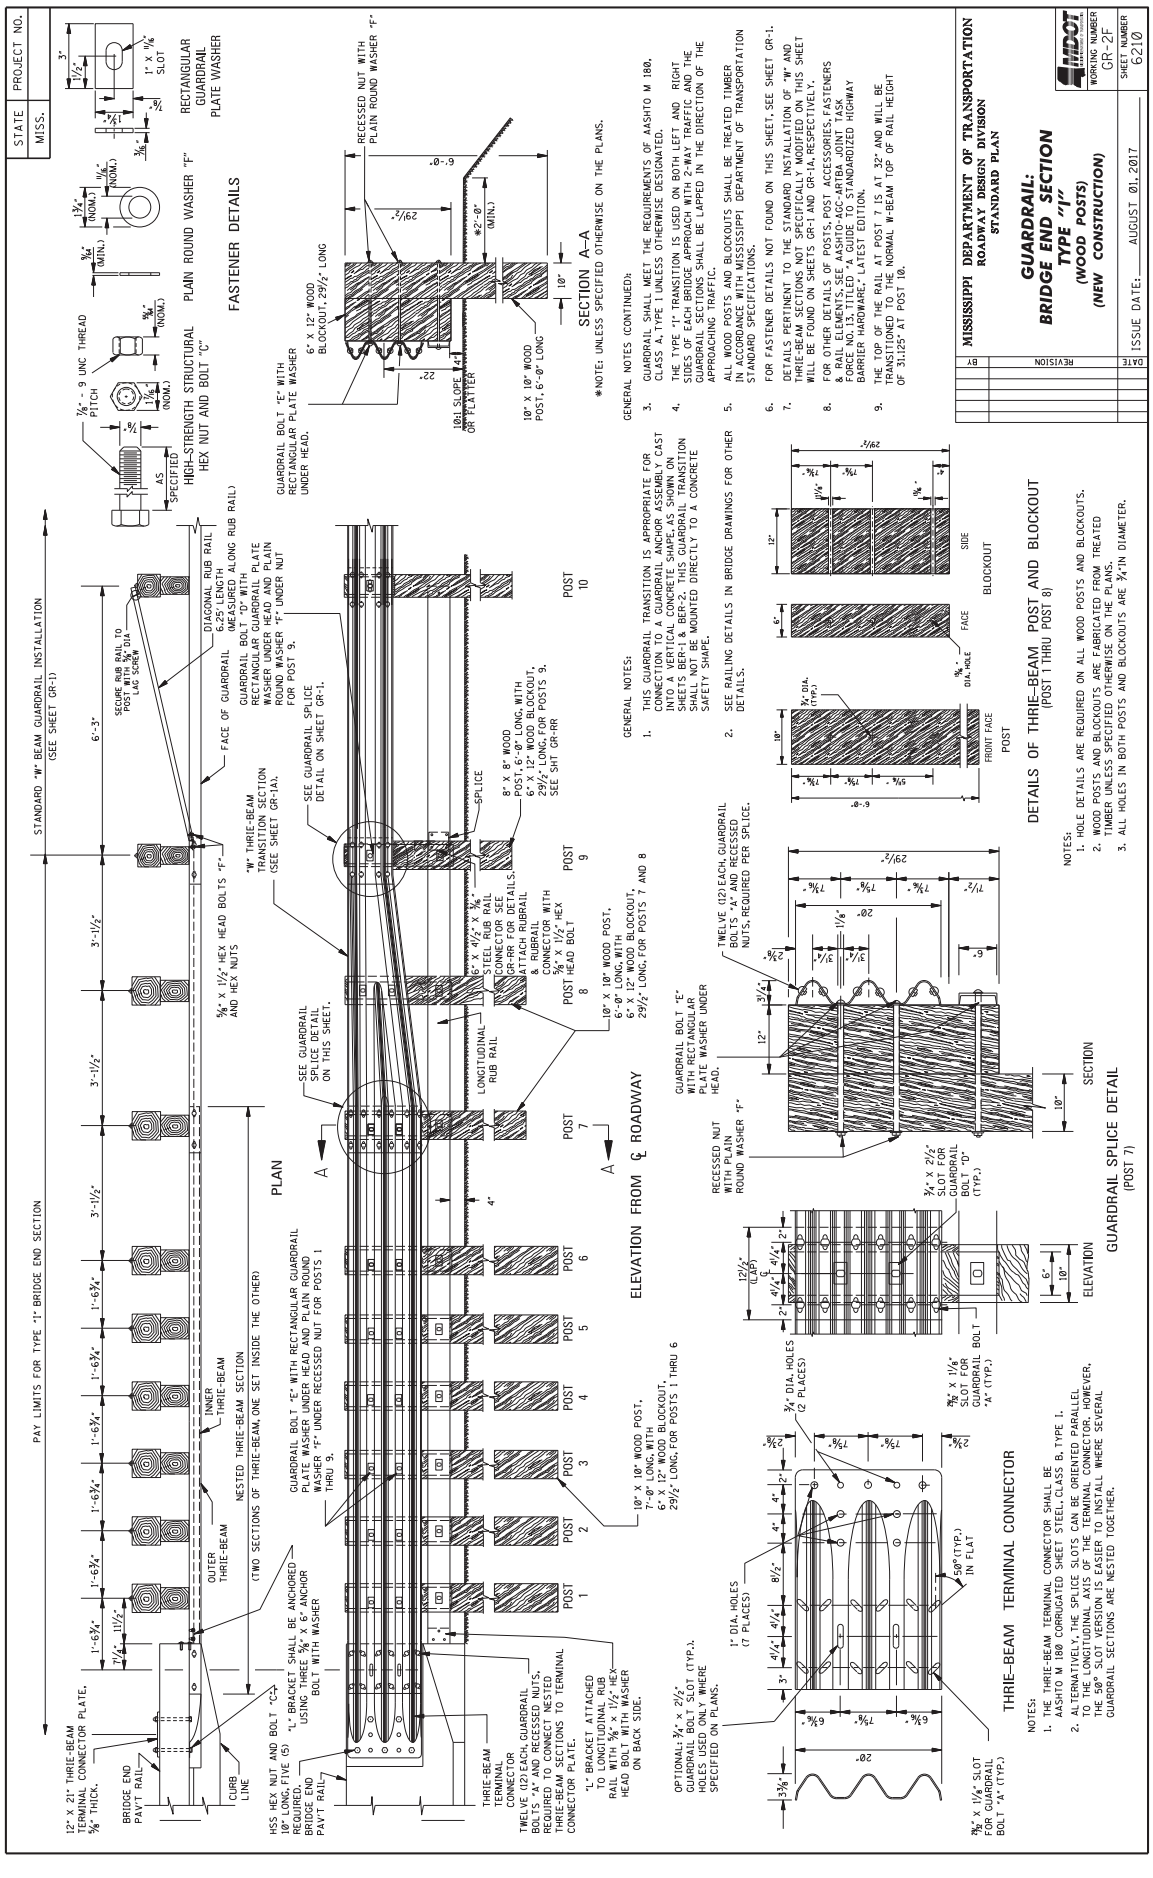
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTION
TYPE "I"
(WOOD POSTS)
(NEW CONSTRUCTION)
WORKING NUMBER GR-2F
SHEET NUMBER 6210
ISSUE DATE: AUGUST 01, 2017
STATE MISS.
PROJECT NO.
STANDARD "W" BEAM GUARDRAIL INSTALLATION (SEE SHEET GR-1)
PAY LIMITS FOR TYPE "I" BRIDGE END SECTION
PLAN
ELEVATION FROM ℄ ROADWAY
SECTION A–A
*NOTE: UNLESS SPECIFIED OTHERWISE ON THE PLANS.
FASTENER DETAILS
DETAILS OF THRIE-BEAM POST AND BLOCKOUT
(POST 1 THRU POST 8)
THRIE-BEAM TERMINAL CONNECTOR
GUARDRAIL SPLICE DETAIL
(POST 7)
GENERAL NOTES:
GENERAL NOTES (CONTINUED):
NOTES:
NOTES:

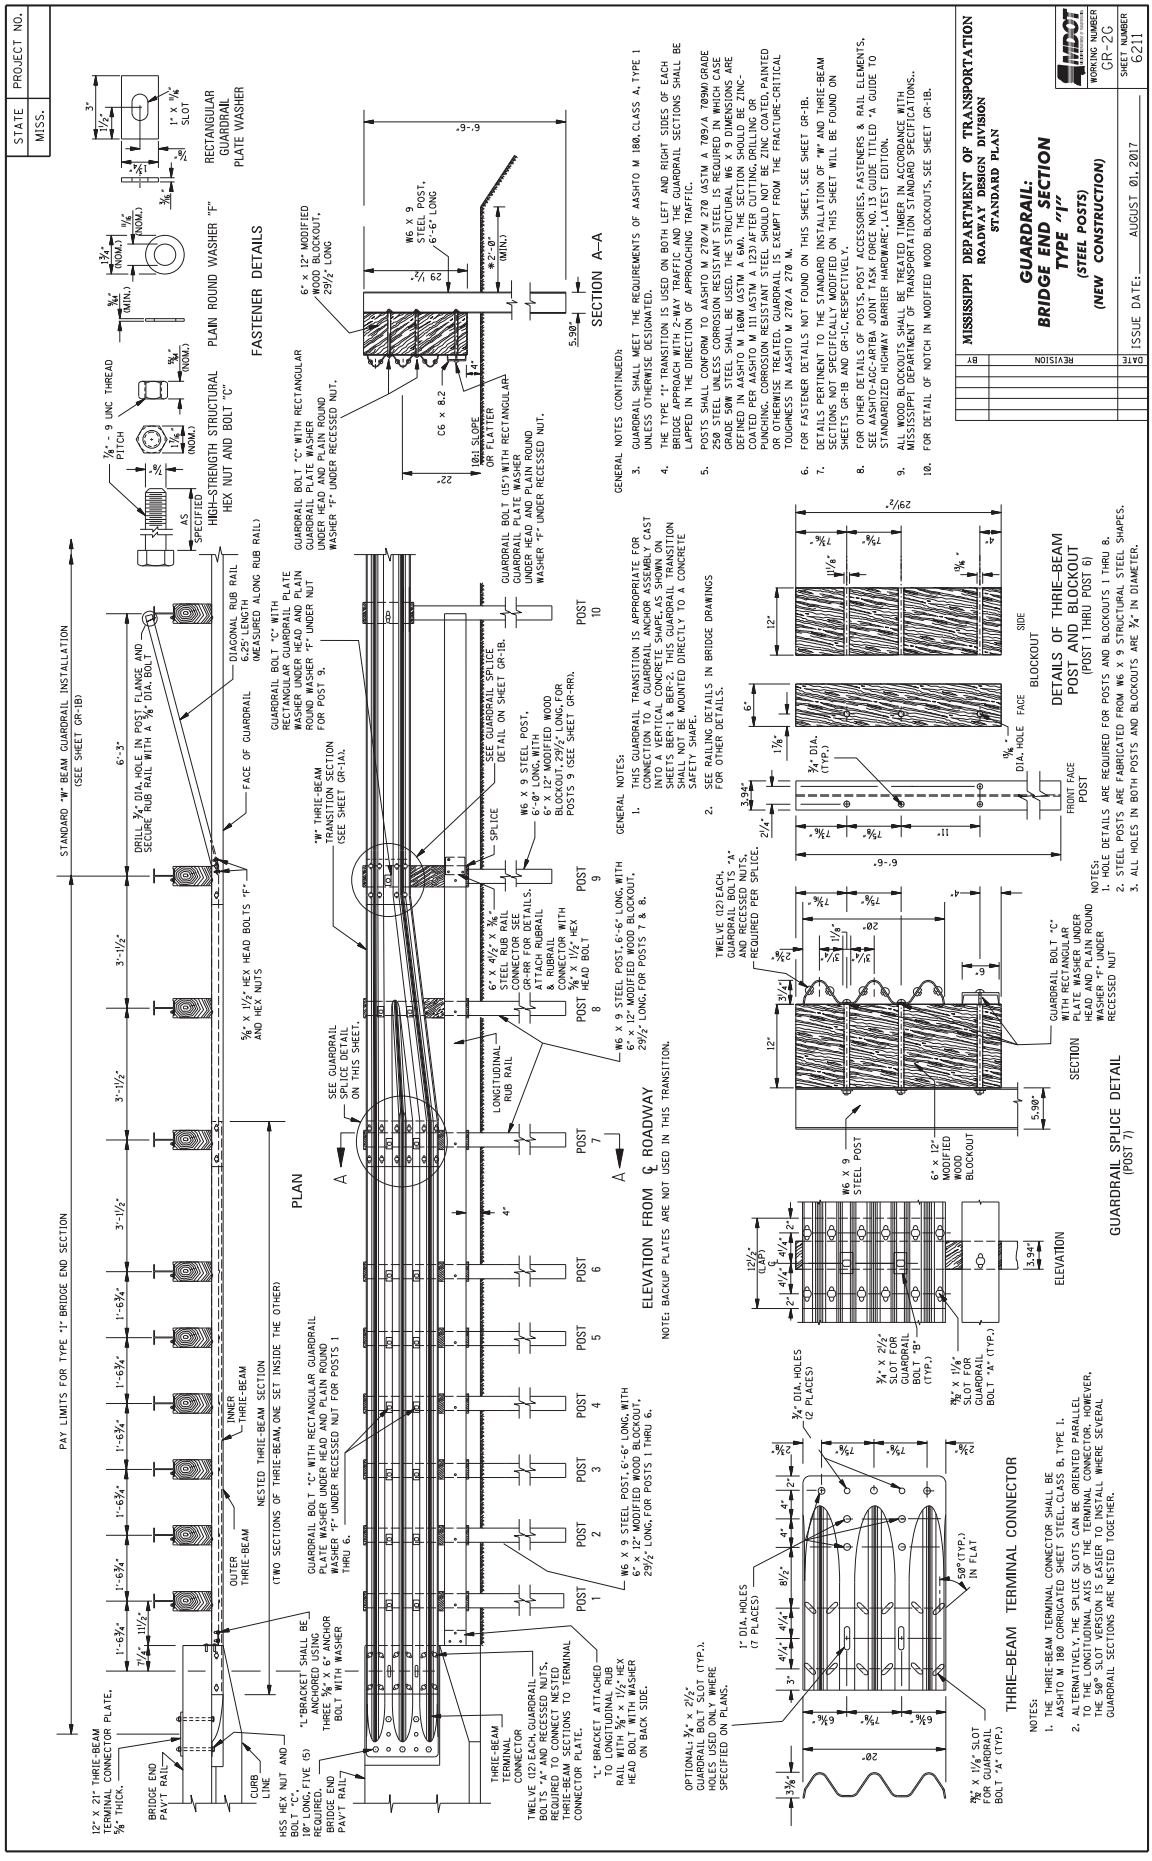
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
BRIDGE END SECTION
TYPE "1"
(STEEL POSTS)
(NEW CONSTRUCTION)
WORKING NUMBER GR-2G
SHEET NUMBER 6211
ISSUE DATE: AUGUST 01, 2017
REVISION
BY
DATE
STANDARD "W" BEAM GUARDRAIL INSTALLATION (SEE SHEET GR-1B)
PAY LIMITS FOR TYPE "1" BRIDGE END SECTION
PLAN
ELEVATION FROM ℄ ROADWAY
NOTE: BACKUP PLATES ARE NOT USED IN THIS TRANSITION.
FASTENER DETAILS
HIGH-STRENGTH STRUCTURAL HEX NUT AND BOLT "C"
PLAIN ROUND WASHER "F"
RECTANGULAR GUARDRAIL PLATE WASHER
SECTION A–A
THRIE-BEAM TERMINAL CONNECTOR
GUARDRAIL SPLICE DETAIL (POST 7)
DETAILS OF THRIE-BEAM POST AND BLOCKOUT (POST 1 THRU POST 6)
GENERAL NOTES (CONTINUED):
GENERAL NOTES:
NOTES:
NOTES:

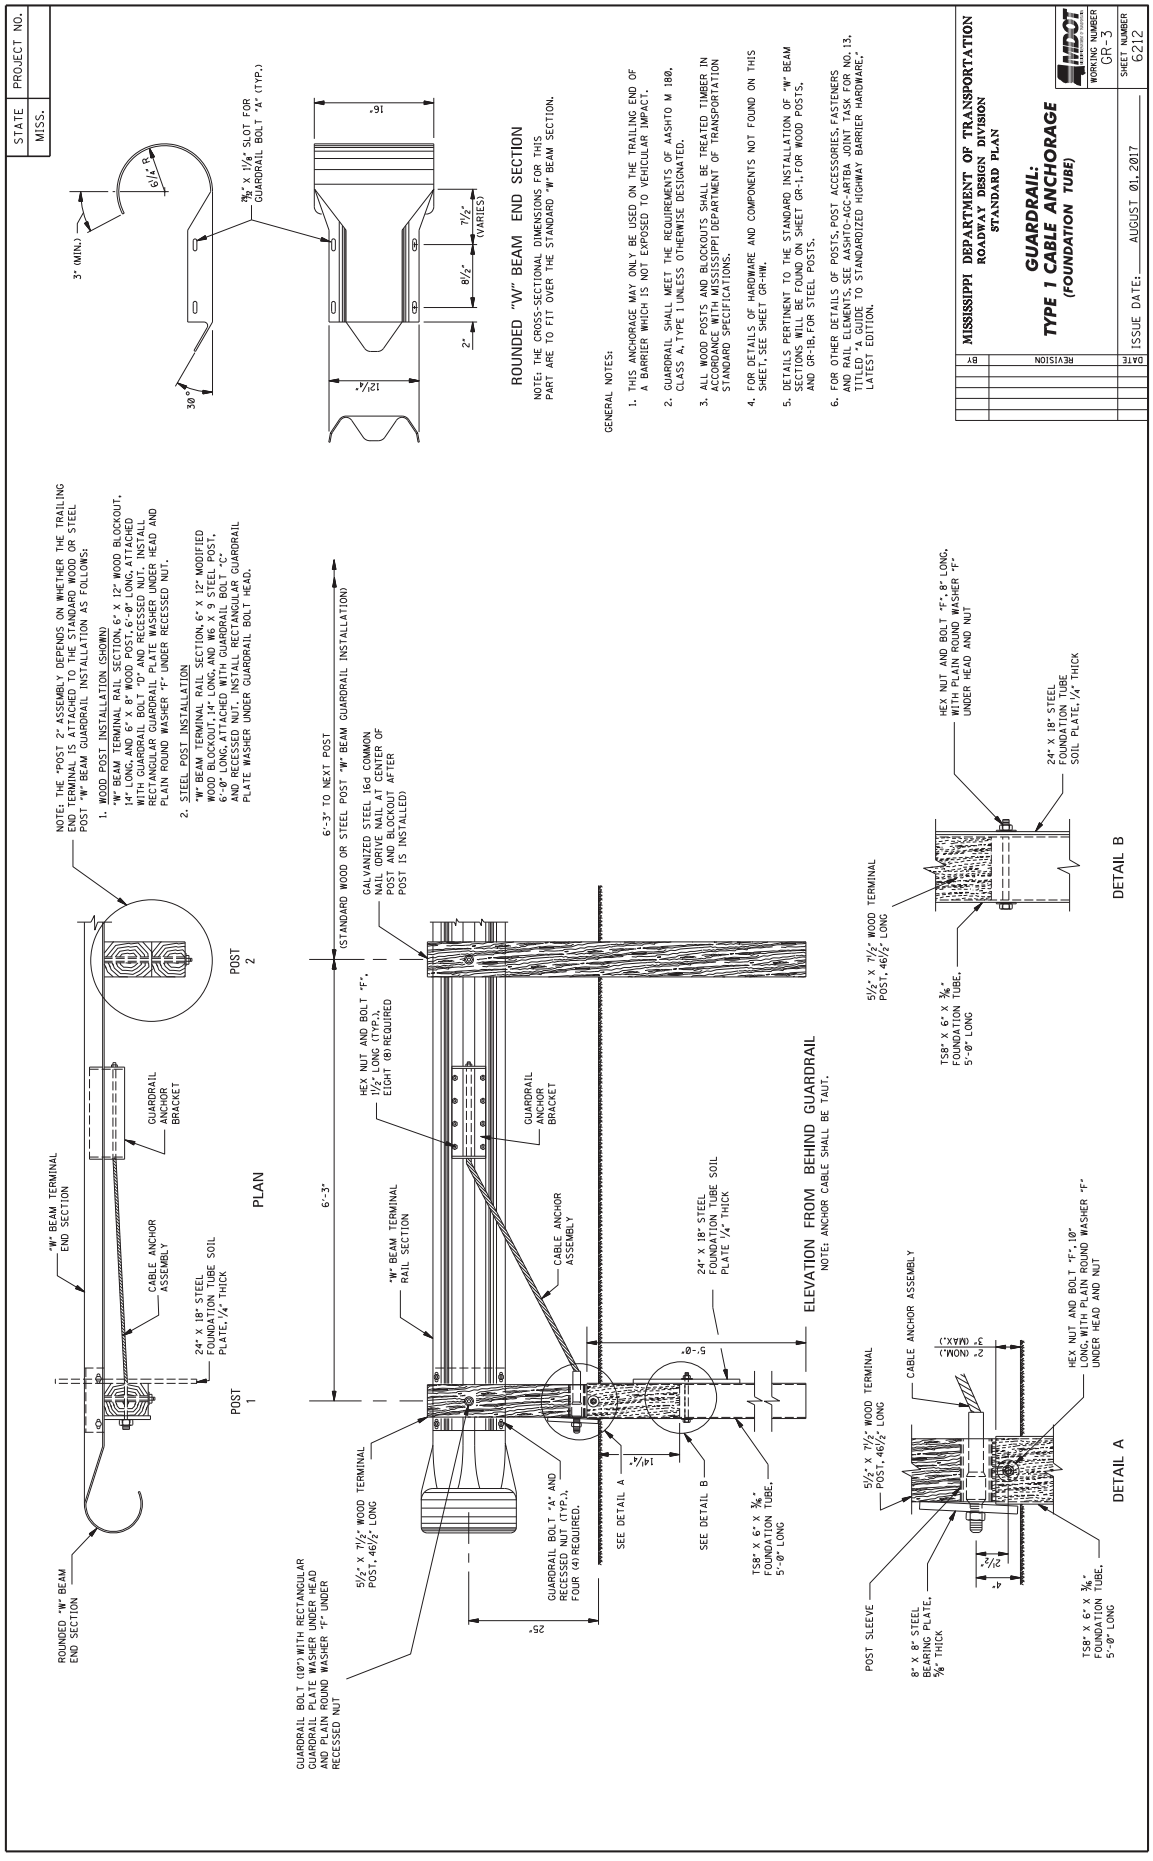
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
TYPE 1 CABLE ANCHORAGE
(FOUNDATION TUBE)
WORKING NUMBER GR-3
SHEET NUMBER 6212
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
GENERAL NOTES:
1. THIS ANCHORAGE MAY ONLY BE USED ON THE TRAILING END OF A BARRIER WHICH IS NOT EXPOSED TO VEHICULAR IMPACT.
2. GUARDRAIL SHALL MEET THE REQUIREMENTS OF AASHTO M 180, CLASS A, TYPE 1 UNLESS OTHERWISE DESIGNATED.
3. ALL WOOD POSTS AND BLOCKOUTS SHALL BE TREATED TIMBER IN ACCORDANCE WITH MISSISSIPPI DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS.
4. FOR DETAILS OF HARDWARE AND COMPONENTS NOT FOUND ON THIS SHEET, SEE SHEET GR-HW.
5. DETAILS PERTINENT TO THE STANDARD INSTALLATION OF "W" BEAM SECTIONS WILL BE FOUND ON SHEET GR-1, FOR WOOD POSTS, AND GR-1B, FOR STEEL POSTS.
6. FOR OTHER DETAILS OF POSTS, POST ACCESSORIES, FASTENERS AND RAIL ELEMENTS, SEE AASHTO-AGC-ARTBA JOINT TASK FOR NO. 13, TITLED "A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE," LATEST EDITION.
ROUNDED "W" BEAM END SECTION
NOTE: THE CROSS-SECTIONAL DIMENSIONS FOR THIS PART ARE TO FIT OVER THE STANDARD "W" BEAM SECTION.
3" (MIN.)
6 1/4" R
30°
7/8" X 1 1/4" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
16"
12 1/4"
8 1/2"
7 1/2" (VARIES)
2"
NOTE: THE "POST 2" ASSEMBLY DEPENDS ON WHETHER THE TRAILING END TERMINAL IS ATTACHED TO THE STANDARD WOOD OR STEEL POST "W" BEAM GUARDRAIL INSTALLATION AS FOLLOWS:
1. WOOD POST INSTALLATION (SHOWN)
"W" BEAM TERMINAL RAIL SECTION, 6" X 12" WOOD BLOCKOUT, 14" LONG, AND 6" X 8" WOOD POST, 6'-0" LONG, ATTACHED WITH GUARDRAIL BOLT "D" AND RECESSED NUT. INSTALL RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT.
2. STEEL POST INSTALLATION
"W" BEAM TERMINAL RAIL SECTION, 6" X 12" MODIFIED WOOD BLOCKOUT, 14" LONG, AND W6 X 9 STEEL POST, 6'-6" LONG, ATTACHED WITH GUARDRAIL BOLT "C" AND RECESSED NUT. INSTALL RECTANGULAR GUARDRAIL PLATE WASHER UNDER GUARDRAIL BOLT HEAD.
"W" BEAM, TERMINAL END SECTION
CABLE ANCHOR ASSEMBLY
GUARDRAIL ANCHOR BRACKET
24" X 18" STEEL FOUNDATION TUBE SOIL PLATE, 1/4" THICK
POST 1
POST 2
PLAN
6'-3" TO NEXT POST (STANDARD WOOD OR STEEL POST "W" BEAM GUARDRAIL INSTALLATION)
GALVANIZED STEEL 16d COMMON NAIL (DRIVE NAIL AT CENTER OF POST AND BLOCKOUT AFTER POST IS INSTALLED)
HEX NUT AND BOLT "F", 1" LONG (TYP.), EIGHT (8) REQUIRED
"W" BEAM TERMINAL RAIL SECTION
6'-3"
5 1/2" X 7 1/2" WOOD TERMINAL POST, 46 1/2" LONG
GUARDRAIL BOLT "A" AND RECESSED NUT (TYP.), FOUR (4) REQUIRED.
25"
14 1/4"
SEE DETAIL A
SEE DETAIL B
5'-0"
TS8" X 6" X 3/16" FOUNDATION TUBE, 5'-0" LONG
ELEVATION FROM BEHIND GUARDRAIL
NOTE: ANCHOR CABLE SHALL BE TAUT.
GUARDRAIL BOLT (10") WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT
ROUNDED "W" BEAM END SECTION
HEX NUT AND BOLT "F", 8" LONG, WITH PLAIN ROUND WASHER "F" UNDER HEAD AND NUT
24" X 18" STEEL FOUNDATION TUBE SOIL PLATE, 1/4" THICK
5 1/2" X 7 1/2" WOOD TERMINAL POST, 46 1/2" LONG
TS8" X 6" X 3/16" FOUNDATION TUBE, 5'-0" LONG
DETAIL B
POST SLEEVE
8" X 8" STEEL BEARING PLATE, 3/8" THICK
5 1/2" X 7 1/2" WOOD TERMINAL POST, 46 1/2" LONG
CABLE ANCHOR ASSEMBLY
2" (NOM.) 3" (MAX.)
HEX NUT AND BOLT "F", 10" LONG, WITH PLAIN ROUND WASHER "F" UNDER HEAD AND NUT
2 1/2"
4"
TS8" X 6" X 3/16" FOUNDATION TUBE, 5'-0" LONG
DETAIL A

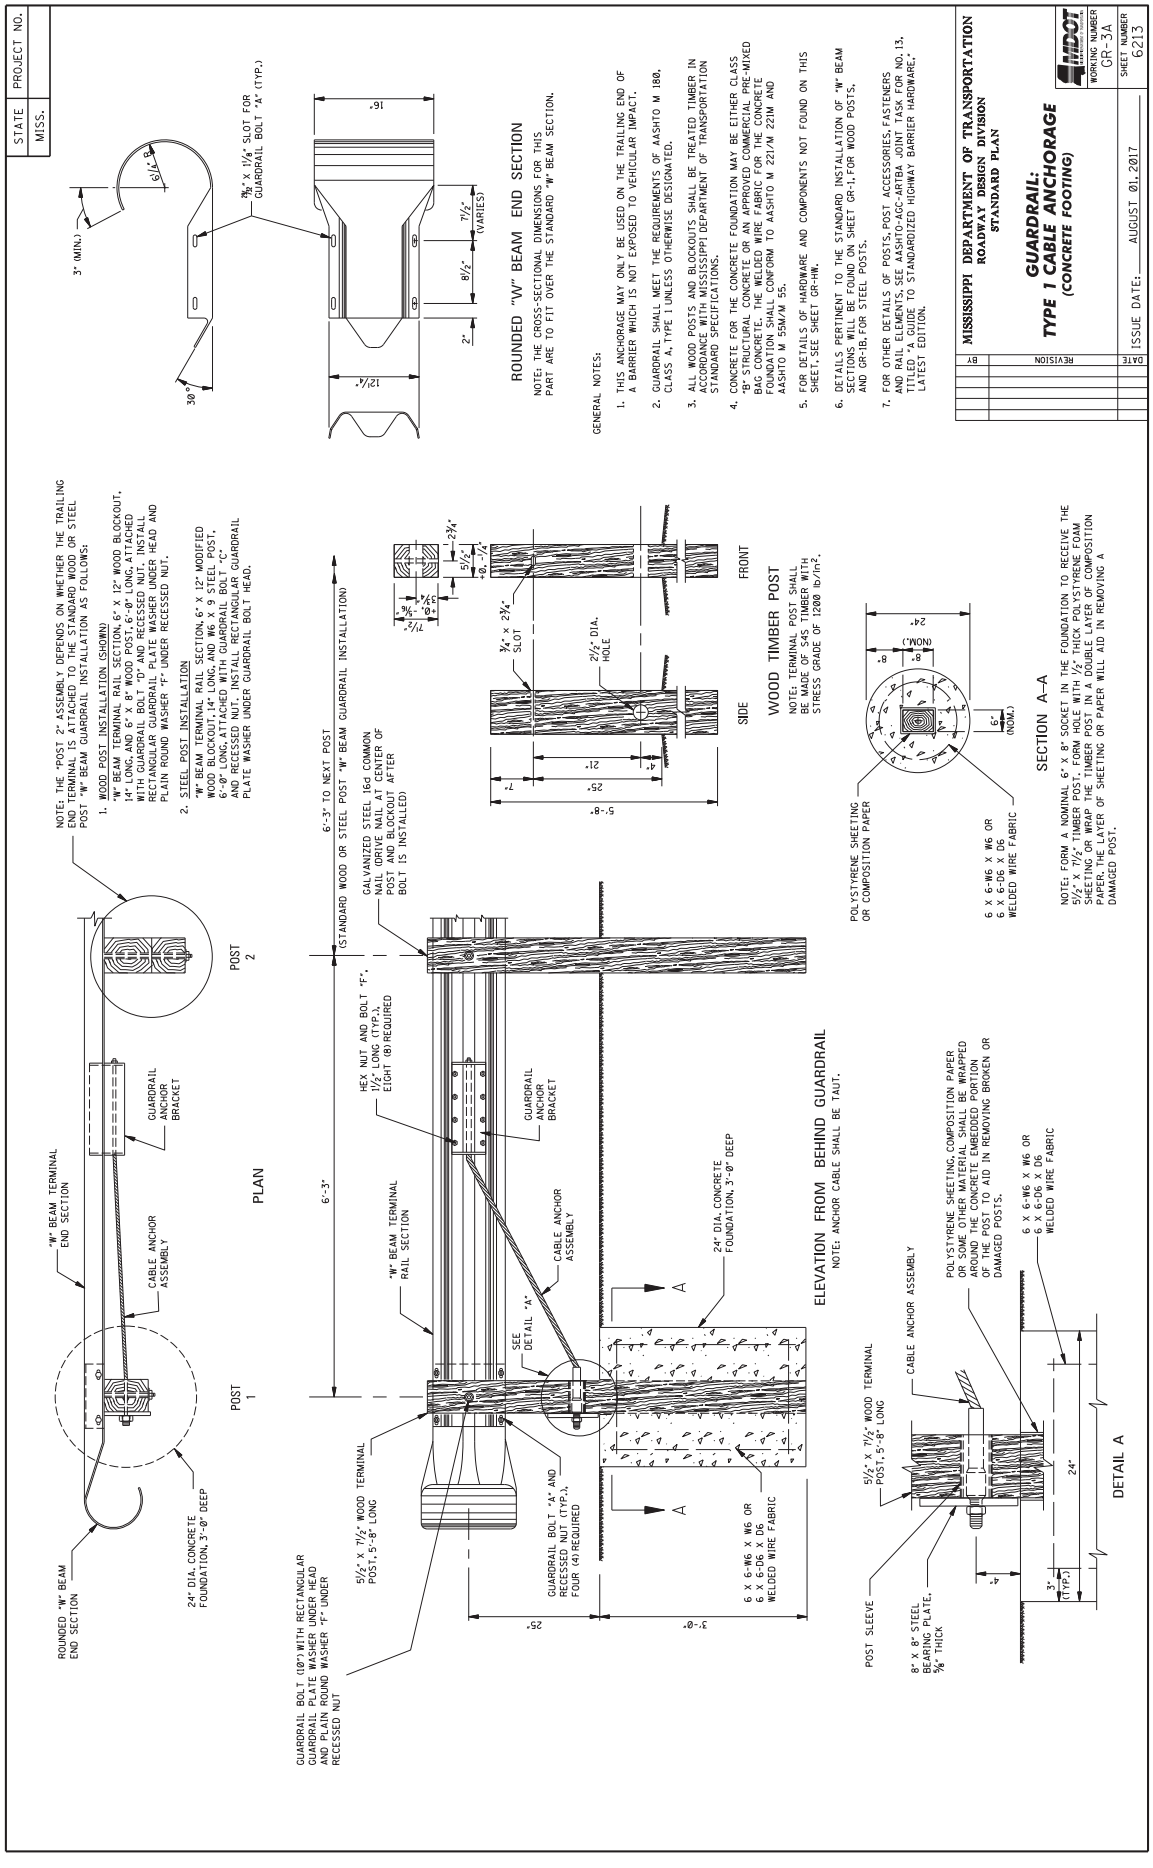
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
TYPE 1 CABLE ANCHORAGE
(CONCRETE FOOTING)
WORKING NUMBER GR-3A
SHEET NUMBER 6213
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
ROUNDED "W" BEAM END SECTION
NOTE: THE CROSS-SECTIONAL DIMENSIONS FOR THIS PART ARE TO FIT OVER THE STANDARD "W" BEAM SECTION.
GENERAL NOTES:
1. THIS ANCHORAGE MAY ONLY BE USED ON THE TRAILING END OF A BARRIER WHICH IS NOT EXPOSED TO VEHICULAR IMPACT.
2. GUARDRAIL SHALL MEET THE REQUIREMENTS OF AASHTO M 180, CLASS A, TYPE I UNLESS OTHERWISE DESIGNATED.
3. ALL WOOD POSTS AND BLOCKOUTS SHALL BE TREATED TIMBER IN ACCORDANCE WITH MISSISSIPPI DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS.
4. CONCRETE FOR THE CONCRETE FOUNDATION MAY BE EITHER CLASS "B" STRUCTURAL CONCRETE OR AN APPROVED COMMERCIAL PRE-MIXED BAG CONCRETE. THE WELDED WIRE FABRIC FOR THE CONCRETE FOUNDATION SHALL CONFORM TO AASHTO M 221/M 221M AND AASHTO M 55M/M 55.
5. FOR DETAILS OF HARDWARE AND COMPONENTS NOT FOUND ON THIS SHEET, SEE SHEET GR-HW.
6. DETAILS PERTINENT TO THE STANDARD INSTALLATION OF "W" BEAM SECTIONS WILL BE FOUND ON SHEET GR-1, FOR WOOD POSTS, AND GR-1B, FOR STEEL POSTS.
7. FOR OTHER DETAILS OF POSTS, POST ACCESSORIES, FASTENERS AND RAIL ELEMENTS, SEE AASHTO-AGC-ARTBA JOINT TASK FOR NO. 13, TITLED "A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE," LATEST EDITION.
NOTE: THE "POST 2" ASSEMBLY DEPENDS ON WHETHER THE TRAILING END TERMINAL IS ATTACHED TO THE STANDARD WOOD OR STEEL POST "W" BEAM GUARDRAIL INSTALLATION AS FOLLOWS:
1. WOOD POST INSTALLATION (SHOWN)
"W" BEAM TERMINAL RAIL SECTION, 6' X 12" WOOD BLOCKOUT, 14" LONG, AND 6' X 8" WOOD POST, 6'-0" LONG, ATTACHED WITH GUARDRAIL BOLT "D" AND RECESSED NUT. INSTALL RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT.
2. STEEL POST INSTALLATION
"W" BEAM TERMINAL RAIL SECTION, 6' X 12" MODIFIED WOOD BLOCKOUT, 14" LONG, AND W6 X 9 STEEL POST, 6'-6" LONG ATTACHED WITH GUARDRAIL BOLT "C" AND RECESSED NUT. INSTALL RECTANGULAR GUARDRAIL PLATE WASHER UNDER GUARDRAIL BOLT HEAD.
3" (MIN.)
30°
7/8" X 1 1/4" SLOT FOR GUARDRAIL BOLT "A" (TYP.)
16"
12 1/4"
8 1/2"
7 1/2" (VARIES)
2"
"W" BEAM END SECTION
CABLE ANCHOR ASSEMBLY
GUARDRAIL ANCHOR BRACKET
POST 1
POST 2
PLAN
24" DIA. CONCRETE FOUNDATION, 3'-0" DEEP
ROUNDED "W" BEAM END SECTION
GUARDRAIL BOLT (10") WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT
6'-3"
6'-3" TO NEXT POST
(STANDARD WOOD OR STEEL POST "W" BEAM GUARDRAIL INSTALLATION)
GALVANIZED STEEL 16d COMMON NAIL (DRIVE NAIL AT CENTER OF POST AND BLOCKOUT AFTER BOLT IS INSTALLED)
HEX NUT AND BOLT "F", 1½" LONG (TYP.), EIGHT (8) REQUIRED
"W" BEAM TERMINAL RAIL SECTION
GUARDRAIL ANCHOR BRACKET
CABLE ANCHOR ASSEMBLY
SEE DETAIL "A"
24" DIA. CONCRETE FOUNDATION, 3'-0" DEEP
5½" X 7½" WOOD TERMINAL POST, 5'-8" LONG
GUARDRAIL BOLT "A" AND RECESSED NUT (TYP.), FOUR (4) REQUIRED
6 X 6-W6 X W6 OR 6 X 6-D6 X D6 WELDED WIRE FABRIC
25"
3'-0"
ELEVATION FROM BEHIND GUARDRAIL
NOTE: ANCHOR CABLE SHALL BE TAUT.
NOTE: TERMINAL POST SHALL BE MADE OF S4S TIMBER WITH STRESS GRADE OF 1200 lb/in².
WOOD TIMBER POST
SIDE
FRONT
¾" X 2¾" SLOT
2½" DIA. HOLE
5'-8"
25"
21"
7"
4"
5½"
+0, -1/4"
2¾"
POLYSTYRENE SHEETING OR COMPOSITION PAPER
6 X 6-W6 X W6 OR 6 X 6-D6 X D6 WELDED WIRE FABRIC
24" (NOM.)
8" (NOM.)
SECTION A–A
NOTE: FORM A NOMINAL 6" X 8" SOCKET IN THE FOUNDATION TO RECEIVE THE 5½" X 7½" TIMBER POST. FORM HOLE WITH 6" POST SLEEVE. POLYSTYRENE SHEETING OR WRAP THE TIMBER POST IN A DOUBLE LAYER OF COMPOSITION PAPER. THE LAYER OF SHEETING OR PAPER WILL AID IN REMOVING A DAMAGED POST.
5½" X 7½" WOOD TERMINAL POST, 5'-8" LONG
CABLE ANCHOR ASSEMBLY
POLYSTYRENE SHEETING, COMPOSITION PAPER OR SOME OTHER MATERIAL SHALL BE WRAPPED AROUND THE CONCRETE EMBEDDED PORTION OF THE POST TO AID IN REMOVING BROKEN OR DAMAGED POSTS.
6 X 6-W6 X W6 OR 6 X 6-D6 X D6 WELDED WIRE FABRIC
POST SLEEVE
8" X 8" STEEL BEARING PLATE, ⅝" THICK
24"
4"
3" (TYP.)
DETAIL A

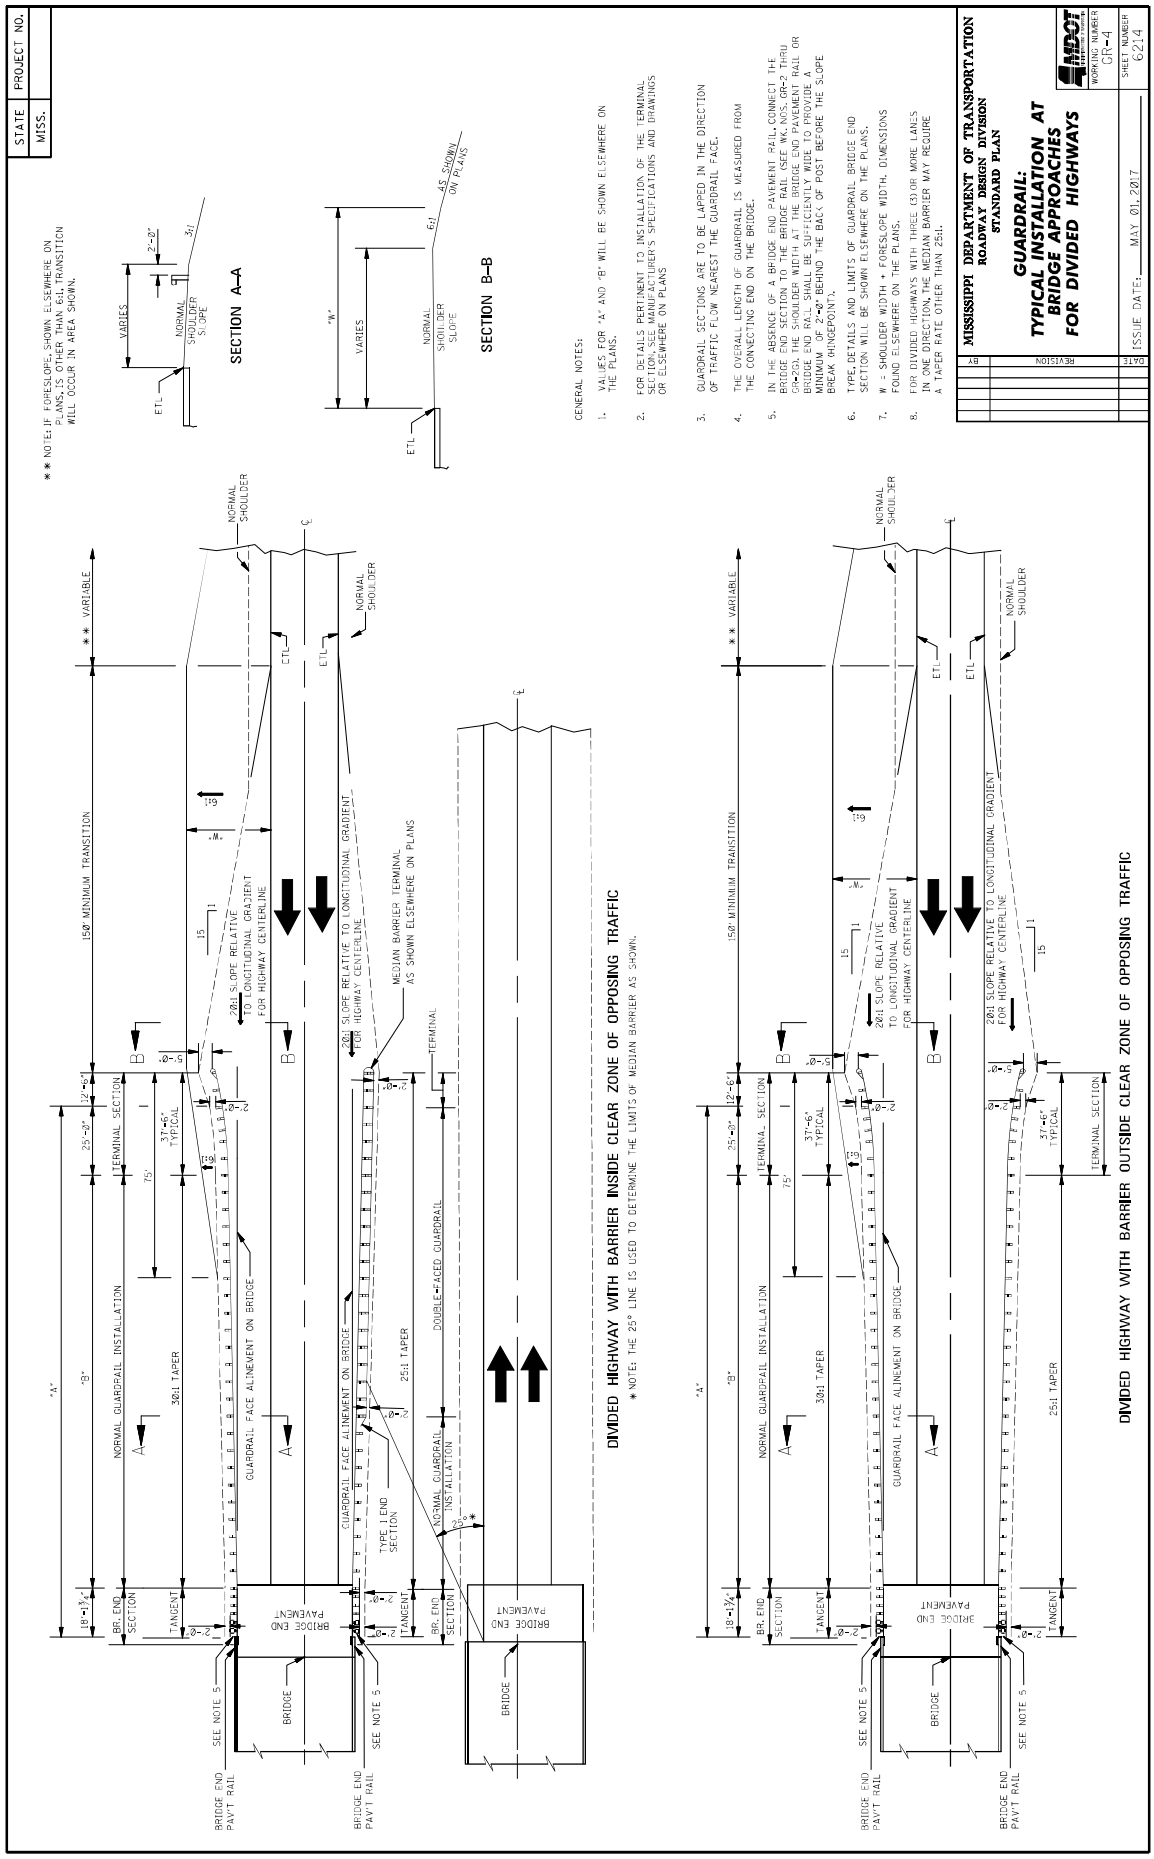
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
TYPICAL INSTALLATION AT BRIDGE APPROACHES FOR DIVIDED HIGHWAYS
WORKING NUMBER GR-4
SHEET NUMBER 6214
ISSUE DATE: MAY 01, 2017
BY REVISION DATE
** NOTE: IF FORESLOPE, SHOWN ELSEWHERE ON PLANS, IS OTHER THAN 6:1, TRANSITION WILL OCCUR IN AREA SHOWN.
SECTION A–A
SECTION B–B
GENERAL NOTES:
1. VALUES FOR "A" AND "B" WILL BE SHOWN ELSEWHERE ON THE PLANS.
2. FOR DETAILS PERTINENT TO INSTALLATION OF THE TERMINAL SECTION, SEE MANUFACTURER'S SPECIFICATIONS AND DRAWINGS OR ELSEWHERE ON PLANS
3. GUARDRAIL SECTIONS ARE TO BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW NEAREST THE GUARDRAIL FACE.
4. THE OVERALL LENGTH OF GUARDRAIL IS MEASURED FROM THE CONNECTING END ON THE BRIDGE.
5. IN THE ABSENCE OF A BRIDGE END PAVEMENT RAIL CONNECT THE BRIDGE END SECTION TO THE BRIDGE RAIL SECTION ACROSS GR-2 THRU GR-3(S). THE SHOULDER WIDTH AT THE BRIDGE END PAVEMENT RAIL OR BRIDGE END RAIL SHALL BE SUFFICIENTLY WIDE TO PROVIDE A MINIMUM OF 2'-0" BEHIND THE BACK OF POST BEFORE THE SLOPE BREAK (HINGEPOINT).
6. TYPE DETAILS AND LIMITS OF GUARDRAIL BRIDGE END SECTION WILL BE SHOWN ELSEWHERE ON THE PLANS.
7. "W" = SHOULDER WIDTH + FORESLOPE WIDTH. DIMENSIONS FOUND ELSEWHERE ON THE PLANS.
8. FOR DIVIDED HIGHWAYS WITH THREE (3) OR MORE LANES IN ONE DIRECTION, THE MEDIAN BARRIER MAY REQUIRE A TAPER RATE OTHER THAN 25:1.
DIVIDED HIGHWAY WITH BARRIER INSIDE CLEAR ZONE OF OPPOSING TRAFFIC
* NOTE: THE 25° LINE IS USED TO DETERMINE THE LIMITS OF MEDIAN BARRIER AS SHOWN.
DIVIDED HIGHWAY WITH BARRIER OUTSIDE CLEAR ZONE OF OPPOSING TRAFFIC
NORMAL SHOULDER
ETL
CL
** VARIABLE
150' MINIMUM TRANSITION
"A"
"B"
"W"
20:1 SLOPE RELATIVE TO LONGITUDINAL GRADIENT FOR HIGHWAY CENTERLINE
MEDIAN BARRIER TERMINAL AS SHOWN ELSEWHERE ON PLANS
TERMINAL SECTION
37'-6" TYPICAL
75'
NORMAL GUARDRAIL INSTALLATION
30:1 TAPER
GUARDRAIL FACE ALINEMENT ON BRIDGE
TYPE I END SECTION
25:1 TAPER
DOUBLE-FACED GUARDRAIL
25°*
BR. END SECTION
TANGENT
BRIDGE END PAVEMENT
BRIDGE
SEE NOTE 5
BRIDGE END PAVT RAIL
VARIES
NORMAL SHOULDER SLOPE
AS SHOWN ON PLANS

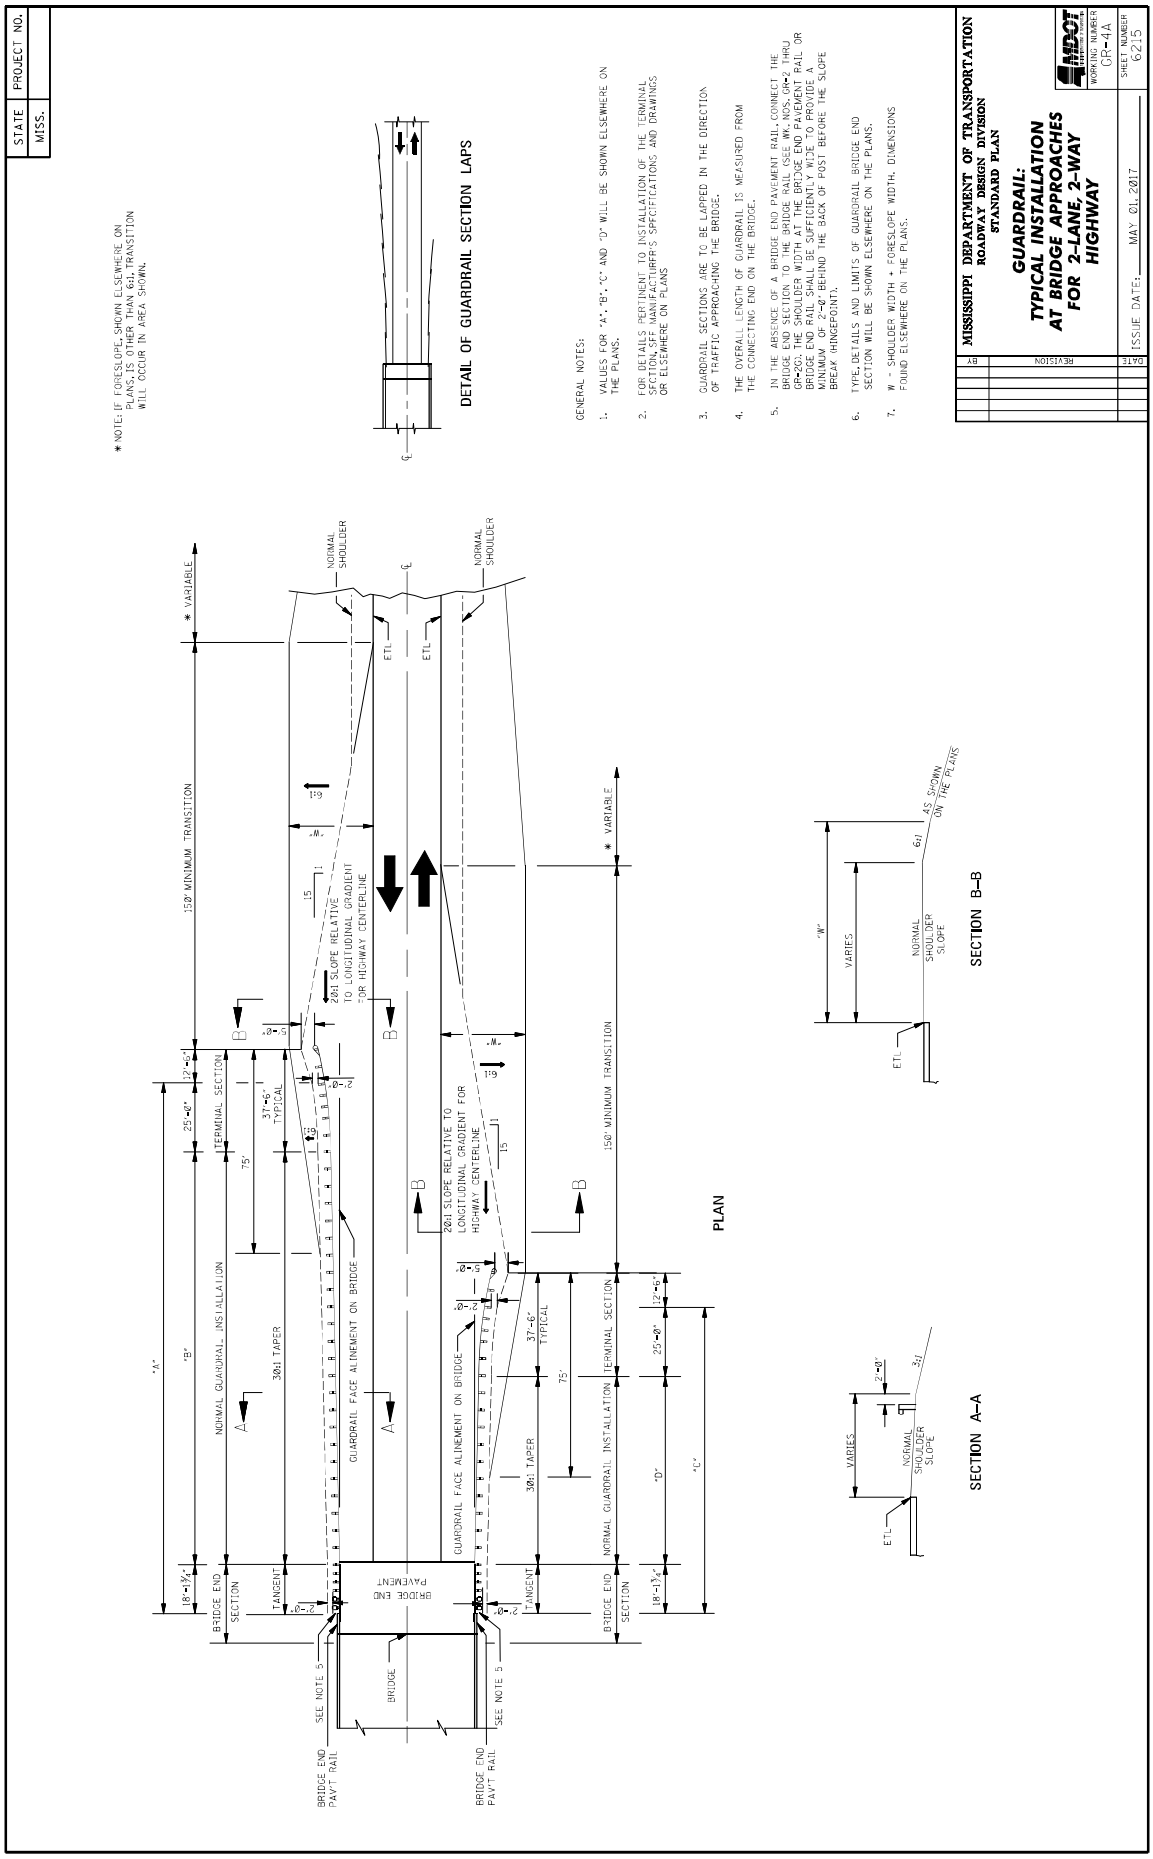
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
TYPICAL INSTALLATION
AT BRIDGE APPROACHES
FOR 2-LANE 2-WAY
HIGHWAY
WORKING NUMBER GR-4A
SHEET NUMBER 6215
ISSUE DATE: MAY 01, 2017
BY REVISION DATE
* NOTE: IF FORESLOPE SHOWN ELSEWHERE ON PLANS, IS OTHER THAN 6:1, TRANSITION WILL OCCUR IN AREA SHOWN.
DETAIL OF GUARDRAIL SECTION LAPS
GENERAL NOTES:
1. VALUES FOR "A", "B", "C" AND "D" WILL BE SHOWN ELSEWHERE ON THE PLANS.
2. FOR DETAILS PERTINENT TO INSTALLATION OF THE TERMINAL SECTION, SEE MANUFACTURER'S SPECIFICATIONS AND DRAWINGS OR ELSEWHERE ON PLANS
3. GUARDRAIL SECTIONS ARE TO BE LAPPED IN THE DIRECTION OF TRAFFIC APPROACHING THE BRIDGE.
4. THE OVERALL LENGTH OF GUARDRAIL IS MEASURED FROM THE CONNECTING END ON THE BRIDGE.
5. IN THE ABSENCE OF A BRIDGE END PAVEMENT RAIL, CONNECT THE BRIDGE END SECTION TO THE BRIDGE RAIL (SEE MS-GR-2 THRU GR-2C). THE SHOULDER WIDTH AT THE BRIDGE END PROVIDED FOR BRIDGE END RAIL SHALL BE SUFFICIENT TO PROVIDE A MINIMUM OF 2'-0" BEHIND THE BACK OF POST BEFORE THE SLOPE BREAK (HINGEPOINT).
6. TYPE DETAILS AND LIMITS OF GUARDRAIL BRIDGE END SECTION WILL BE SHOWN ELSEWHERE ON THE PLANS.
7. "W" = SHOULDER WIDTH + FORESLOPE WIDTH. DIMENSIONS FOUND ELSEWHERE ON THE PLANS.
PLAN
SECTION A–A
SECTION B–B
"A"
"B"
"C"
"D"
"W"
* VARIABLE
150' MINIMUM TRANSITION
NORMAL GUARDRAIL INSTALLATION
TERMINAL SECTION
BRIDGE END SECTION
TANGENT
37'-6" TYPICAL
75'
30:1 TAPER
GUARDRAIL FACE ALINEMENT ON BRIDGE
20:1 SLOPE RELATIVE TO LONGITUDINAL GRADIENT FOR HIGHWAY CENTERLINE
NORMAL SHOULDER
ETL
BRIDGE
BRIDGE END PAVT. RAIL
SEE NOTE 5
BRIDGE END PAVEMENT
18'-1½"
12'-6"
25'-0"
VARIES
NORMAL SHOULDER SLOPE
AS SHOWN ON THE PLANS
6:1
3:1
2'-0"

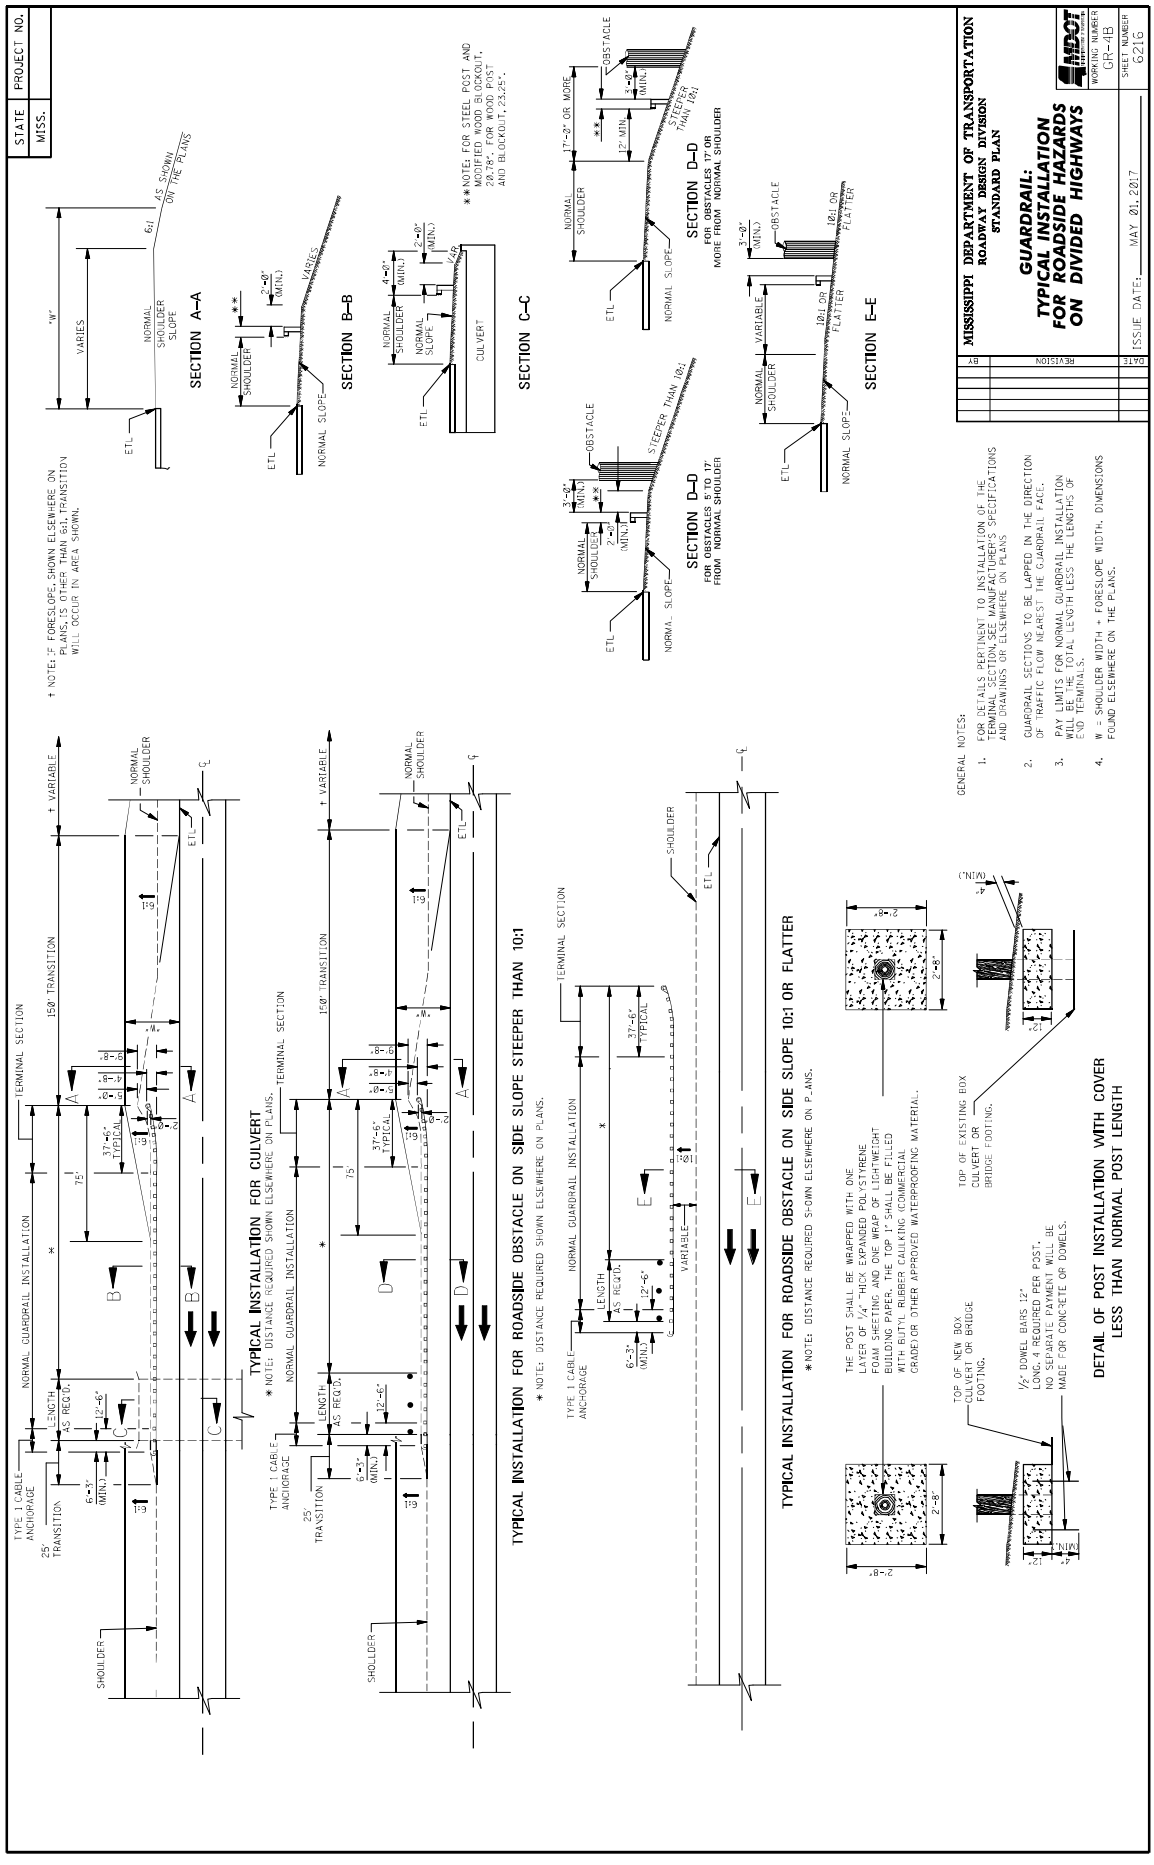
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
TYPICAL INSTALLATION
FOR ROADSIDE HAZARDS
ON DIVIDED HIGHWAYS
WORKING NUMBER GR-4B
SHEET NUMBER 6216
ISSUE DATE: MAY 01, 2017
DATE
REVISION
BY
SECTION A–A
SECTION B–B
SECTION C–C
SECTION D–D
FOR OBSTACLES 5' TO 17' FROM NORMAL SHOULDER
SECTION D–D
FOR OBSTACLES 17' OR MORE FROM NORMAL SHOULDER
SECTION E–E
† NOTE: IF FORESLOPE, SHOWN ELSEWHERE ON PLANS, IS OTHER THAN 6:1, TRANSITION WILL OCCUR IN AREA SHOWN.
** NOTE: FOR STEEL POST AND ROUND WOOD POST, MODIFIED WOOD BLOCKOUT, AND BLOCKOUT, 23.5".
GENERAL NOTES:
1. FOR DETAILS PERTINENT TO INSTALLATION OF THE TERMINAL SECTION, SEE MANUFACTURER'S SPECIFICATIONS AND DRAWINGS OR ELSEWHERE ON PLANS.
2. GUARDRAIL SECTIONS TO BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW NEAREST THE GUARDRAIL FACE.
3. PAY LIMITS FOR NORMAL GUARDRAIL INSTALLATION WILL BE THE TOTAL LENGTH LESS THE LENGTHS OF END TERMINALS.
4. W = SHOULDER WIDTH + FORESLOPE WIDTH. DIMENSIONS FOUND ELSEWHERE ON THE PLANS.
TYPICAL INSTALLATION FOR CULVERT
TYPICAL INSTALLATION FOR ROADSIDE OBSTACLE ON SIDE SLOPE STEEPER THAN 10:1
TYPICAL INSTALLATION FOR ROADSIDE OBSTACLE ON SIDE SLOPE 10:1 OR FLATTER
DETAIL OF POST INSTALLATION WITH COVER
LESS THAN NORMAL POST LENGTH

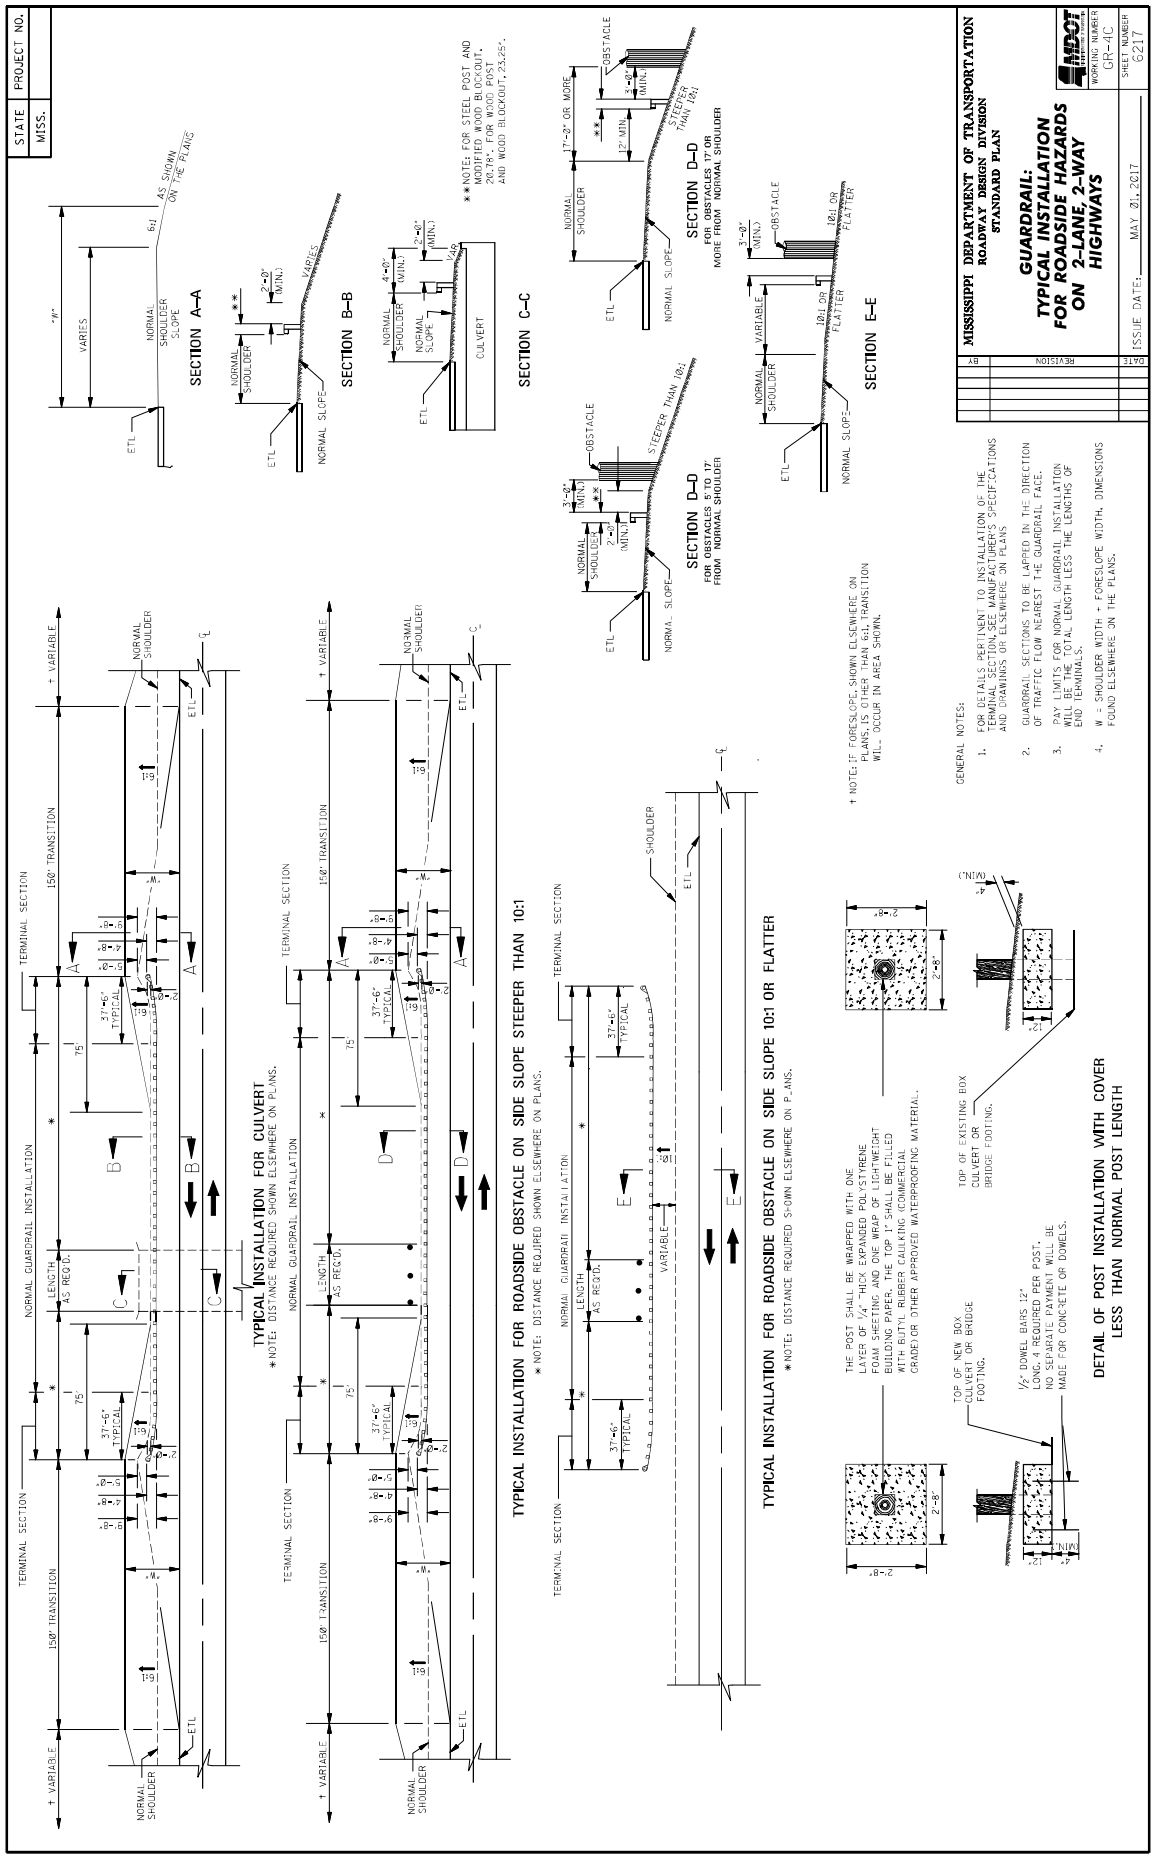
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL: TYPICAL INSTALLATION FOR ROADSIDE HAZARDS ON 2-LANE, 2-WAY HIGHWAYS
WORKING NUMBER GR-4C
SHEET NUMBER 6217
ISSUE DATE: MAY 01, 2017
DATE
BY
REVISION
SECTION A-A
SECTION B-B
SECTION C-C
SECTION D-D FOR OBSTACLES 5' TO 17' FROM NORMAL SHOULDER
SECTION D-D FOR OBSTACLES 17' OR MORE FROM NORMAL SHOULDER
SECTION E-E
** NOTE: FOR STEEL POST AND MODIFIED WOOD BLOCKOUT, USE 12" POWER POST 12.25" AND WOOD BLOCKOUT, 23.25".
TYPICAL INSTALLATION FOR CULVERT
* NOTE: DISTANCE REQUIRED SHOWN ELSEWHERE ON PLANS.
TYPICAL INSTALLATION FOR ROADSIDE OBSTACLE ON SIDE SLOPE STEEPER THAN 10:1
* NOTE: DISTANCE REQUIRED SHOWN ELSEWHERE ON PLANS.
TYPICAL INSTALLATION FOR ROADSIDE OBSTACLE ON SIDE SLOPE 10:1 OR FLATTER
* NOTE: DISTANCE REQUIRED SHOWN ELSEWHERE ON PLANS.
† NOTE: IF FORESLOPE SHOWN ELSEWHERE ON PLANS IS OTHER THAN 6:1 TRANSITION WILL OCCUR IN AREA SHOWN.
GENERAL NOTES:
1. FOR DETAILS PERTINENT TO INSTALLATION OF THE TERMINAL SECTION, SEE MANUFACTURER'S SPECIFICATIONS AND DRAWINGS OR ELSEWHERE ON PLANS
2. GUARDRAIL SECTIONS TO BE LAPPED IN THE DIRECTION OF TRAFFIC FLOW NEAREST THE GUARDRAIL FACE.
3. PAY LIMITS FOR NORMAL GUARDRAIL INSTALLATION WILL BE THE TOTAL LENGTH LESS THE LENGTHS OF END TERMINALS.
4. W = SHOULDER WIDTH + FORESLOPE WIDTH. DIMENSIONS FOUND ELSEWHERE ON THE PLANS.
THE POST SHALL BE WRAPPED WITH ONE LAYER OF 1/4" THICK EXPANDED POLYSTYRENE FOAM SHEETING AND ONE WRAP OF LIGHTWEIGHT BUILDING PAPER. THE TOP 1' SHALL BE FILLED WITH BUTYL RUBBER CAULKING (COMMERCIAL GRADE) OR OTHER APPROVED WATERPROOFING MATERIAL.
TOP OF NEW BOX CULVERT OR BRIDGE FOOTING.
TOP OF EXISTING BOX CULVERT OR BRIDGE FOOTING.
1/2" DOWEL BARS 12" LONG 4 REQUIRED PER POST. NO SPECIAL EQUIPMENT WILL BE MADE FOR CONCRETE OR DOWELS.
DETAIL OF POST INSTALLATION WITH COVER LESS THAN NORMAL POST LENGTH

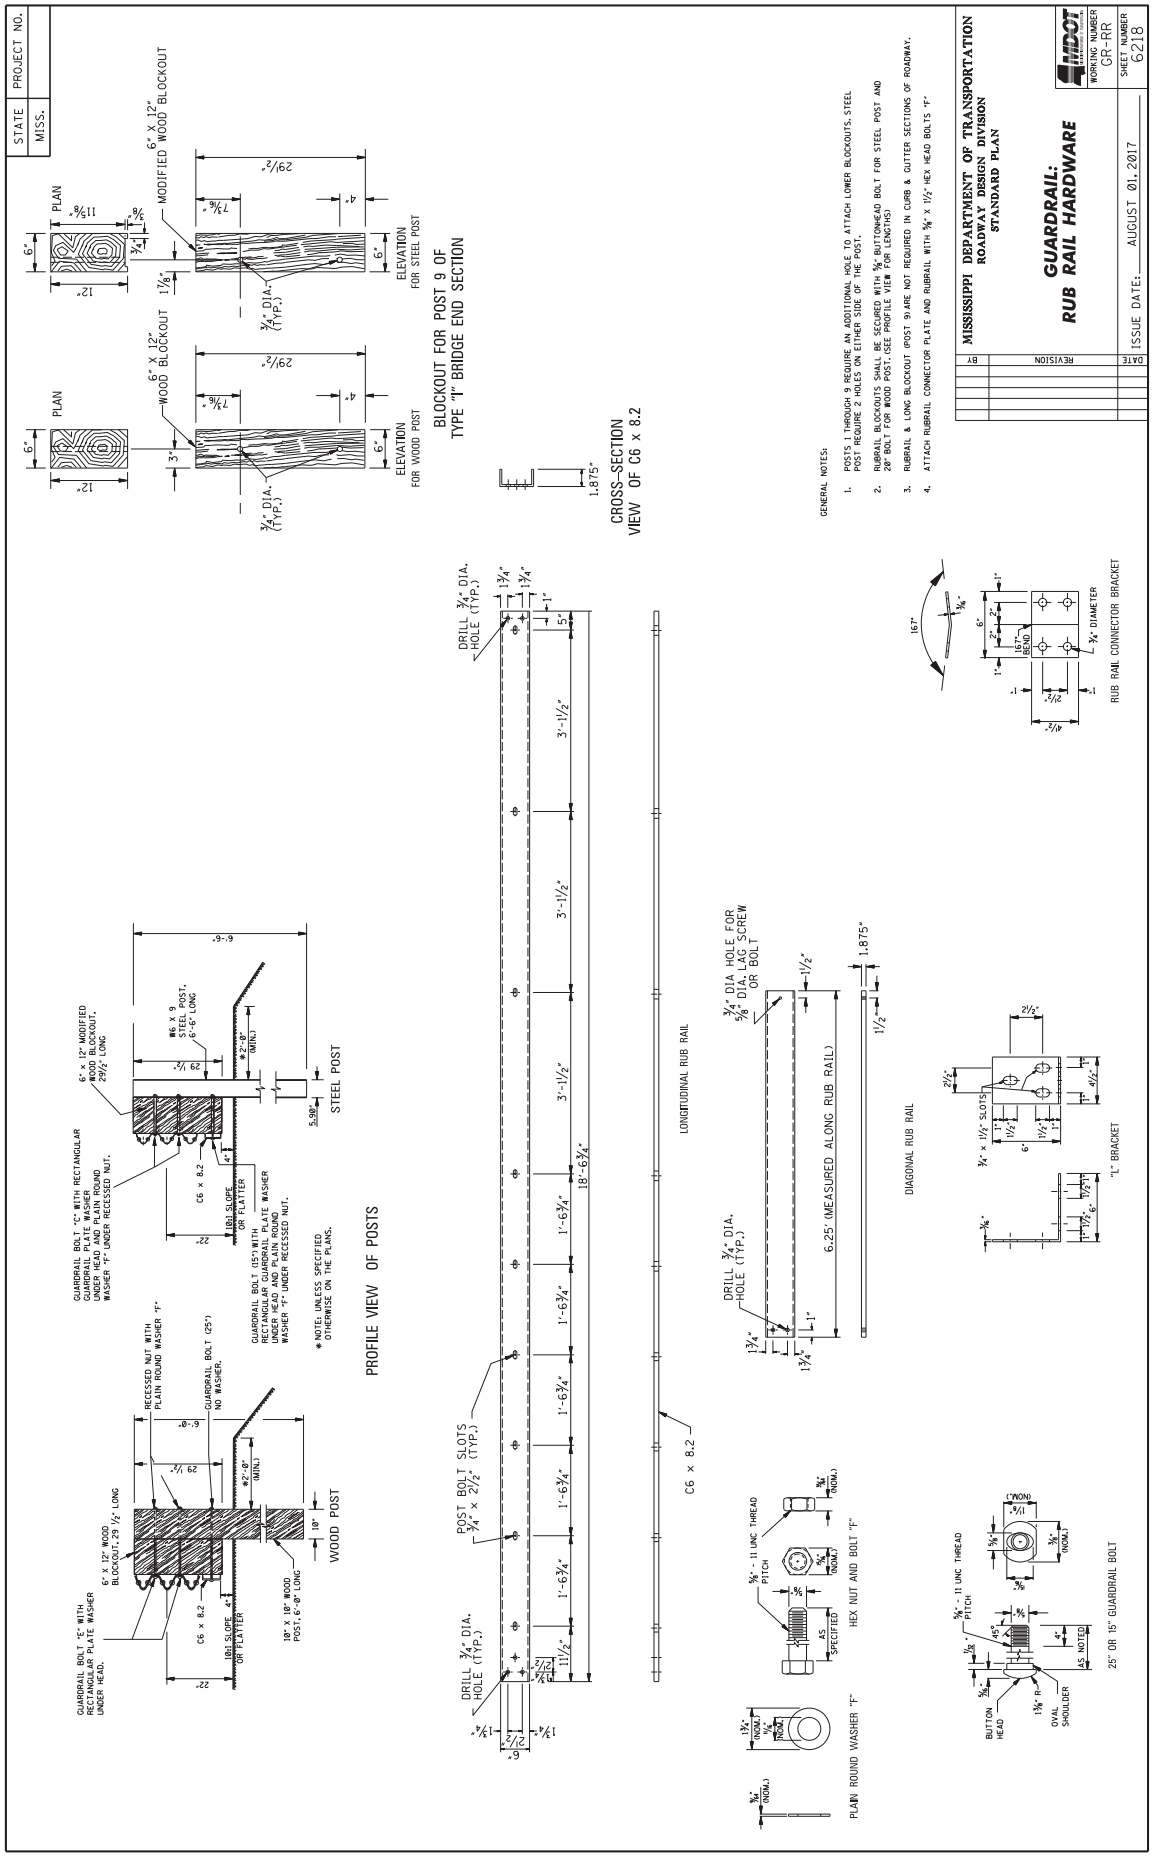
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
RUB RAIL HARDWARE
WORKING NUMBER GR-RR
SHEET NUMBER 6218
ISSUE DATE: AUGUST 01, 2017
BY
REVISION
DATE
GENERAL NOTES:
1. POSTS 1 THROUGH 9 REQUIRE AN ADDITIONAL HOLE TO ATTACH LOWER BLOCKOUTS. STEEL POST REQUIRE 2 HOLES ON EITHER SIDE OF THE POST.
2. RUBRAIL BLOCKOUTS SHALL BE SECURED WITH ⅝" BUTTONHEAD BOLT FOR STEEL POST AND 20" BOLT FOR WOOD POST. (SEE PROFILE VIEW FOR LENGTHS)
3. RUBRAIL & LONG BLOCKOUT (POST 9) ARE NOT REQUIRED IN CURB & GUTTER SECTIONS OF ROADWAY.
4. ATTACH RUBRAIL CONNECTOR PLATE AND RUBRAIL WITH ⅝" X 1½" HEX HEAD BOLTS "F"
BLOCKOUT FOR POST 9 OF TYPE "1" BRIDGE END SECTION
6" X 12" WOOD BLOCKOUT
6" X 12" MODIFIED WOOD BLOCKOUT
PLAN
ELEVATION FOR WOOD POST
ELEVATION FOR STEEL POST
¾" DIA. (TYP.)
CROSS-SECTION VIEW OF C6 x 8.2
1.875"
PROFILE VIEW OF POSTS
6" x 12" MODIFIED WOOD BLOCKOUT, 29½" LONG
#6 x 9 STEEL POST, 6'-6" LONG
GUARDRAIL BOLT "C" WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT.
C6 x 8.2
10¼ SLOPE OR FLATTER
GUARDRAIL BOLT (15") WITH RECTANGULAR GUARDRAIL PLATE WASHER UNDER HEAD AND PLAIN ROUND WASHER "F" UNDER RECESSED NUT.
* NOTE: UNLESS SPECIFIED OTHERWISE ON THE PLANS.
STEEL POST
6" X 12" WOOD BLOCKOUT, 29½" LONG
RECESSED NUT WITH PLAIN ROUND WASHER "F"
GUARDRAIL BOLT (25") NO WASHER.
10" X 10" WOOD POST, 6'-0" LONG
WOOD POST
GUARDRAIL BOLT "E" WITH RECTANGULAR PLATE WASHER UNDER HEAD.
DRILL ¾" DIA. HOLE (TYP.)
POST BOLT SLOTS ¾" x 2½" (TYP.)
LONGITUDINAL RUB RAIL
C6 x 8.2
¾" DIA HOLE FOR ⅝" DIA. LAG SCREW OR BOLT
6.25" (MEASURED ALONG RUB RAIL)
DIAGONAL RUB RAIL
RUB RAIL CONNECTOR BRACKET
"L" BRACKET
¾" x 1½" SLOTS
⅝" - 11 UNC THREAD PITCH
HEX NUT AND BOLT "F"
PLAIN ROUND WASHER "F"
BUTTON HEAD
OVAL SHOULDER
25" OR 15" GUARDRAIL BOLT

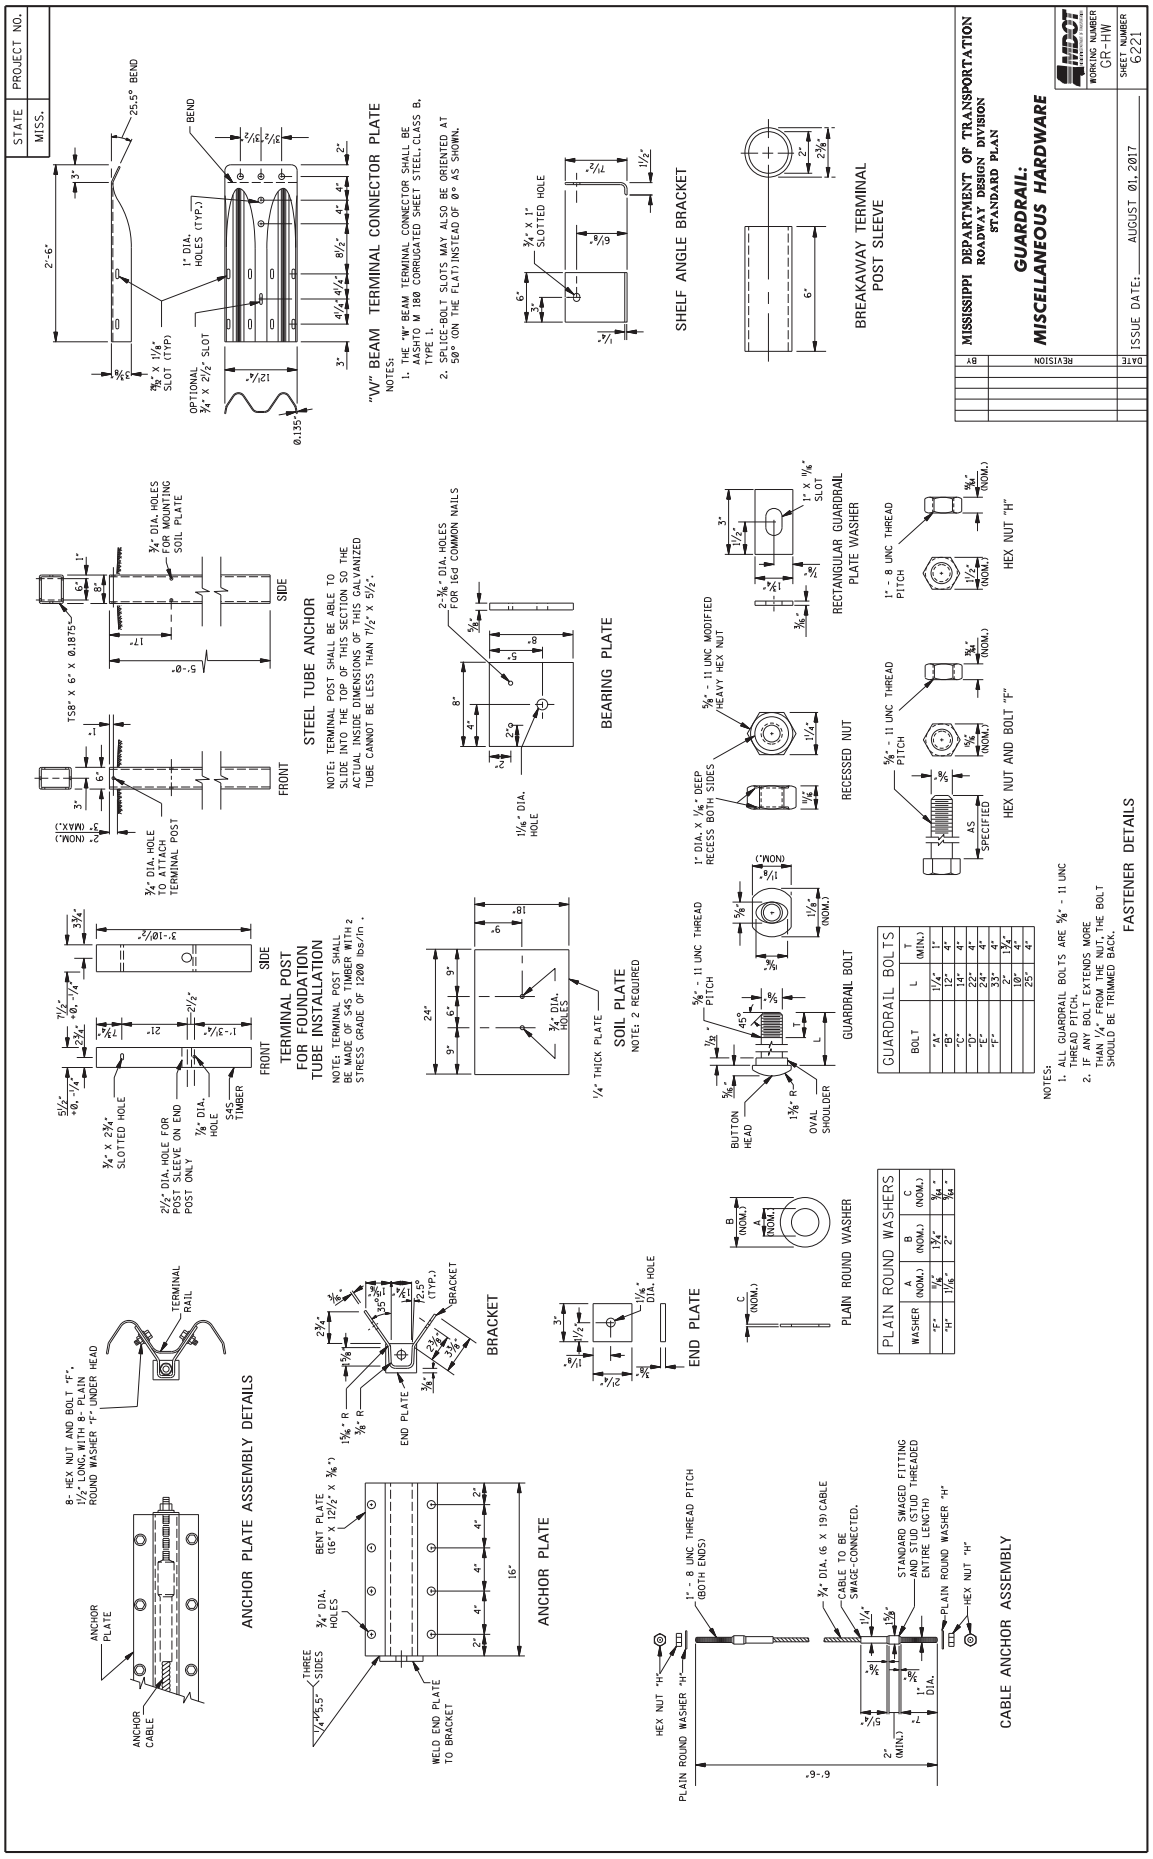
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
GUARDRAIL:
MISCELLANEOUS HARDWARE
WORKING NUMBER GR-HW
SHEET NUMBER 6221
ISSUE DATE: AUGUST 01, 2017
REVISION
DATE
BY
"W" BEAM TERMINAL CONNECTOR PLATE
NOTES:
1. THE "W" BEAM TERMINAL CONNECTOR SHALL BE AASHTO M 180 CORRUGATED SHEET STEEL, CLASS B, TYPE 1.
2. SPLICE-BOLT SLOTS MAY ALSO BE ORIENTED AT 50° (ON THE FLAT) INSTEAD OF 0° AS SHOWN.
SHELF ANGLE BRACKET
BREAKAWAY TERMINAL POST SLEEVE
STEEL TUBE ANCHOR
NOTE: TERMINAL POST SHALL BE ABLE TO SLIDE INTO THE TOP OF THIS SECTION SO THE ACTUAL INSIDE DIMENSIONS OF THIS GALVANIZED TUBE CANNOT BE LESS THAN 7½" X 5½".
TERMINAL POST FOR FOUNDATION TUBE INSTALLATION
NOTE: TERMINAL POST SHALL BE MADE OF S4S TIMBER WITH A STRESS GRADE OF 1200 lbs/in.²
BEARING PLATE
SOIL PLATE
NOTE: 2 REQUIRED
RECESSED NUT
RECTANGULAR GUARDRAIL PLATE WASHER
HEX NUT "H"
HEX NUT AND BOLT "F"
GUARDRAIL BOLT
GUARDRAIL BOLTS
BOLT | L | T (MIN.)
"A" | 1¼" | 1"
"B" | 12" | 4"
"C" | 14" | 4"
"D" | 22" | 4"
"E" | 24" | 4"
"F" | 33" | 4"
"G" | 2' | 1¾"
"H" | 10' | 4"
"I" | 25' | 4"
NOTES:
1. ALL GUARDRAIL BOLTS ARE ⅝" - 11 UNC THREAD PITCH.
2. IF ANY BOLT EXTENDS MORE THAN ¼" FROM THE NUT, THE BOLT SHOULD BE TRIMMED BACK.
FASTENER DETAILS
PLAIN ROUND WASHERS
WASHER | A (NOM.) | B (NOM.) | C (NOM.)
"F" | ¾" | 1¾" | ⅝"
"H" | 1⅛" | 2" | ¾"
PLAIN ROUND WASHER
ANCHOR PLATE ASSEMBLY DETAILS
8- HEX NUT AND BOLT "F", 1½" LONG, WITH 8- PLAIN ROUND WASHER "F" UNDER HEAD
TERMINAL RAIL
ANCHOR PLATE
ANCHOR CABLE
BRACKET
END PLATE
BENT PLATE (16" X 12½" X ⅜")
WELD END PLATE TO BRACKET
ANCHOR PLATE
END PLATE
CABLE ANCHOR ASSEMBLY
HEX NUT "H"
PLAIN ROUND WASHER "H"
1" - 8 UNC THREAD PITCH (BOTH ENDS)
¾" DIA. (6 X 19) CABLE
CABLE TO BE SWAGE-CONNECTED.
STANDARD SWAGED FITTING AND STUD (STUD THREADED ENTIRE LENGTH)

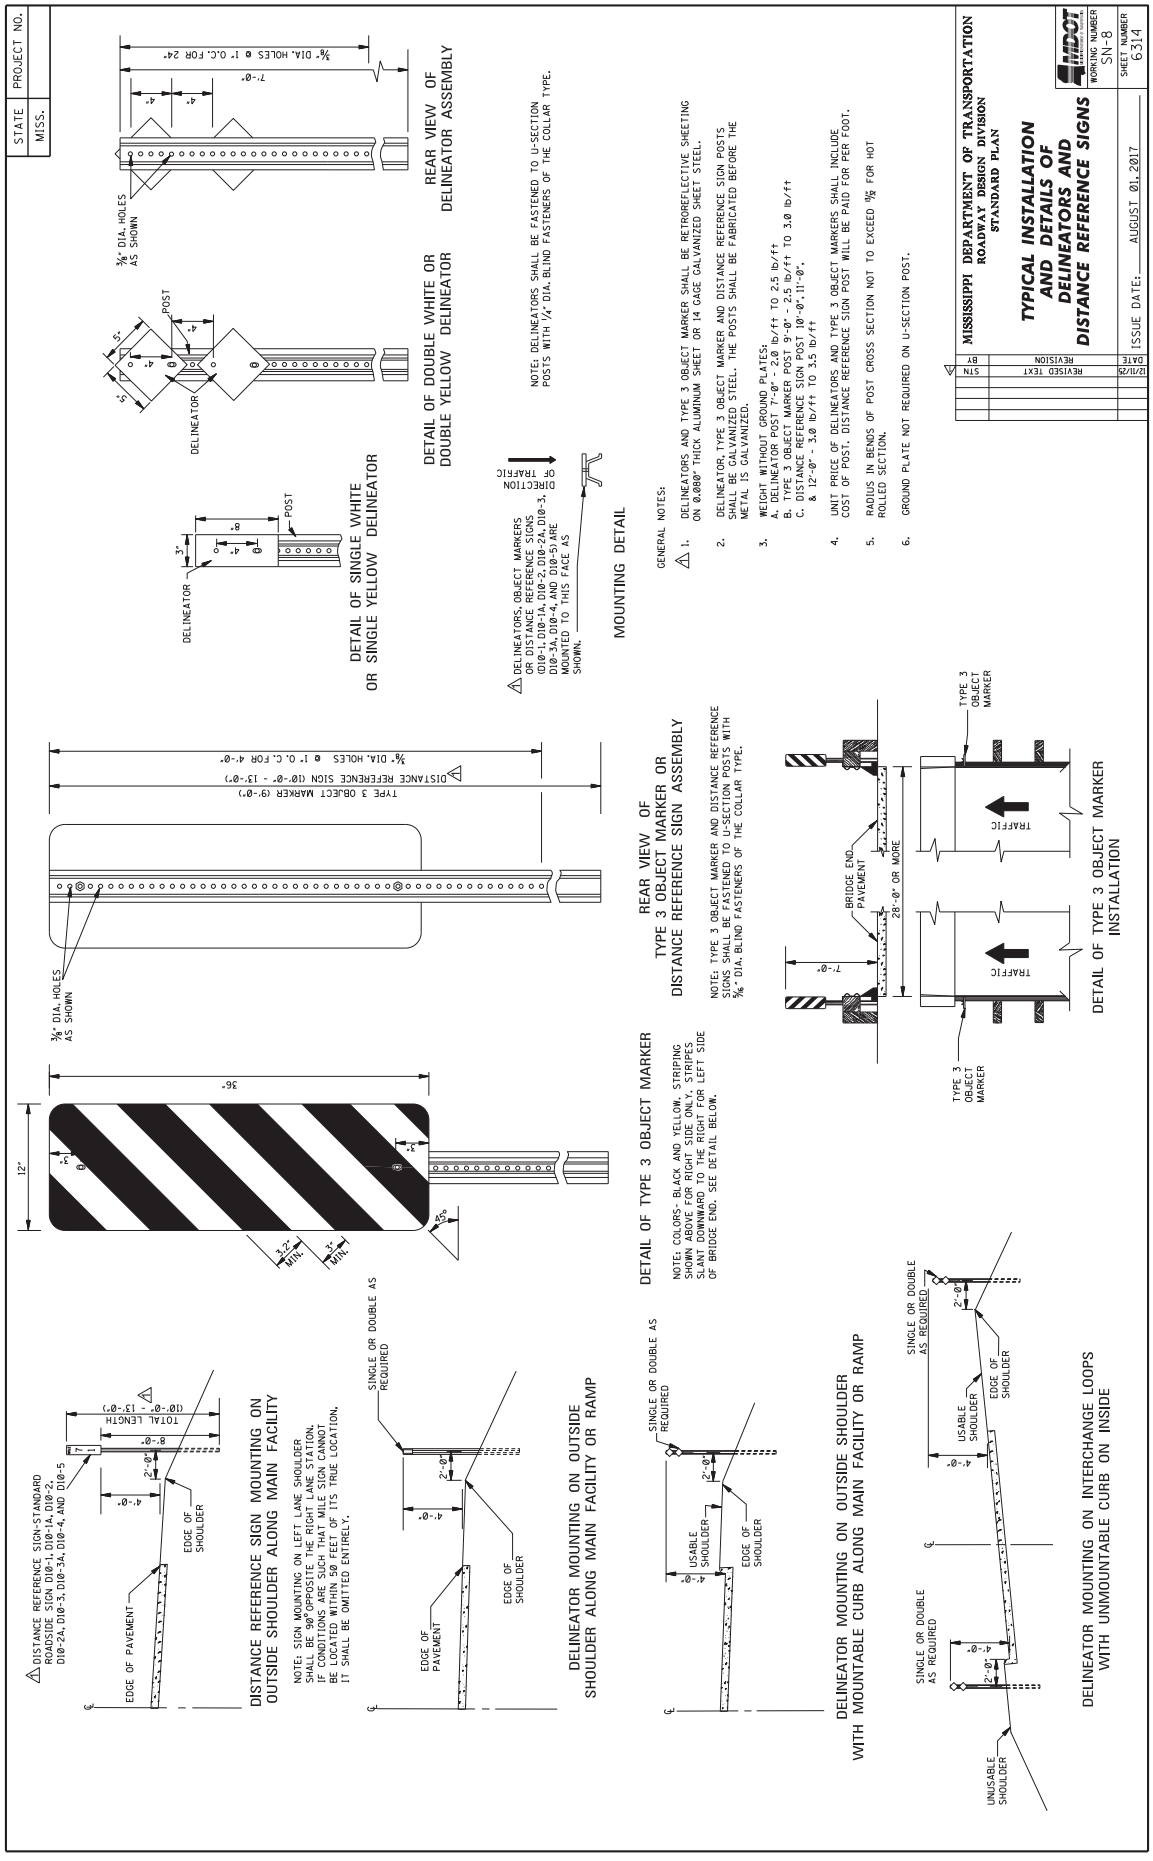
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TYPICAL INSTALLATION AND DETAILS OF DELINEATORS AND DISTANCE REFERENCE SIGNS
WORKING NUMBER SN-8
SHEET NUMBER 6314
ISSUE DATE: AUGUST 01, 2017
REVISION DATE BY
REVISED TEXT 12/11/20 STN
GENERAL NOTES:
1. DELINEATORS AND TYPE 3 OBJECT MARKER SHALL BE RETROREFLECTIVE SHEETING ON 0.080" THICK ALUMINUM SHEET OR 14 GAGE GALVANIZED SHEET STEEL.
2. DELINEATOR, TYPE 3 OBJECT MARKER AND DISTANCE REFERENCE SIGN POSTS SHALL BE GALVANIZED STEEL. THE POSTS SHALL BE FABRICATED BEFORE THE METAL IS GALVANIZED.
3. WEIGHT WITHOUT GROUND PLATES:
A. DELINEATOR POST 7'-0" - 2.0 lb/ft TO 2.5 lb/ft
B. TYPE 3 OBJECT MARKER POST 9'-0" - 2.5 lb/ft TO 3.0 lb/ft
C. DISTANCE REFERENCE SIGN POST 10'-0",11'-0", & 12'-0" - 3.0 lb/ft TO 3.5 lb/ft
4. UNIT PRICE OF DELINEATORS AND TYPE 3 OBJECT MARKERS SHALL INCLUDE COST OF POST. DISTANCE REFERENCE SIGN POST WILL BE PAID FOR PER FOOT.
5. RADIUS IN BENDS OF POST CROSS SECTION NOT TO EXCEED 5/8 FOR HOT ROLLED SECTION.
6. GROUND PLATE NOT REQUIRED ON U-SECTION POST.
NOTE: DELINEATORS SHALL BE FASTENED TO U-SECTION POSTS WITH 1/4" DIA. BLIND FASTENERS OF THE COLLAR TYPE.
REAR VIEW OF DELINEATOR ASSEMBLY
DETAIL OF DOUBLE WHITE OR DOUBLE YELLOW DELINEATOR
DETAIL OF SINGLE WHITE OR SINGLE YELLOW DELINEATOR
MOUNTING DETAIL
DELINEATORS, OBJECT MARKERS OR DISTANCE REFERENCE SIGNS (D10-1, D10-1A, D10-2, D10-2A, D10-3, D10-3A, D10-4, AND D10-5) ARE MOUNTED TO THIS FACE AS SHOWN.
DIRECTION OF TRAFFIC
REAR VIEW OF TYPE 3 OBJECT MARKER OR DISTANCE REFERENCE SIGN ASSEMBLY
NOTE: TYPE 3 OBJECT MARKER AND DISTANCE REFERENCE SIGNS SHALL BE FASTENED TO U-SECTION POSTS WITH 5/16" DIA. BLIND FASTENERS OF THE COLLAR TYPE.
DETAIL OF TYPE 3 OBJECT MARKER
NOTE: COLORS- BLACK AND YELLOW. STRIPING SHOWN ABOVE FOR RIGHT SIDE ONLY. STRIPES SLANT DOWNWARD TO THE RIGHT FOR LEFT SIDE OF BRIDGE END. SEE DETAIL BELOW.
DETAIL OF TYPE 3 OBJECT MARKER INSTALLATION
DISTANCE REFERENCE SIGN MOUNTING ON OUTSIDE SHOULDER ALONG MAIN FACILITY
NOTE: SIGN MOUNTING ON LEFT LANE SHOULDER SHALL BE 500' OPPOSITE THE RIGHT LANE STATION. IF CONDITIONS ARE SUCH THAT MILE SIGN CANNOT BE LOCATED WITHIN 500 FEET OF ITS TRUE LOCATION, IT SHALL BE OMITTED ENTIRELY.
DELINEATOR MOUNTING ON OUTSIDE SHOULDER ALONG MAIN FACILITY OR RAMP
DELINEATOR MOUNTING ON OUTSIDE SHOULDER ALONG MAIN FACILITY OR RAMP
DELINEATOR MOUNTING ON INTERCHANGE LOOPS WITH UNMOUNTABLE CURB ON INSIDE
DISTANCE REFERENCE SIGN-STANDARD ROADSIDE SIGN D10-1, D10-1A, D10-2, D10-2A, D10-3, D10-3A, D10-4, AND D10-5
TOTAL LENGTH (10'-0" - 13'-0")
EDGE OF PAVEMENT
EDGE OF SHOULDER
USABLE SHOULDER
UNUSABLE SHOULDER
SINGLE OR DOUBLE AS REQUIRED
BRIDGE END PAVEMENT
TRAFFIC
TYPE 3 OBJECT MARKER

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 – NOTICE TO BIDDERS NO. 7624 **CODE: (SP)**

DATE: 01/20/2026

SUBJECT: Standard Drawings

Standard Drawings attached hereto shall govern appropriate items of required work.

Larger copies of Standard Drawings may be purchased from:

MDOT Plans Print Shop
MDOT Shop Complex, Building C, Room 114
2567 North West Street
P.O. Box 1850
Jackson, MS 39215-1850
Telephone: (601) 359-7460
or FAX: (601) 359-7461
or e-mail: plans@mdot.state.ms.us

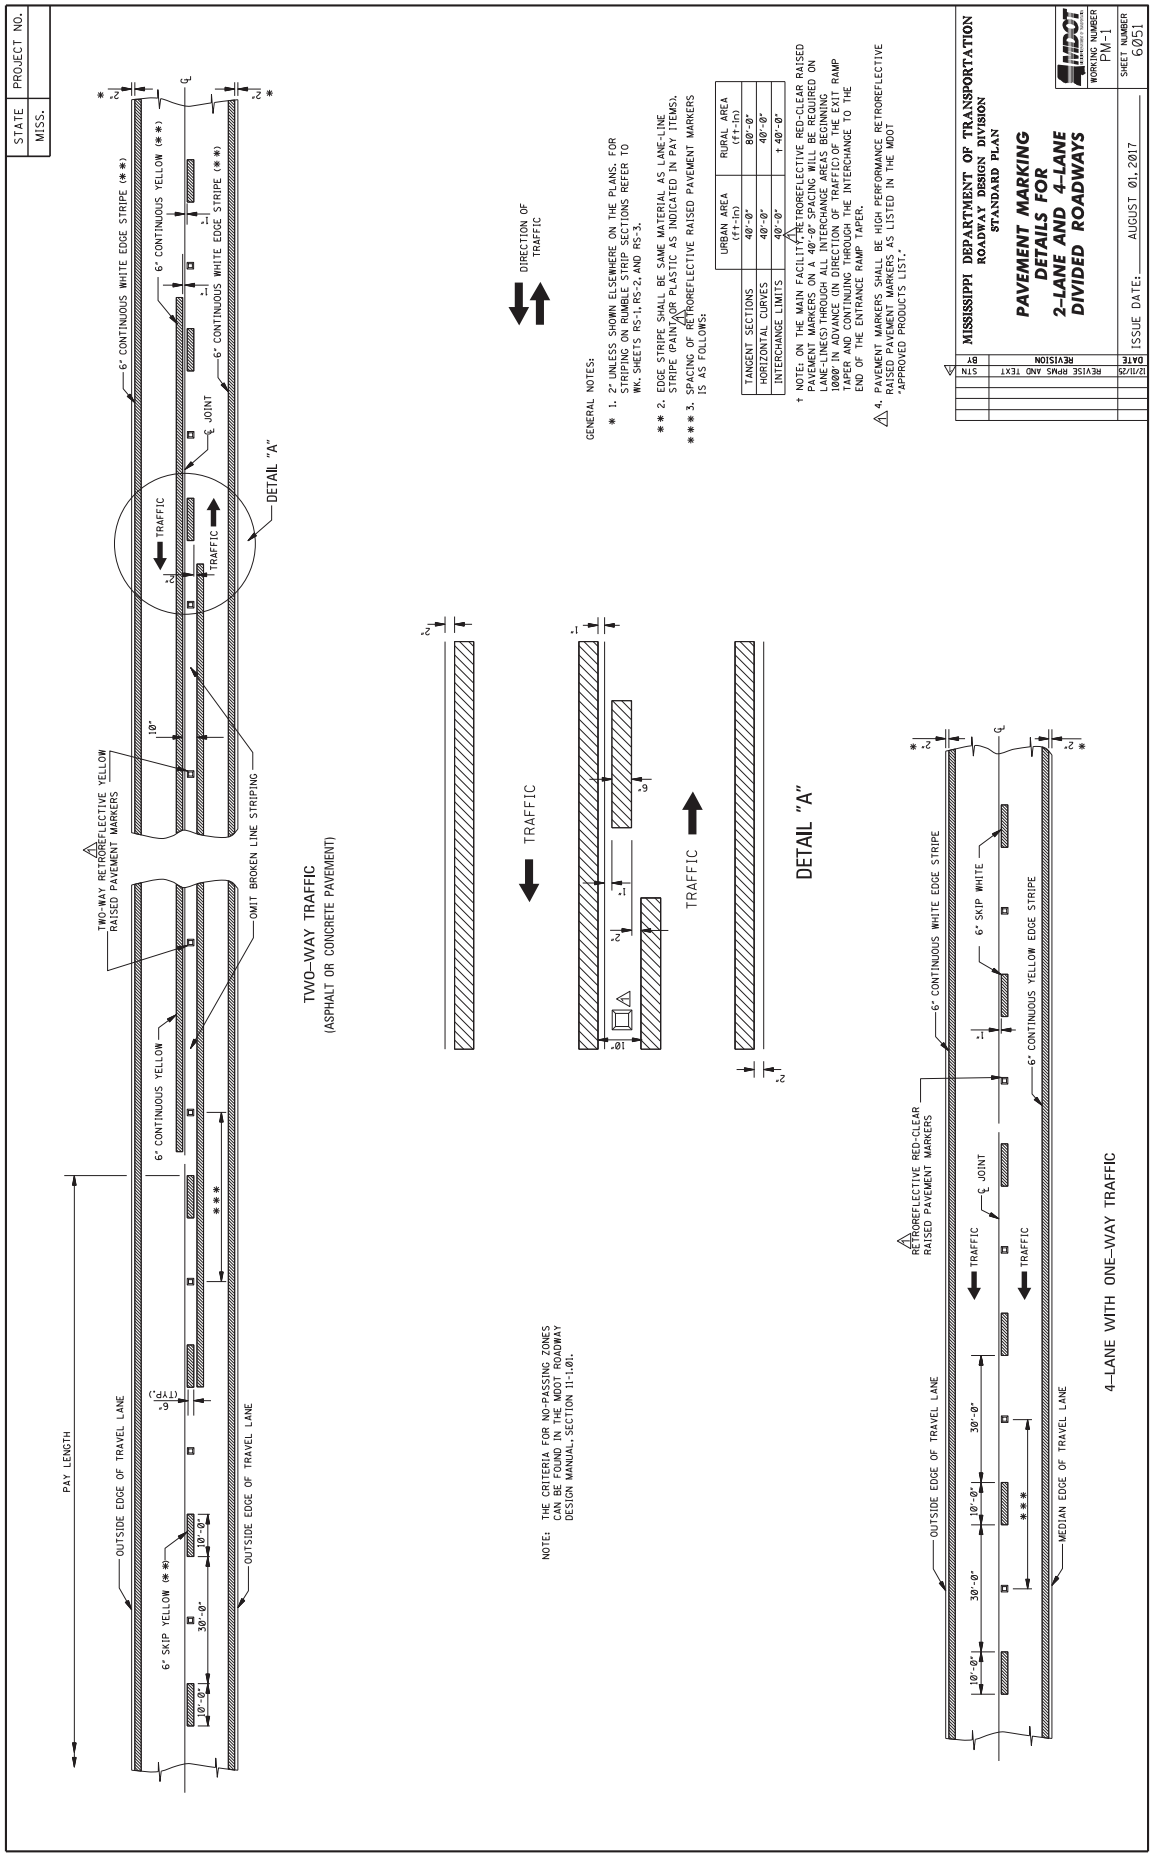
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING DETAILS FOR 2-LANE AND 4-LANE DIVIDED ROADWAYS
WORKING NUMBER PM-1
SHEET NUMBER 6051
ISSUE DATE: AUGUST 01, 2017
REVISE RPMS AND TEXT
DATE 12/11/20
BY
STN
PAY LENGTH
OUTSIDE EDGE OF TRAVEL LANE
6" SKIP YELLOW (**)
6" CONTINUOUS YELLOW
6" CONTINUOUS WHITE EDGE STRIPE (**)
6" CONTINUOUS YELLOW (**)
6" CONTINUOUS WHITE EDGE STRIPE (**)
TWO-WAY RETROREFLECTIVE YELLOW RAISED PAVEMENT MARKERS
OMIT BROKEN LINE STRIPING
DETAIL "A"
TRAFFIC
TWO-WAY TRAFFIC
(ASPHALT OR CONCRETE PAVEMENT)
DIRECTION OF TRAFFIC
GENERAL NOTES:
* 1. 2" UNLESS SHOWN ELSEWHERE ON THE PLANS. FOR STRIPING ON RUMBLE STRIP SECTIONS REFER TO WK. SHEETS RS-1, RS-2, AND RS-3.
** 2. EDGE STRIPE SHALL BE SAME MATERIAL AS LANE-LINE STRIPE (PAINT OR PLASTIC AS INDICATED IN PAY ITEMS).
*** 3. SPACING OF RETROREFLECTIVE RAISED PAVEMENT MARKERS IS AS FOLLOWS:
URBAN AREA (ft-in) / RURAL AREA (ft-in)
TANGENT SECTIONS 40'-0" / 80'-0"
HORIZONTAL CURVES 40'-0" / 40'-0"
INTERCHANGE LIMITS 40'-0" / † 40'-0"
† NOTE: ON THE MAIN FACILITY, RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS ON 40'-0" SPACING WILL BE REQUIRED ON LANE LINE(S) THROUGH ALL INTERCHANGE AREAS BEGINNING 1000' IN ADVANCE (IN DIRECTION OF TRAFFIC) OF THE EXIT RAMP TAPER AND CONTINUING THROUGH THE INTERCHANGE TO THE END OF THE ENTRANCE RAMP TAPER.
△4. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RETROREFLECTIVE RAISED PAVEMENT MARKERS AS LISTED IN THE MDOT "APPROVED PRODUCTS LIST."
NOTE: THE CRITERIA FOR NO-PASSING ZONES CAN BE FOUND IN THE MDOT ROADWAY DESIGN MANUAL, SECTION 11-1.01.
DETAIL "A"
TRAFFIC
RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS
6" CONTINUOUS WHITE EDGE STRIPE
6" SKIP WHITE
6" CONTINUOUS YELLOW EDGE STRIPE
OUTSIDE EDGE OF TRAVEL LANE
MEDIAN EDGE OF TRAVEL LANE
4-LANE WITH ONE-WAY TRAFFIC

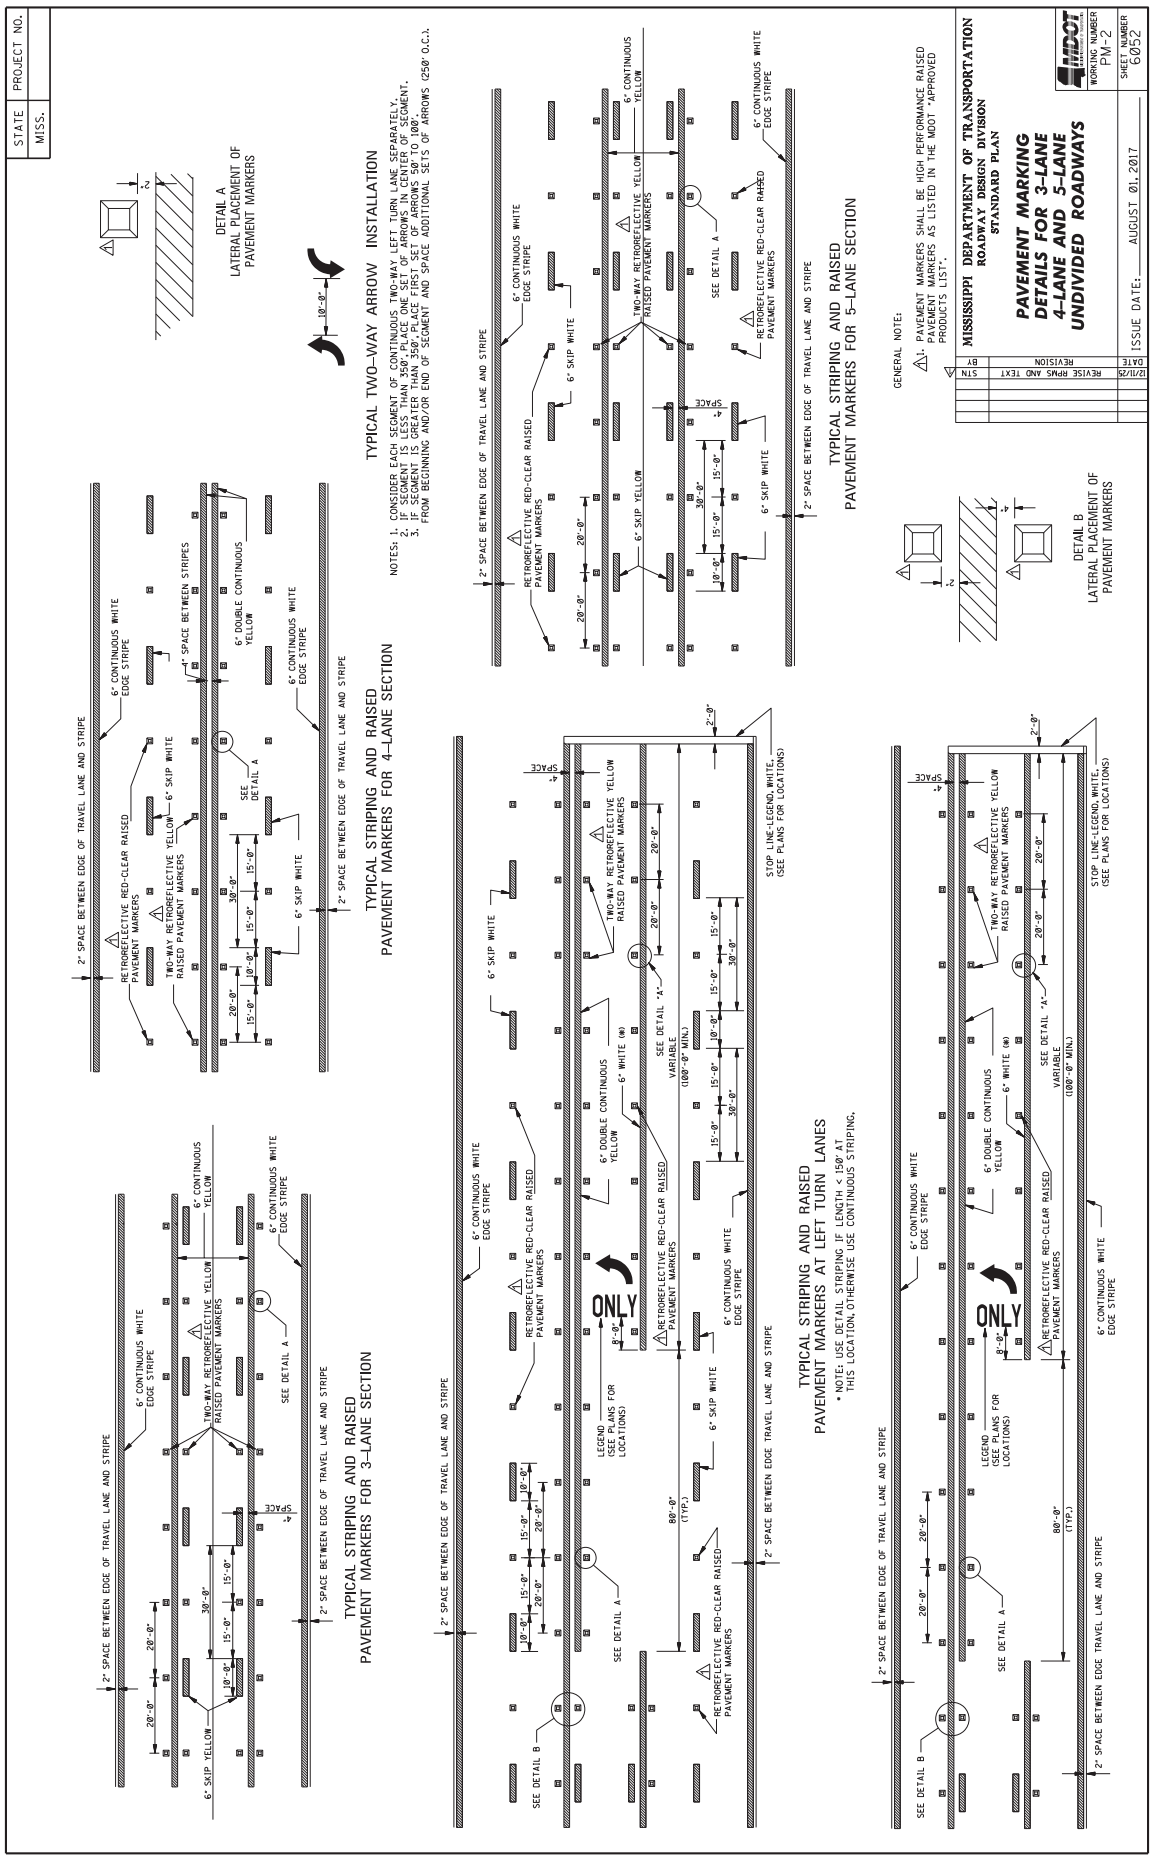
STATE MISS.
PROJECT NO.
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS FOR 3-LANE SECTION
TYPICAL TWO-WAY ARROW INSTALLATION
NOTES: 1. CONSIDER EACH SEGMENT OF CONTINUOUS TWO-WAY LEFT TURN LANE SEPARATELY.
2. IF SEGMENT IS LESS THAN 350', PLACE ONE SET OF ARROWS IN EACH SEGMENT.
3. IF SEGMENT IS GREATER THAN 350', PLACE FIRST SET OF ARROWS 50' TO 100' FROM BEGINNING AND/OR END OF SEGMENT AND SPACE ADDITIONAL SETS OF ARROWS (250' O.C.).
DETAIL A LATERAL PLACEMENT OF PAVEMENT MARKERS
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS FOR 4-LANE SECTION
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS AT LEFT TURN LANES
* NOTE: USE DETAIL STRIPING IF LENGTH < 150' AT THIS LOCATION, OTHERWISE USE CONTINUOUS STRIPING.
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS FOR 5-LANE SECTION
DETAIL B LATERAL PLACEMENT OF PAVEMENT MARKERS
GENERAL NOTE:
1. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RAISED PAVEMENT MARKERS AS LISTED IN THE MDOT "APPROVED PRODUCTS LIST".
STN | REVISION | BY | DATE
REVISE RPMS AND TEXT | STN | 12/11/20
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING DETAILS FOR 3-LANE 4-LANE AND 5-LANE UNDIVIDED ROADWAYS
ISSUE DATE: AUGUST 01, 2017
WORKING NUMBER FM-2
SHEET NUMBER 6052

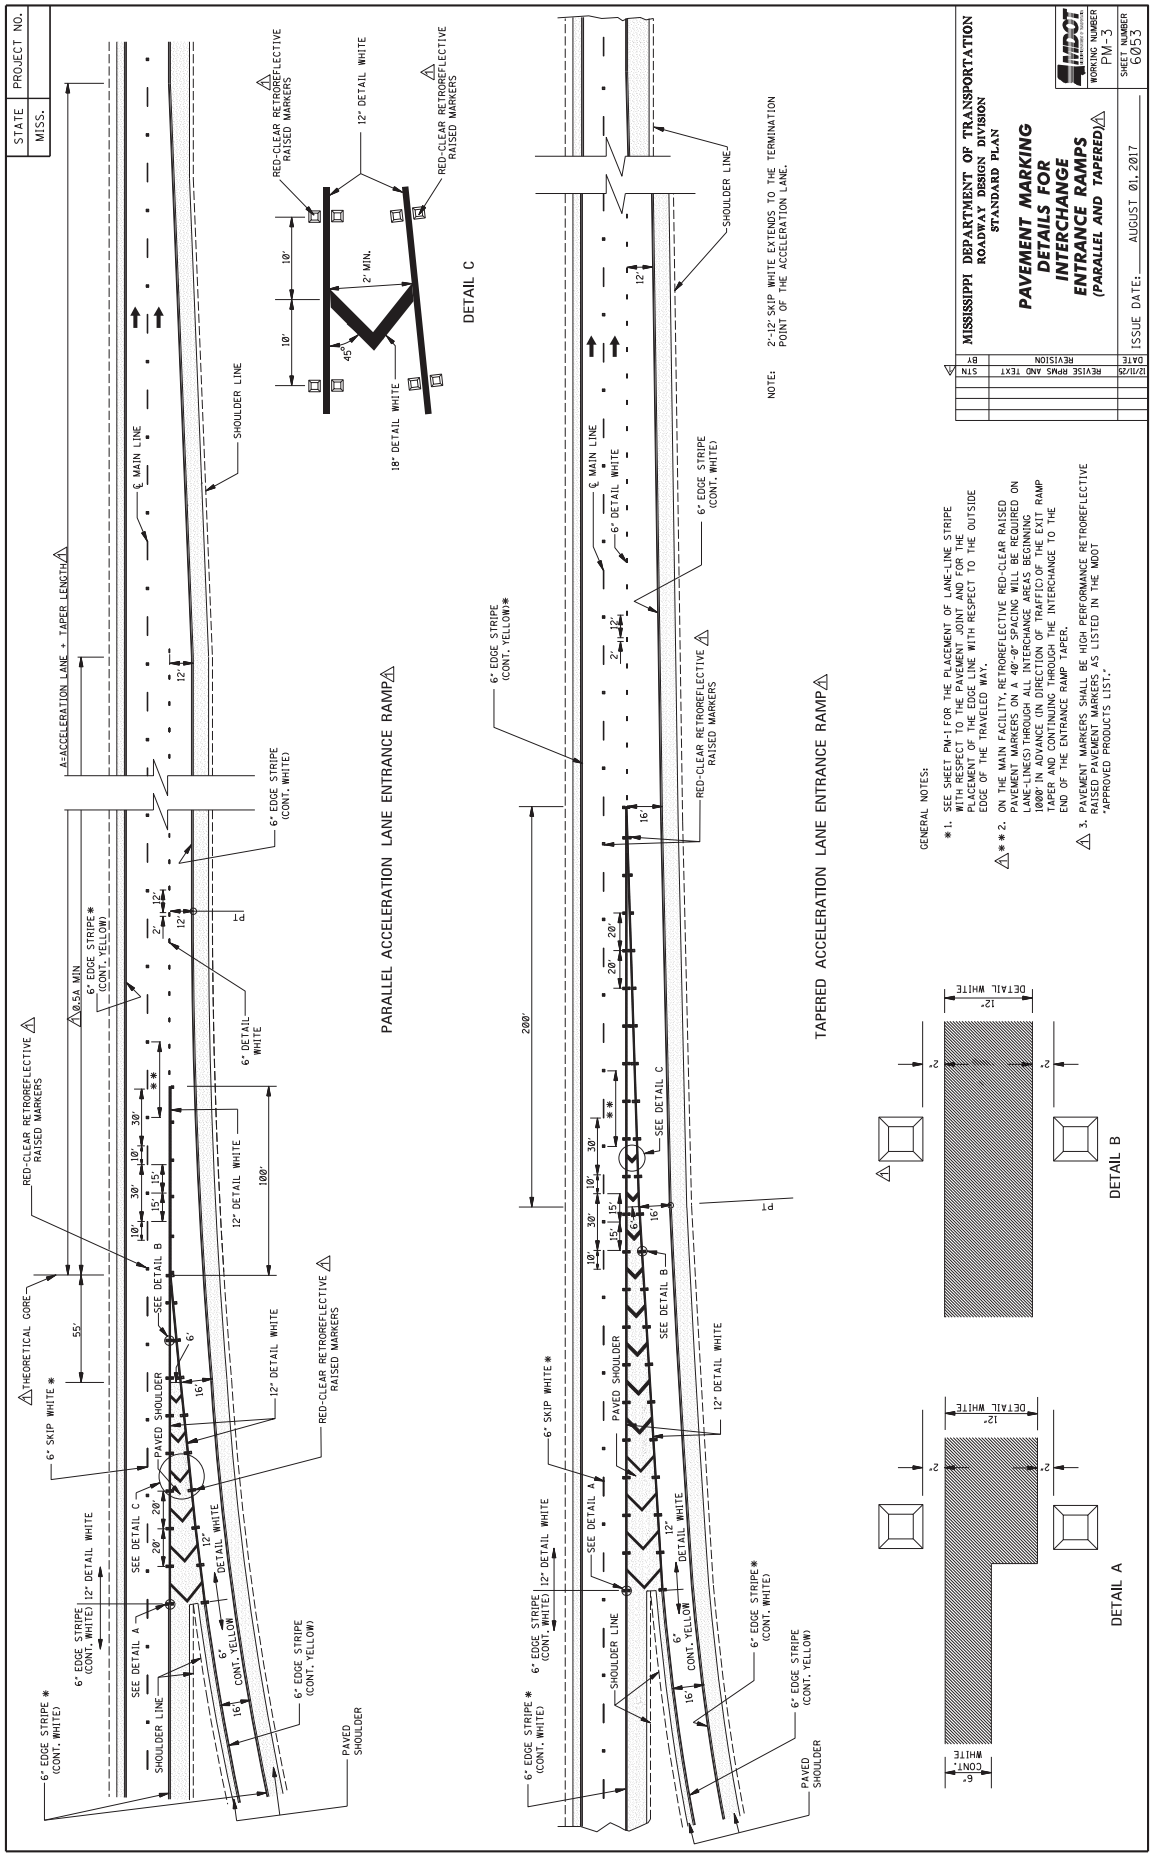
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING DETAILS FOR INTERCHANGE ENTRANCE RAMPS (PARALLEL AND TAPERED)
WORKING NUMBER PM-3
SHEET NUMBER 6053
ISSUE DATE: AUGUST 01, 2017
REVISION
DATE
BY
12/11/23 REVISE RPMS AND TEXT STN
PARALLEL ACCELERATION LANE ENTRANCE RAMP
TAPERED ACCELERATION LANE ENTRANCE RAMP
DETAIL A
DETAIL B
DETAIL C
GENERAL NOTES:
*1. SEE SHEET PM-1 FOR THE PLACEMENT OF LANE-LINE STRIPE WITH RESPECT TO THE PAVEMENT JOINT AND FOR THE PLACEMENT OF THE EDGE LINE WITH RESPECT TO THE OUTSIDE EDGE OF THE TRAVELED WAY.
**2. ON THE MAIN FACILITY, RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS ON A 40'-0" SPACING WILL BE REQUIRED ON LANE-LINE(S) THROUGH ALL INTERCHANGE AREAS BEGINNING 1000' IN ADVANCE (IN DIRECTION OF TRAFFIC) OF THE EXIT RAMP TAPER AND CONTINUING THROUGH THE INTERCHANGE TO THE END OF THE ENTRANCE RAMP TAPER.
3. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RETROREFLECTIVE RAISED PAVEMENT MARKERS AS LISTED IN THE MDOT "APPROVED PRODUCTS LIST."
NOTE: 2'-12' SKIP WHITE EXTENDS TO THE TERMINATION POINT OF THE ACCELERATION LANE.

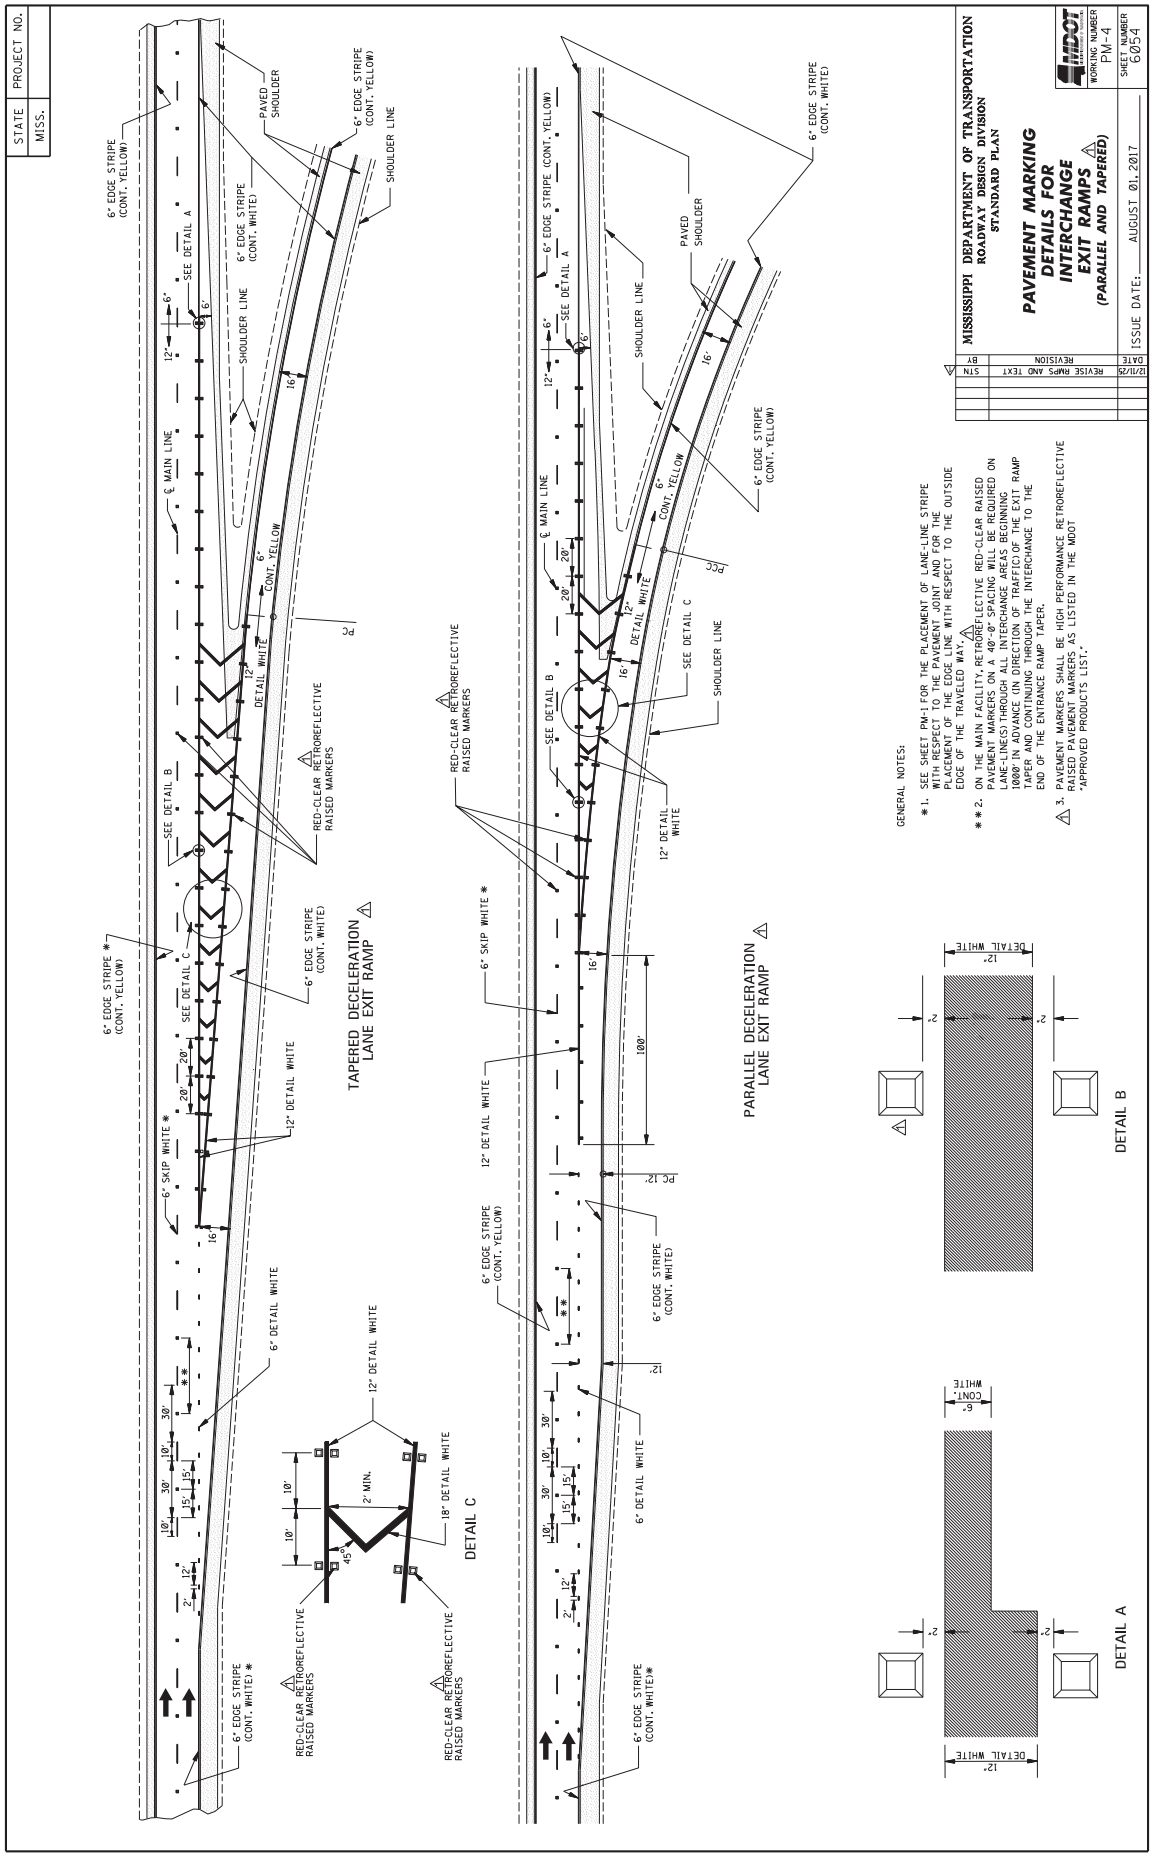
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING DETAILS FOR INTERCHANGE EXIT RAMPS
(PARALLEL AND TAPERED)
WORKING NUMBER PM-4
SHEET NUMBER 6054
ISSUE DATE: AUGUST 01, 2017
DATE 12/11/23 BY STN REVISION REVISE RAMPS AND TEXT
TAPERED DECELERATION LANE EXIT RAMP
PARALLEL DECELERATION LANE EXIT RAMP
DETAIL A
DETAIL B
DETAIL C
GENERAL NOTES:
* 1. SEE SHEET PM-1 FOR THE PLACEMENT OF LANE-LINE STRIPE WITH RESPECT TO THE PAVEMENT JOINT AND FOR THE PLACEMENT OF THE EDGE LINE WITH RESPECT TO THE OUTSIDE EDGE OF THE TRAVELED WAY.
* * 2. ON THE MAIN FACILITY, RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS ON A 40'-0" SPACING WILL BE REQUIRED ON LANE-LINE(S) THROUGH ALL INTERCHANGE AREAS BEGINNING 1000' IN ADVANCE (IN DIRECTION OF TRAFFIC) OF THE EXIT RAMP TAPER AND CONTINUING THROUGH THE INTERCHANGE TO THE END OF THE ENTRANCE RAMP TAPER.
3. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RETROREFLECTIVE RAISED PAVEMENT MARKERS AS LISTED IN THE MDOT "APPROVED PRODUCTS LIST."

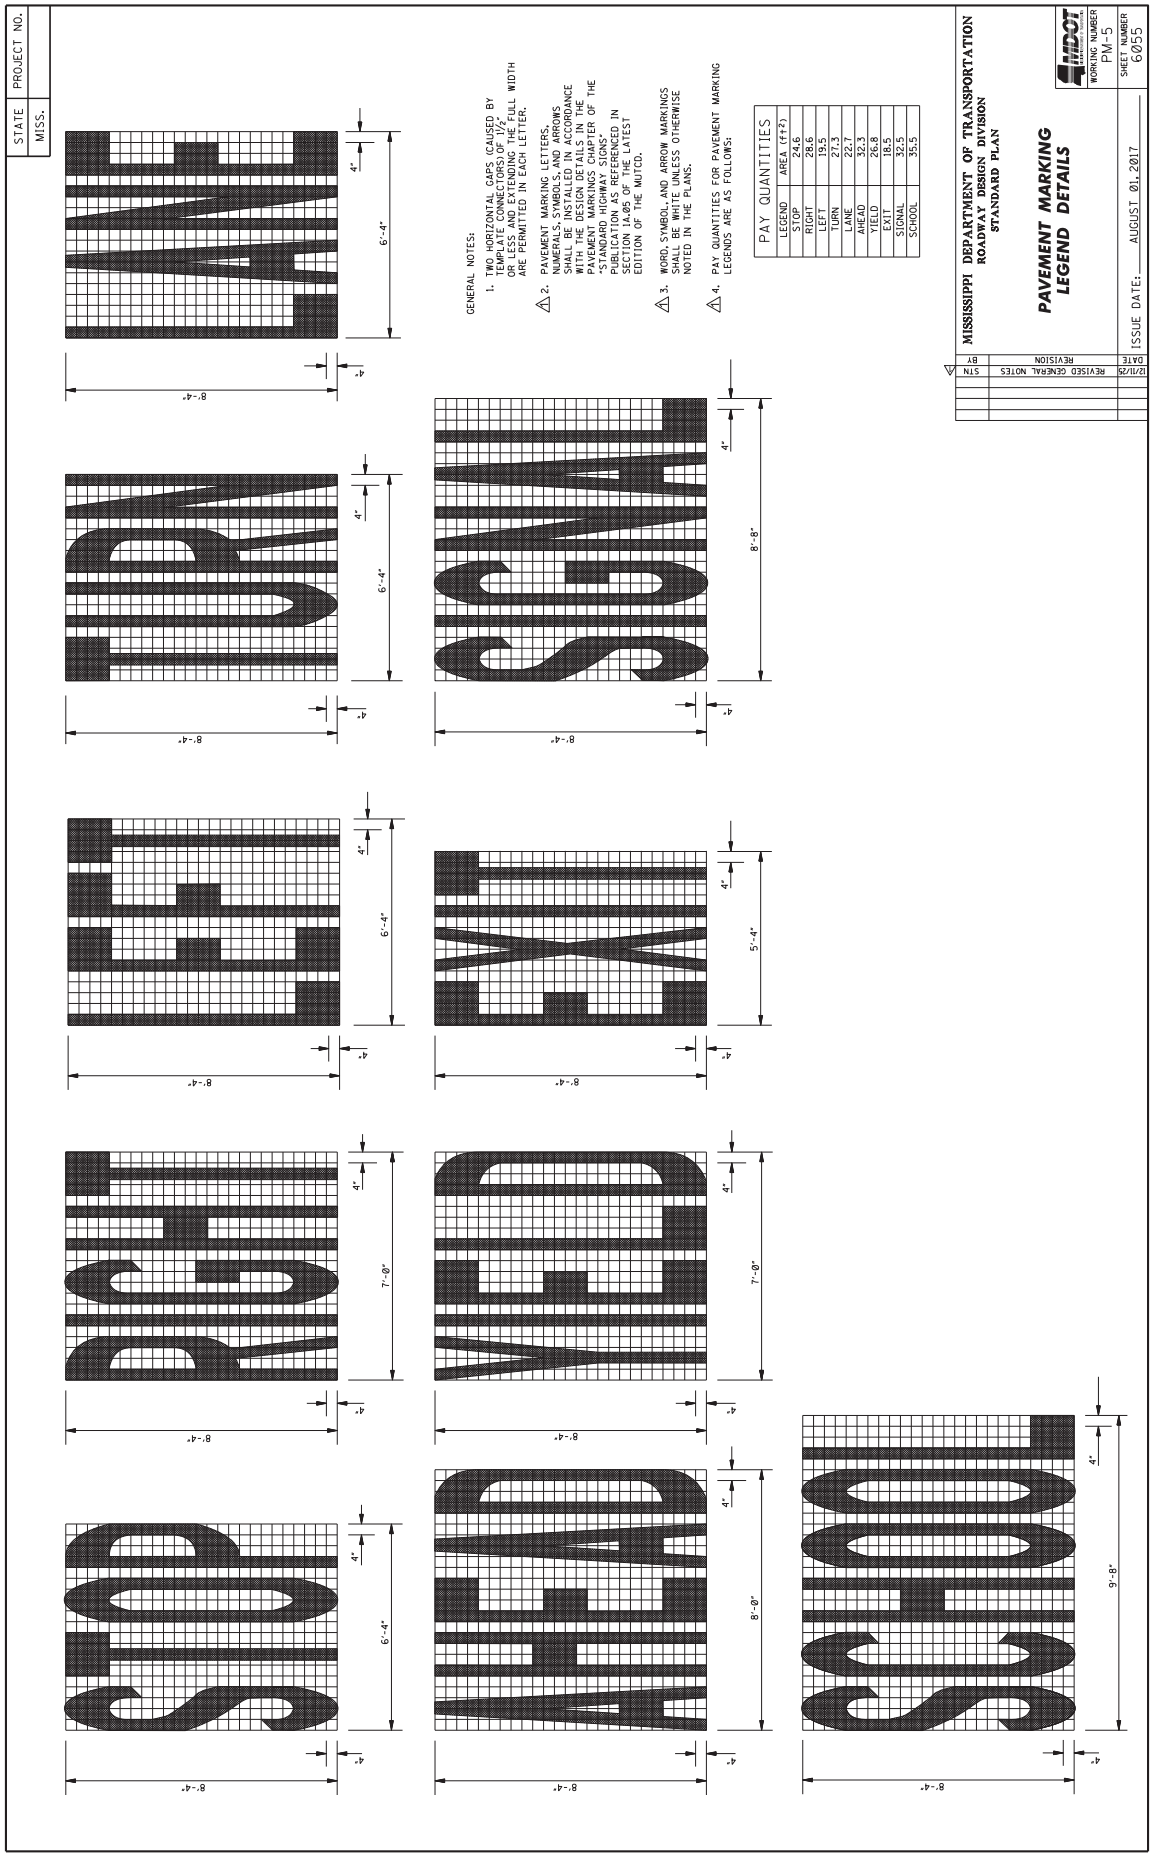
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING LEGEND DETAILS
WORKING NUMBER PM-5
SHEET NUMBER 6055
ISSUE DATE: AUGUST 01, 2017
GENERAL NOTES:
1. TWO HORIZONTAL GAPS (CAUSED BY TEMPLATE CONNECTORS) OF 1/2" OR LESS AND EXTENDING THE FULL WIDTH ARE PERMITTED IN EACH LETTER.
2. PAVEMENT MARKING LETTERS, NUMERALS, SYMBOLS, AND ARROWS SHALL BE INSTALLED IN ACCORDANCE WITH THE DESIGN DETAILS IN THE PAVEMENT MARKINGS CHAPTER OF THE STANDARD HIGHWAY SIGNS PUBLICATION AS REFERENCED IN SECTION 1A.05 OF THE LATEST EDITION OF THE MUTCD.
3. WORD, SYMBOL, AND ARROW MARKINGS SHALL BE WHITE UNLESS OTHERWISE NOTED IN THE PLANS.
4. PAY QUANTITIES FOR PAVEMENT MARKING LEGENDS ARE AS FOLLOWS:
PAY QUANTITIES
LEGEND AREA (FT²)
STOP 24.6
RIGHT 28.6
LEFT 19.5
TURN 27.3
LANE 22.7
AHEAD 32.3
YIELD 26.8
EXIT 18.5
SIGNAL 32.5
SCHOOL 35.5
STN BY REVISION DATE
REVISED GENERAL NOTES 12/1/25

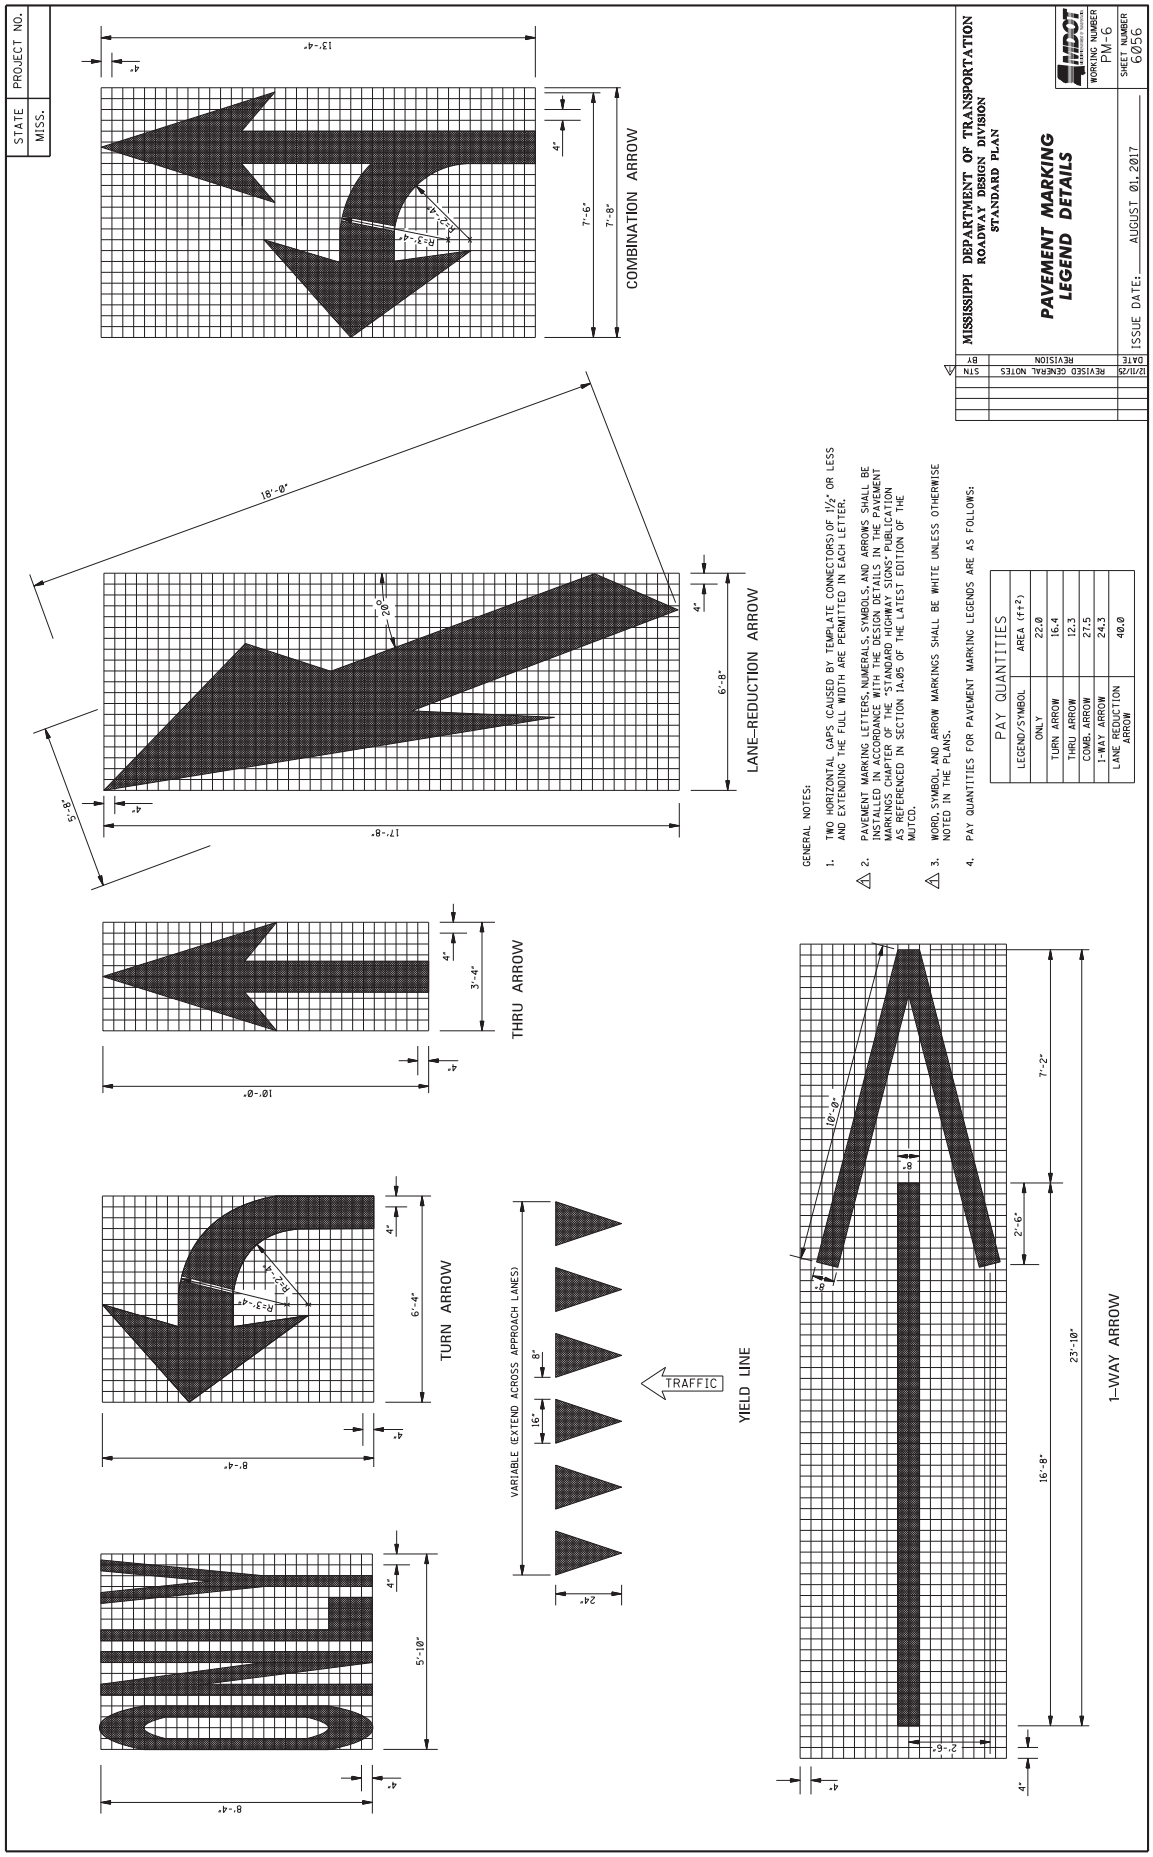
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING LEGEND DETAILS
WORKING NUMBER PM-6
SHEET NUMBER 6056
ISSUE DATE: AUGUST 01, 2017
REVISED GENERAL NOTES
12/11/20
REVISION
DATE
BY
STN
COMBINATION ARROW
LANE-REDUCTION ARROW
THRU ARROW
TURN ARROW
YIELD LINE
TRAFFIC
VARIABLE (EXTEND ACROSS APPROACH LANES)
1-WAY ARROW
GENERAL NOTES:
1. TWO HORIZONTAL GAPS (CAUSED BY TEMPLATE CONNECTORS) OF 1/2" OR LESS AND EXTENDING THE FULL WIDTH ARE PERMITTED IN EACH LETTER.
2. PAVEMENT MARKING LETTERS, NUMERALS, SYMBOLS, AND ARROWS SHALL BE INSTALLED IN ACCORDANCE WITH THE DESIGN DETAILS IN THE PAVEMENT MARKINGS CHAPTER OF THE "STANDARD HIGHWAY SIGNS" PUBLICATION AS REFERENCED IN SECTION 1A.05 OF THE LATEST EDITION OF THE MUTCD.
3. WORD, SYMBOL AND ARROW MARKINGS SHALL BE WHITE UNLESS OTHERWISE NOTED IN THE PLANS.
4. PAY QUANTITIES FOR PAVEMENT MARKING LEGENDS ARE AS FOLLOWS:
PAY QUANTITIES
LEGEND/SYMBOL | AREA (ft²)
ONLY | 22.0
TURN ARROW | 16.4
THRU ARROW | 12.3
COMB. ARROW | 27.5
1-WAY ARROW | 24.3
LANE REDUCTION ARROW | 40.0

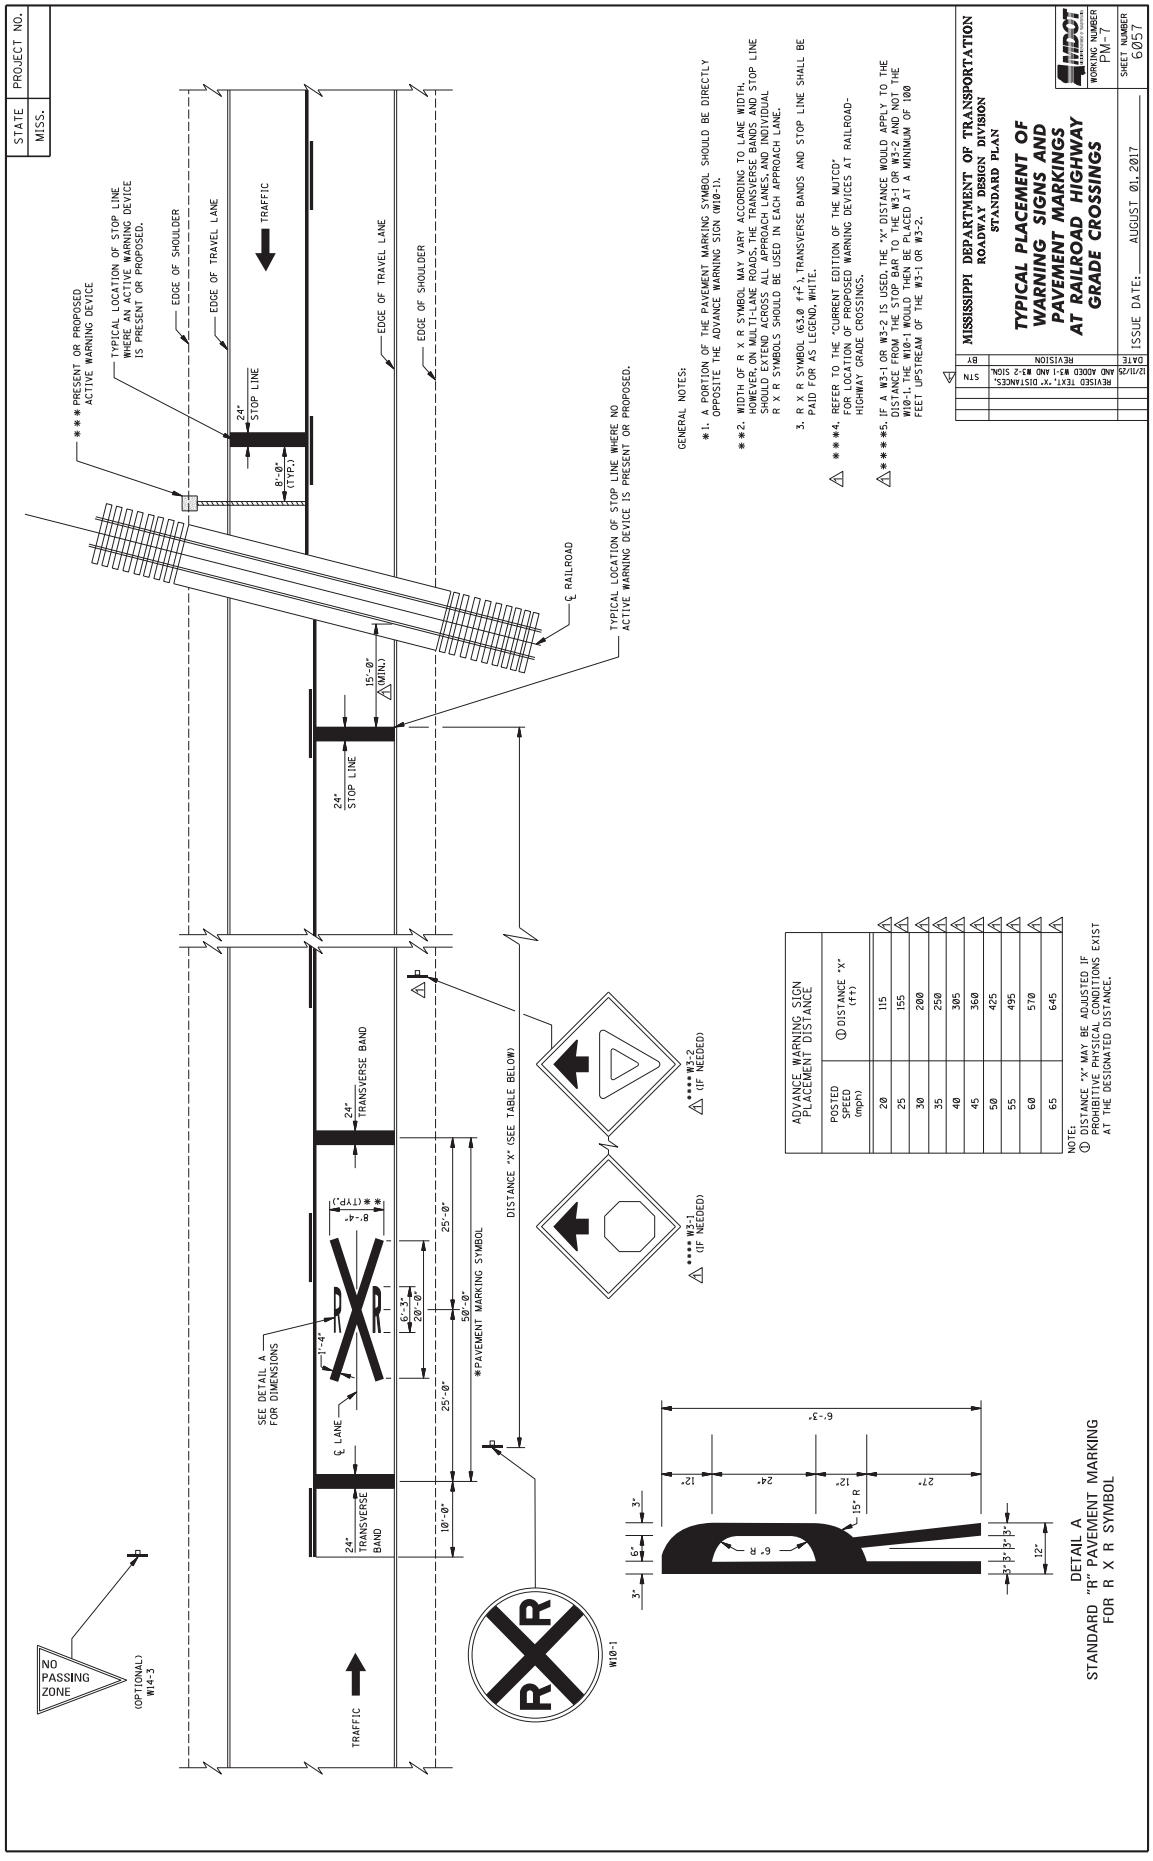
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TYPICAL PLACEMENT OF WARNING SIGNS AND PAVEMENT MARKINGS AT RAILROAD HIGHWAY GRADE CROSSINGS
WORKING NUMBER FM-7
SHEET NUMBER 6057
ISSUE DATE: AUGUST 01, 2017
REVISED TEXT, 'X' DISTANCES, AND ADDED M3-1 AND M3-2 SIGN.
12/11/20
STN
DATE
REVISION
BY
GENERAL NOTES:
*1. A PORTION OF THE PAVEMENT MARKING SYMBOL SHOULD BE DIRECTLY OPPOSITE THE ADVANCE WARNING SIGN (W10-1).
**2. WIDTH OF R X R SYMBOL MAY VARY ACCORDING TO LANE WIDTH. HOWEVER, ON MULTI-LANE ROADS, THE TRANSVERSE BANDS AND STOP LINE SHOULD EXTEND ACROSS ALL APPROACH LANES, AND INDIVIDUAL R X R SYMBOLS SHOULD BE USED IN EACH APPROACH LANE.
3. R X R SYMBOL (63.0 ft²), TRANSVERSE BANDS AND STOP LINE SHALL BE PAID FOR AS LEGEND, WHITE.
***4. REFER TO THE "CURRENT EDITION OF THE MUTCD" FOR LOCATION OF PROPOSED WARNING DEVICES AT RAILROAD-HIGHWAY GRADE CROSSINGS.
****5. IF A W3-1 OR W3-2 IS USED, THE 'X' DISTANCE WOULD APPLY TO THE DISTANCE FROM THE STOP BAR TO THE W10-1 AND TO THE W10-1, THE W10-1 WOULD THEN BE PLACED AT A MINIMUM OF 100 FEET UPSTREAM OF THE W3-1 OR W3-2.
*** PRESENT OR PROPOSED ACTIVE WARNING DEVICE
TYPICAL LOCATION OF STOP LINE WHERE AN ACTIVE WARNING DEVICE IS PRESENT OR PROPOSED.
EDGE OF SHOULDER
EDGE OF TRAVEL LANE
TRAFFIC
24" STOP LINE
8'-0" (TYP.)
℄ RAILROAD
TYPICAL LOCATION OF STOP LINE WHERE NO ACTIVE WARNING DEVICE IS PRESENT OR PROPOSED.
15'-0" (MIN.)
24" TRANSVERSE BAND
SEE DETAIL A FOR DIMENSIONS
1'-4"
6'-3"
20'-0"
25'-0"
50'-0"
*PAVEMENT MARKING SYMBOL
DISTANCE "X" (SEE TABLE BELOW)
10'-0"
℄ LANE
W10-1
**** W3-1 (IF NEEDED)
**** W3-2 (IF NEEDED)
NO PASSING ZONE
(OPTIONAL) W14-3
ADVANCE WARNING SIGN PLACEMENT DISTANCE
POSTED SPEED (mph)
① DISTANCE "X" (ft)
20 115
25 155
30 200
35 250
40 305
45 360
50 425
55 495
60 570
65 645
NOTE:
① DISTANCE "X" MAY BE ADJUSTED IF PROHIBITIVE PHYSICAL CONDITIONS EXIST AT THE DESIGNATED DISTANCE.
DETAIL A
STANDARD "R" PAVEMENT MARKING FOR R X R SYMBOL
6'-3"
12"
24"
27"
15° R
6" R
3"
6"
12"
3" 3" 3"

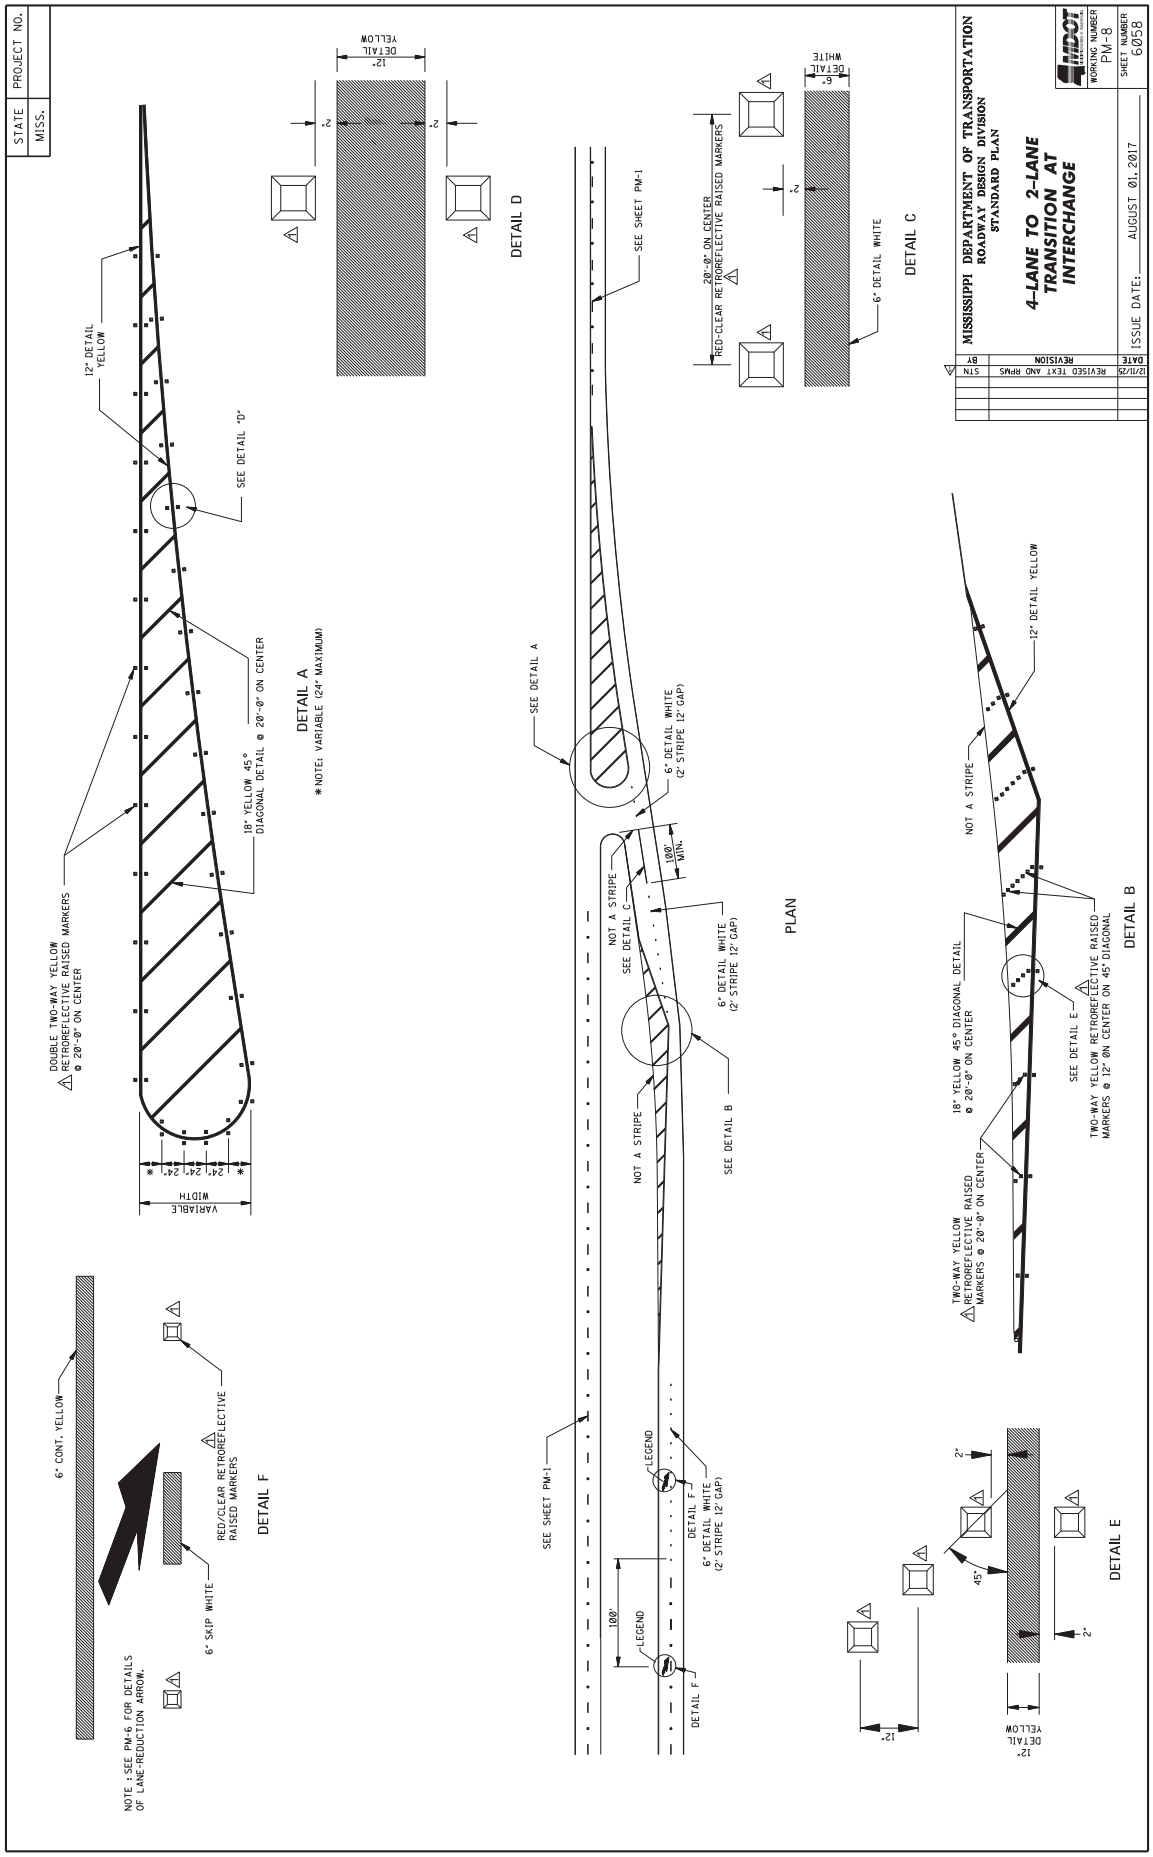
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
4-LANE TO 2-LANE TRANSITION AT INTERCHANGE
WORKING NUMBER PM-8
SHEET NUMBER 6058
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY STN
12/11/20 REVISED TEXT AND RPMS
DOUBLE TWO-WAY YELLOW RETROREFLECTIVE RAISED MARKERS @ 20'-0" ON CENTER
12" DETAIL YELLOW
SEE DETAIL "D"
18" YELLOW 45° DIAGONAL DETAIL @ 20'-0" ON CENTER
VARIABLE WIDTH
24" 24" 24" 24" *
DETAIL A
*NOTE: VARIABLE (24" MAXIMUM)
DETAIL D
12" DETAIL YELLOW
2"
20'-0" ON CENTER
RED-CLEAR RETROREFLECTIVE RAISED MARKERS
6" DETAIL WHITE
DETAIL C
6" CONT. YELLOW
RED/CLEAR RETROREFLECTIVE RAISED MARKERS
6" SKIP WHITE
NOTE : SEE PM-6 FOR DETAILS OF LANE-REDUCTION ARROW.
DETAIL F
SEE SHEET PM-1
SEE DETAIL A
6" DETAIL WHITE (2" STRIPE 12' GAP)
100' MIN.
NOT A STRIPE
SEE DETAIL C
SEE DETAIL B
LEGEND
DETAIL F
PLAN
NOT A STRIPE
12" DETAIL YELLOW
18" YELLOW 45° DIAGONAL DETAIL @ 20'-0" ON CENTER
SEE DETAIL E
TWO-WAY YELLOW RETROREFLECTIVE RAISED MARKERS @ 20'-0" ON CENTER
TWO-WAY YELLOW RETROREFLECTIVE RAISED MARKERS @ 12' ON CENTER ON 45° DIAGONAL
DETAIL B
45°
12" DETAIL YELLOW
DETAIL E

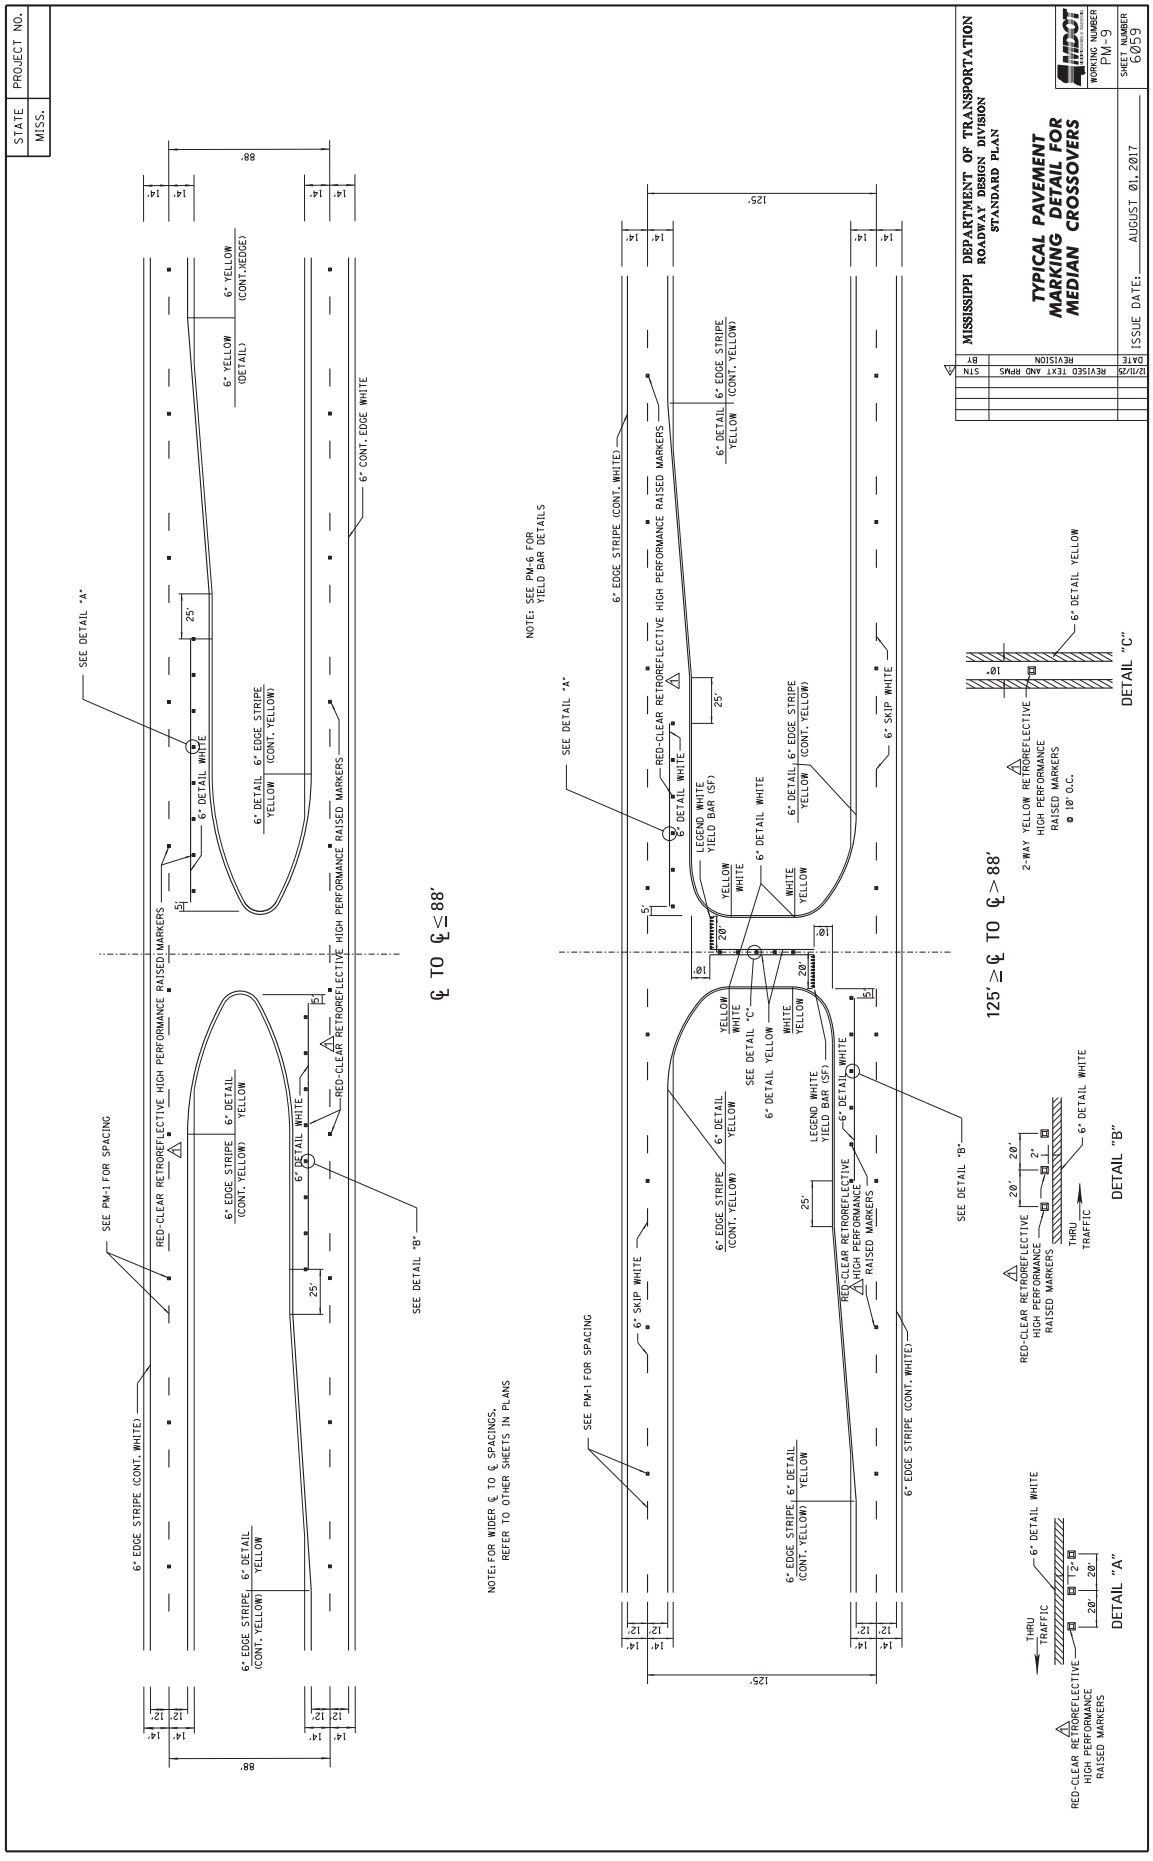
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TYPICAL PAVEMENT MARKING DETAIL FOR MEDIAN CROSSOVERS
WORKING NUMBER PM-9
SHEET NUMBER 6059
ISSUE DATE: AUGUST 01, 2017
REVISED TEXT AND RPMS
SEE DETAIL "A"
SEE DETAIL "B"
SEE PM-1 FOR SPACING
RED-CLEAR RETROREFLECTIVE HIGH PERFORMANCE RAISED MARKERS
6" EDGE STRIPE (CONT. WHITE)
6" DETAIL WHITE
6" EDGE STRIPE (CONT. YELLOW)
6" DETAIL YELLOW
6" YELLOW (DETAIL)
6" YELLOW (CONT. EDGE)
6" CONT. EDGE WHITE
℄ TO ℄ ≤ 88'
NOTE: FOR WIDER ℄ TO ℄ SPACINGS, REFER TO OTHER SHEETS IN PLANS
NOTE: SEE PM-6 FOR YIELD BAR DETAILS
LEGEND WHITE YIELD BAR (SF)
6" SKIP WHITE
SEE DETAIL "C"
6" DETAIL YELLOW
125' ≥ ℄ TO ℄ > 88'
2-WAY YELLOW RETROREFLECTIVE HIGH PERFORMANCE RAISED MARKERS @ 10' O.C.
DETAIL "C"
DETAIL "A"
DETAIL "B"
THRU TRAFFIC

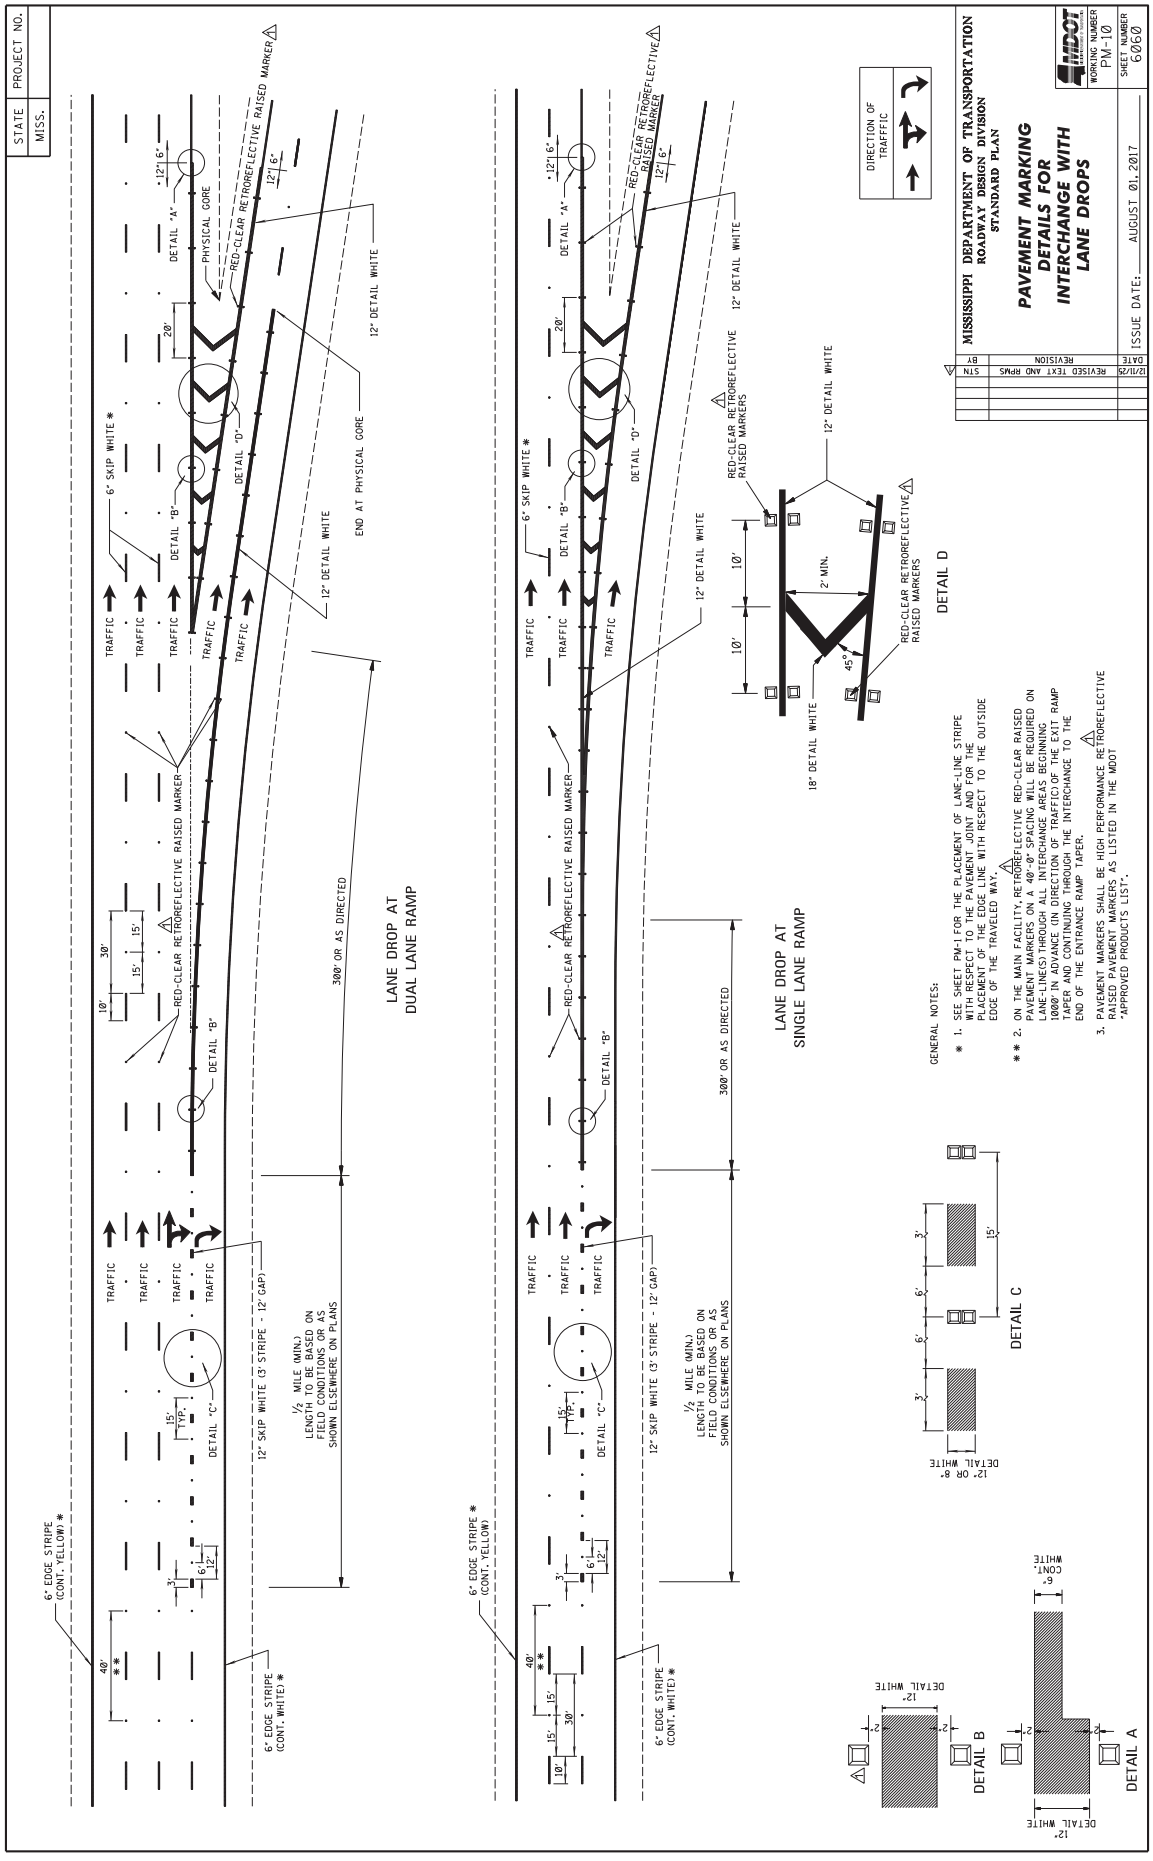
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
PAVEMENT MARKING DETAILS FOR INTERCHANGE WITH LANE DROPS
WORKING NUMBER PM-10
SHEET NUMBER 6060
ISSUE DATE: AUGUST 01, 2017
REVISED TEXT AND RPMS
LANE DROP AT DUAL LANE RAMP
LANE DROP AT SINGLE LANE RAMP
DETAIL D
DETAIL C
DETAIL B
DETAIL A
GENERAL NOTES:
* 1. SEE SHEET PM-1 FOR THE PLACEMENT OF LANE-LINE STRIPE WITH RESPECT TO THE PAVEMENT JOINT AND FOR THE PLACEMENT OF THE EDGE LINE WITH RESPECT TO THE OUTSIDE EDGE OF THE TRAVELED WAY.
** 2. ON THE MAIN FACILITY, RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS ON A 40'-0" SPACING WILL BE REQUIRED ON LANE-LINE(S) THROUGH ALL INTERCHANGE AREAS BEGINNING 1000' IN ADVANCE (IN DIRECTION OF TRAFFIC) OF THE EXIT RAMP TAPER AND CONTINUING THROUGH THE INTERCHANGE TO THE END OF THE ENTRANCE RAMP TAPER.
3. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RETROREFLECTIVE RAISED PAVEMENT MARKERS AS LISTED IN THE MDOT "APPROVED PRODUCTS LIST".
DIRECTION OF TRAFFIC

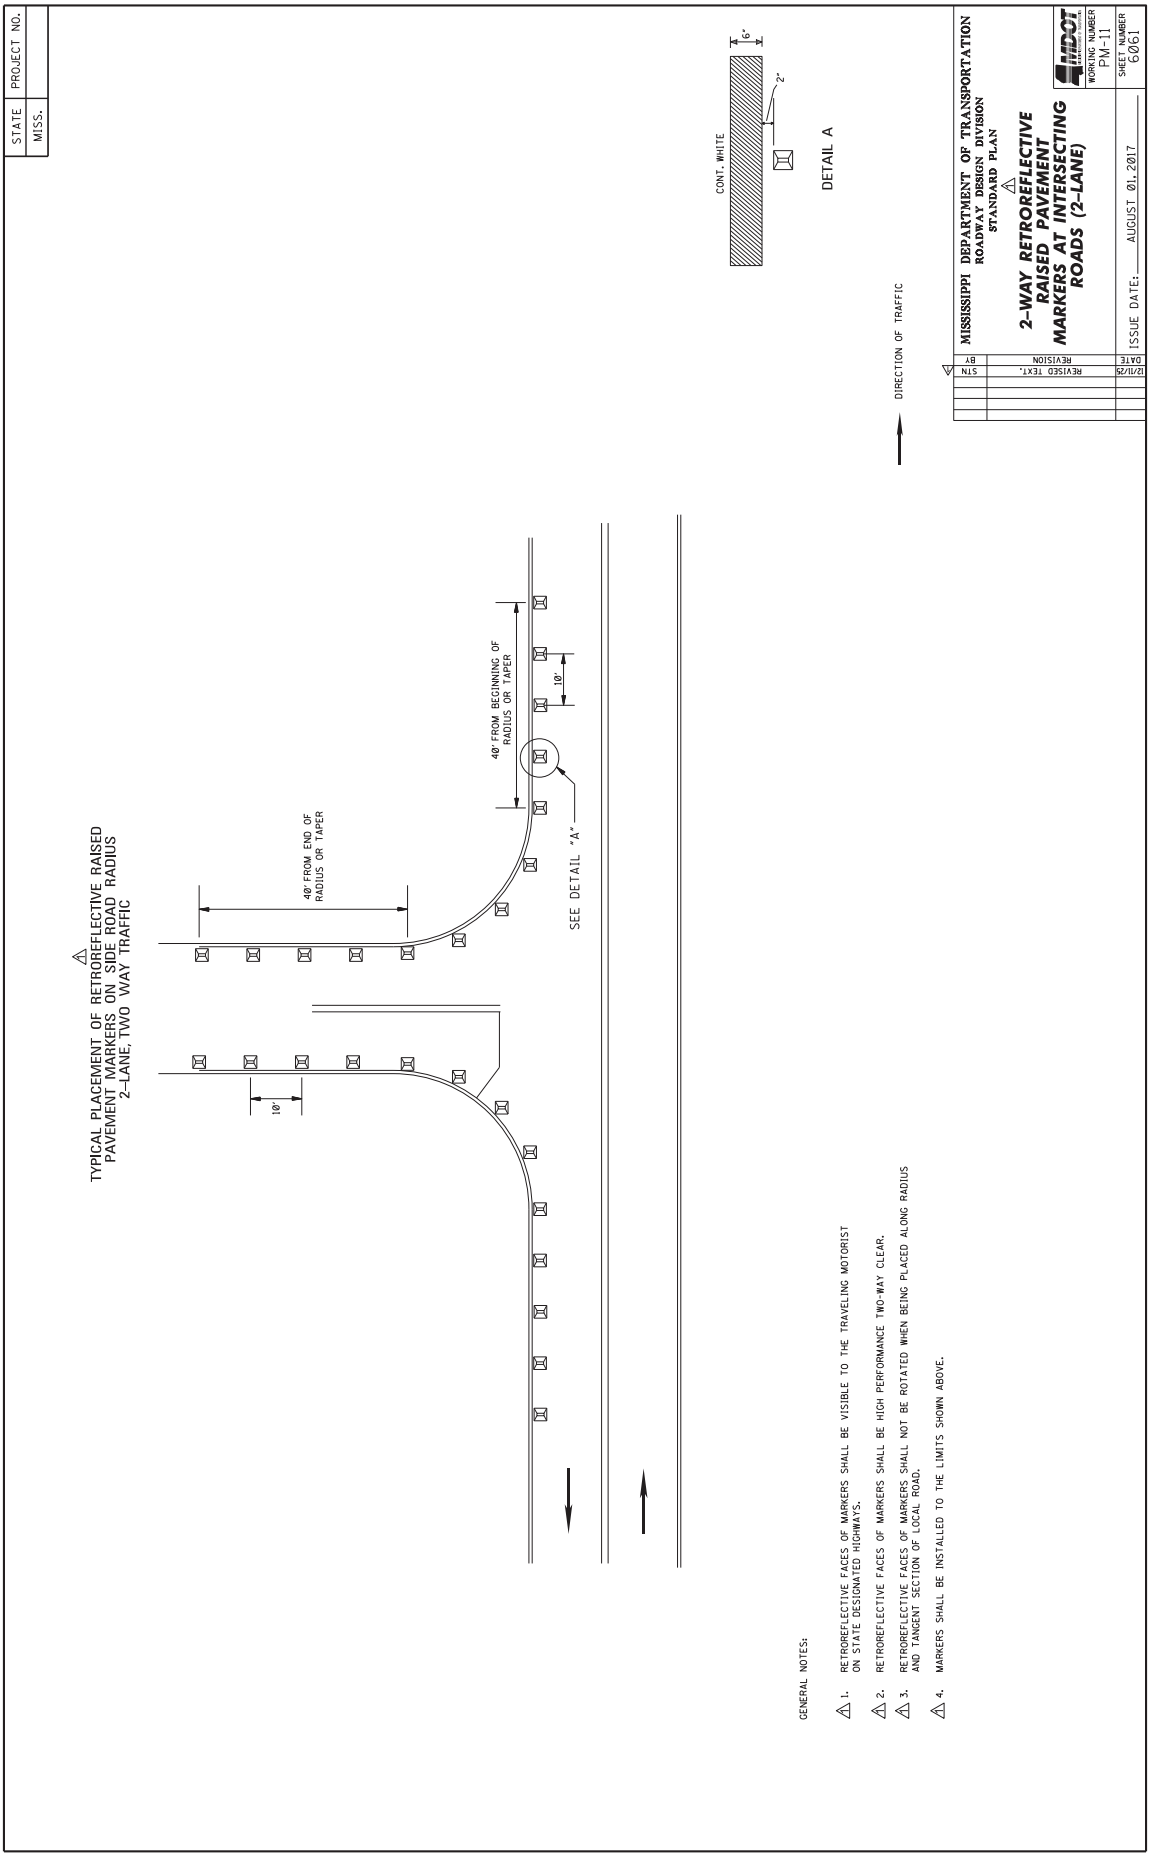
STATE
MISS.
PROJECT NO.
TYPICAL PLACEMENT OF RETROREFLECTIVE RAISED PAVEMENT MARKERS ON SIDE ROAD RADIUS 2-LANE, TWO WAY TRAFFIC
40' FROM END OF RADIUS OR TAPER
40' FROM BEGINNING OF RADIUS OR TAPER
10'
10'
SEE DETAIL "A"
DIRECTION OF TRAFFIC
CONT. WHITE
6"
2"
DETAIL A
GENERAL NOTES:
1. RETROREFLECTIVE FACES OF MARKERS SHALL BE VISIBLE TO THE TRAVELING MOTORIST ON STATE DESIGNATED HIGHWAYS.
2. RETROREFLECTIVE FACES OF MARKERS SHALL BE HIGH PERFORMANCE TWO-WAY CLEAR.
3. RETROREFLECTIVE FACES OF MARKERS SHALL NOT BE ROTATED WHEN BEING PLACED ALONG RADIUS AND TANGENT SECTION OF LOCAL ROAD.
4. MARKERS SHALL BE INSTALLED TO THE LIMITS SHOWN ABOVE.
STN
REVISED TEXT.
12/11/20
BY
REVISION
DATE
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
2-WAY RETROREFLECTIVE RAISED PAVEMENT MARKERS AT INTERSECTING ROADS (2-LANE)
MDOT
WORKING NUMBER
PM-11
SHEET NUMBER
6061
ISSUE DATE: AUGUST 01, 2017

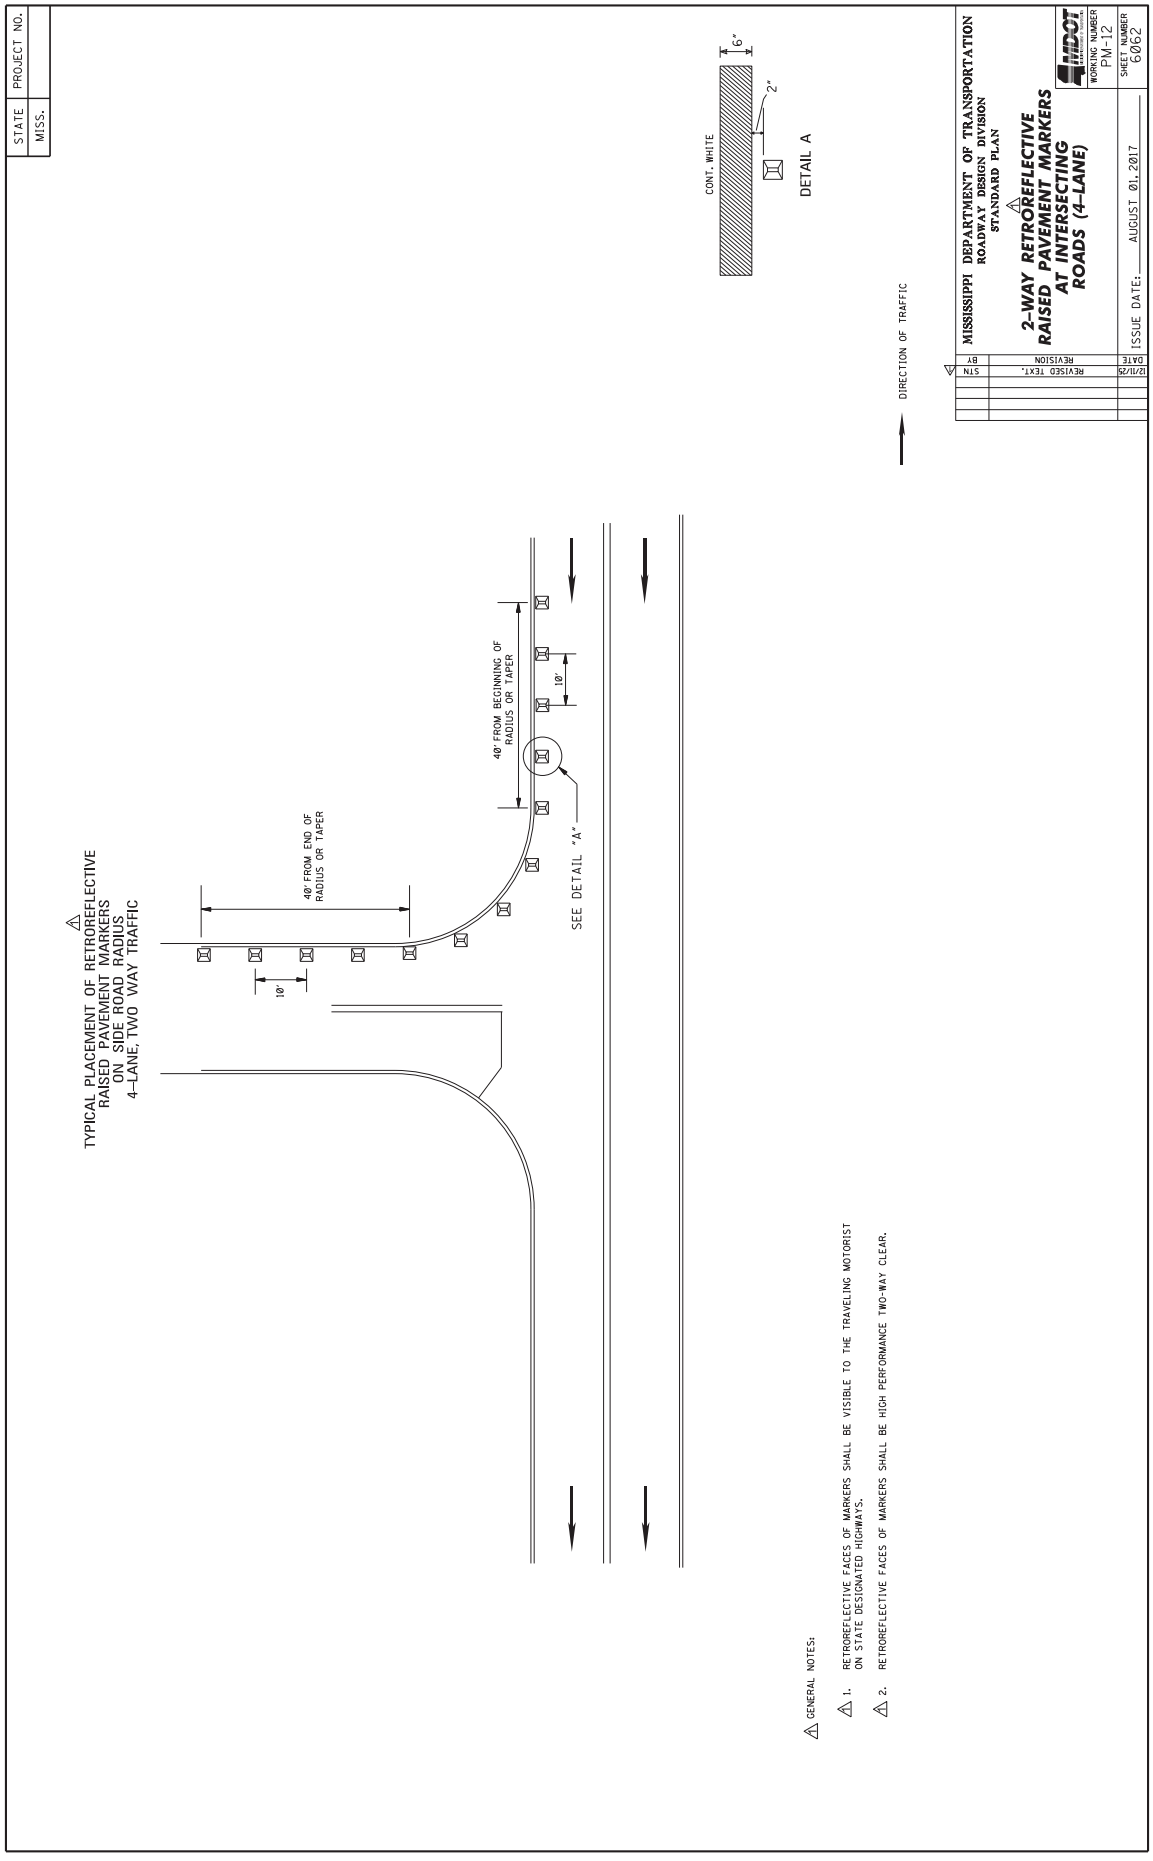
STATE
MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
2-WAY RETROREFLECTIVE RAISED PAVEMENT MARKERS AT INTERSECTING ROADS (4-LANE)
WORKING NUMBER PM-12
SHEET NUMBER 6062
ISSUE DATE: AUGUST 01, 2017
DATE
REVISION
BY
12/11/25
REVISED TEXT.
STM
TYPICAL PLACEMENT OF RETROREFLECTIVE RAISED PAVEMENT MARKERS ON SIDE ROAD RADIUS 4-LANE, TWO WAY TRAFFIC
40' FROM END OF RADIUS OR TAPER
40' FROM BEGINNING OF RADIUS OR TAPER
10'
10'
SEE DETAIL "A"
DIRECTION OF TRAFFIC
CONT. WHITE
6"
2"
DETAIL A
GENERAL NOTES:
1. RETROREFLECTIVE FACES OF MARKERS SHALL BE VISIBLE TO THE TRAVELING MOTORIST ON STATE DESIGNATED HIGHWAYS.
2. RETROREFLECTIVE FACES OF MARKERS SHALL BE HIGH PERFORMANCE TWO-WAY CLEAR.

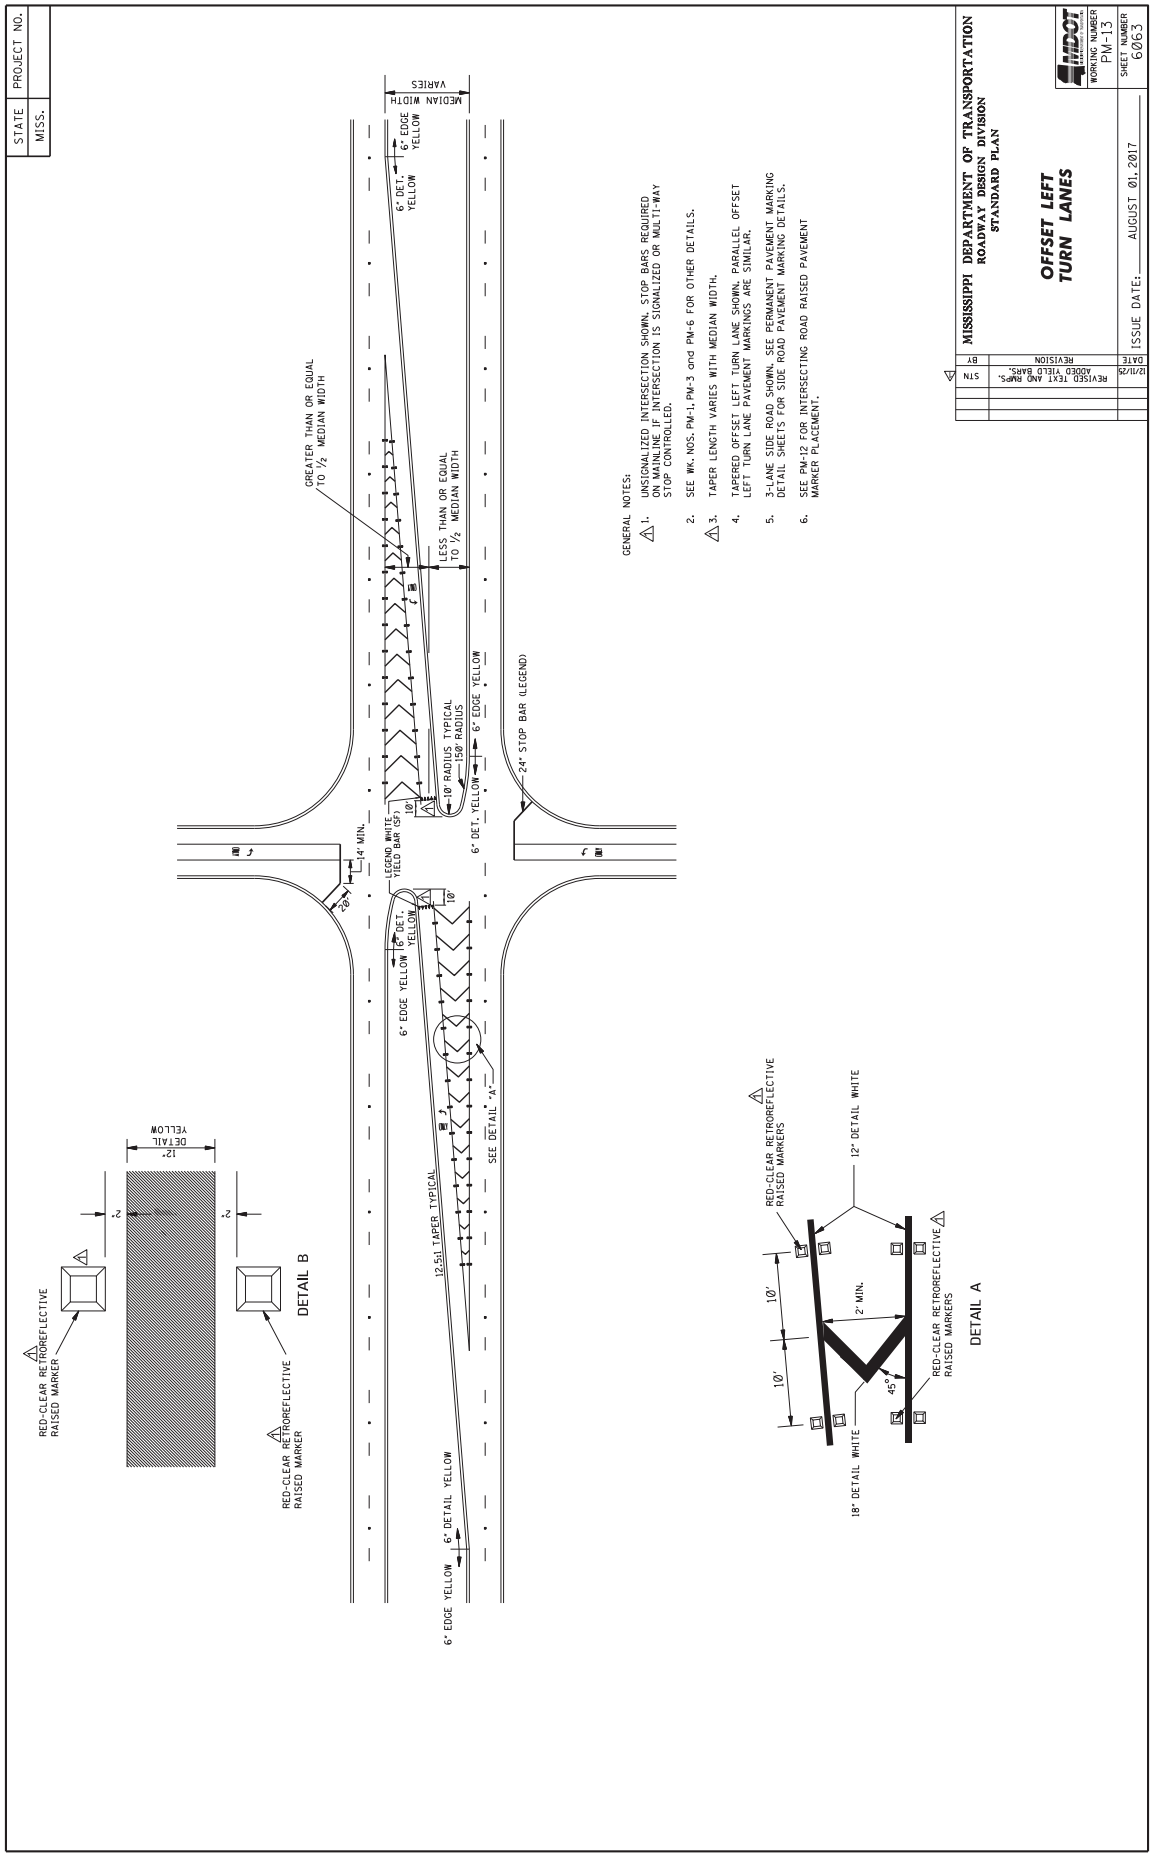
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
OFFSET LEFT TURN LANES
WORKING NUMBER PM-13
SHEET NUMBER 6063
ISSUE DATE: AUGUST 01, 2017
REVISION
REVISED TEXT AND DWGS, ADDED YIELD BARS.
DATE 12/11/20
BY STN
GENERAL NOTES:
1. UNSIGNALIZED INTERSECTION SHOWN. STOP BARS REQUIRED ONLY WHERE INTERSECTION IS SIGNALIZED OR MULTI-WAY STOP CONTROLLED.
2. SEE MK. NOS. PM-1, PM-3 and PM-6 FOR OTHER DETAILS.
3. TAPER LENGTH VARIES WITH MEDIAN WIDTH.
4. TAPERED OFFSET LEFT TURN LANE SHOWN. PARALLEL OFFSET LEFT TURN LANE PAVEMENT MARKINGS ARE SIMILAR.
5. 3-LANE SIDE ROAD SHOWN. SEE PERMANENT PAVEMENT MARKING DETAIL SHEETS FOR SIDE ROAD PAVEMENT MARKING DETAILS.
6. SEE PM-12 FOR INTERSECTING ROAD RAISED PAVEMENT MARKER PLACEMENT.
GREATER THAN OR EQUAL TO ½ MEDIAN WIDTH
LESS THAN OR EQUAL TO ½ MEDIAN WIDTH
MEDIAN WIDTH VARIES
6" EDGE YELLOW
6" DET. YELLOW
10' RADIUS TYPICAL
150' RADIUS
24" STOP BAR (LEGEND)
LEGEND WHITE YIELD BAR (SP)
14' MIN.
20'
12.5:1 TAPER TYPICAL
SEE DETAIL "A"
6" DETAIL YELLOW
DETAIL B
12" DETAIL YELLOW
2"
RED-CLEAR RETROREFLECTIVE RAISED MARKER
DETAIL A
RED-CLEAR RETROREFLECTIVE RAISED MARKERS
12" DETAIL WHITE
18" DETAIL WHITE
10'
2' MIN.
45°

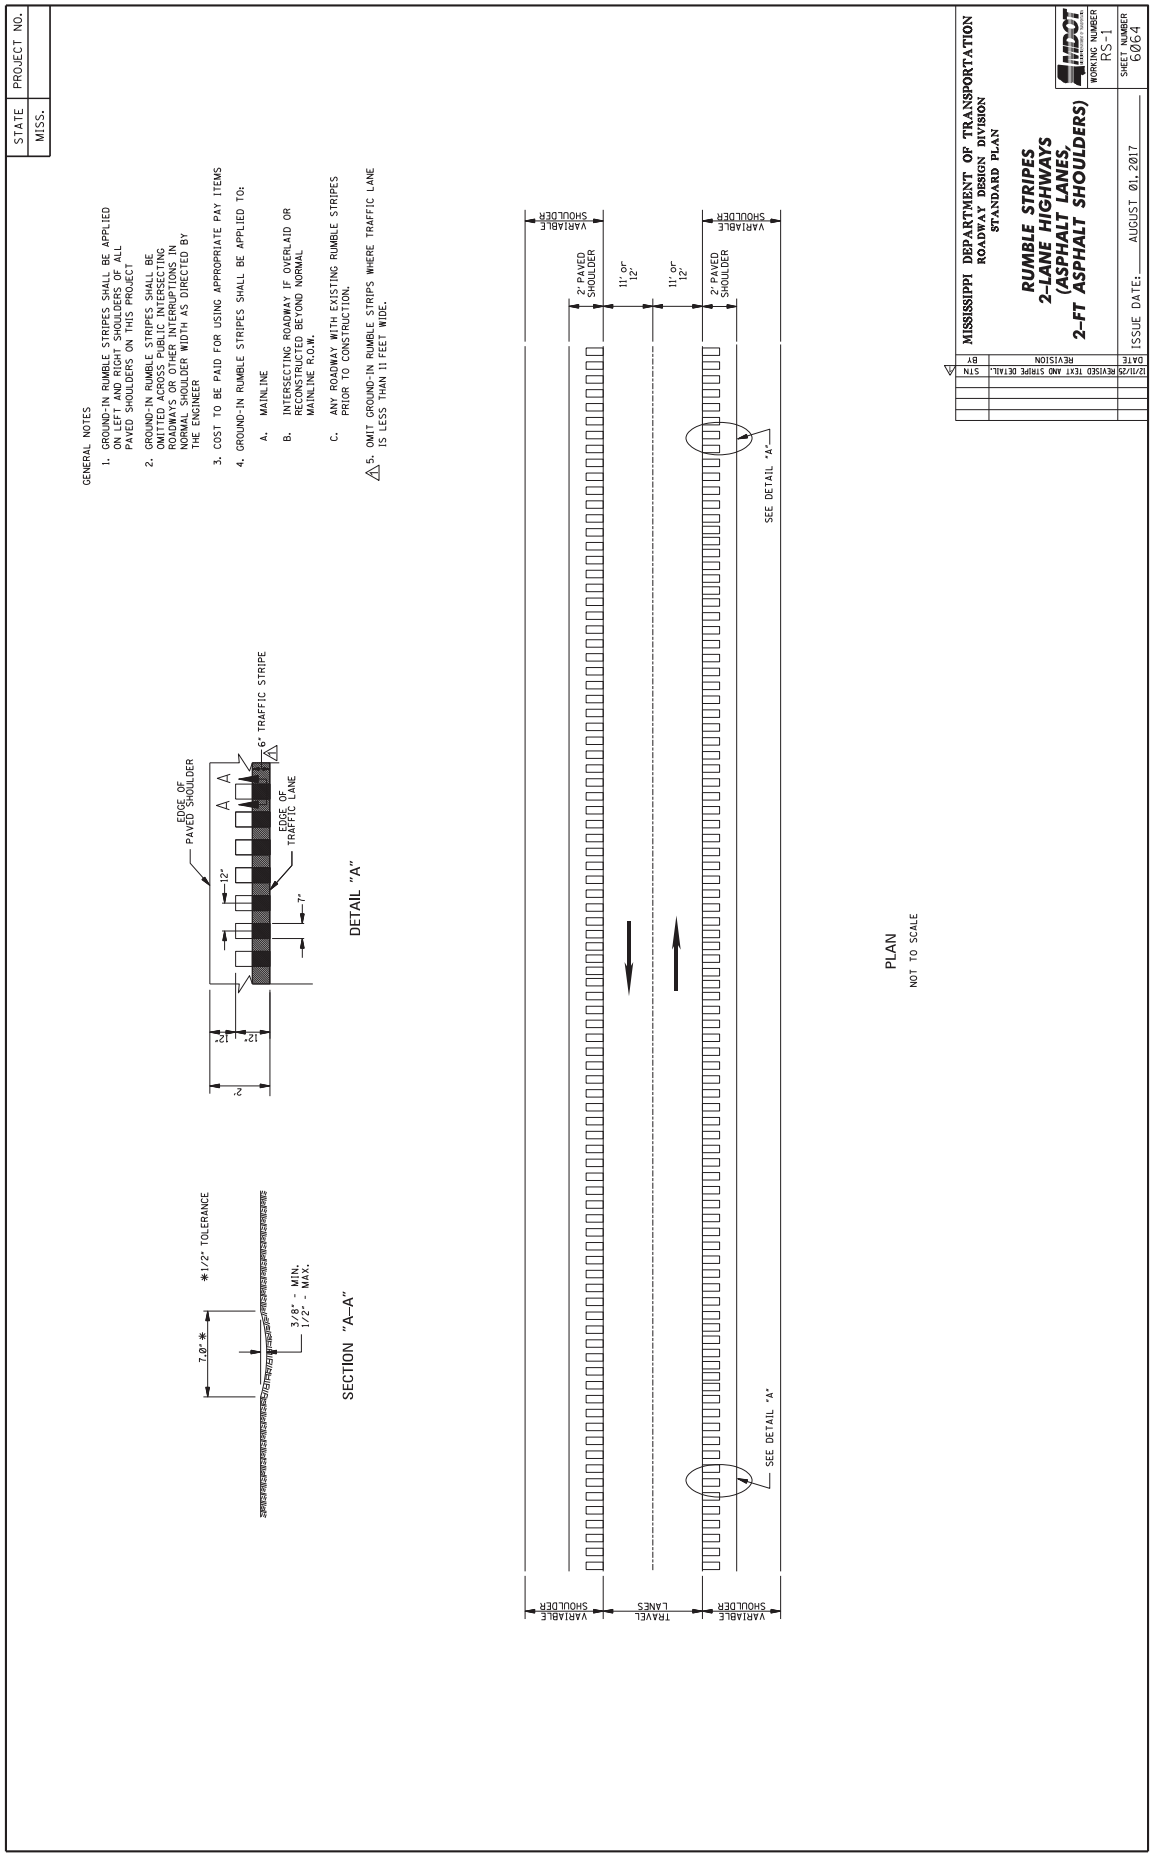
STATE
MISS.
PROJECT NO.
GENERAL NOTES
1. GROUND-IN RUMBLE STRIPES SHALL BE APPLIED ON LEFT AND RIGHT SHOULDERS OF ALL PAVED SHOULDERS ON THIS PROJECT
2. GROUND-IN RUMBLE STRIPES SHALL BE OMITTED ACROSS PUBLIC INTERSECTING ROADWAYS OR OTHER INTERRUPTIONS IN NORMAL SHOULDER WIDTH AS DIRECTED BY THE ENGINEER
3. COST TO BE PAID FOR USING APPROPRIATE PAY ITEMS
4. GROUND-IN RUMBLE STRIPES SHALL BE APPLIED TO:
A. MAINLINE
B. INTERSECTING ROADWAY IF OVERLAID OR RECONSTRUCTED BEYOND NORMAL MAINLINE R.O.W.
C. ANY ROADWAY WITH EXISTING RUMBLE STRIPES PRIOR TO CONSTRUCTION.
5. OMIT GROUND-IN RUMBLE STRIPS WHERE TRAFFIC LANE IS LESS THAN 11 FEET WIDE.
EDGE OF PAVED SHOULDER
6" TRAFFIC STRIPE
EDGE OF TRAFFIC LANE
12"
7"
DETAIL "A"
7.0"*
*1/2" TOLERANCE
3/8" - MIN.
1/2" - MAX.
SECTION "A–A"
VARIABLE SHOULDER
2' PAVED SHOULDER
11' or 12'
TRAVEL LANES
SEE DETAIL 'A'
PLAN
NOT TO SCALE
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
RUMBLE STRIPES
2-LANE HIGHWAYS
(ASPHALT LANES,
2-FT ASPHALT SHOULDERS)
WORKING NUMBER RS-1
SHEET NUMBER 6064
ISSUE DATE: AUGUST 01, 2017
STN BY REVISION DATE
12/11/25 REVISED TEXT AND STRIPE DETAIL

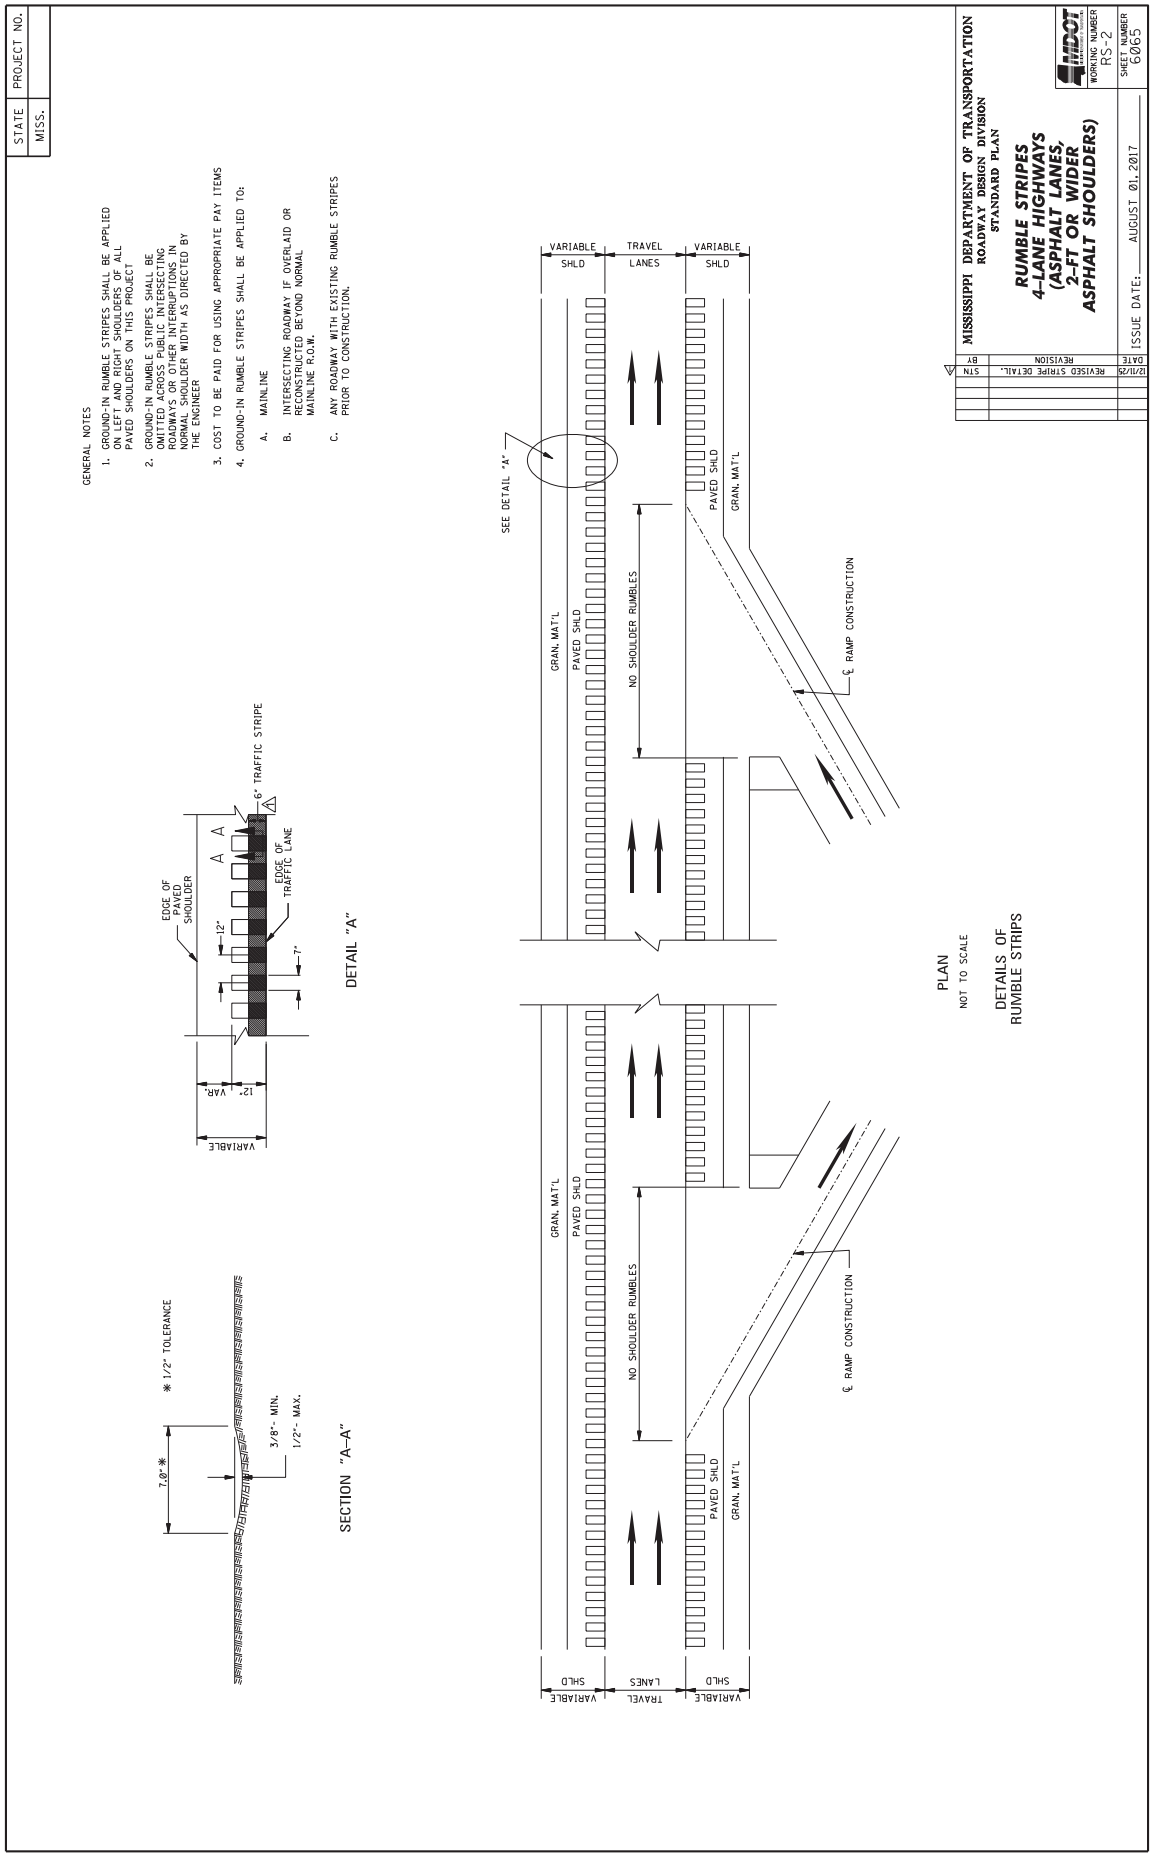
STATE
MISS.
PROJECT NO.
GENERAL NOTES
1. GROUND-IN RUMBLE STRIPES SHALL BE APPLIED ON LEFT AND RIGHT SHOULDERS OF ALL PAVED SHOULDERS ON THIS PROJECT
2. GROUND-IN RUMBLE STRIPES SHALL BE OMITTED ACROSS PUBLIC INTERSECTING ROADWAYS OR OTHER INTERRUPTIONS IN NORMAL SHOULDER WIDTH AS DIRECTED BY THE ENGINEER
3. COST TO BE PAID FOR USING APPROPRIATE PAY ITEMS
4. GROUND-IN RUMBLE STRIPES SHALL BE APPLIED TO:
A. MAINLINE
B. INTERSECTING ROADWAY IF OVERLAID OR RECONSTRUCTED BEYOND NORMAL MAINLINE R.O.W.
C. ANY ROADWAY WITH EXISTING RUMBLE STRIPES PRIOR TO CONSTRUCTION.
6" TRAFFIC STRIPE
EDGE OF PAVED SHOULDER
EDGE OF TRAFFIC LANE
12"
7"
12" VAR.
VARIABLE
DETAIL "A"
7.0"*
* 1/2" TOLERANCE
3/8"- MIN.
1/2"- MAX.
SECTION "A-A"
VARIABLE SHLD
TRAVEL LANES
VARIABLE SHLD
SEE DETAIL "A"
GRAN. MAT'L
PAVED SHLD
NO SHOULDER RUMBLES
PAVED SHLD
GRAN. MAT'L
℄ RAMP CONSTRUCTION
PLAN
NOT TO SCALE
DETAILS OF RUMBLE STRIPS
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
RUMBLE STRIPES
4-LANE HIGHWAYS
(ASPHALT LANES,
2-FT OR WIDER
ASPHALT SHOULDERS)
WORKING NUMBER
RS-2
SHEET NUMBER
6065
ISSUE DATE: AUGUST 01, 2017
STN
REVISED STRIPE DETAIL.
DATE
REVISION
BY

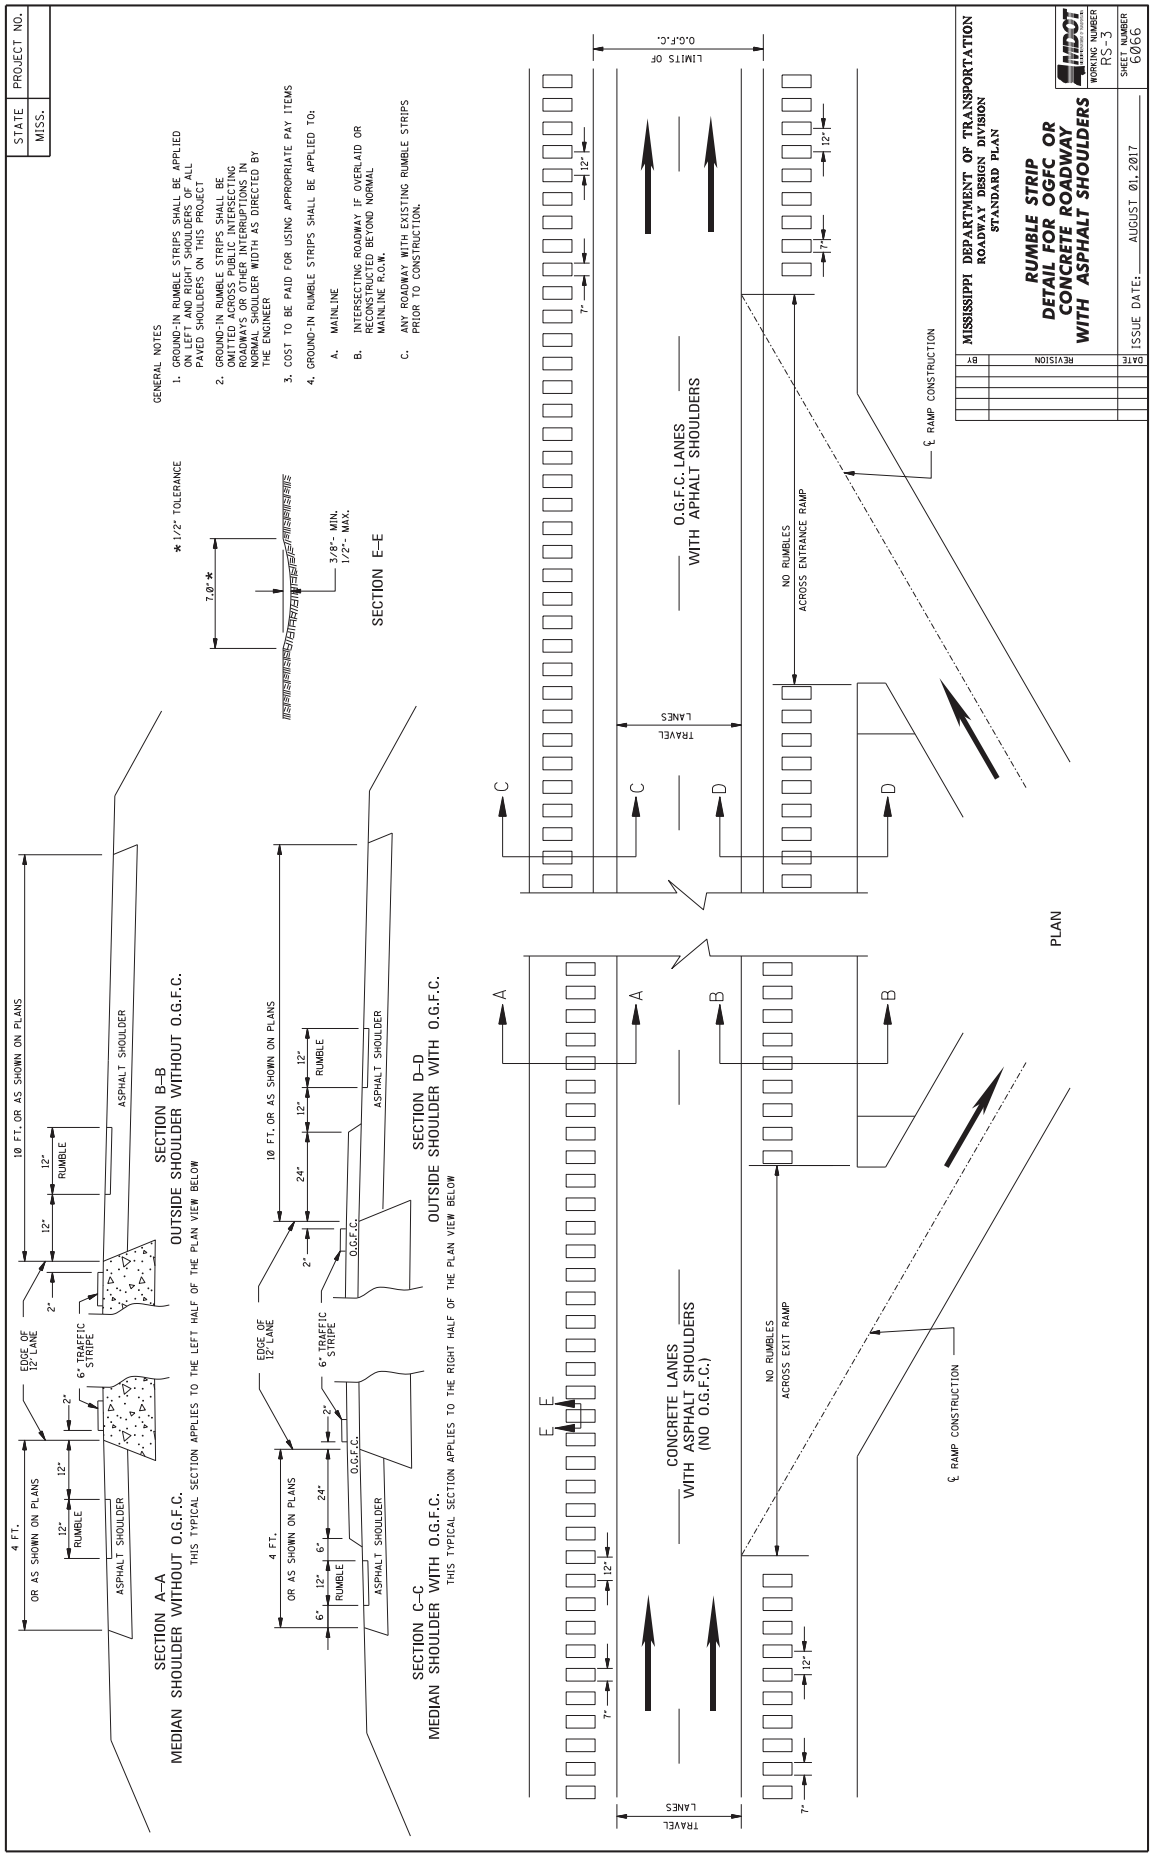
STATE MISS.
PROJECT NO.
GENERAL NOTES
1. GROUND-IN RUMBLE STRIPS SHALL BE APPLIED ON LEFT AND RIGHT SHOULDERS OF ALL PAVED SHOULDERS ON THIS PROJECT
2. GROUND-IN RUMBLE STRIPS SHALL BE OMITTED ACROSS PUBLIC INTERSECTING ROADWAYS OR OTHER INTERRUPTIONS IN NORMAL SHOULDER WIDTH AS DIRECTED BY THE ENGINEER
3. COST TO BE PAID FOR USING APPROPRIATE PAY ITEMS
4. GROUND-IN RUMBLE STRIPS SHALL BE APPLIED TO:
A. MAINLINE
B. INTERSECTING ROADWAY IF OVERLAID OR RECONSTRUCTED BEYOND NORMAL MAINLINE R.O.W.
C. ANY ROADWAY WITH EXISTING RUMBLE STRIPS PRIOR TO CONSTRUCTION.
* 1/2" TOLERANCE
7.0"*
3/8"- MIN.
1/2"- MAX.
SECTION E-E
SECTION A-A
MEDIAN SHOULDER WITHOUT O.G.F.C.
THIS TYPICAL SECTION APPLIES TO THE LEFT HALF OF THE PLAN VIEW BELOW
4 FT.
OR AS SHOWN ON PLANS
EDGE OF 12' LANE
6" TRAFFIC STRIPE
2"
12" RUMBLE
ASPHALT SHOULDER
SECTION B-B
OUTSIDE SHOULDER WITHOUT O.G.F.C.
10 FT. OR AS SHOWN ON PLANS
12" RUMBLE
ASPHALT SHOULDER
SECTION C-C
MEDIAN SHOULDER WITH O.G.F.C.
THIS TYPICAL SECTION APPLIES TO THE RIGHT HALF OF THE PLAN VIEW BELOW
6" 12" 6"
24"
O.G.F.C.
SECTION D-D
OUTSIDE SHOULDER WITH O.G.F.C.
PLAN
CONCRETE LANES
WITH ASPHALT SHOULDERS
(NO O.G.F.C.)
O.G.F.C. LANES
WITH APHALT SHOULDERS
NO RUMBLES
ACROSS EXIT RAMP
NO RUMBLES
ACROSS ENTRANCE RAMP
℄ RAMP CONSTRUCTION
TRAVEL LANES
LIMITS OF O.G.F.C.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
RUMBLE STRIP
DETAIL FOR OGFC OR
CONCRETE ROADWAY
WITH ASPHALT SHOULDERS
BY
REVISION
DATE
ISSUE DATE: AUGUST 01, 2017
WORKING NUMBER RS-3
SHEET NUMBER 6066

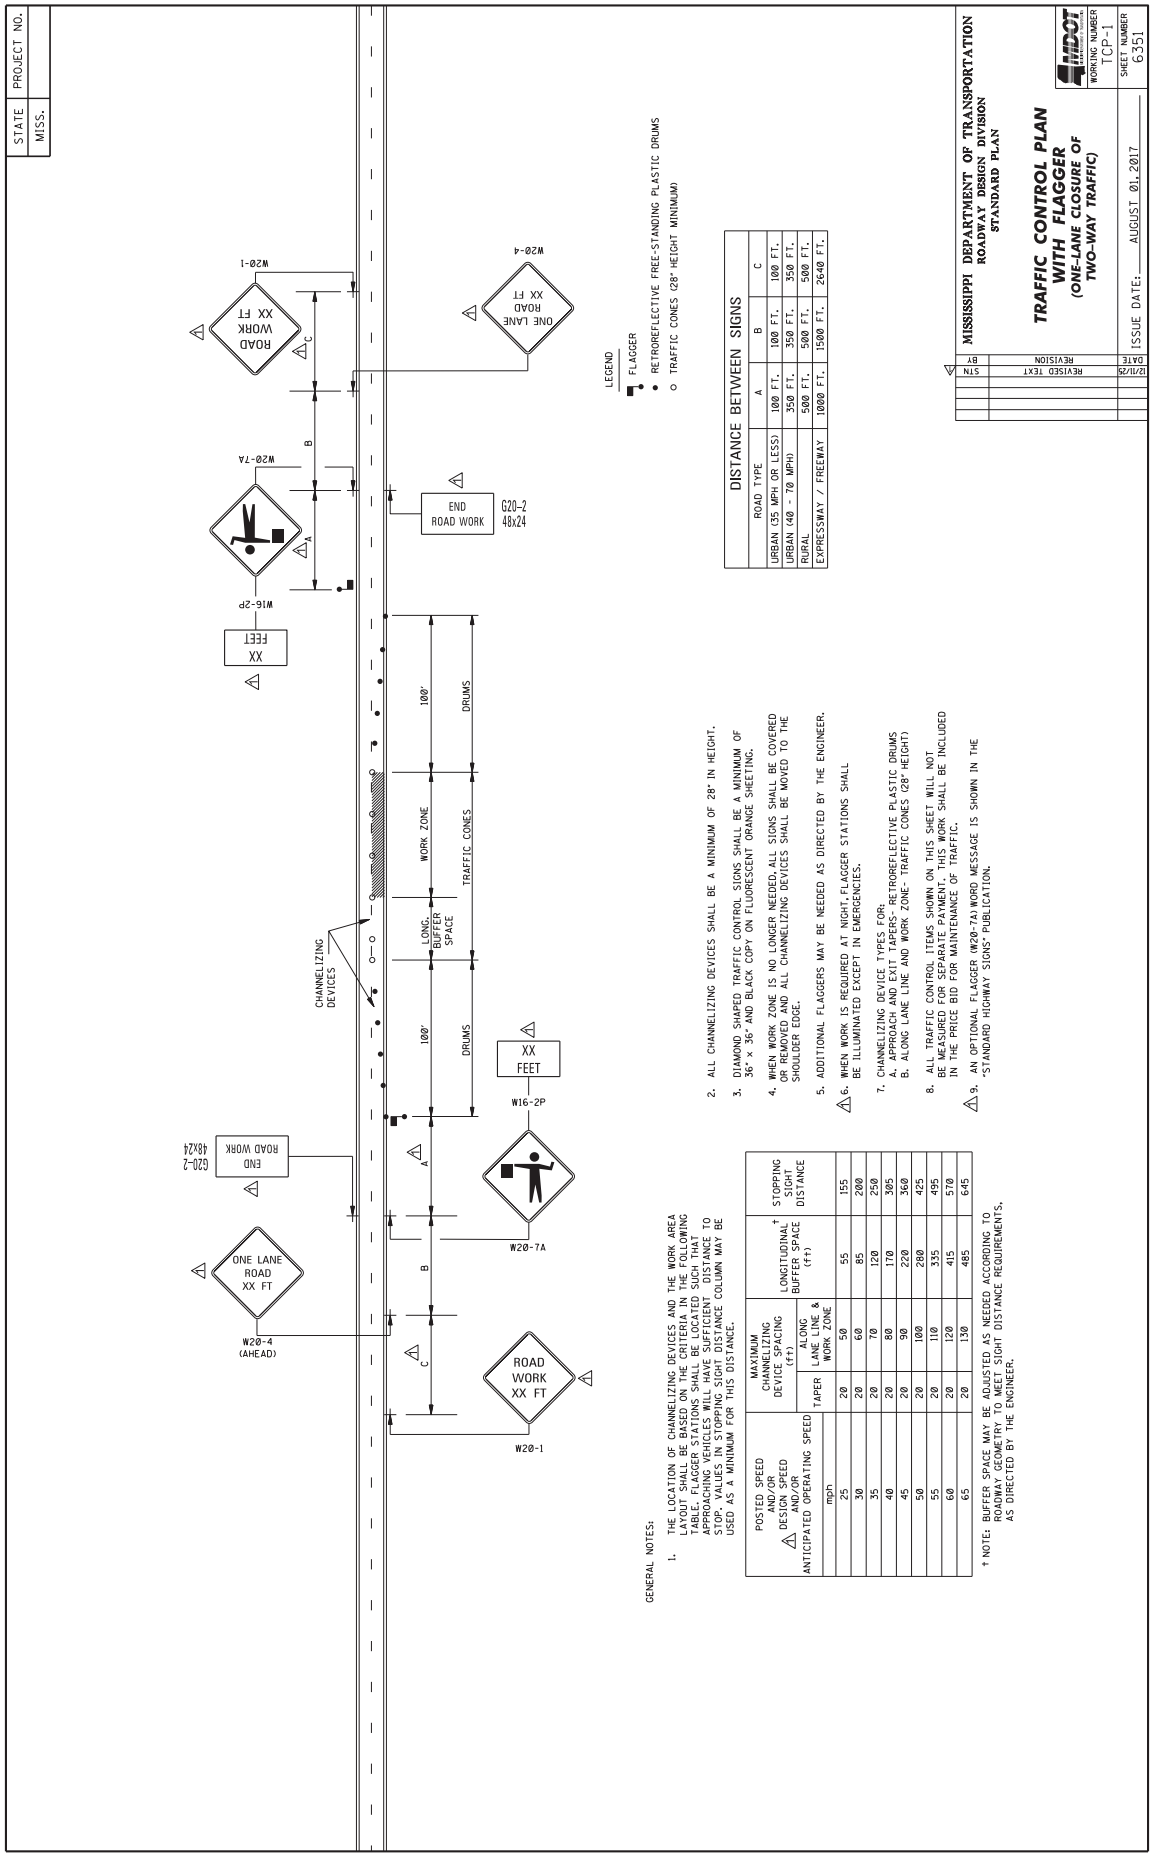

DISTANCE BETWEEN SIGNS

ROAD TYPE	A	B	C
URBAN (35 MPH OR LESS)	100 FT.	100 FT.	100 FT.
URBAN (40 - 70 MPH)	350 FT.	350 FT.	350 FT.
RURAL	500 FT.	500 FT.	500 FT.
EXPRESSWAY / FREEWAY	1000 FT.	1500 FT.	2640 FT.

GENERAL NOTES:

1. THE LOCATION OF CHANNELIZING DEVICES AND THE WORK AREA LAYOUT SHALL BE BASED ON THE CRITERIA IN THE FOLLOWING TABLE. FLAGGER STATIONS SHALL BE LOCATED SUCH THAT APPROACHING VEHICLES WILL HAVE SUFFICIENT DISTANCE TO STOP. VALUES IN STOPPING SIGHT DISTANCE COLUMN MAY BE USED AS A MINIMUM FOR THIS DISTANCE.

POSTED SPEED AND/OR ⚠ DESIGN SPEED AND/OR ANTICIPATED OPERATING SPEED	MAXIMUM CHANNELIZING DEVICE SPACING (ft)		LONGITUDINAL † BUFFER SPACE (ft)	STOPPING SIGHT DISTANCE
	TAPER	ALONG LANE LINE & WORK ZONE		
mph				
25	20	50	55	155
30	20	60	85	200
35	20	70	120	250
40	20	80	170	305
45	20	90	220	360
50	20	100	280	425
55	20	110	335	495
60	20	120	415	570
65	20	130	485	645

† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRY TO MEET SIGHT DISTANCE REQUIREMENTS, AS DIRECTED BY THE ENGINEER.

2. ALL CHANNELIZING DEVICES SHALL BE A MINIMUM OF 28" IN HEIGHT.
3. DIAMOND SHAPED TRAFFIC CONTROL SIGNS SHALL BE A MINIMUM OF 36" × 36" AND BLACK COPY ON FLUORESCENT ORANGE SHEETING.
4. WHEN WORK ZONE IS NO LONGER NEEDED, ALL SIGNS SHALL BE COVERED OR REMOVED AND ALL CHANNELIZING DEVICES SHALL BE MOVED TO THE SHOULDER EDGE.
5. ADDITIONAL FLAGGERS MAY BE NEEDED AS DIRECTED BY THE ENGINEER.
⚠ 6. WHEN WORK IS REQUIRED AT NIGHT, FLAGGER STATIONS SHALL BE ILLUMINATED EXCEPT IN EMERGENCIES.
7. CHANNELIZING DEVICE TYPES FOR:
   A. APPROACH AND EXIT TAPERS- RETROREFLECTIVE PLASTIC DRUMS
   B. ALONG LANE LINE AND WORK ZONE- TRAFFIC CONES (28" HEIGHT)
8. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.
⚠ 9. AN OPTIONAL FLAGGER (W20-7A) WORD MESSAGE IS SHOWN IN THE "STANDARD HIGHWAY SIGNS" PUBLICATION.

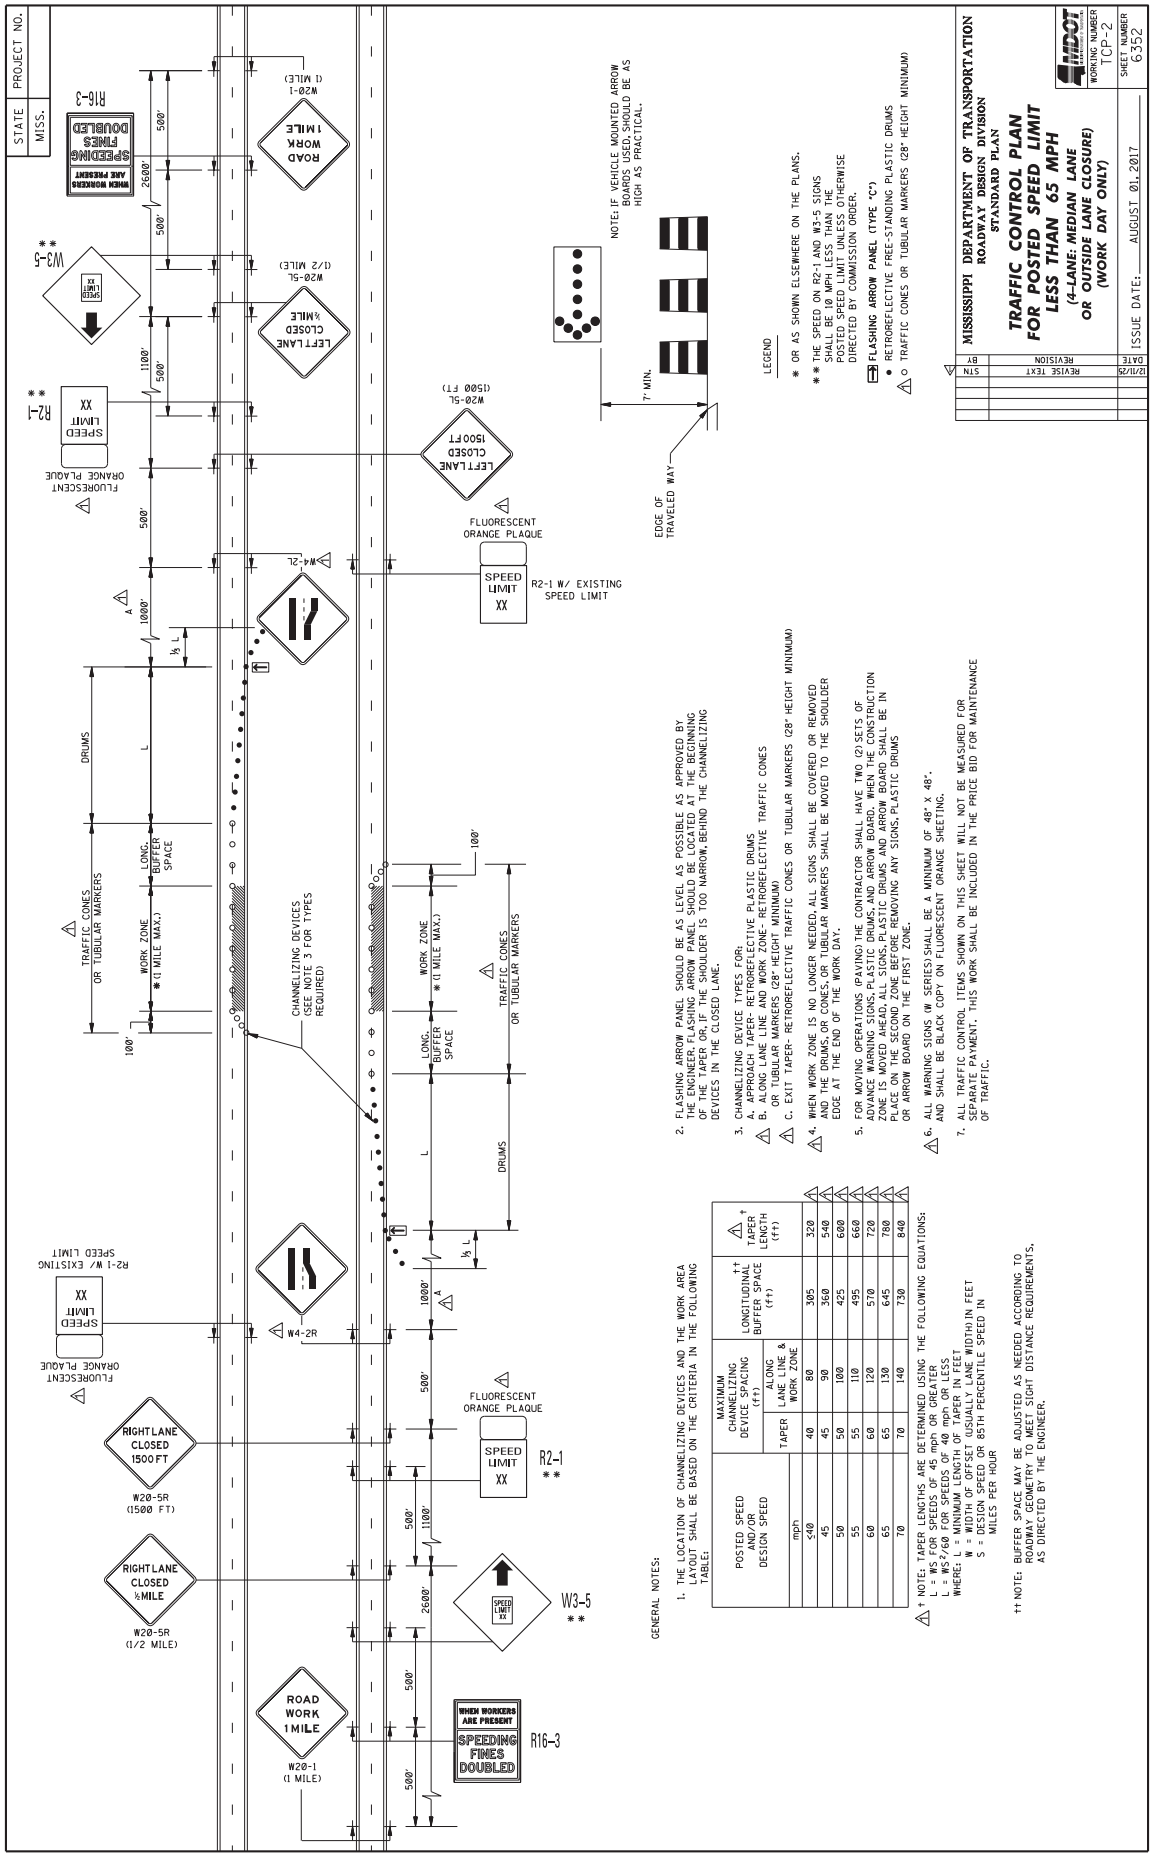
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TRAFFIC CONTROL PLAN
FOR POSTED SPEED LIMIT
LESS THAN 65 MPH
(4-LANE: MEDIAN LANE OR OUTSIDE LANE CLOSURE)
(WORK DAY ONLY)
WORKING NUMBER TCP-2
SHEET NUMBER 6352
ISSUE DATE: AUGUST 01, 2017
REVISION
BY
DATE
STN
REVISE TEXT
12/1/25
LEGEND
* OR AS SHOWN ELSEWHERE ON THE PLANS.
** THE SPEED ON R2-1 AND W3-5 SIGNS SHALL BE 10 MPH LESS THAN THE POSTED SPEED LIMIT UNLESS OTHERWISE DIRECTED BY COMMISSION ORDER.
FLASHING ARROW PANEL (TYPE "C")
RETROREFLECTIVE FREE-STANDING PLASTIC DRUMS
TRAFFIC CONES OR TUBULAR MARKERS (28" HEIGHT MINIMUM)
NOTE: IF VEHICLE MOUNTED ARROW BOARDS USED, SHOULD BE AS HIGH AS PRACTICAL.
7' MIN.
EDGE OF TRAVELED WAY
ROAD WORK 1 MILE
W20-1 (1 MILE)
LEFT LANE CLOSED ½ MILE
W20-5L (1/2 MILE)
LEFT LANE CLOSED 1500 FT
W20-5L (1500 FT)
RIGHT LANE CLOSED 1500 FT
W20-5R (1500 FT)
RIGHT LANE CLOSED ½ MILE
W20-5R (1/2 MILE)
WHEN WORKERS ARE PRESENT
SPEEDING FINES DOUBLED
R16-3
W3-5 **
SPEED LIMIT XX
R2-1 **
SPEED LIMIT XX
FLUORESCENT ORANGE PLAQUE
R2-1 W/ EXISTING SPEED LIMIT
W4-2L
W4-2R
TRAFFIC CONES OR TUBULAR MARKERS
DRUMS
LONG. BUFFER SPACE
WORK ZONE * (1 MILE MAX.)
CHANNELIZING DEVICES (SEE NOTE 3 FOR TYPES REQUIRED)
100'
500'
1000'
1100'
2600'
⅓ L
A
GENERAL NOTES:
1. THE LOCATION OF CHANNELIZING DEVICES AND THE WORK AREA LAYOUT SHALL BE BASED ON THE CRITERIA IN THE FOLLOWING TABLE:
POSTED SPEED AND/OR DESIGN SPEED | MAXIMUM CHANNELIZING DEVICE SPACING (ft) TAPER | ALONG LANE LINE & WORK ZONE | LONGITUDINAL BUFFER SPACE (ft) †† | TAPER LENGTH (ft) †
mph | 40 | 80 | 305 | 320
≤40 | 45 | 90 | 360 | 540
45 | 50 | 100 | 425 | 600
50 | 55 | 110 | 495 | 660
55 | 60 | 120 | 570 | 720
60 | 65 | 130 | 645 | 780
65 | 70 | 140 | 730 | 840
† NOTE: TAPER LENGTHS ARE DETERMINED USING THE FOLLOWING EQUATIONS:
L = WS FOR SPEEDS OF 45 mph OR GREATER
L = WS²/60 FOR SPEEDS OF 40 mph OR LESS
WHERE: L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET (USUALLY LANE WIDTH) IN FEET
S = DESIGN SPEED OR 85TH PERCENTILE SPEED IN MILES PER HOUR
†† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRY TO MEET SIGHT DISTANCE REQUIREMENTS, AS DIRECTED BY THE ENGINEER.
2. FLASHING ARROW PANEL SHOULD BE AS LEVEL AS POSSIBLE AS APPROVED BY THE ENGINEER. FLASHING ARROW PANEL SHOULD BE LOCATED AT THE BEGINNING OF THE TAPER OR, IF THE SHOULDER IS TOO NARROW, BEHIND THE CHANNELIZING DEVICES IN THE CLOSED LANE.
3. CHANNELIZING DEVICE TYPES FOR:
A. APPROACH TAPER- RETROREFLECTIVE PLASTIC DRUMS
B. ALONG LANE LINE AND WORK ZONE- RETROREFLECTIVE TRAFFIC CONES OR TUBULAR MARKERS (28" HEIGHT MINIMUM)
C. EXIT TAPER- RETROREFLECTIVE TRAFFIC CONES OR TUBULAR MARKERS (28" HEIGHT MINIMUM)
4. WHEN WORK ZONE IS NO LONGER NEEDED, ALL SIGNS SHALL BE COVERED OR REMOVED AND THE DRUMS OR CONES OR TUBULAR MARKERS SHALL BE MOVED TO THE SHOULDER EDGE AT THE END OF THE WORK DAY.
5. FOR MOVING OPERATIONS (PAVING) THE CONTRACTOR SHALL HAVE TWO (2) SETS OF ADVANCE WARNING SIGNS, PLASTIC DRUMS, AND ARROW BOARD. WHEN THE CONSTRUCTION ZONE IS MOVED AHEAD, ALL SIGNS, PLASTIC DRUMS AND ARROW BOARD SHALL BE IN PLACE ON THE SECOND SET BEFORE REMOVING ANY SIGNS, PLASTIC DRUMS OR ARROW BOARD ON THE FIRST ZONE.
6. ALL WARNING SIGNS (W SERIES) SHALL BE A MINIMUM OF 48" X 48", AND SHALL BE BLACK COPY ON FLUORESCENT ORANGE SHEETING.
7. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.

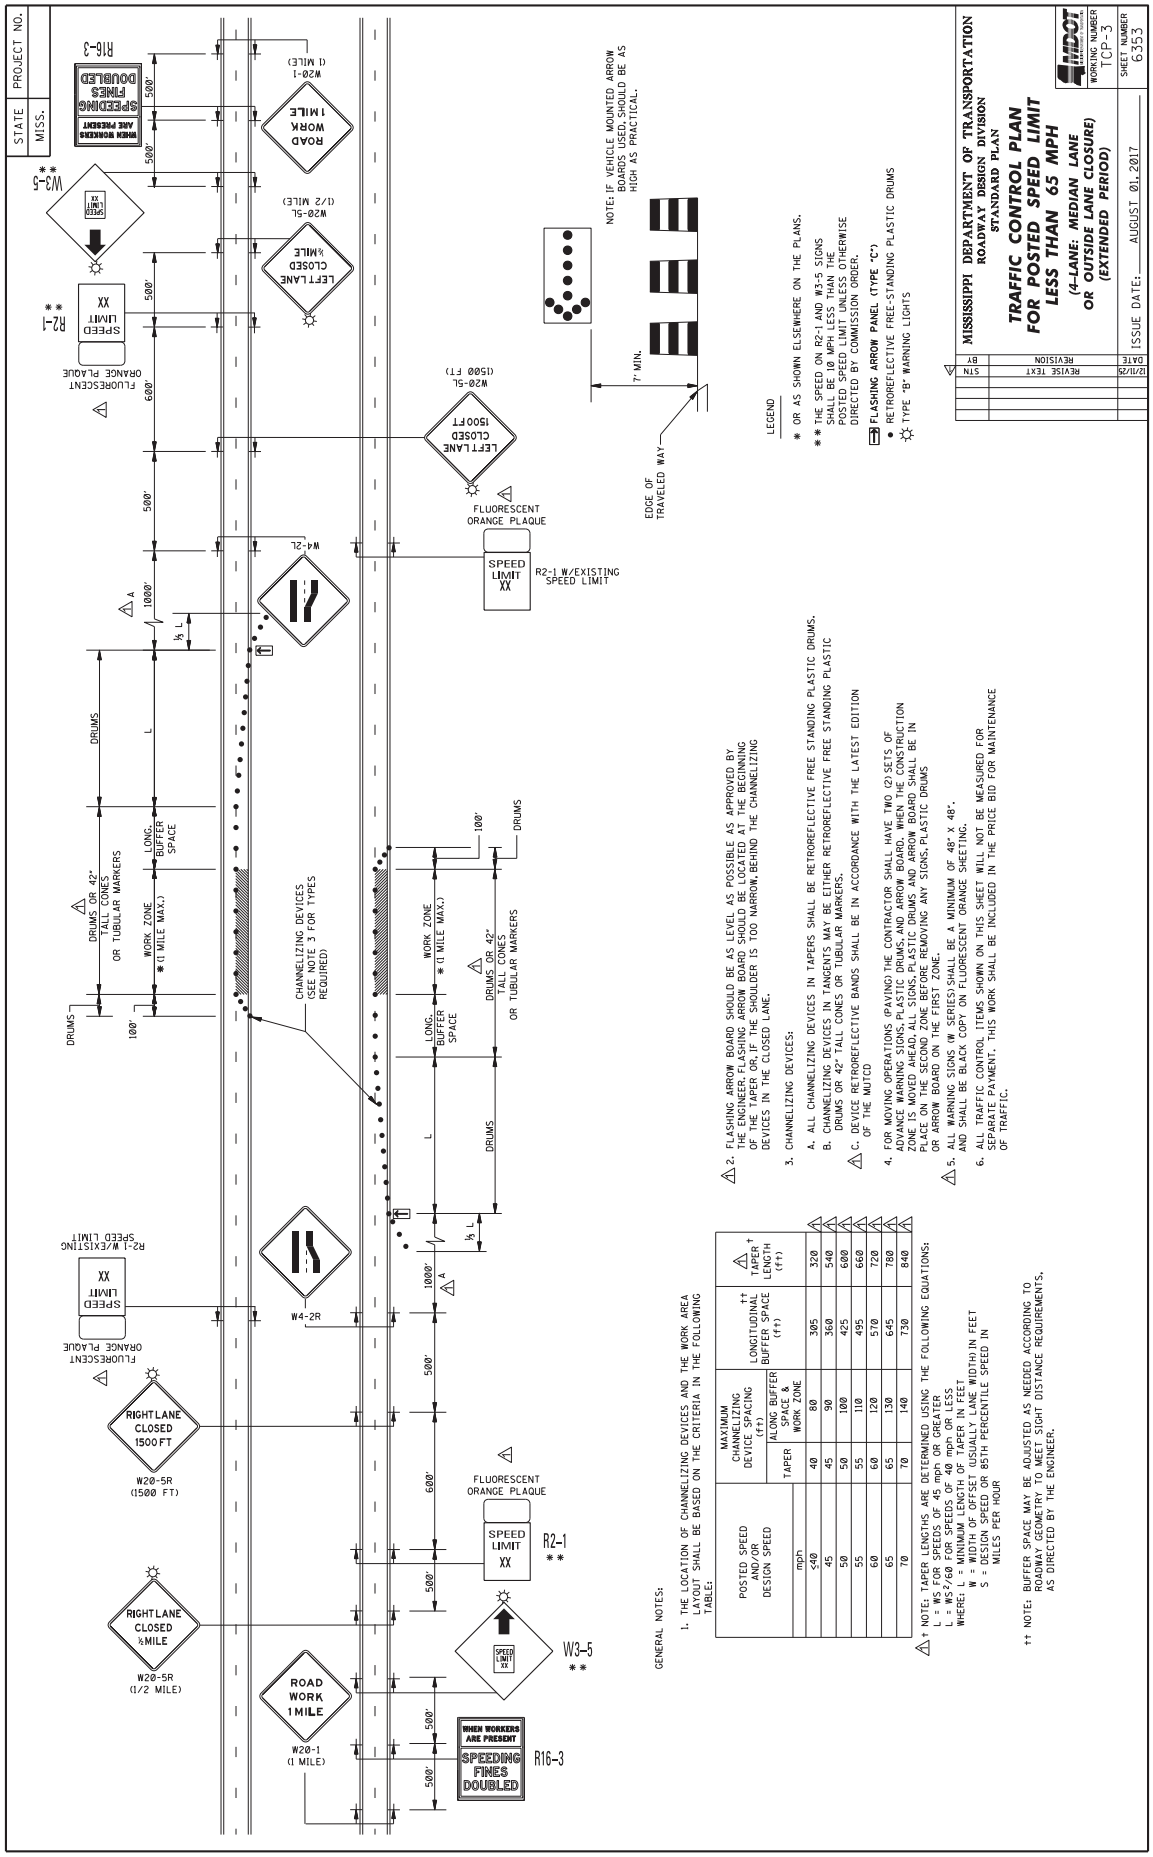
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TRAFFIC CONTROL PLAN
FOR POSTED SPEED LIMIT
LESS THAN 65 MPH
(4-LANE: MEDIAN LANE
OR OUTSIDE LANE CLOSURE)
(EXTENDED PERIOD)
WORKING NUMBER TCP-3
SHEET NUMBER 6353
ISSUE DATE: AUGUST 01, 2017
REVISION
DATE
BY
12/11/20 REVISE TEXT STN
LEGEND
* OR AS SHOWN ELSEWHERE ON THE PLANS.
** THE SPEED ON R2-1 AND W3-5 SIGNS SHALL BE 10 MPH LESS THAN THE POSTED SPEED LIMIT UNLESS OTHERWISE DIRECTED BY COMMISSION ORDER.
FLASHING ARROW PANEL (TYPE "C")
RETROREFLECTIVE FREE-STANDING PLASTIC DRUMS
TYPE "B" WARNING LIGHTS
NOTE: IF VEHICLE MOUNTED ARROW BOARDS USED, SHOULD BE AS HIGH AS PRACTICAL.
7' MIN.
EDGE OF TRAVELED WAY
ROAD WORK 1 MILE
W20-1 (1 MILE)
LEFT LANE CLOSED ½ MILE
W20-5L (1/2 MILE)
LEFT LANE CLOSED 1500 FT
W20-5L (1500 FT)
RIGHT LANE CLOSED ½ MILE
W20-5R (1/2 MILE)
RIGHT LANE CLOSED 1500 FT
W20-5R (1500 FT)
WHEN WORKERS ARE PRESENT
SPEEDING FINES DOUBLED
R16-3
W3-5 **
SPEED LIMIT XX
R2-1 **
SPEED LIMIT XX
R2-1 W/EXISTING SPEED LIMIT
FLUORESCENT ORANGE PLAQUE
W4-2L
W4-2R
DRUMS
DRUMS OR 42" TALL CONES OR TUBULAR MARKERS
WORK ZONE * (1 MILE MAX.)
LONG. BUFFER SPACE
CHANNELIZING DEVICES (SEE NOTE 3 FOR TYPES REQUIRED)
100'
500'
600'
1000'
A
½ L
L
GENERAL NOTES:
1. THE LOCATION OF CHANNELIZING DEVICES AND THE WORK AREA LAYOUT SHALL BE BASED ON THE CRITERIA IN THE FOLLOWING TABLE:
POSTED SPEED / DESIGN SPEED | MAXIMUM CHANNELIZING DEVICE SPACING (ft) | LONGITUDINAL† BUFFER SPACE (ft) | TAPER† LENGTH (ft)
TAPER | ALONG BUFFER SPACE & WORK ZONE
mph
≤40 40 80 305 320
45 45 90 360 540
50 50 100 425 600
55 55 110 495 660
60 60 120 570 720
65 65 130 645 780
70 70 140 730 840
† NOTE: TAPER LENGTHS ARE DETERMINED USING THE FOLLOWING EQUATIONS:
L = WS²/60 FOR SPEEDS OF 45 mph OR LESS
L = WS/60 FOR SPEEDS OF 40 mph OR LESS
WHERE: L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET (USUALLY LANE WIDTH) IN FEET
S = DESIGN SPEED OR 85TH PERCENTILE SPEED IN MILES PER HOUR
†† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRY TO MEET SIGHT DISTANCE REQUIREMENTS, AS DIRECTED BY THE ENGINEER.
2. FLASHING ARROW BOARD SHOULD BE AS LEVEL AS POSSIBLE AS APPROVED BY THE ENGINEER. FLASHING ARROW BOARD SHOULD BE LOCATED AT THE BEGINNING OF THE TAPER ONLY IF THE SHOULDER IS TOO NARROW, BEHIND THE CHANNELIZING DEVICES IN THE CLOSED LANE.
3. CHANNELIZING DEVICES:
A. ALL CHANNELIZING DEVICES IN TAPERS SHALL BE RETROREFLECTIVE FREE STANDING PLASTIC DRUMS.
B. CHANNELIZING DEVICES IN TANGENTS MAY BE EITHER RETROREFLECTIVE FREE STANDING PLASTIC DRUMS OR 42" TALL CONES OR TUBULAR MARKERS.
C. DEVICE RETROREFLECTIVE BANDS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE MUTCD
4. FOR MOVING OPERATIONS (PAVING) THE CONTRACTOR SHALL HAVE TWO (2) SETS OF ADVANCE WARNING SIGNS, PLASTIC DRUMS, AND ARROW BOARD. WHEN THE CONSTRUCTION ZONE IS MOVED AHEAD, ALL SIGNS, PLASTIC DRUMS AND ARROW BOARD SHALL BE IN PLACE ON THE SECOND ZONE BEFORE REMOVING ANY SIGNS, PLASTIC DRUMS OR ARROW BOARD ON THE FIRST ZONE.
5. ALL WARNING SIGNS (W SERIES) SHALL BE A MINIMUM OF 48" X 48", AND SHALL BE BLACK COPY ON FLUORESCENT ORANGE SHEETING.
6. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.

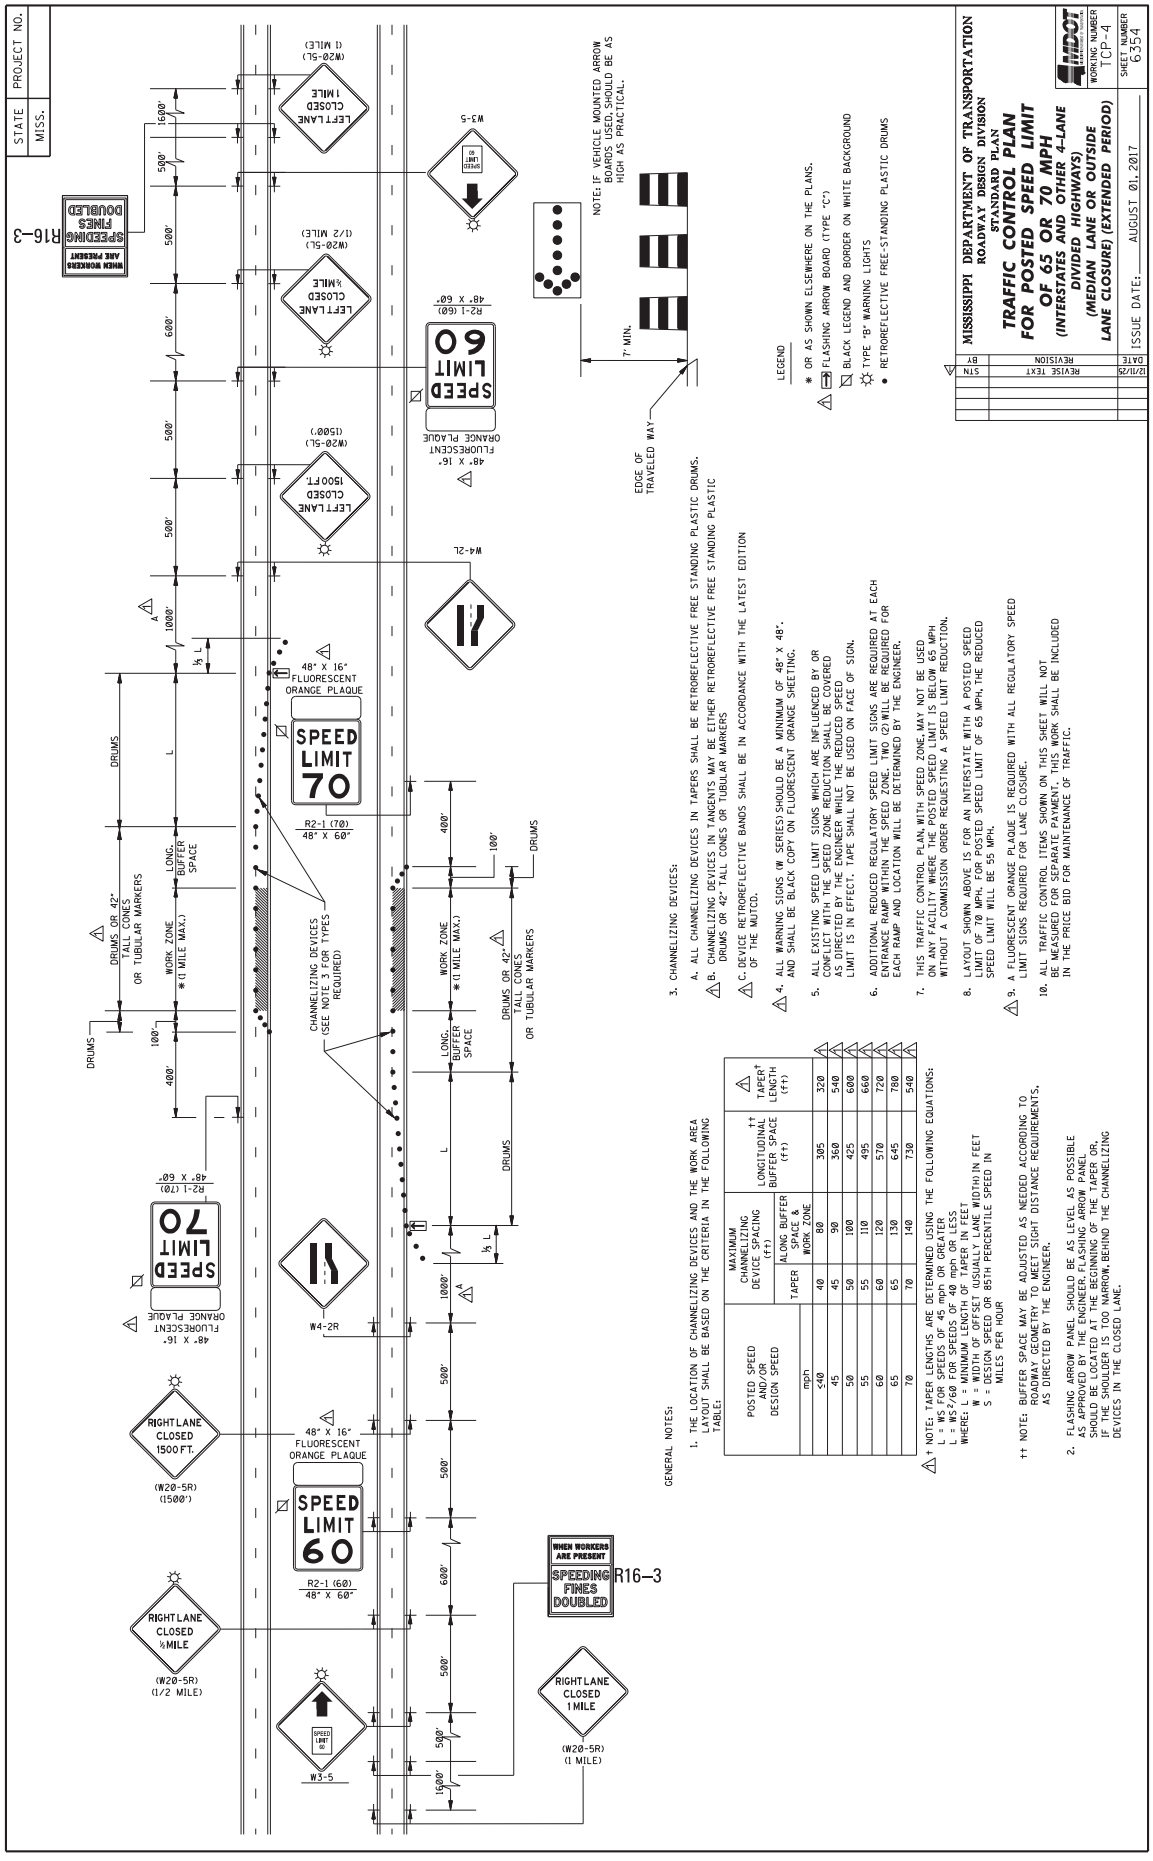
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TRAFFIC CONTROL PLAN
FOR POSTED SPEED LIMIT
OF 65 OR 70 MPH
(INTERSTATES AND OTHER 4-LANE DIVIDED HIGHWAYS)
(MEDIAN LANE OR OUTSIDE LANE CLOSURE) (EXTENDED PERIOD)
WORKING NUMBER TCP-4
SHEET NUMBER 6354
ISSUE DATE: AUGUST 01, 2017
REVISE TEXT 12/11/25 STN
DATE REVISION BY
LEGEND
* OR AS SHOWN ELSEWHERE ON THE PLANS.
FLASHING ARROW BOARD (TYPE "C")
BLACK LEGEND AND BORDER ON WHITE BACKGROUND
TYPE "B" WARNING LIGHTS
RETROREFLECTIVE FREE-STANDING PLASTIC DRUMS
GENERAL NOTES:
1. THE LOCATION OF CHANNELIZING DEVICES AND THE WORK AREA LAYOUT SHALL BE BASED ON THE CRITERIA IN THE FOLLOWING TABLE:
POSTED SPEED AND/OR DESIGN SPEED
MAXIMUM CHANNELIZING DEVICE SPACING (FEET)
TAPER
ALONG BUFFER SPACE & WORK ZONE
LONGITUDINAL BUFFER SPACE (ft)
TAPER† LENGTH (ft)
mph
<40 40 80 305 320
45 45 90 360 540
50 50 100 425 600
55 55 110 495 660
60 60 120 570 720
65 65 130 645 780
70 70 140 730 540
† NOTE: TAPER LENGTHS ARE DETERMINED USING THE FOLLOWING EQUATIONS:
L = WS FOR SPEEDS OF 45 mph OR GREATER
L = WS²/60 FOR SPEEDS OF 40 mph OR LESS
WHERE: L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET (USUALLY LANE WIDTH) IN FEET
S = DESIGN SPEED OR 85TH PERCENTILE SPEED IN MILES PER HOUR
†† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRICS TO ENSURE SIGHT DISTANCE REQUIREMENTS AS DIRECTED BY THE ENGINEER.
2. FLASHING ARROW PANEL SHOULD BE AS LEVEL AS POSSIBLE AS APPROVED BY THE ENGINEER. FLASHING ARROW PANEL SHOULD BE LOCATED AT THE BEGINNING OF THE TAPER OR, IF THE SHOULDER IS TOO NARROW, BEHIND THE CHANNELIZING DEVICES IN THE CLOSED LANE.
3. CHANNELIZING DEVICES:
A. ALL CHANNELIZING DEVICES IN TAPERS SHALL BE RETROREFLECTIVE FREE STANDING PLASTIC DRUMS.
B. CHANNELIZING DEVICES IN TANGENTS MAY BE EITHER RETROREFLECTIVE FREE STANDING PLASTIC DRUMS OR 42" TALL CONES OR TUBULAR MARKERS
C. DEVICE RETROREFLECTIVE BANDS SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE MUTCD.
4. ALL WARNING SIGNS (W SERIES) SHOULD BE A MINIMUM OF 48" X 48". AND SHALL BE BLACK COPY ON FLUORESCENT ORANGE SHEETING.
5. ALL EXISTING SPEED LIMIT SIGNS WHICH ARE INFLUENCED BY OR CONFLICT WITH THE SPEED ZONE REDUCTION SHALL BE COVERED AS DIRECTED BY THE ENGINEER. WHEN THE REDUCED SPEED LIMIT IS IN EFFECT. TAPE SHALL NOT BE USED ON FACE OF SIGN.
6. ADDITIONAL REDUCED REGULATORY SPEED LIMIT SIGNS ARE REQUIRED AT EACH ENTRANCE RAMP WITHIN THE SPEED ZONE. TWO (2) WILL BE REQUIRED FOR EACH RAMP AND LOCATION WILL BE DETERMINED BY THE ENGINEER.
7. THIS TRAFFIC CONTROL PLAN, WITH SPEED ZONE, MAY NOT BE USED ON ANY FACILITY WHERE THE POSTED SPEED LIMIT IS BELOW 65 MPH WITHOUT A COMMISSION ORDER REQUESTING A SPEED LIMIT REDUCTION.
8. LAYOUT SHOWN ABOVE IS FOR AN INTERSTATE WITH A POSTED SPEED LIMIT OF 70 MPH AND A POSTED SPEED LIMIT OF 65 MPH, THE REDUCED SPEED LIMIT WILL BE 55 MPH.
9. A FLUORESCENT ORANGE PLAQUE IS REQUIRED WITH ALL REGULATORY SPEED LIMIT SIGNS REQUIRED FOR LANE CLOSURE.
10. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.
NOTE: IF VEHICLE MOUNTED ARROW BOARDS USED, SHOULD BE AS HIGH AS PRACTICAL.
7' MIN.
EDGE OF TRAVELED WAY
W4-2L
W4-2R
W3-5
R2-1 (60) 48" X 60"
R2-1 (70) 48" X 60"
48" X 16" FLUORESCENT ORANGE PLAQUE
SPEED LIMIT 70
SPEED LIMIT 60
R16-3
SPEEDING FINES DOUBLED
WHEN WORKERS ARE PRESENT
LEFT LANE CLOSED 1 MILE (M20-5L) (1 MILE)
LEFT LANE CLOSED ½ MILE (M20-5L) (1/2 MILE)
LEFT LANE CLOSED 1500 FT (M20-5L) (1500')
RIGHT LANE CLOSED 1500 FT. (W20-5R) (1500')
RIGHT LANE CLOSED ½ MILE (W20-5R) (1/2 MILE)
RIGHT LANE CLOSED 1 MILE (W20-5R) (1 MILE)
DRUMS OR 42" TALL CONES OR TUBULAR MARKERS
WORK ZONE * (1 MILE MAX.)
LONG. BUFFER SPACE
CHANNELIZING DEVICES (SEE NOTE 3 FOR TYPES REQUIRED)
DRUMS
L
½ L
A
100'
400'
500'
600'
1000'
1500'

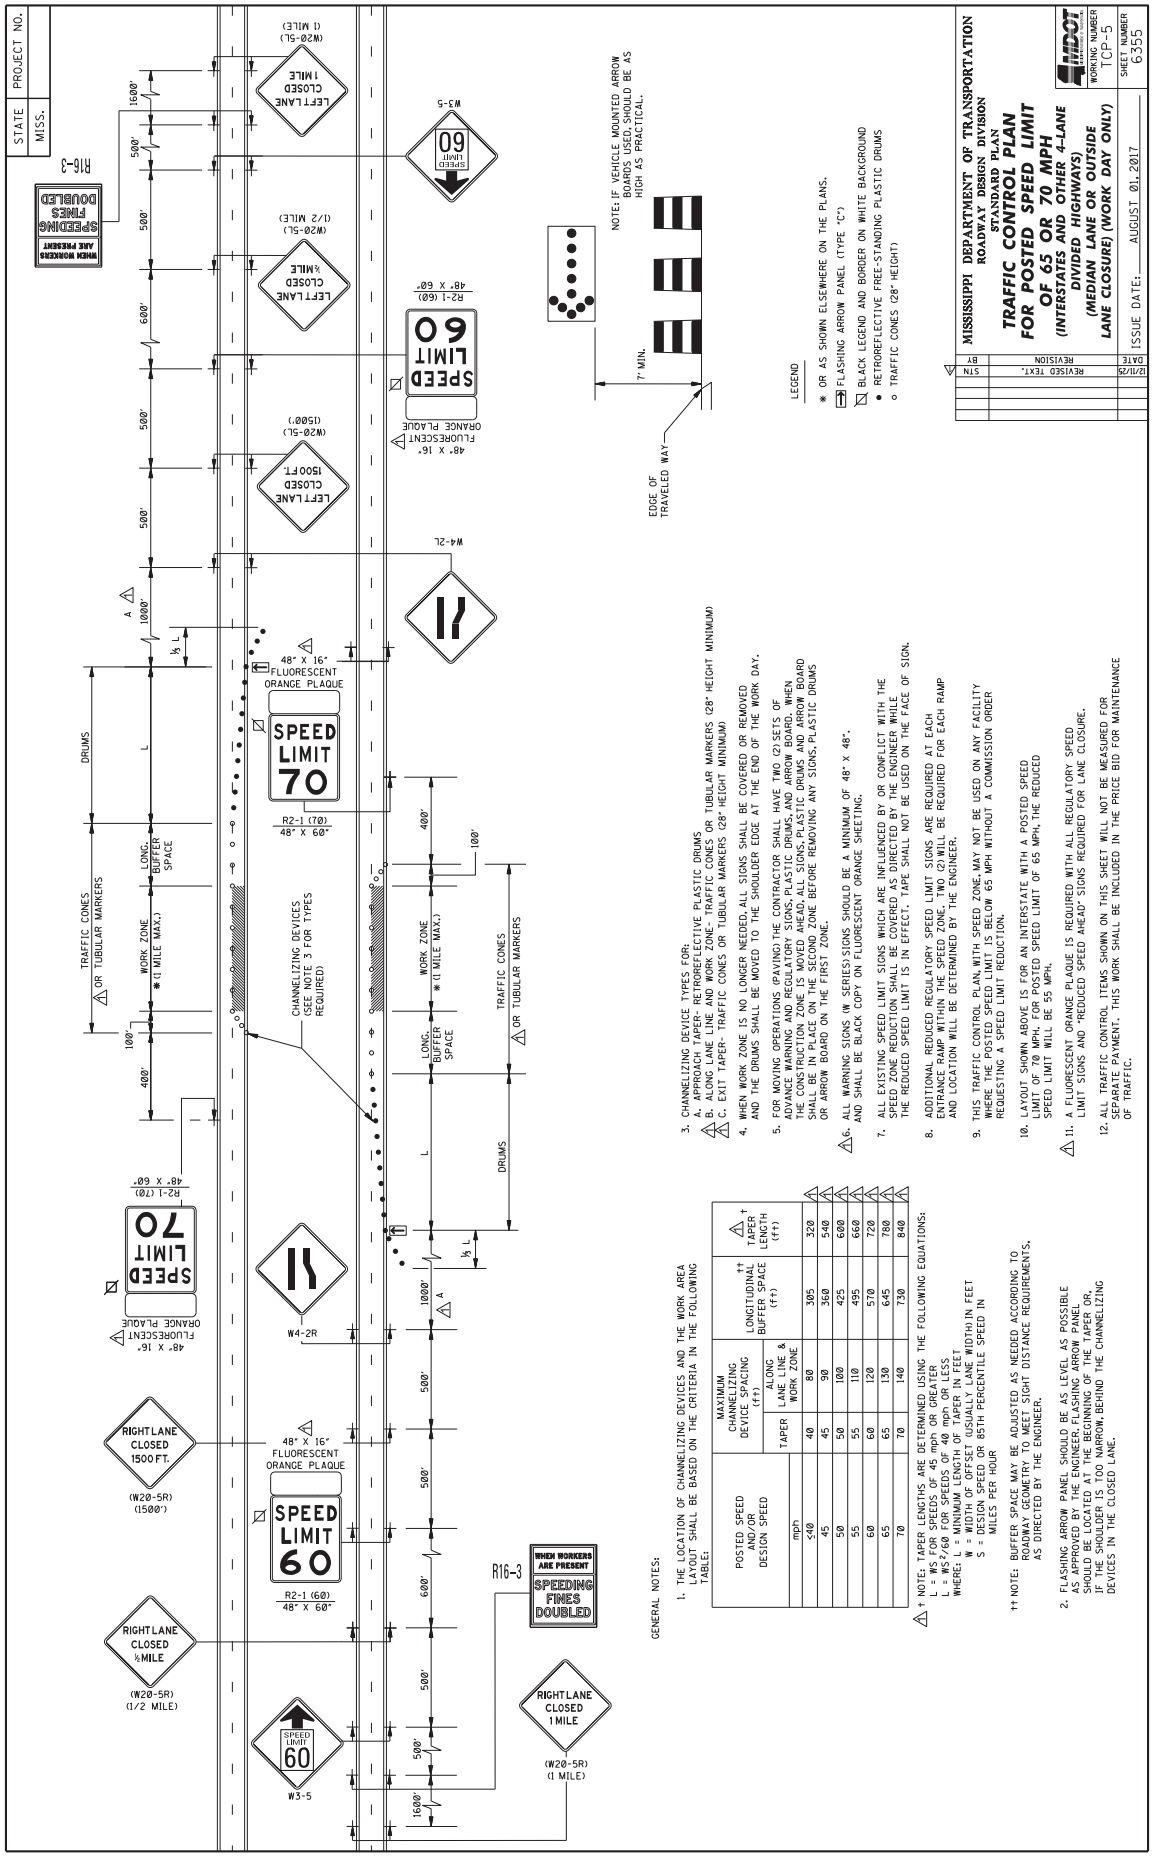
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TRAFFIC CONTROL PLAN
FOR POSTED SPEED LIMIT
OF 65 OR 70 MPH
(INTERSTATES AND OTHER 4-LANE DIVIDED HIGHWAYS)
(MEDIAN LANE OR OUTSIDE LANE CLOSURE) (WORK DAY ONLY)
ISSUE DATE: AUGUST 01, 2017
WORKING NUMBER TCP-5
SHEET NUMBER 6355
REVISED TEXT.
SPEED LIMIT 70
SPEED LIMIT 60
RIGHT LANE CLOSED 1500 FT.
RIGHT LANE CLOSED ½MILE
RIGHT LANE CLOSED 1 MILE
LEFT LANE CLOSED 1 MILE
LEFT LANE CLOSED ½MILE
LEFT LANE CLOSED 1500 FT.
WHEN WORKERS ARE PRESENT
SPEEDING FINES DOUBLED
TRAFFIC CONES OR TUBULAR MARKERS
WORK ZONE * (1 MILE MAX.)
LONG. BUFFER SPACE
DRUMS
CHANNELIZING DEVICES (SEE NOTE 3 FOR TYPES REQUIRED)
FLUORESCENT ORANGE PLAQUE
EDGE OF TRAVELED WAY
7' MIN.
NOTE: IF VEHICLE MOUNTED ARROW BOARDS USED, SHOULD BE AS HIGH AS PRACTICAL.
LEGEND
* OR AS SHOWN ELSEWHERE ON THE PLANS.
FLASHING ARROW PANEL (TYPE "C")
BLACK LEGEND AND BORDER ON WHITE BACKGROUND
RETROREFLECTIVE FREE-STANDING PLASTIC DRUMS
TRAFFIC CONES (28" HEIGHT)
GENERAL NOTES:
1. THE LOCATION OF CHANNELIZING DEVICES AND THE WORK AREA LAYOUT SHALL BE BASED ON THE CRITERIA IN THE FOLLOWING TABLE:
POSTED SPEED AND/OR DESIGN SPEED
MAXIMUM CHANNELIZING DEVICE SPACING (††)
TAPER
ALONG LANE LINE & WORK ZONE
LONGITUDINAL BUFFER SPACE (††)
TAPER † (††)
mph
≤40 40 80 305 320
45 45 90 360 540
50 50 100 425 600
55 55 110 495 660
60 60 120 570 720
65 65 130 645 780
70 70 140 730 840
† NOTE: TAPER LENGTHS ARE DETERMINED USING THE FOLLOWING EQUATIONS:
L = WS FOR SPEEDS OF 45 mph OR GREATER
L = WS²/60 FOR SPEEDS OF 40 mph OR LESS
WHERE: L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET (USUALLY LANE WIDTH) IN FEET
S = DESIGN SPEED OR 85TH PERCENTILE SPEED IN MILES PER HOUR
†† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRY TO MEET SIGHT DISTANCE REQUIREMENTS, AS DIRECTED BY THE ENGINEER.
2. FLASHING ARROW PANEL SHOULD BE AS LEVEL AS POSSIBLE AS APPROVED BY THE ENGINEER. FLASHING ARROW PANEL SHOULD BE LOCATED AT THE BEGINNING OF THE TAPER OR, IF THE SHOULDER IS TOO NARROW, BEHIND THE CHANNELIZING DEVICES IN THE CLOSED LANE.
3. CHANNELIZING DEVICE TYPES FOR:
A. APPROACH TAPER- RETROREFLECTIVE PLASTIC DRUMS
B. ALONG LANE LINE AND WORK ZONE- TRAFFIC CONES OR TUBULAR MARKERS (28" HEIGHT MINIMUM)
C. EXIT TAPER- TRAFFIC CONES OR TUBULAR MARKERS (28" HEIGHT MINIMUM)
4. WHEN WORK ZONE IS NO LONGER NEEDED, ALL SIGNS SHALL BE COVERED OR REMOVED AND THE DRUMS SHALL BE MOVED TO THE SHOULDER EDGE AT THE END OF THE WORK DAY.
5. FOR MOVING OPERATIONS (PAVING) THE CONTRACTOR SHALL HAVE TWO (2) SETS OF ADVANCE WARNING AND REGULATORY SIGNS, PLASTIC DRUMS, AND ARROW BOARD. WHEN THE CONSTRUCTION ZONE IS MOVED AHEAD, ALL SIGNS, PLASTIC DRUMS AND ARROW BOARD SHALL BE IN PLACE ON THE SECOND ZONE BEFORE REMOVING ANY SIGNS, PLASTIC DRUMS OR ARROW BOARD ON THE FIRST ZONE.
6. ALL WARNING SIGNS (W SERIES) SIGNS SHOULD BE A MINIMUM OF 48" X 48", AND SHALL BE BLACK COPY ON FLUORESCENT ORANGE SHEETING.
7. ALL EXISTING SPEED LIMIT SIGNS WHICH ARE INFLUENCED BY OR CONFLICT WITH THE SPEED ZONE REDUCTION SHALL BE COVERED AS DIRECTED BY THE ENGINEER WHILE THE REDUCED SPEED LIMIT IS IN EFFECT. TAPE SHALL NOT BE USED ON THE FACE OF SIGN.
8. ADDITIONAL REDUCED REGULATORY SPEED LIMIT SIGNS ARE REQUIRED AT EACH ENTRANCE RAMP WITHIN THE SPEED ZONE. TWO (2) WILL BE REQUIRED FOR EACH RAMP AND LOCATION WILL BE DETERMINED BY THE ENGINEER.
9. THIS TRAFFIC CONTROL PLAN, WITH SPEED ZONE, MAY NOT BE USED ON ANY FACILITY WHERE THE POSTED SPEED LIMIT IS BELOW 65 MPH WITHOUT A COMMISSION ORDER REQUESTING A SPEED LIMIT REDUCTION.
10. LAYOUT SHOWN ABOVE IS FOR AN INTERSTATE WITH A POSTED SPEED LIMIT OF 70 MPH. FOR POSTED SPEED LIMIT OF 65 MPH, THE REDUCED SPEED LIMIT WILL BE 55 MPH.
11. A FLUORESCENT ORANGE PLAQUE IS REQUIRED WITH ALL REGULATORY SPEED LIMIT SIGNS AND "REDUCED SPEED AHEAD" SIGNS REQUIRED FOR LANE CLOSURE.
12. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.

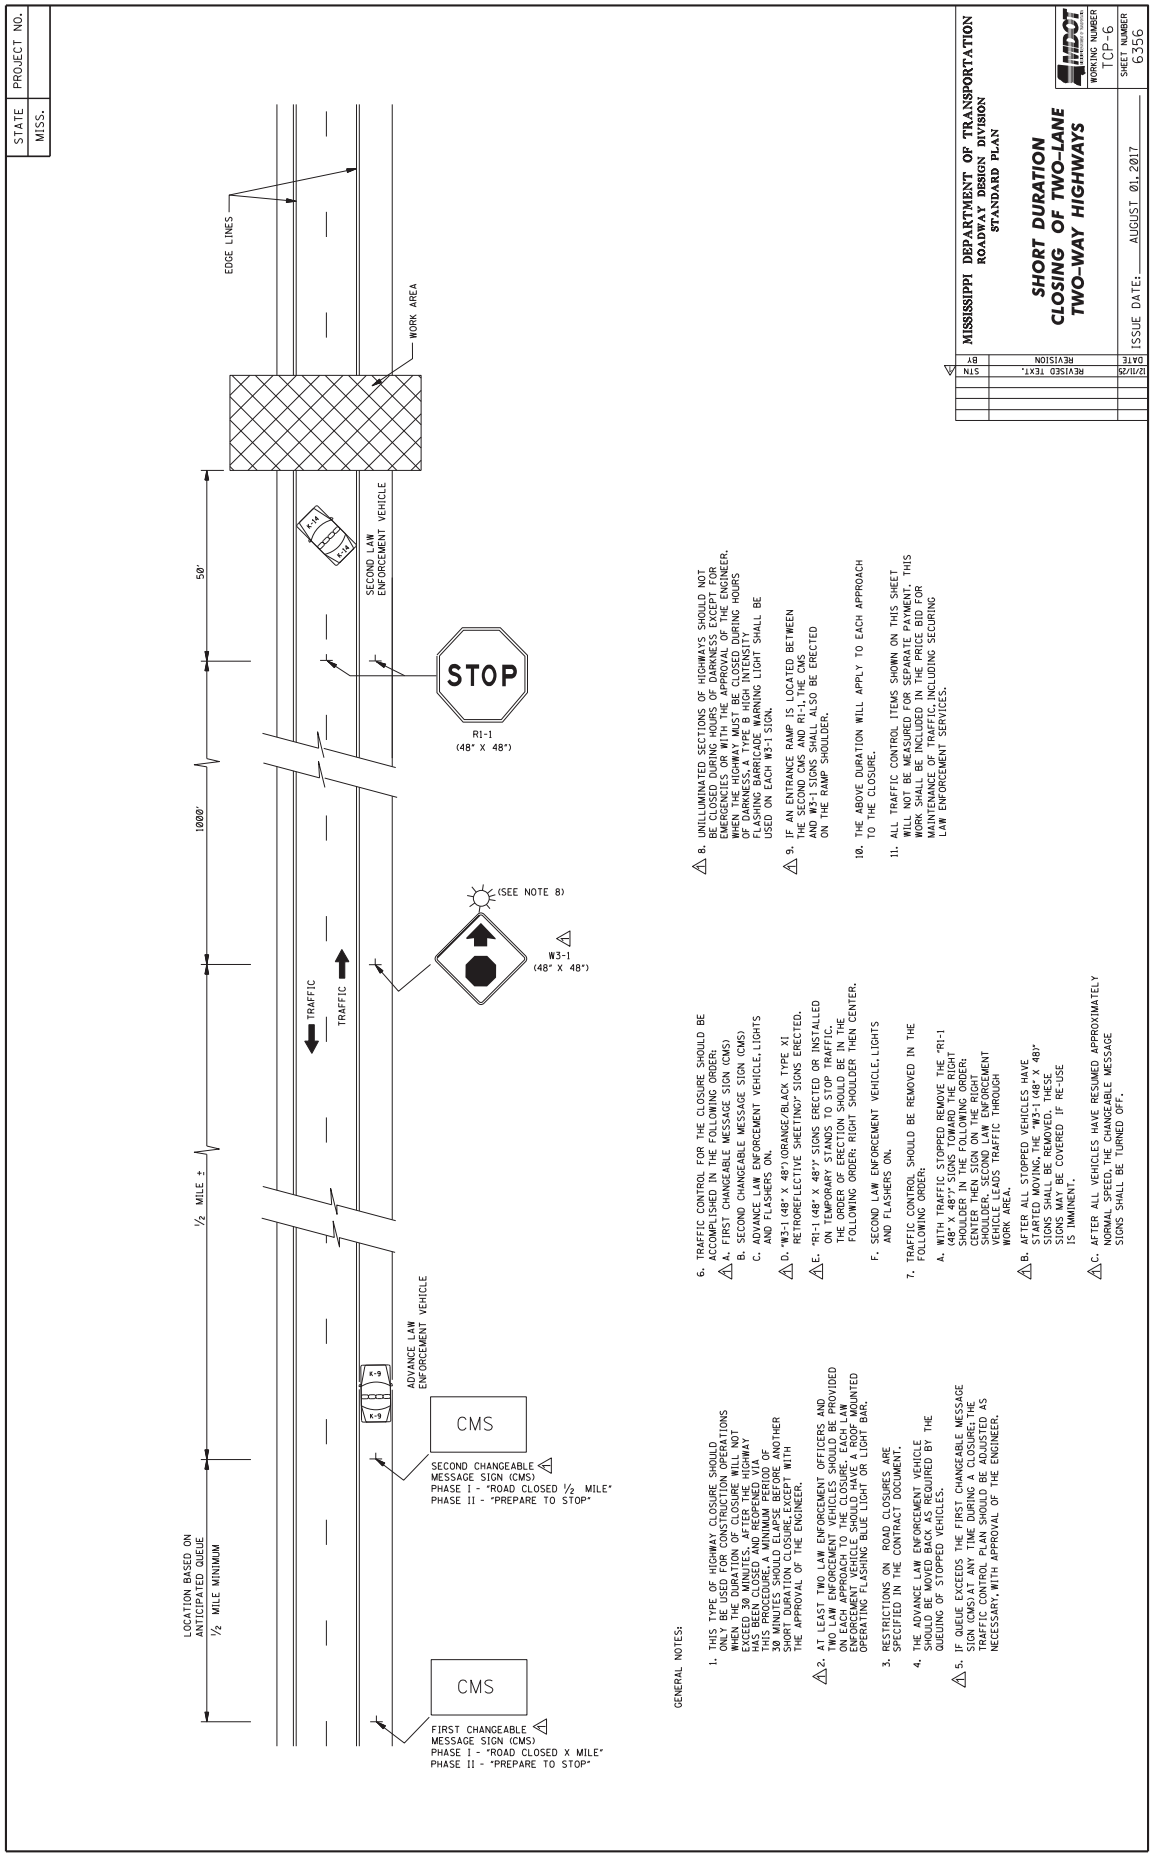
STATE
MISS.
PROJECT NO.
EDGE LINES
WORK AREA
SECOND LAW ENFORCEMENT VEHICLE
STOP
R1-1
(48" X 48")
50'
1000'
½ MILE ±
TRAFFIC
TRAFFIC
(SEE NOTE 8)
W3-1
(48" X 48")
ADVANCE LAW ENFORCEMENT VEHICLE
CMS
SECOND CHANGEABLE MESSAGE SIGN (CMS)
PHASE I - "ROAD CLOSED ½ MILE"
PHASE II - "PREPARE TO STOP"
CMS
FIRST CHANGEABLE MESSAGE SIGN (CMS)
PHASE I - "ROAD CLOSED X MILE"
PHASE II - "PREPARE TO STOP"
LOCATION BASED ON ANTICIPATED QUEUE
½ MILE MINIMUM
GENERAL NOTES:
1. THIS TYPE OF HIGHWAY CLOSURE SHOULD ONLY BE USED FOR CONSTRUCTION OPERATIONS WHEN THE DURATION OF CLOSURE WILL NOT EXCEED 30 MINUTES. AFTER THE HIGHWAY HAS BEEN CLOSED AND ESCORTED VIA THIS PROCEDURE, A MINIMUM PERIOD OF 30 MINUTES SHOULD ELAPSE BEFORE ANOTHER SHORT DURATION CLOSURE, EXCEPT WITH THE APPROVAL OF THE ENGINEER.
2. AT LEAST TWO LAW ENFORCEMENT OFFICERS AND TWO LAW ENFORCEMENT VEHICLES SHOULD BE PROVIDED ON EACH APPROACH TO THE CLOSURE. EACH LAW ENFORCEMENT VEHICLE SHOULD HAVE A ROOF-MOUNTED OPERATING FLASHING BLUE LIGHT OR LIGHT BAR.
3. RESTRICTIONS ON ROAD CLOSURES ARE SPECIFIED IN THE CONTRACT DOCUMENT.
4. THE ADVANCE LAW ENFORCEMENT VEHICLE SHOULD BE MOVED BACK AS REQUIRED BY THE QUEUING OF STOPPED VEHICLES.
5. IF QUEUE EXCEEDS THE FIRST CHANGEABLE MESSAGE SIGN (CMS) AT ANY TIME DURING A CLOSURE, THE TRAFFIC CONTROL PLAN SHOULD BE ADJUSTED AS NECESSARY, WITH APPROVAL OF THE ENGINEER.
6. TRAFFIC CONTROL FOR THE CLOSURE SHOULD BE ACCOMPLISHED IN THE FOLLOWING ORDER:
A. FIRST CHANGEABLE MESSAGE SIGN (CMS)
B. SECOND CHANGEABLE MESSAGE SIGN (CMS)
C. ADVANCE LAW ENFORCEMENT VEHICLE, LIGHTS AND FLASHERS ON.
D. W3-1 (48" X 48") ORANGE/BLACK TYPE XI RETROREFLECTIVE SHEETING SIGNS ERECTED.
E. "R1-1 (48" X 48")" SIGNS ERECTED OR INSTALLED ON TEMPORARY STANDS TO STOP TRAFFIC, THE ORDER OF ERECTION SHOULD BE IN THE FOLLOWING ORDER: RIGHT SHOULDER THEN CENTER.
F. SECOND LAW ENFORCEMENT VEHICLE, LIGHTS AND FLASHERS ON.
7. TRAFFIC CONTROL SHOULD BE REMOVED IN THE FOLLOWING ORDER:
A. WITH TRAFFIC STOPPED REMOVE THE "R1-1 (48" X 48")" SIGNS FROM THE ROADWAY; SHOULDER IN THE FOLLOWING ORDER: CENTER THEN SIGN ON THE RIGHT SHOULDER. SECOND LAW ENFORCEMENT VEHICLE LEADS TRAFFIC THROUGH WORK AREA.
B. AFTER ALL STOPPED VEHICLES HAVE STARTED MOVING REMOVE THE W3-1 (48" X 48") SIGNS. THESE SIGNS MAY BE COVERED IF RE-USE IS IMMINENT.
C. AFTER ALL VEHICLES HAVE RESUMED APPROXIMATELY NORMAL SPEED, THE CHANGEABLE MESSAGE SIGNS SHALL BE TURNED OFF.
8. UNILLUMINATED SECTIONS OF HIGHWAYS SHOULD NOT BE CLOSED DURING HOURS OF DARKNESS EXCEPT FOR EMERGENCIES OR WITH THE APPROVAL OF THE ENGINEER. WHEN THE HIGHWAY MUST BE CLOSED DURING HOURS OF DARKNESS, A TYPE B HIGH INTENSITY FLASHING BARRICADE WARNING LIGHT SHALL BE USED ON EACH W3-1 SIGN.
9. IF AN ENTRANCE RAMP IS LOCATED BETWEEN THE SECOND CMS AND R1-1, THE CMS AND W3-1 SIGNS SHALL ALSO BE ERECTED ON THE RAMP SHOULDER.
10. THE ABOVE DURATION WILL APPLY TO EACH APPROACH TO THE CLOSURE.
11. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT; THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC, INCLUDING SECURING LAW ENFORCEMENT SERVICES.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
SHORT DURATION CLOSING OF TWO-LANE TWO-WAY HIGHWAYS
WORKING NUMBER TCP-6
ISSUE DATE: AUGUST 01, 2017
SHEET NUMBER 6356
DATE REVISION BY
12/11/25 REVISED TEXT. STM

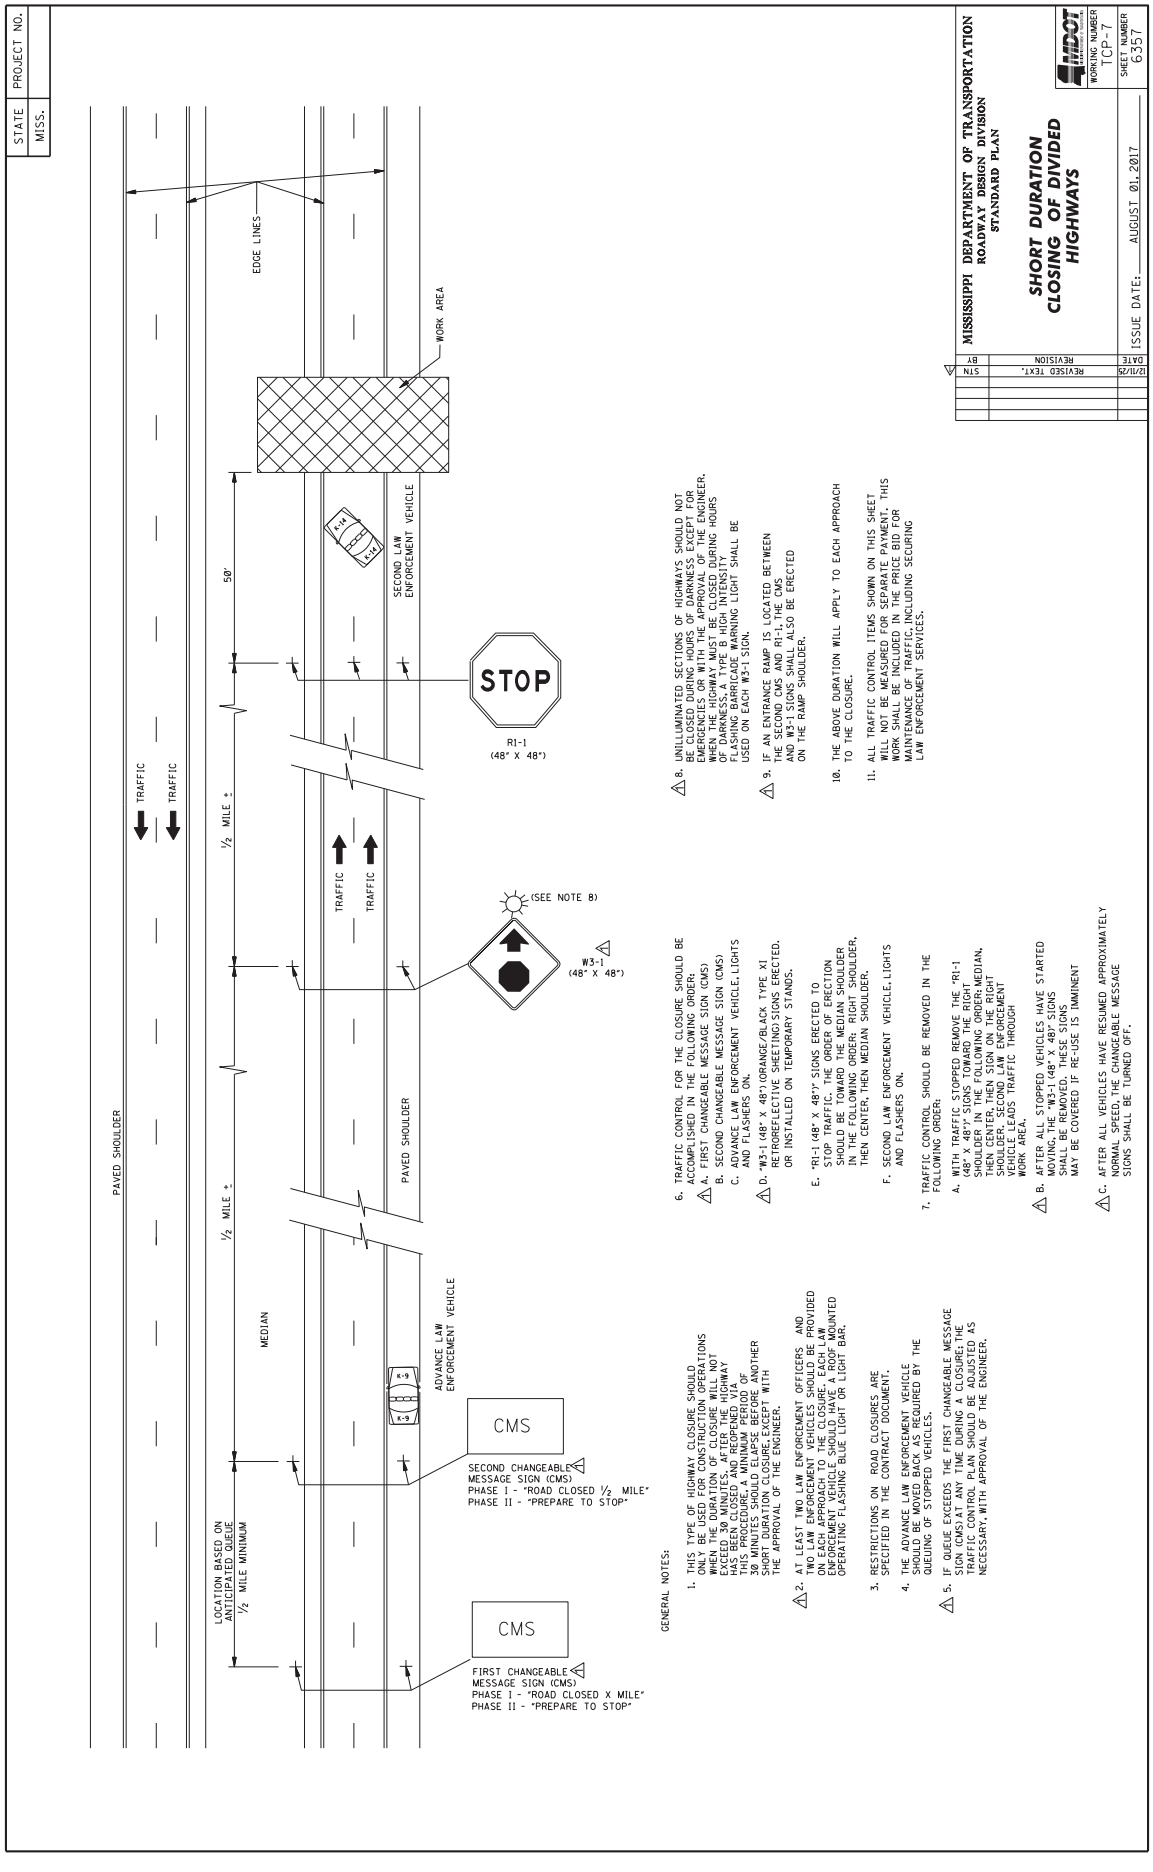
STATE
MISS.
PROJECT NO.
PAVED SHOULDER
TRAFFIC
TRAFFIC
½ MILE ±
EDGE LINES
50'
WORK AREA
SECOND LAW ENFORCEMENT VEHICLE
STOP
R1-1 (48" X 48")
TRAFFIC
TRAFFIC
(SEE NOTE 8)
W3-1 (48" X 48")
PAVED SHOULDER
½ MILE ±
MEDIAN
LOCATION BASED ON ANTICIPATED QUEUE ½ MILE MINIMUM
ADVANCE LAW ENFORCEMENT VEHICLE
CMS
SECOND CHANGEABLE MESSAGE SIGN (CMS) PHASE I - "ROAD CLOSED ½ MILE" PHASE II - "PREPARE TO STOP"
CMS
FIRST CHANGEABLE MESSAGE SIGN (CMS) PHASE I - "ROAD CLOSED X MILE" PHASE II - "PREPARE TO STOP"
GENERAL NOTES:
1. THIS TYPE OF HIGHWAY CLOSURE SHOULD ONLY BE USED FOR CONSTRUCTION OPERATIONS WHERE THE DURATION OF CLOSURE WILL NOT EXCEED 30 MINUTES, AFTER THE HIGHWAY HAS BEEN CLOSED AND REOPENED VIA THIS PROCEDURE, A MINIMUM PERIOD OF 30 MINUTES SHOULD ELAPSE BEFORE ANOTHER SHORT DURATION CLOSURE, EXCEPT WITH THE APPROVAL OF THE ENGINEER.
2. AT LEAST TWO LAW ENFORCEMENT OFFICERS AND TWO LAW ENFORCEMENT VEHICLES SHOULD BE PROVIDED ON EACH APPROACH TO THE CLOSURE. EACH LAW ENFORCEMENT VEHICLE SHOULD HAVE A ROOF MOUNTED OPERATING FLASHING BLUE LIGHT OR LIGHT BAR.
3. RESTRICTIONS ON ROAD CLOSURES ARE SPECIFIED IN THE CONTRACT DOCUMENT.
4. THE ADVANCE LAW ENFORCEMENT VEHICLE SHOULD BE MOVED BACK AS REQUIRED BY THE QUEUING OF STOPPED VEHICLES.
5. IF QUEUE EXCEEDS THE FIRST CHANGEABLE MESSAGE SIGN (CMS) AT ANY TIME DURING A CLOSURE, THE TRAFFIC CONTROL PLAN SHOULD BE ADJUSTED AS NECESSARY, WITH APPROVAL OF THE ENGINEER.
6. TRAFFIC CONTROL FOR THE CLOSURE SHOULD BE ACCOMPLISHED IN THE FOLLOWING ORDER:
A. FIRST CHANGEABLE MESSAGE SIGN (CMS)
B. SECOND CHANGEABLE MESSAGE SIGN (CMS)
C. ADVANCE LAW ENFORCEMENT VEHICLE, LIGHTS AND FLASHERS ON.
D. "W3-1 (48" X 48") (ORANGE/BLACK TYPE XI RETROREFLECTIVE SHEETING) SIGNS ERECTED. OR INSTALLED ON TEMPORARY STANDS.
E. "R1-1 (48" X 48") " SIGNS ERECTED TO STOP TRAFFIC, THE ORDER OF ERECTION SHOULD BE TOWARD THE MEDIAN SHOULDER ON THE FOLLOWING ORDER: RIGHT SHOULDER, THEN CENTER, THEN MEDIAN SHOULDER.
F. SECOND LAW ENFORCEMENT VEHICLE, LIGHTS AND FLASHERS ON.
7. TRAFFIC CONTROL SHOULD BE REMOVED IN THE FOLLOWING ORDER:
A. WITH TRAFFIC STOPPED REMOVE THE "R1-1 (48" X 48") SIGNS TOWARD THE RIGHT SHOULDER, THEN TOWARD THE MEDIAN, THEN CENTER, THEN SIGN ON THE RIGHT SHOULDER. SECOND LAW ENFORCEMENT VEHICLE LEADS TRAFFIC THROUGH WORK AREA.
B. AFTER ALL STOPPED VEHICLES HAVE STARTED MOVING, THE W3-1 (48" X 48") SIGNS SHALL BE REMOVED. WHERE SIGNS MAY BE COVERED IF RE-USE IS IMMINENT
C. AFTER ALL VEHICLES HAVE RESUMED APPROXIMATELY NORMAL SPEED, THE CHANGEABLE MESSAGE SIGNS SHALL BE TURNED OFF.
8. UNILLUMINATED SECTIONS OF HIGHWAYS SHOULD NOT BE CLOSED DURING HOURS OF DARKNESS EXCEPT FOR EMERGENCIES OR WITH THE APPROVAL OF THE ENGINEER. WHEN HIGHWAYS ARE CLOSED DURING HOURS OF DARKNESS, A TYPE 'B' HIGH INTENSITY FLASHING BARRICADE WARNING LIGHT SHALL BE USED ON EACH W3-1 SIGN.
9. IF AN ENTRANCE RAMP IS LOCATED BETWEEN THE SECOND CMS AND R1-1, THE CMS AND W3-1 SIGNS SHALL ALSO BE ERECTED ON THE RAMP SHOULDER.
10. THE ABOVE DURATION WILL APPLY TO EACH APPROACH TO THE CLOSURE.
11. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC INCLUDING SECURING LAW ENFORCEMENT SERVICES.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
SHORT DURATION CLOSING OF DIVIDED HIGHWAYS
MDOT
WORKING NUMBER TCP-7
SHEET NUMBER 6357
ISSUE DATE: AUGUST 01, 2017
DATE | REVISION | BY
12/11/25 | REVISED TEXT. | STM

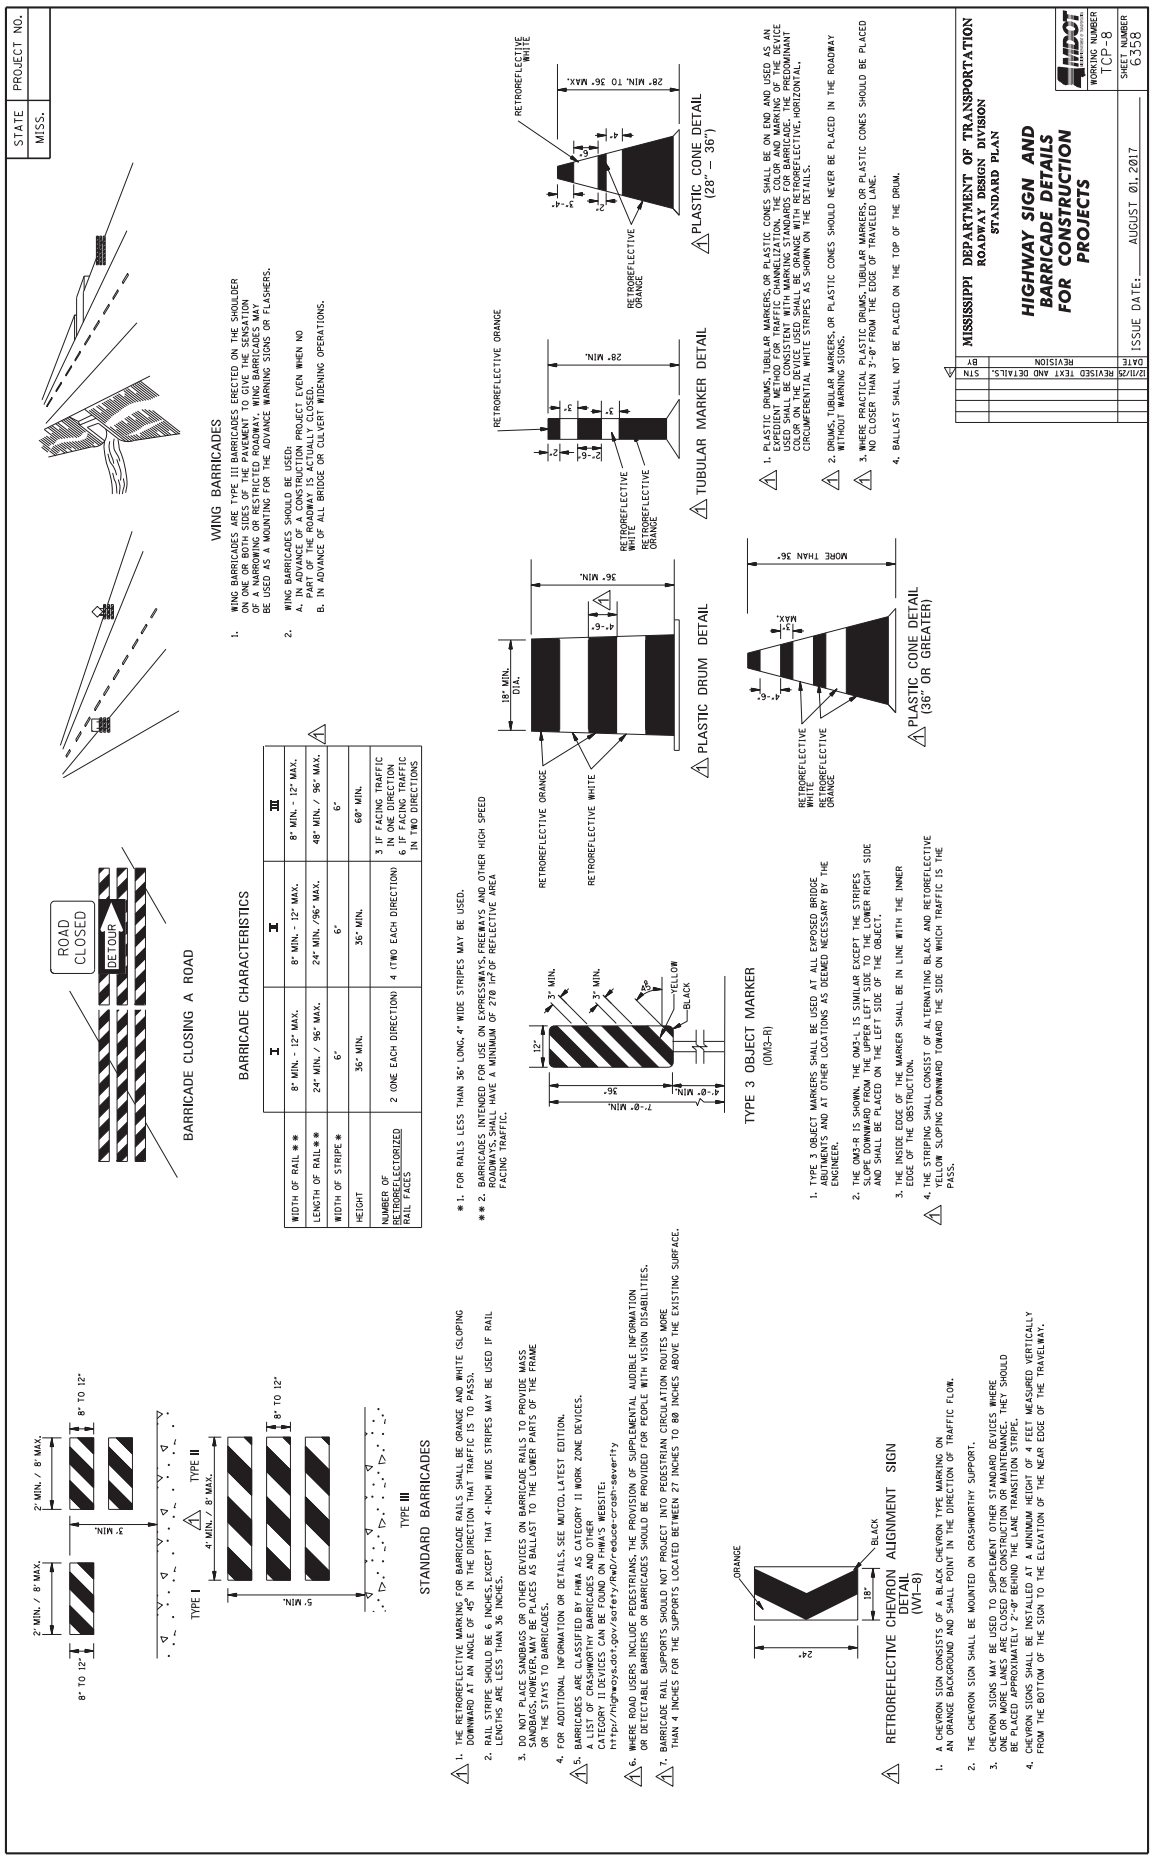
STATE MISS.
PROJECT NO.
ROAD CLOSED
DETOUR
BARRICADE CLOSING A ROAD
WING BARRICADES
1. WING BARRICADES ARE TYPE III BARRICADES ERECTED ON THE SHOULDER ON ONE OR BOTH SIDES OF THE PAVEMENT TO GIVE THE SENSATION OF A NARROWING OR RESTRICTED ROADWAY. WING BARRICADES MAY BE USED AS A MOUNTING FOR THE ADVANCE WARNING SIGNS OR FLASHERS.
2. WING BARRICADES SHOULD BE USED:
A. IN ADVANCE OF A CONSTRUCTION PROJECT EVEN WHEN NO PART OF THE ROADWAY IS ACTUALLY CLOSED.
B. IN ADVANCE OF ALL BRIDGE OR CULVERT WIDENING OPERATIONS.
BARRICADE CHARACTERISTICS
I II III
WIDTH OF RAIL** 8" MIN. - 12" MAX. 8" MIN. - 12" MAX. 8" MIN. - 12" MAX.
LENGTH OF RAIL** 24" MIN. / 96" MAX. 24" MIN. /96" MAX. 48" MIN. / 96" MAX.
WIDTH OF STRIPE* 6" 6" 6"
HEIGHT 36" MIN. 36" MIN. 60" MIN.
NUMBER OF RETROREFLECTORIZED RAIL FACES 2 (ONE EACH DIRECTION) 4 (TWO EACH DIRECTION) 3 IF FACING TRAFFIC IN ONE DIRECTION 6 IF FACING TRAFFIC IN TWO DIRECTIONS
2" MIN. / 8" MAX.
8" TO 12"
5' MIN.
TYPE I
4" MIN. / 8" MAX.
TYPE II
5' MIN.
TYPE III
STANDARD BARRICADES
1. THE RETROREFLECTIVE MARKING FOR BARRICADE RAILS SHALL BE ORANGE AND WHITE (SLOPING DOWNWARD AT AN ANGLE OF 45° IN THE DIRECTION THAT TRAFFIC IS TO PASS).
2. RAIL STRIPE SHOULD BE 6 INCHES EXCEPT THAT 4-INCH WIDE STRIPES MAY BE USED IF RAIL LENGTHS ARE LESS THAN 36 INCHES.
3. DO NOT PLACE SANDBAGS OR OTHER DEVICES ON BARRICADE RAILS TO PROVIDE MASS SANDBAGS, HOWEVER, MAY BE PLACES AS BALLAST TO THE LOWER PARTS OF THE FRAME OR THE STAYS TO BARRICADES.
4. FOR ADDITIONAL INFORMATION OR DETAILS, SEE MUTCD, LATEST EDITION.
5. BARRICADES ARE CLASSIFIED BY FHWA AS CATEGORY II WORK ZONE DEVICES. A LIST OF CRASHWORTHY BARRICADES AND OTHER CATEGORY II DEVICES CAN BE FOUND ON FHWA'S WEBSITE: http://safety.fhwa.dot.gov/roadway_dept/policy/mutcd/fhwaac_ccdph.htm#severity
6. WHERE ROAD USERS INCLUDE PEDESTRIANS, THE PROVISION OF SUPPLEMENTAL AUDIBLE INFORMATION OR DETECTABLE BARRIERS OR BARRICADES SHOULD BE PROVIDED FOR PEOPLE WITH VISION DISABILITIES.
7. BARRICADE RAIL SUPPORTS SHOULD NOT PROJECT INTO PEDESTRIAN CIRCULATION ROUTES MORE THAN 4 INCHES FOR THE SUPPORTS LOCATED BETWEEN 27 INCHES TO 80 INCHES ABOVE THE EXISTING SURFACE.
* 1. FOR RAILS LESS THAN 36" LONG, 4" WIDE STRIPES MAY BE USED.
** 2. BARRICADES INTENDED FOR USE ON EXPRESSWAYS, FREEWAYS AND OTHER HIGH SPEED ROADWAYS, SHALL HAVE A MINIMUM OF 270 in² OF REFLECTIVE AREA FACING TRAFFIC.
ORANGE
24"
18"
BLACK
RETROREFLECTIVE CHEVRON ALIGNMENT SIGN DETAIL (W1-8)
1. A CHEVRON SIGN CONSISTS OF A BLACK CHEVRON TYPE MARKING ON AN ORANGE BACKGROUND AND SHALL POINT IN THE DIRECTION OF TRAFFIC FLOW.
2. THE CHEVRON SIGN SHALL BE MOUNTED ON CRASHWORTHY SUPPORT.
3. CHEVRON SIGNS MAY BE USED TO SUPPLEMENT OTHER STANDARD DEVICES WHERE ONE OR MORE LANES ARE CLOSED FOR CONSTRUCTION OR MAINTENANCE. THEY SHOULD BE PLACED APPROXIMATELY 2'-0" BEHIND THE LANE TRANSITION STRIPE.
4. CHEVRON SIGNS SHALL BE INSTALLED AT A MINIMUM HEIGHT OF 4 FEET MEASURED VERTICALLY FROM THE BOTTOM OF THE SIGN TO THE ELEVATION OF THE NEAR EDGE OF THE TRAVELWAY.
12"
3" MIN.
3" MIN.
45°
YELLOW
BLACK
36"
7'-0" MIN.
4'-0" MIN.
TYPE 3 OBJECT MARKER (OM3-R)
1. TYPE 3 OBJECT MARKERS SHALL BE USED AT ALL EXPOSED BRIDGE APPROACHES AND AT OTHER LOCATIONS AS DEEMED NECESSARY BY THE ENGINEER.
2. THE OM3-R IS SHOWN. THE OM3-L IS SIMILAR EXCEPT THE STRIPES SLOPE DOWNWARD FROM THE LOWER LEFT SIDE TO THE LOWER RIGHT SIDE AND SHALL BE PLACED ON THE LEFT SIDE OF THE OBJECT.
3. THE INSIDE EDGE OF THE MARKER SHALL BE IN LINE WITH THE INNER EDGE OF THE OBSTRUCTION.
4. THE STRIPING SHALL CONSIST OF ALTERNATING BLACK AND RETOREFLECTIVE YELLOW SLOPING DOWNWARD TOWARD THE SIDE ON WHICH TRAFFIC IS TO PASS.
RETROREFLECTIVE ORANGE
36" MIN.
18" MIN. DIA.
4'-6"
RETROREFLECTIVE WHITE
PLASTIC DRUM DETAIL
MORE THAN 36".
4'-6"
MAX.
RETROREFLECTIVE WHITE
RETROREFLECTIVE ORANGE
PLASTIC CONE DETAIL (36" OR GREATER)
RETROREFLECTIVE ORANGE
28" MIN.
RETROREFLECTIVE WHITE
RETROREFLECTIVE ORANGE
TUBULAR MARKER DETAIL
RETROREFLECTIVE WHITE
28" MIN. TO 36" MAX.
RETROREFLECTIVE ORANGE
PLASTIC CONE DETAIL (28" – 36")
1. PLASTIC DRUMS, TUBULAR MARKERS, OR PLASTIC CONES SHALL BE ON END AND USED AS AN EXPEDIENT METHOD FOR TRAFFIC CHANNELIZATION, THE COLOR AND MARKING OF THE DEVICE USED SHALL BE CONSISTENT WITH MARKING STANDARDS FOR BARRICADE. THE PREDOMINANT COLOR ON DRUMS AND CONES SHALL BE ORANGE WITH RETROREFLECTIVE, HORIZONTAL, CIRCUMFERENTIAL WHITE STRIPES AS SHOWN ON THE DETAILS.
2. DRUMS, TUBULAR MARKERS, OR PLASTIC CONES SHOULD NEVER BE PLACED IN THE ROADWAY WITHOUT WARNING SIGNS.
3. WHERE PRACTICAL PLASTIC DRUMS, TUBULAR MARKERS, OR PLASTIC CONES SHOULD BE PLACED NO CLOSER THAN 3'-0" FROM THE EDGE OF TRAVELED LANE.
4. BALLAST SHALL NOT BE PLACED ON THE TOP OF THE DRUM.
BY STN REVISION DATE
12/11/25 REVISED TEXT AND DETAILS.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
HIGHWAY SIGN AND BARRICADE DETAILS FOR CONSTRUCTION PROJECTS
MDOT
WORKING NUMBER TCP-8
ISSUE DATE: AUGUST 01, 2017
SHEET NUMBER 6358

STATE	PROJECT NO.
MISS.	

MOBILE OPERATIONS ON MULTILANE ROAD

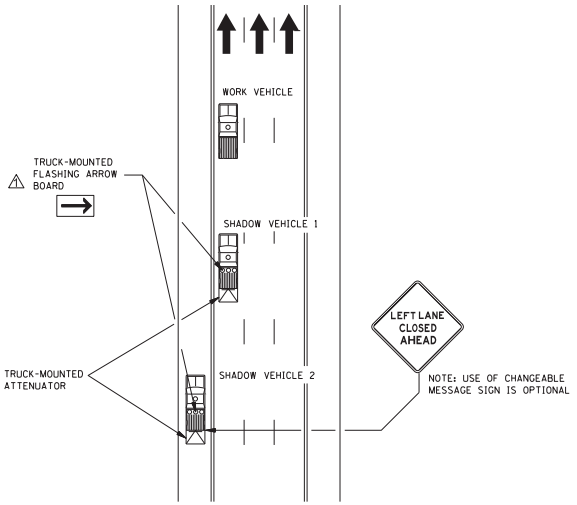

MOBILE OPERATIONS ON MULTILANE ROAD

NOTES FOR MULTILANE LANE OPERATION:

1. SHADOW AND WORK VEHICLES SHALL DISPLAY HIGH-INTENSITY ROTATING, FLASHING, OSCILLATING, OR STROBE LIGHTS. AN ARROW BOARD SHALL BE USED WHEN A FREEWAY LANE IS CLOSED. WHEN MORE THAN ONE FREEWAY LANE IS CLOSED, A SEPARATE ARROW BOARD SHALL BE USED FOR EACH CLOSED LANE.
2. SHADOW VEHICLE 2 SHOULD BE EQUIPPED WITH AN ARROW BOARD AND TRUCK MOUNTED ATTENUATOR (TMA), AN APPROPRIATE LANE CLOSURE SIGN SHOULD BE PLACED ON SHADOW VEHICLE 2 SO AS NOT TO OBSCURE THE ARROW BOARD.
3. SHADOW VEHICLE 1 SHOULD BE EQUIPPED WITH AN ARROW BOARD AND TRUCK-MOUNTED ATTENUATOR (TMA).
4. SHADOW VEHICLE 2 SHOULD TRAVEL AT A VARYING DISTANCE FROM THE WORK OPERATION SO AS TO PROVIDE ADEQUATE SIGHT DISTANCE FOR TRAFFIC APPROACHING FROM THE REAR.
5. THE SPACING BETWEEN THE WORK VEHICLES AND THE SHADOW VEHICLES, AND BETWEEN EACH SHADOW VEHICLE, SHOULD BE MINIMIZED TO DETER ROAD USERS FROM DRIVING IN BETWEEN.
6. ON HIGH-SPEED ROADWAYS, A THIRD SHADOW VEHICLE (NOT SHOWN) MAY BE USED WITH SHADOW VEHICLE 1 IN THE CLOSED LANE, SHADOW VEHICLE 2 STRADDLING THE EDGE LINE, AND SHADOW VEHICLE 3 ON THE SHOULDER.
7. ARROW BOARD SHALL BE AS A MINIMUM TYPE B, 60" X 30" IN ACCORDANCE WITH THE CRITERIA PRESENTED IN THE MUTCD.
8. WORK SHOULD NORMALLY BE DONE DURING OFF-PEAK HOURS.
9. VEHICLE-MOUNTED SIGNS SHOULD BE MOUNTED WITH THE BOTTOM OF THE SIGN LOCATED AT A MINIMUM HEIGHT OF 48" ABOVE THE PAVEMENT AND SHALL NOT BE OBSCURED BY EQUIPMENT OR SUPPLIES. SIGN LEGENDS SHALL BE COVERED OR TURNED FROM VIEW WHEN WORK IS NOT IN PROGRESS.
10. WHEN THE WORK VEHICLE OCCUPIES AN INTERIOR LANE (A LANE OTHER THAN THE FAR RIGHT OR FAR LEFT) OF A DIRECTIONAL ROADWAY HAVING A RIGHT-HAND SHOULDER 10 FEET OR MORE IN WIDTH, SHADOW VEHICLE 2 SHOULD DRIVE ON THE RIGHT-HAND SHOULDER WITH A SIGN INDICATING THAT WORK IS TAKING PLACE IN THE INTERIOR LANE.
11. ON HIGH-SPEED ROADWAYS, A THIRD SHADOW VEHICLE (NOT SHOWN) MAY BE USED WITH SHADOW VEHICLE 1 IN THE CLOSED LANE, SHADOW VEHICLE 2 STRADDLING THE EDGE LINE, AND SHADOW VEHICLE 3 ON THE SHOULDER.
12. WHERE ADEQUATE SHOULDER WIDTH IS NOT AVAILABLE, SHADOW VEHICLE 3 MAY ALSO STRADDLE THE EDGE LINE.
13. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.

MOBILE OPERATIONS ON TWO–LANE ROAD

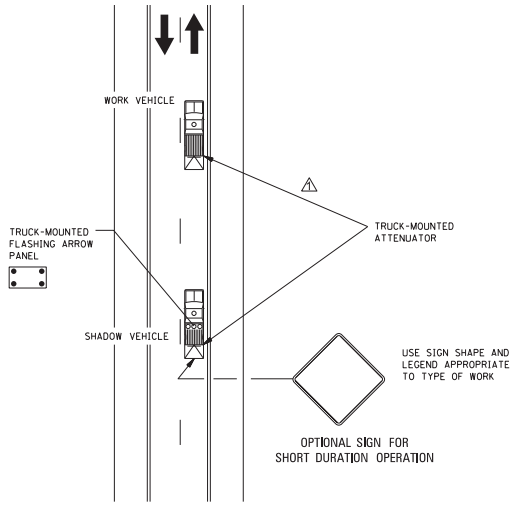

MOBILE OPERATIONS ON TWO–LANE ROAD

NOTES FOR TWO-LANE OPERATION:

1. WHERE PRACTICAL AND WHEN NEEDED, THE WORK AND SHADOW VEHICLES SHOULD PULL OVER PERIODICALLY TO ALLOW TRAFFIC TO PASS. IF THIS CAN NOT BE DONE FREQUENTLY, AS AN ALTERNATIVE, A "DO NOT PASS" SIGN MAY BE PLACED ON THE REAR OF THE VEHICLE BLOCKING THE LANE.
2. THE DISTANCE BETWEEN THE WORK AND SHADOW VEHICLES MAY VARY ACCORDING TO TERRAIN, PAINT DRYING TIME, AND OTHER FACTORS. SHADOW VEHICLES ARE USED TO WARN TRAFFIC OF THE OPERATION AHEAD. WHENEVER ADEQUATE STOPPING SIGHT DISTANCE EXISTS TO THE REAR, THE SHADOW VEHICLE SHOULD MAINTAIN THE MINIMUM DISTANCE AND PROCEED AT THE SAME SPEED AS THE WORK VEHICLE. THE SHADOW VEHICLE SHOULD SLOW DOWN IN ADVANCE OF VERTICAL OR HORIZONTAL CURVES THAT RESTRICT SIGHT DISTANCE.
3. ADDITIONAL SHADOW VEHICLES TO WARN AND REDUCE THE SPEED OF ONCOMING OR OPPOSING TRAFFIC MAY BE USED. POLICE PATROL CARS MAY BE USED FOR THIS PURPOSE.
4. A TRUCK-MOUNTED ATTENUATOR (TMA) SHOULD BE USED ON THE SHADOW VEHICLE AND MAY BE USED ON THE WORK VEHICLE.
5. THE WORK VEHICLE SHALL BE EQUIPPED WITH BEACONS, AND THE SHADOW VEHICLES SHALL BE EQUIPPED WITH TWO HIGH-INTENSITY FLASHING LIGHTS MOUNTED ON THE REAR, ADJACENT TO THE SIGN. SHADOW AND WORK VEHICLES SHALL DISPLAY FLASHING OR ROTATING BEACONS BOTH FORWARD AND TO THE REAR.
6. VEHICLE-MOUNTED SIGNS SHOULD BE MOUNTED WITH THE BOTTOM OF THE SIGN LOCATED AT A MINIMUM HEIGHT OF 48" ABOVE THE PAVEMENT AND SHALL NOT BE OBSCURED BY EQUIPMENT OR SUPPLIES. SIGN LEGENDS SHALL BE COVERED OR TURNED FROM VIEW WHEN WORK IS NOT IN PROGRESS.
7. ARROW BOARD TO BE USED IN CAUTION MODE.
8. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT. THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.

DATE	REVISION	BY
12/17/25	REVISED TEXT AND DETAILS	SYN

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN

TRAFFIC CONTROL PLAN
MOBILE OPERATIONS
MULTILANE ROADS
AND
TWO–LANE ROADS

MDOT

WORKING NUMBER
TCP-9

ISSUE DATE: AUGUST 01, 2017

SHEET NUMBER
6359

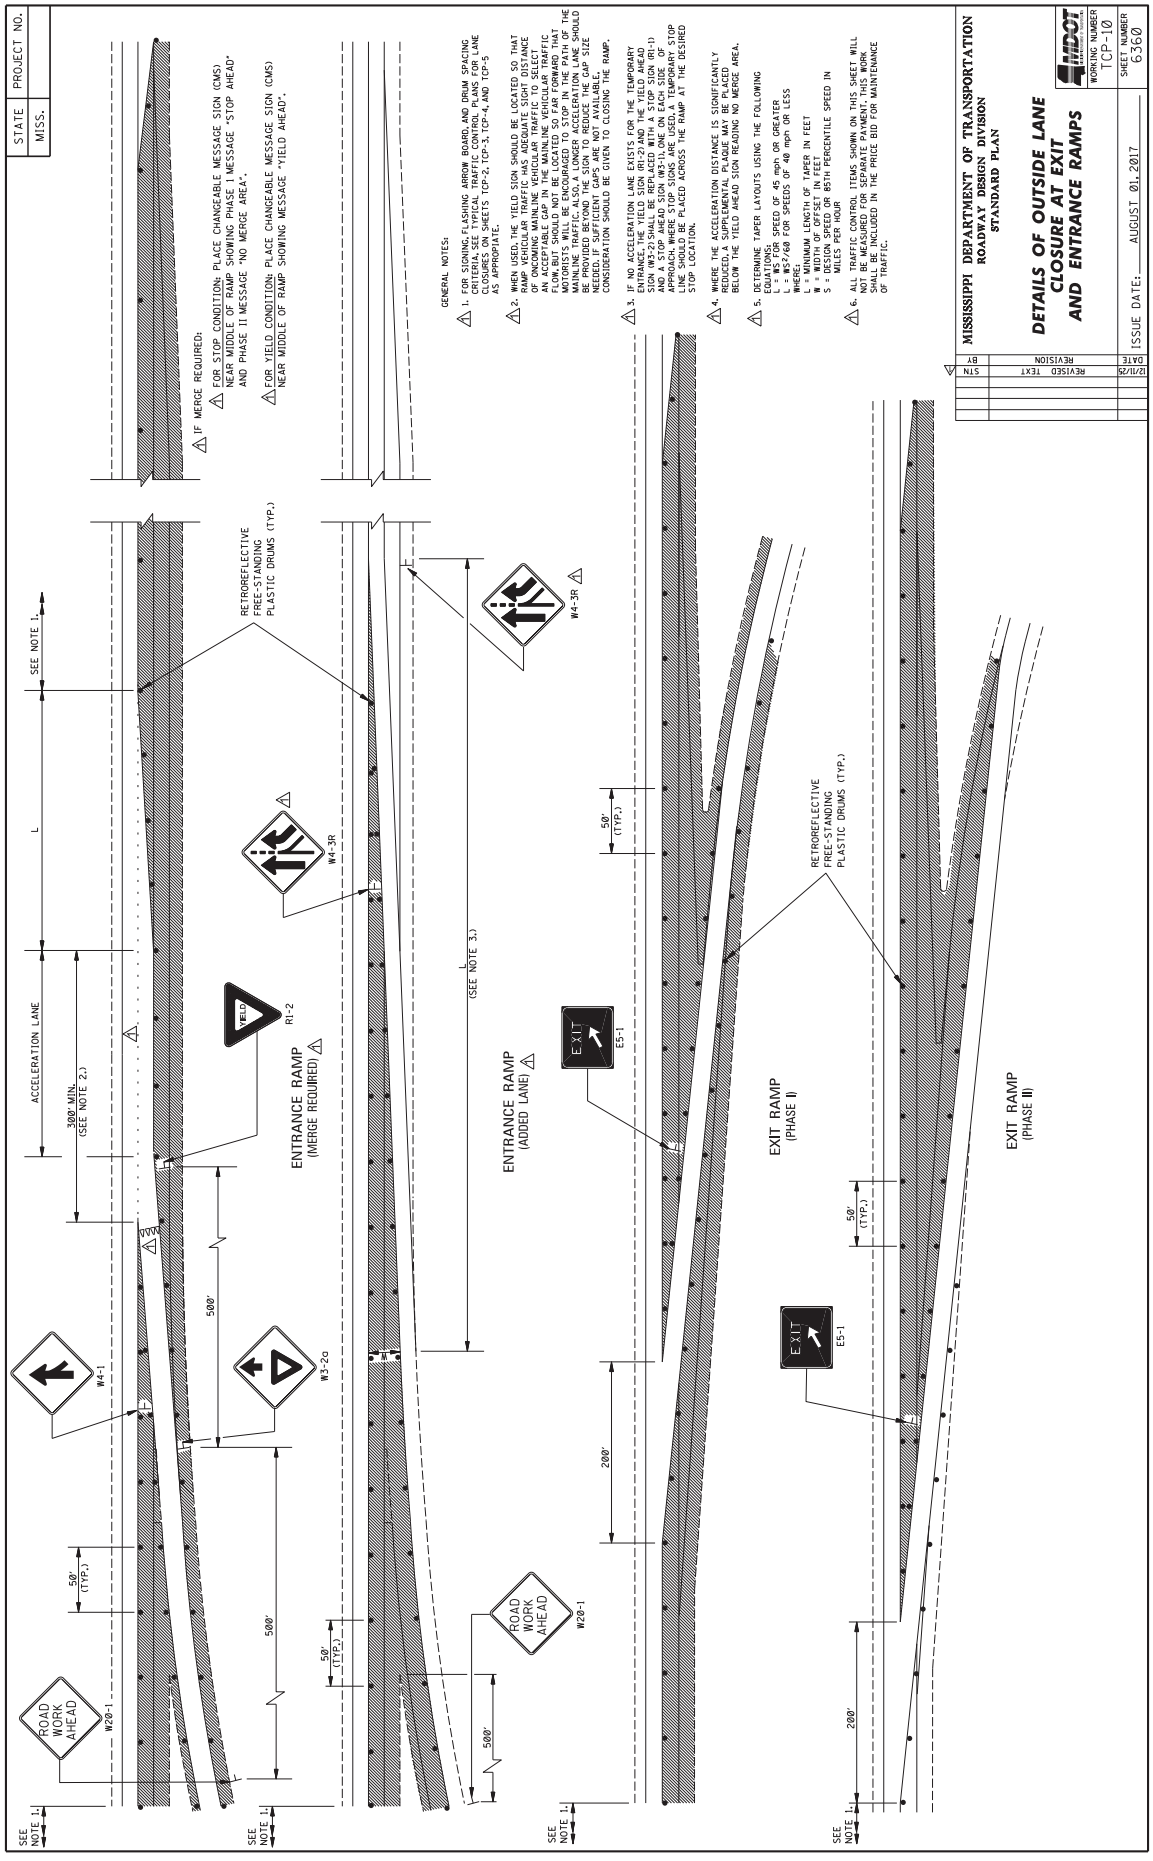
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
DETAILS OF OUTSIDE LANE CLOSURE AT EXIT AND ENTRANCE RAMPS
WORKING NUMBER TCP-10
SHEET NUMBER 6360
ISSUE DATE: AUGUST 01, 2017
REVISED TEXT
GENERAL NOTES:
1. FOR SIGNING, FLASHING ARROW BOARD, AND DRUM SPACING CRITERIA SEE STANDARD TRAFFIC CONTROL PLANS FOR LANE CLOSURES ON SHEETS TCP-2, TCP-3, TCP-4, AND TCP-5 AS APPROPRIATE.
2. WHEN USED, THE YIELD SIGN SHOULD BE LOCATED SO THAT RAMP VEHICULAR TRAFFIC HAS ADEQUATE SIGHT DISTANCE OF ONCOMING MAINLINE VEHICULAR TRAFFIC TO SELECT AN ACCEPTABLE GAP IN THE MAINLINE VEHICULAR TRAFFIC FLOW, BUT SHOULD NOT BE LOCATED SO FAR FORWARD THAT MOTORISTS WILL BE ENCOURAGED TO STOP IN THE PATH OF THE MAINLINE TRAFFIC. ALSO, A LONGER ACCELERATION LANE SHOULD BE PROVIDED BEYOND THE YIELD SIGN TO PROVIDE THE GAP SIZE NEEDED. IF SUFFICIENT GAPS ARE NOT AVAILABLE, CONSIDERATION SHOULD BE GIVEN TO CLOSING THE RAMP.
3. IF NO ACCELERATION LANE EXISTS FOR THE TEMPORARY ENTRANCE RAMP, THE YIELD AHEAD SIGN (R1-2) AND THE YIELD AHEAD SIGN (W3-2) SHALL BE REPLACED WITH A STOP SIGN (R1-1) AND A STOP AHEAD SIGN (W3-1), ONE ON EACH SIDE OF APPROACHING TRAFFIC. ALSO, A SUPPLEMENTAL STOP LINE SHOULD BE PLACED ACROSS THE RAMP AT THE DESIRED STOP LOCATION.
4. WHERE THE ACCELERATION DISTANCE IS SIGNIFICANTLY REDUCED, A SUPPLEMENTAL PLAQUE MAY BE PLACED BELOW THE YIELD AHEAD SIGN READING NO MERGE AREA.
5. DETERMINE TAPER LAYOUTS USING THE FOLLOWING CRITERIA:
L = WS FOR SPEED OF 45 mph OR GREATER
L = WS²/60 FOR SPEEDS OF 40 mph OR LESS
WHERE:
L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET IN FEET
S = DESIGN SPEED OR 85TH PERCENTILE SPEED IN MILES PER HOUR
6. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET WILL NOT BE MEASURED FOR SEPARATE PAYMENT; THIS WORK SHALL BE INCLUDED IN THE PRICE BID FOR MAINTENANCE OF TRAFFIC.
IF MERGE REQUIRED:
FOR STOP CONDITION: PLACE CHANGEABLE MESSAGE SIGN (CMS) NEAR MIDDLE OF RAMP SHOWING PHASE I MESSAGE "STOP AHEAD" AND PHASE II MESSAGE "NO MERGE AREA".
FOR YIELD CONDITION: PLACE CHANGEABLE MESSAGE SIGN (CMS) NEAR MIDDLE OF RAMP SHOWING MESSAGE "YIELD AHEAD".
ENTRANCE RAMP (MERGE REQUIRED)
ENTRANCE RAMP (ADDED LANE)
EXIT RAMP (PHASE I)
EXIT RAMP (PHASE II)
ACCELERATION LANE
L
300' MIN. (SEE NOTE 2.)
500'
200'
50' (TYP.)
SEE NOTE 1.
RETROREFLECTIVE FREE-STANDING PLASTIC DRUMS (TYP.)
ROAD WORK AHEAD W20-1
W4-1
W3-2o
W4-3R
R1-2
YIELD
E5-1
EXIT

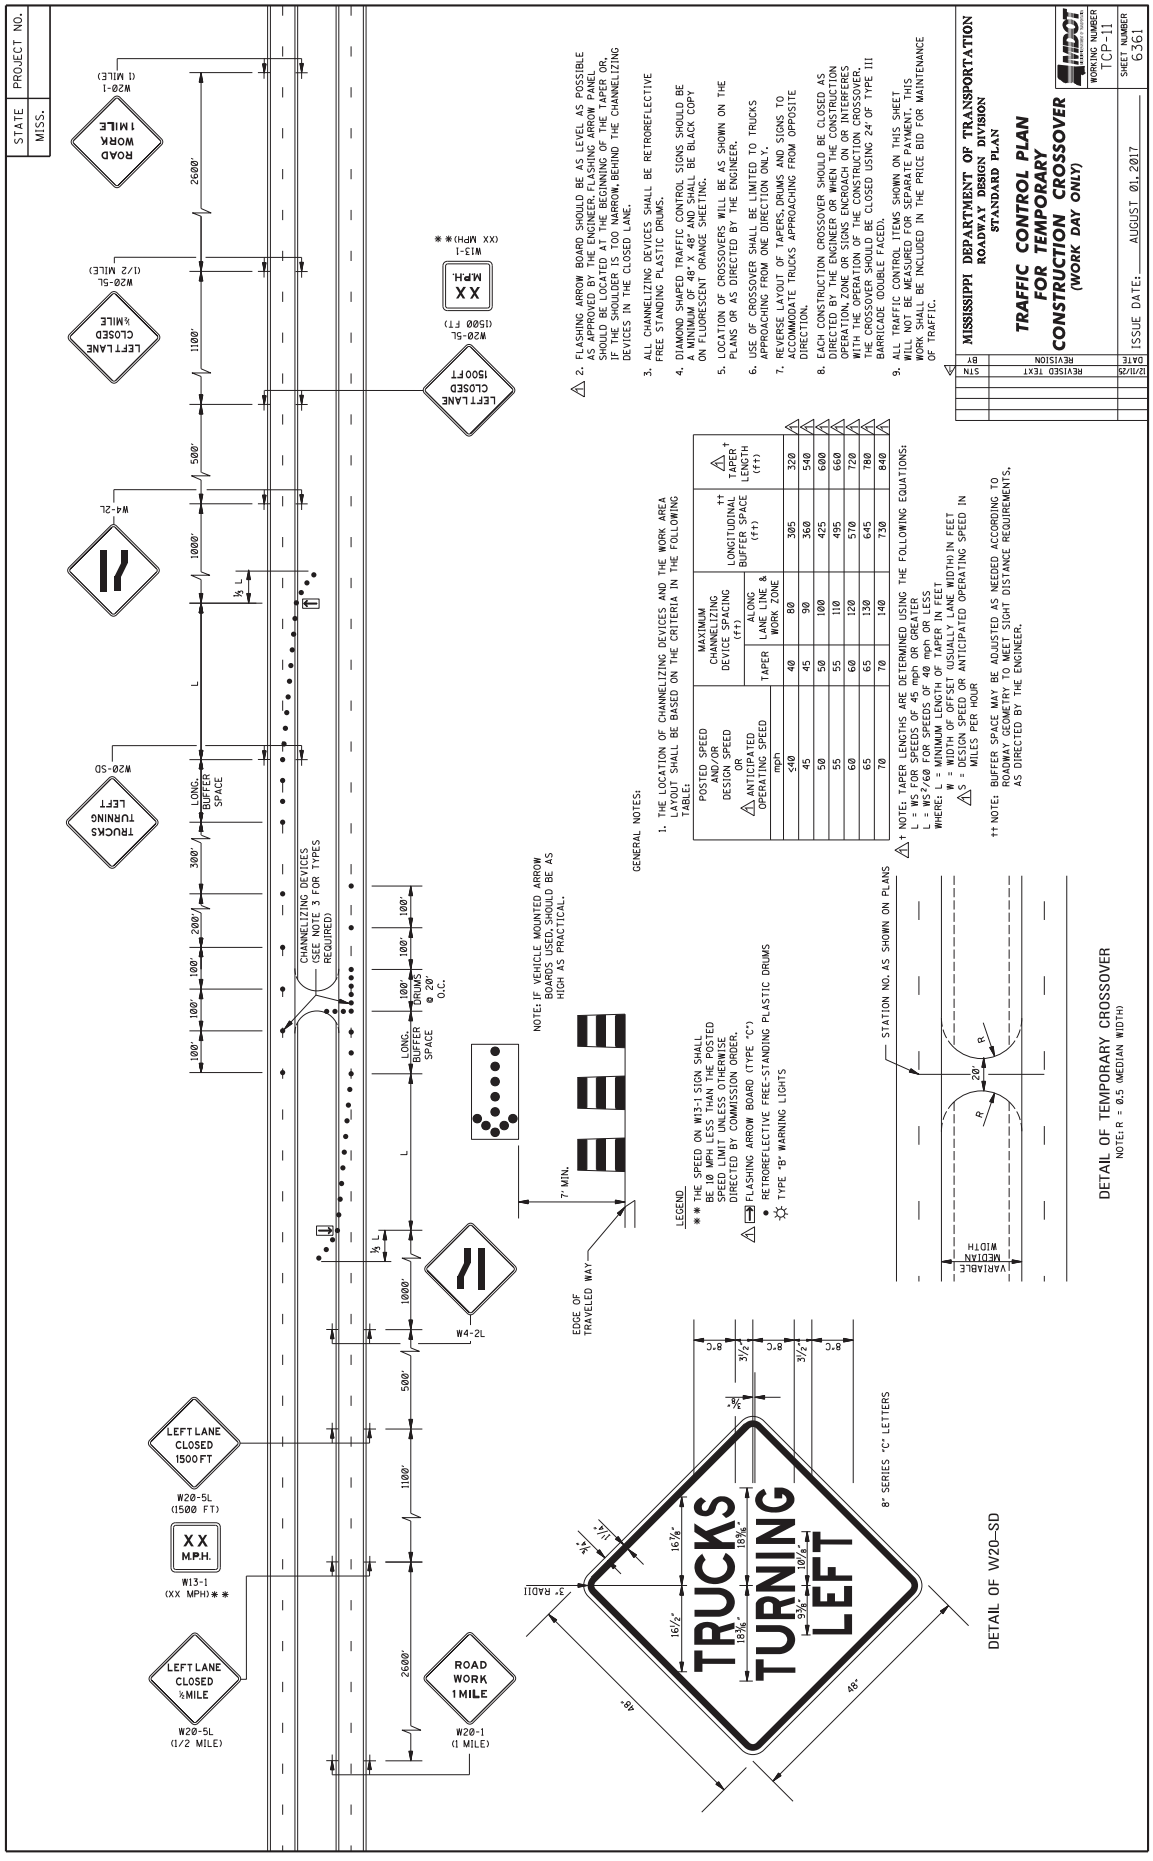

POSTED SPEED AND/OR DESIGN SPEED OR ⚠ ANTICIPATED OPERATING SPEED mph	MAXIMUM CHANNELIZING DEVICES SPACING (ft)		†† LONGITUDINAL BUFFER SPACE (ft)	⚠ † TAPER LENGTH (ft)
	TAPER	ALONG LANE LINE & WORK ZONE		
≤40	40	80	305	320
45	45	90	360	540
50	50	100	425	600
55	55	110	495	660
60	60	120	570	720
65	65	130	645	780
70	70	140	730	840

⚠ † NOTE: TAPER LENGTHS ARE DETERMINED USING THE FOLLOWING EQUATIONS:
L = WS FOR SPEEDS OF 45 mph OR GREATER
L = WS²/60 FOR SPEEDS OF 40 mph OR LESS
WHERE: L = MINIMUM LENGTH OF TAPER IN FEET
W = WIDTH OF OFFSET (EQUAL LANE WIDTH) IN FEET
⚠ S = DESIGN SPEED OR ANTICIPATED OPERATING SPEED IN MILES PER HOUR

†† NOTE: BUFFER SPACE MAY BE ADJUSTED AS NEEDED ACCORDING TO ROADWAY GEOMETRY TO MEET SIGHT DISTANCE REQUIREMENTS, AS DIRECTED BY THE ENGINEER.

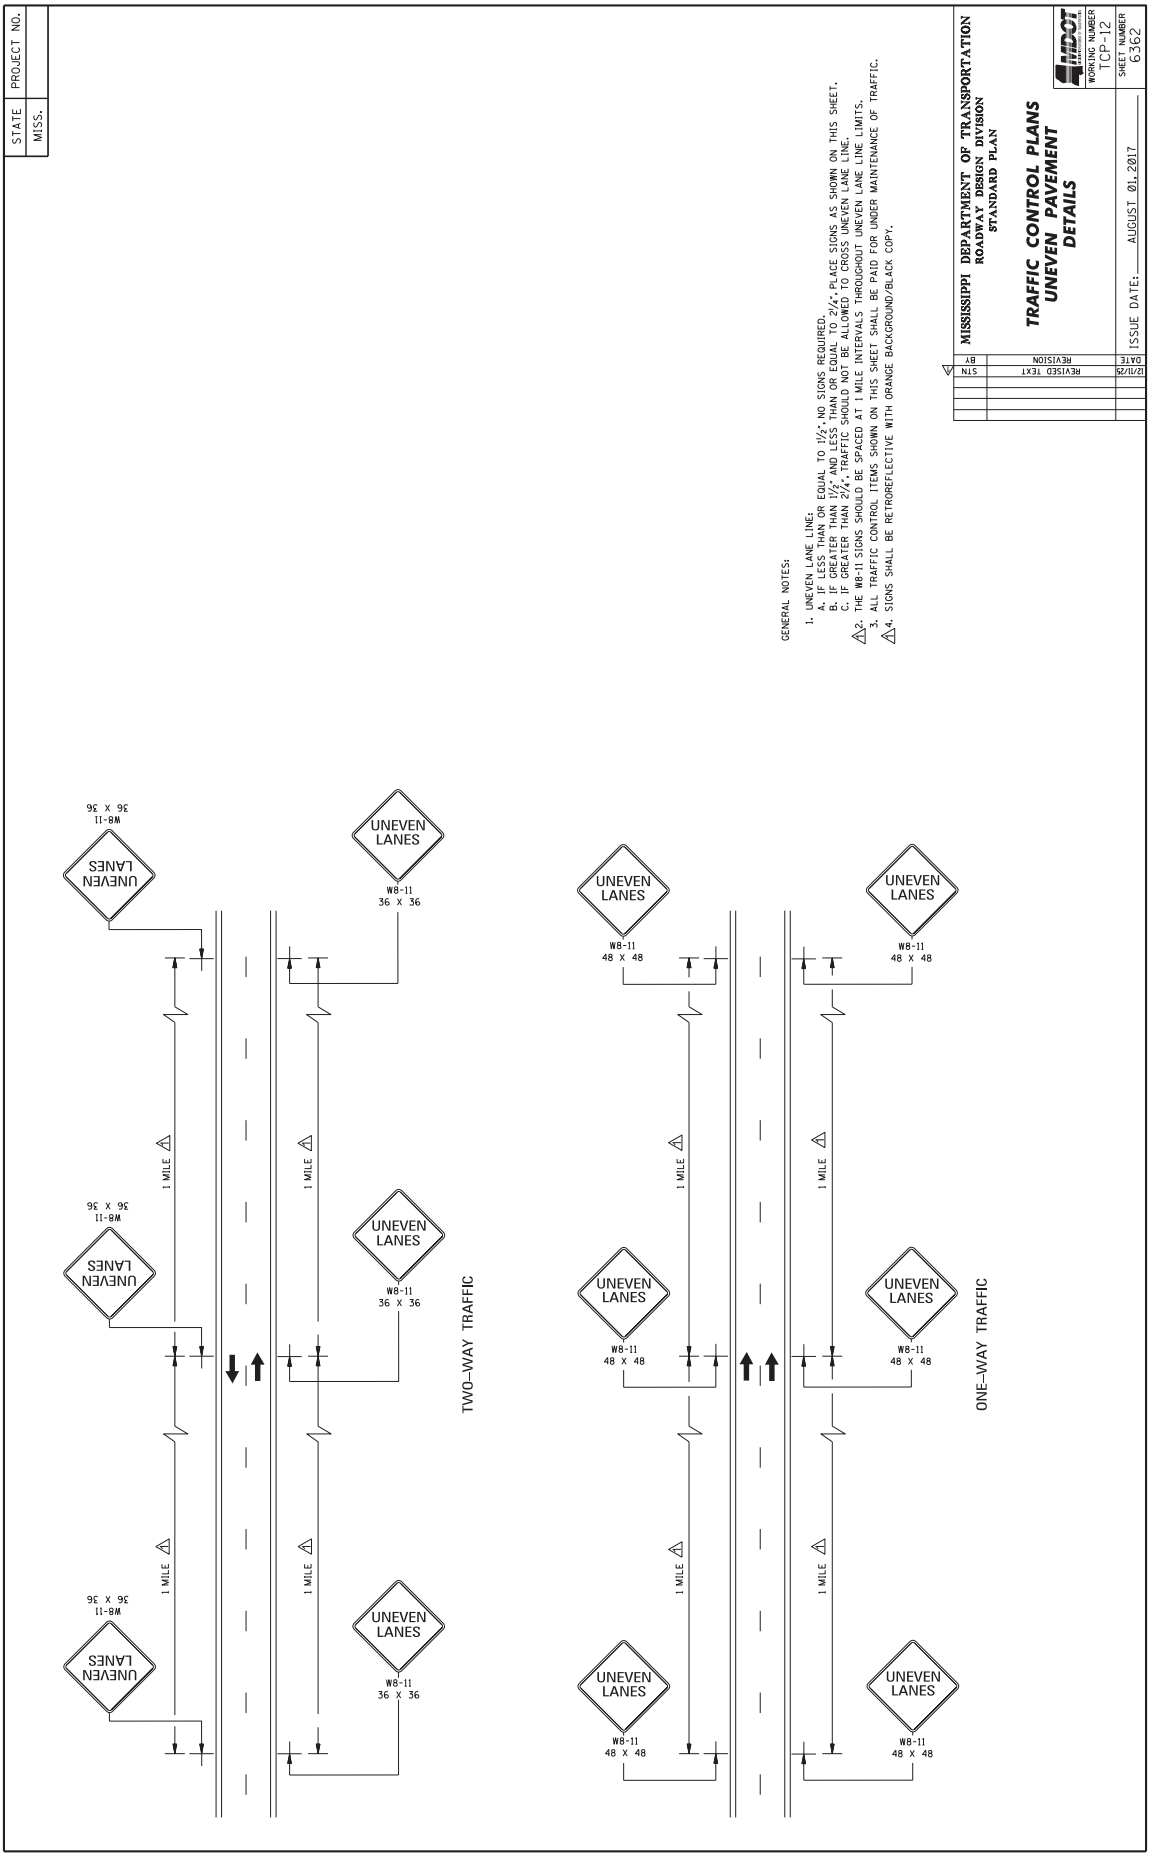
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TRAFFIC CONTROL PLANS
UNEVEN PAVEMENT
DETAILS
WORKING NUMBER TCP-12
SHEET NUMBER 6362
ISSUE DATE: AUGUST 01, 2017
DATE REVISION BY
12/1/25 REVISED TEXT STN
GENERAL NOTES:
1. UNEVEN LANE LINE:
A. IF LESS THAN OR EQUAL TO 1½", NO SIGNS REQUIRED.
B. IF GREATER THAN 1½" AND LESS THAN OR EQUAL TO 2¼", PLACE SIGNS AS SHOWN ON THIS SHEET.
C. IF GREATER THAN 2¼", TRAFFIC SHOULD NOT BE ALLOWED TO CROSS UNEVEN LANE LINE.
2. THE W8-11 SIGNS SHOULD BE SPACED AT 1 MILE INTERVALS THROUGHOUT UNEVEN LANE LINE LIMITS.
3. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER MAINTENANCE OF TRAFFIC.
4. SIGNS SHALL BE RETROREFLECTIVE WITH ORANGE BACKGROUND/BLACK COPY.
TWO-WAY TRAFFIC
ONE-WAY TRAFFIC
UNEVEN LANES
W8-11
36 X 36
48 X 48
1 MILE

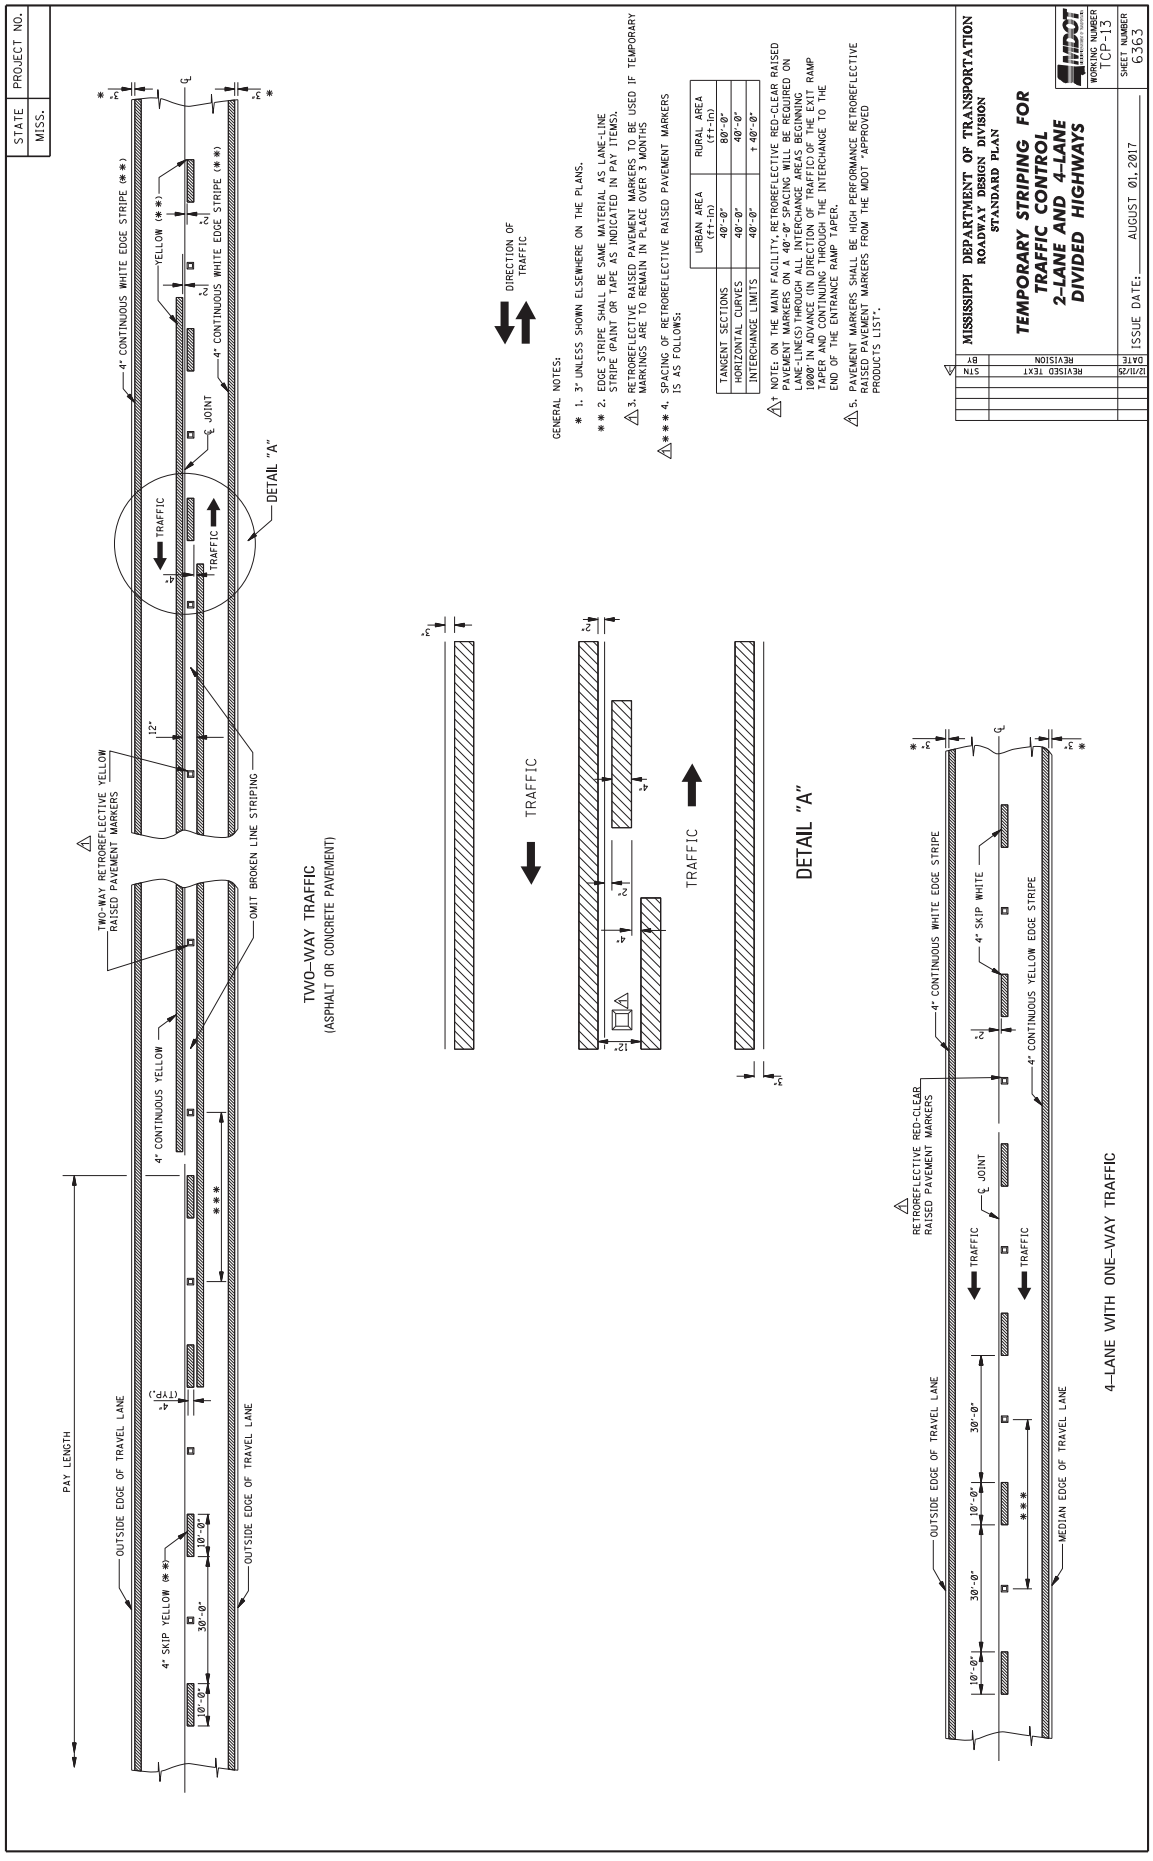
STATE MISS.
PROJECT NO.
PAY LENGTH
OUTSIDE EDGE OF TRAVEL LANE
4" SKIP YELLOW (**)
4" CONTINUOUS YELLOW
TWO-WAY RETROREFLECTIVE YELLOW RAISED PAVEMENT MARKERS
OMIT BROKEN LINE STRIPING
OUTSIDE EDGE OF TRAVEL LANE
4" CONTINUOUS WHITE EDGE STRIPE (**)
YELLOW (**)
4" CONTINUOUS WHITE EDGE STRIPE (**)
℄ JOINT
TRAFFIC
DETAIL "A"
TWO-WAY TRAFFIC
(ASPHALT OR CONCRETE PAVEMENT)
DIRECTION OF TRAFFIC
GENERAL NOTES:
* 1. 3" UNLESS SHOWN ELSEWHERE ON THE PLANS.
** 2. EDGE STRIPE SHALL BE SAME MATERIAL AS LANE-LINE STRIPE (PAINT OR TAPE AS INDICATED IN PAY ITEMS).
△3. RETROREFLECTIVE RAISED PAVEMENT MARKERS TO BE USED IF TEMPORARY MARKINGS ARE TO REMAIN IN PLACE OVER 3 MONTHS
△*** 4. SPACING OF RETROREFLECTIVE RAISED PAVEMENT MARKERS IS AS FOLLOWS:
URBAN AREA (ft-in) | RURAL AREA (ft-in)
TANGENT SECTIONS 40'-0" 80'-0"
HORIZONTAL CURVES 40'-0" 40'-0"
INTERCHANGE LIMITS 40'-0" † 40'-0"
△† NOTE: ON THE MAIN FACILITY, RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS ON A 40'-0" SPACING WILL BE REQUIRED ON LANE-LINES) THROUGH ALL INTERCHANGE AREAS BEGINNING (ABOVE INSIGNIFICANT DISTANCE) THE GORE AREA AT THE RAMP TAPER AND CONTINUING THROUGH THE INTERCHANGE TO THE END OF THE ENTRANCE RAMP TAPER.
△5. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RETROREFLECTIVE RAISED PAVEMENT MARKERS FROM THE MDOT "APPROVED PRODUCTS LIST".
DETAIL "A"
4" CONTINUOUS WHITE EDGE STRIPE
4" SKIP WHITE
4" CONTINUOUS YELLOW EDGE STRIPE
RETROREFLECTIVE RED-CLEAR RAISED PAVEMENT MARKERS
OUTSIDE EDGE OF TRAVEL LANE
MEDIAN EDGE OF TRAVEL LANE
4-LANE WITH ONE-WAY TRAFFIC
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TEMPORARY STRIPING FOR TRAFFIC CONTROL 2-LANE AND 4-LANE DIVIDED HIGHWAYS
MDOT
WORKING NUMBER TCP-13
SHEET NUMBER 6363
ISSUE DATE: AUGUST 01, 2017
STN BY DATE REVISION
12/11/20 REVISED TEXT

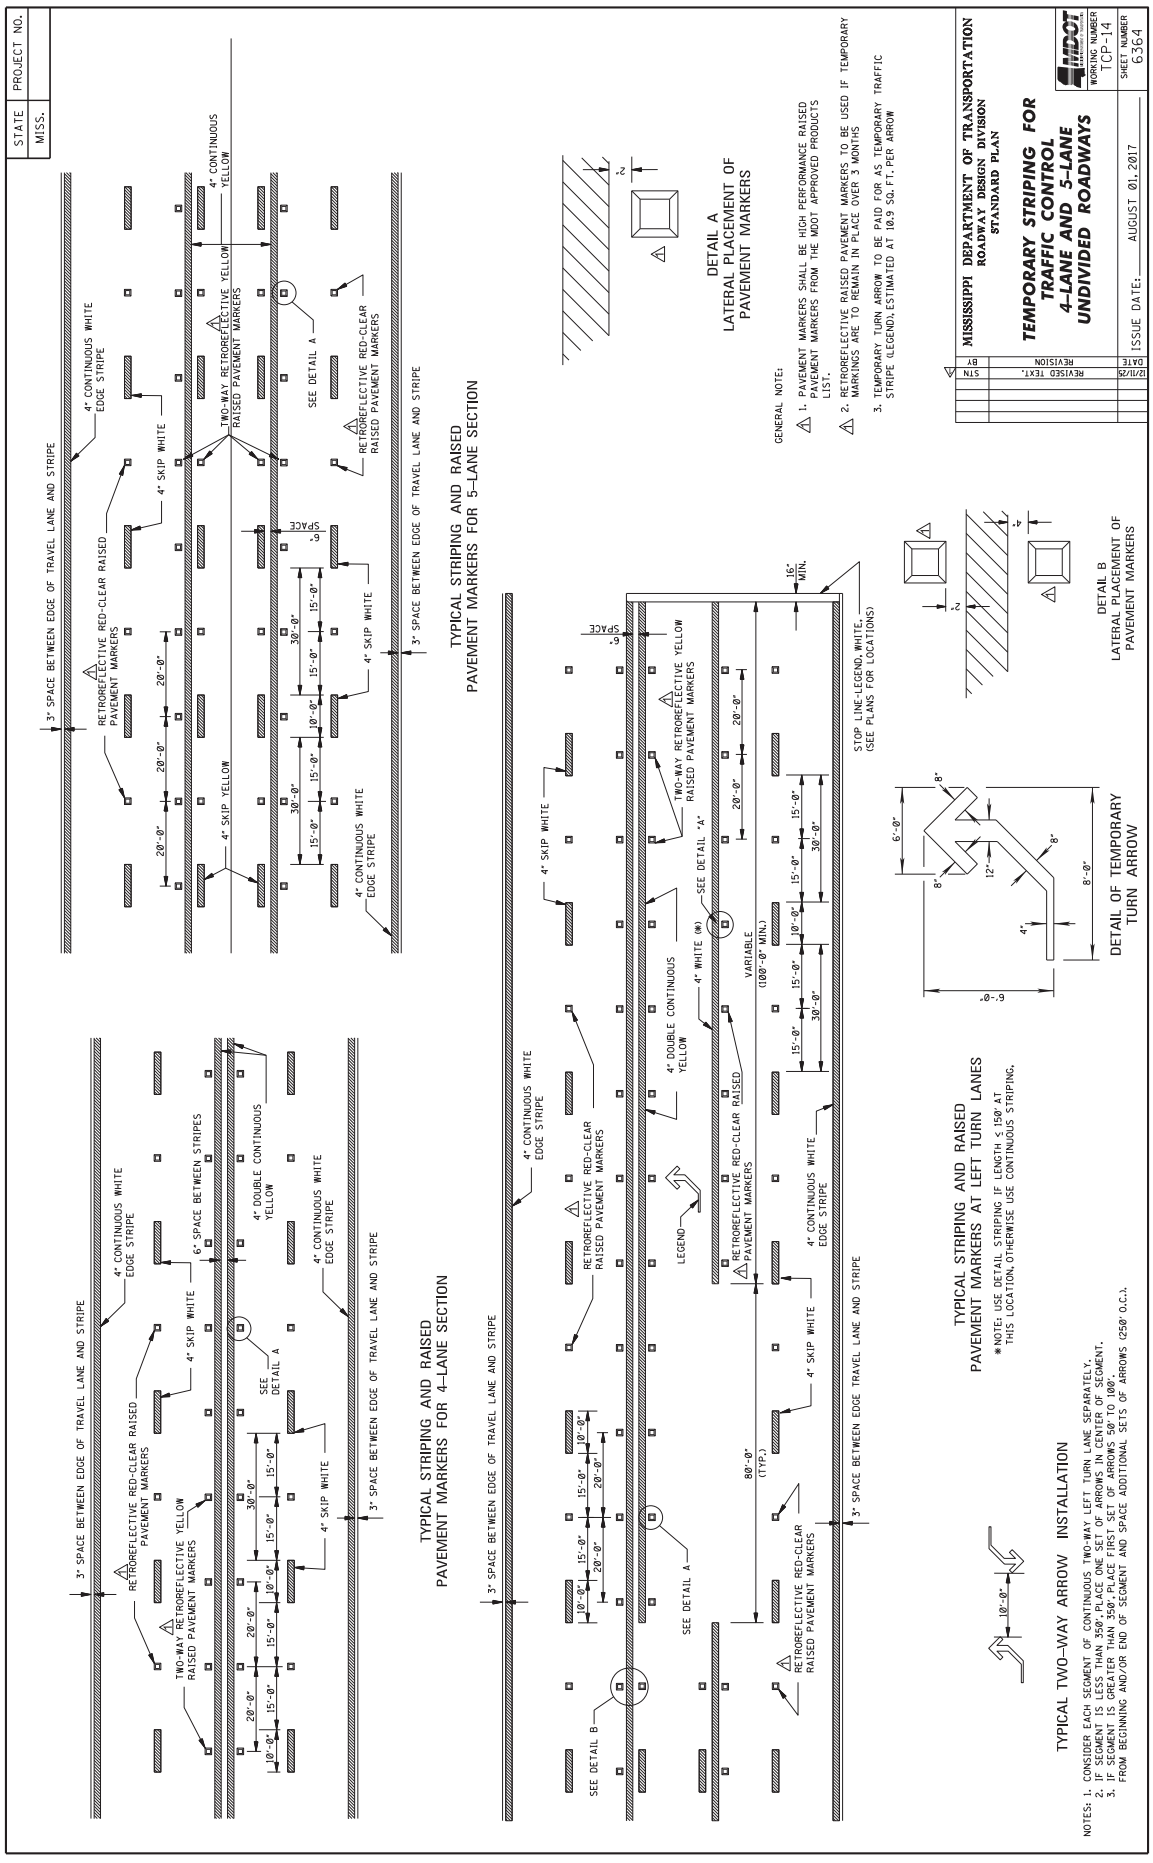
STATE MISS.
PROJECT NO.
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN
TEMPORARY STRIPING FOR TRAFFIC CONTROL 4-LANE AND 5-LANE UNDIVIDED ROADWAYS
WORKING NUMBER TCP-14
SHEET NUMBER 6364
ISSUE DATE: AUGUST 01, 2017
STN BY REVISION DATE
12/11/25 REVISED TEXT.
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS FOR 4-LANE SECTION
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS FOR 5-LANE SECTION
TYPICAL STRIPING AND RAISED PAVEMENT MARKERS AT LEFT TURN LANES
* NOTE: USE DETAIL STRIPING IF LENGTH ≤ 150' AT THIS LOCATION, OTHERWISE USE CONTINUOUS STRIPING.
TYPICAL TWO-WAY ARROW INSTALLATION
DETAIL A LATERAL PLACEMENT OF PAVEMENT MARKERS
DETAIL B LATERAL PLACEMENT OF PAVEMENT MARKERS
DETAIL OF TEMPORARY TURN ARROW
GENERAL NOTE:
1. PAVEMENT MARKERS SHALL BE HIGH PERFORMANCE RAISED PAVEMENT MARKERS FROM THE MDOT APPROVED PRODUCTS LIST.
2. RETROREFLECTIVE RAISED PAVEMENT MARKERS TO BE USED IF TEMPORARY MARKINGS ARE TO REMAIN IN PLACE OVER 3 MONTHS
3. TEMPORARY TURN ARROW TO BE PAID FOR AS TEMPORARY TRAFFIC STRIPE (LEGEND), ESTIMATED AT 10.9 SQ. FT. PER ARROW
NOTES: 1. CONSIDER EACH SEGMENT OF CONTINUOUS TWO-WAY LEFT TURN LANE SEPARATELY.
2. IF SEGMENT IS LESS THAN 350', PLACE ONE SET OF ARROWS IN CENTER OF SEGMENT.
3. IF SEGMENT IS GREATER THAN 350', PLACE FIRST SET OF ARROWS 50' TO 100' FROM BEGINNING AND/OR END OF SEGMENT AND SPACE ADDITIONAL SETS OF ARROWS @250' O.C.).

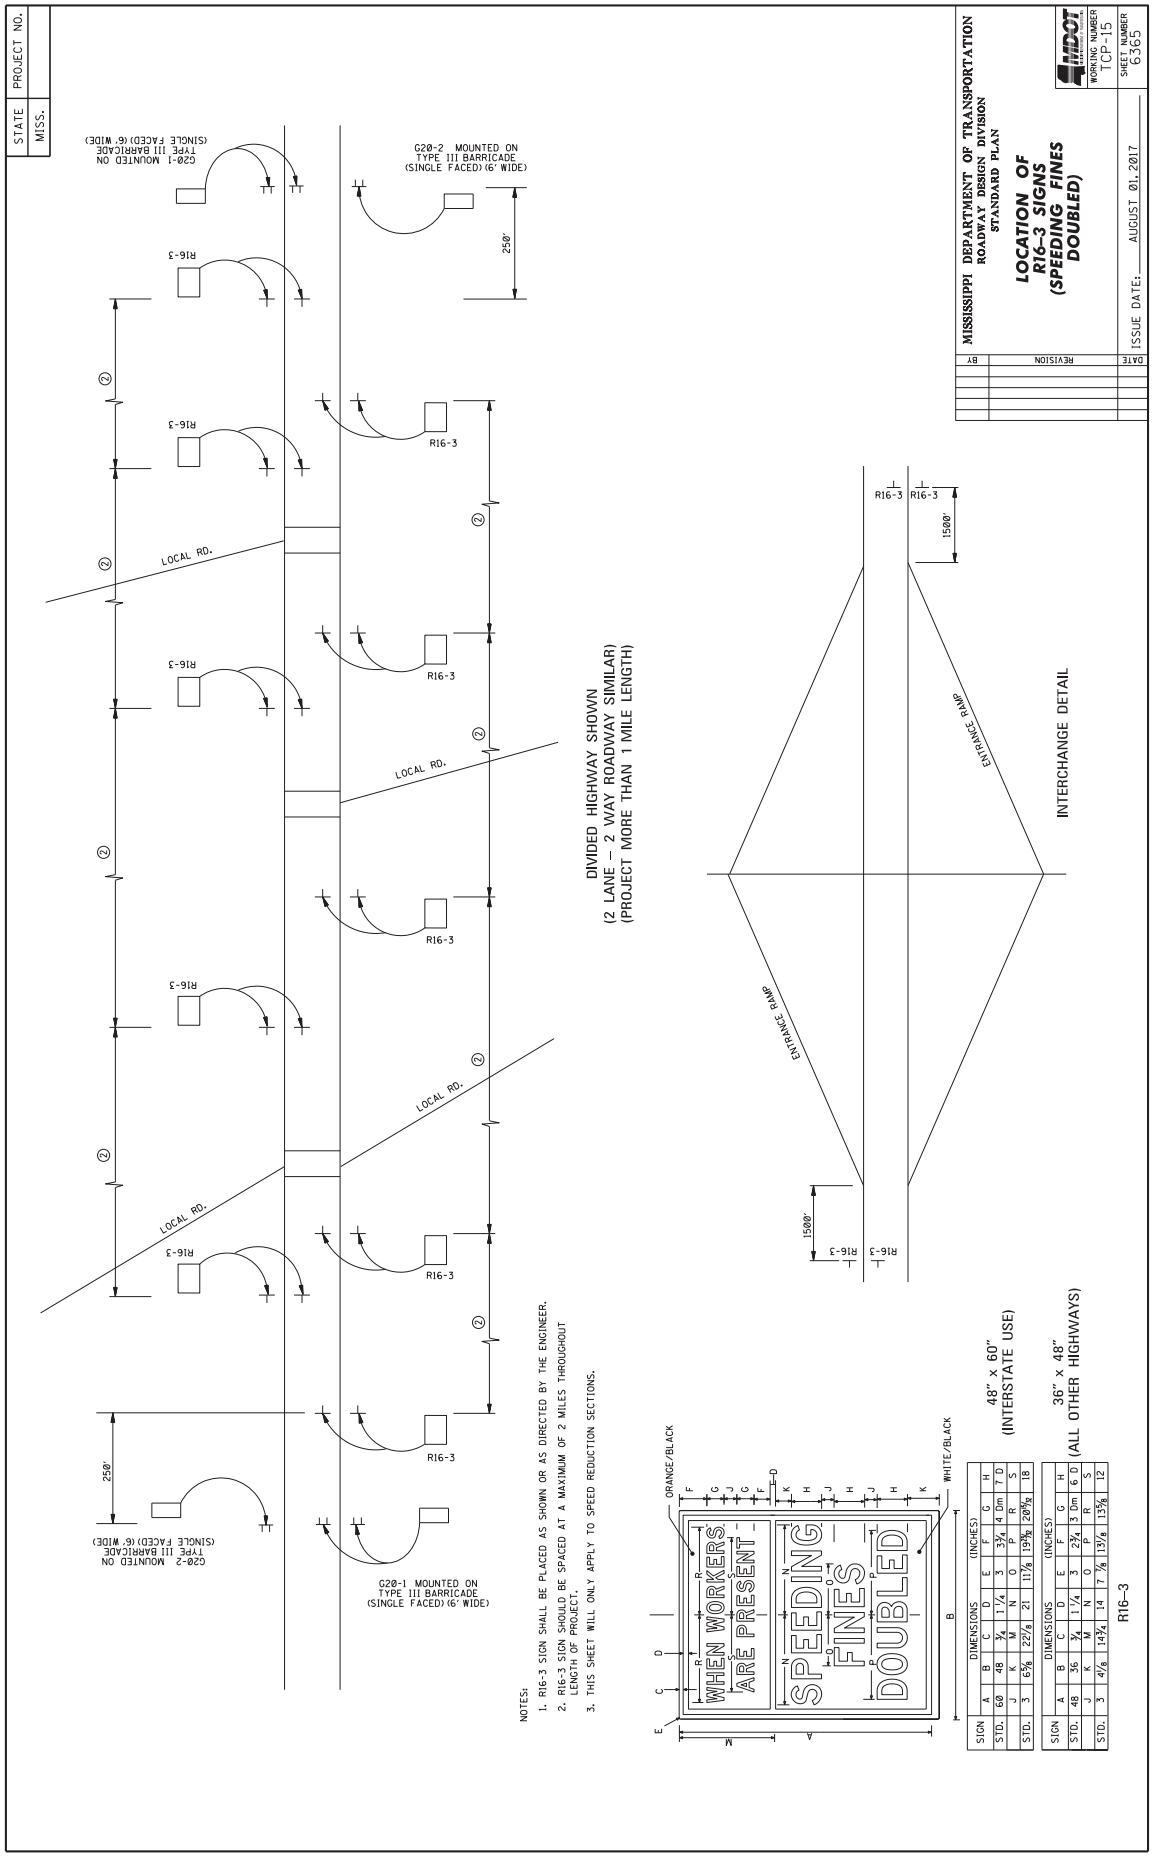

SIGN	DIMENSIONS (INCHES)								
	A	B	C	D	E	F	G	H
STD.	60	48	¾	1 ¼	3	3¾	4 Dm	7 D
	J	K	M	N	O	P	R	S
STD.	3	6⅝	22⅛	21	11⅞	19⅜	20⅜	18

SIGN	DIMENSIONS (INCHES)								
	A	B	C	D	E	F	G	H
STD.	48	36	¾	1 ¼	3	2¾	3 Dm	6 D
	J	K	M	N	O	P	R	S
STD.	3	4⅛	14¾	14	7 ⅞	13⅛	13⅝	12

STATE	PROJECT NO.
MISS.	

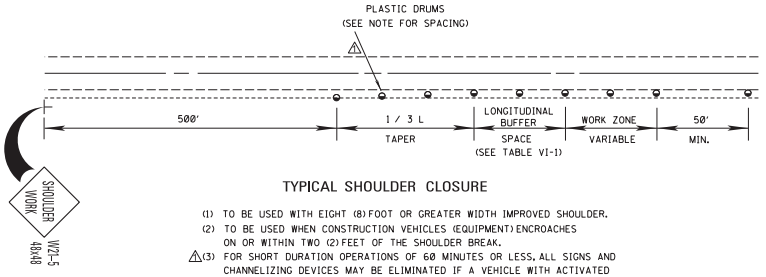

TYPICAL SHOULDER CLOSURE

(1) TO BE USED WITH EIGHT (8) FOOT OR GREATER WIDTH IMPROVED SHOULDER.
(2) TO BE USED WHEN CONSTRUCTION VEHICLES (EQUIPMENT) ENCROACHES ON OR WITHIN TWO (2) FEET OF THE SHOULDER BREAK.
△(3) FOR SHORT DURATION OPERATIONS OF 60 MINUTES OR LESS, ALL SIGNS AND CHANNELIZING DEVICES MAY BE ELIMINATED IF A VEHICLE WITH ACTIVATED HIGH-INTENSITY ROTATING, FLASHING, OSCILLATING, OR STROBE LIGHTS IS USED.

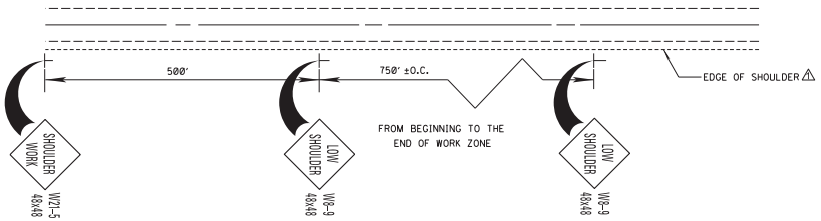

TYPICAL SHOULDER WORK #1
(SEE NOTE A–1 THIS SHEET)

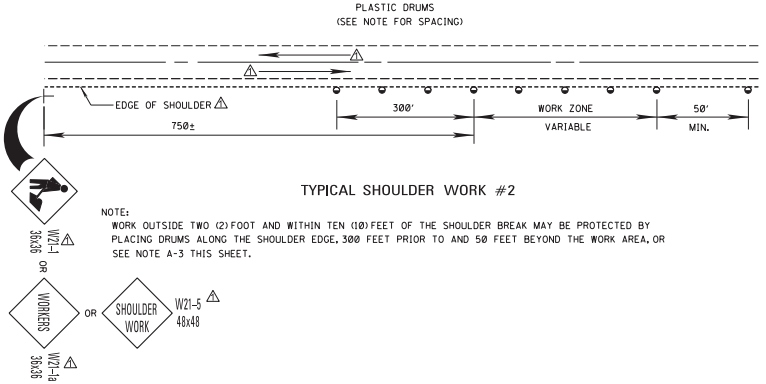

TYPICAL SHOULDER WORK #2

NOTE:
WORK OUTSIDE TWO (2) FOOT AND WITHIN TEN (10) FEET OF THE SHOULDER BREAK MAY BE PROTECTED BY PLACING DRUMS ALONG THE SHOULDER EDGE, 300 FEET PRIOR TO AND 50 FEET BEYOND THE WORK AREA, OR SEE NOTE A-3 THIS SHEET.

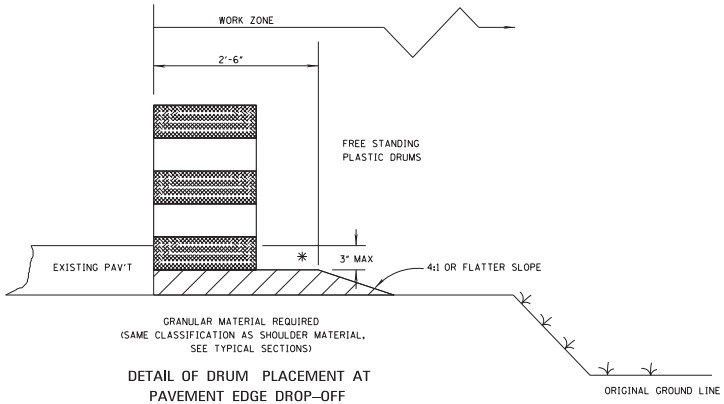

DETAIL OF DRUM PLACEMENT AT PAVEMENT EDGE DROP–OFF

NOTES:

✳ A. PAVEMENT EDGE DROP-OFF

1. IF LESS THAN TWO AND ONE QUARTER (2.25) INCHES-NO PROTECTION REQUIRED. PLACE A SHOULDER WORK SIGN (W21-5) 500 FEET IN ADVANCE OF WORK ZONE SHOULDER AND A LOW SHOULDER SIGN (W8-9) AT THE BEGINNING AND THROUGHOUT THE WORK ZONE ø (750'+0.C.).

△ 2. TWO AND ONE QUARTER TO THREE INCHES-PLACE DRUMS, VERTICAL PANELS OR BARRICADES EVERY 100 FEET ON TANGENT SECTIONS FOR SPEEDS OF 50 MILES PER HOUR OR GREATER. CONES MAY BE USED IN PLACE OF DRUMS, PANELS, AND BARRICADES DURING DAYLIGHT HOURS. FOR TANGENT SECTIONS WITH SPEEDS LESS THAN 50 MILES PER HOUR AND FOR CURVES, DEVICES SHOULD BE PLACED EVERY 50 FEET. SPACING FOR TAPERS SHOULD BE IN ACCORDANCE WITH THE MUTCD (1 / 3 L, WHERE L IS THE TAPER LENGTH IN FEET.)

3. GREATER THAN THREE (3) INCHES-POSITIVE SEPARATION OR WEDGE WITH 4:1 OR FLATTER SLOPE NEEDED. IF THERE IS EIGHT (8) FEET OR MORE DISTANCE BETWEEN THE EDGE OF TRAVEL LANE AND DROP-OFF, THEN DRUMS, PANELS OR BARRICADES MAY BE USED.

4. FOR TEMPORARY CONDITIONS, DROP-OFFS GREATER THAN THREE (3) INCHES MAY BE PROTECTED WITH DRUMS, VERTICAL PANELS OR BARRICADES FOR SHORT DISTANCES DURING DAYLIGHT HOURS WHILE WORK IS BEING DONE IN THE DROP-OFF AREA.

5. LESSER TREATMENTS THAN THOSE DESCRIBED ABOVE MAY BE CONSIDERED FOR LOW-VOLUME LOCAL STREETS.

△ B. DRUM, VERTICAL PANEL, OR BARRICADE SPACING

1. TANGENTS = 2 X S
2. TAPERS = L / 3
WHERE L = S X W
L = TAPER LENGTH IN FEET
△ S = SPEED IN MPH (POSTED OR ANTICIPATED OPERATING SPEED)
W = WIDTH OF OFFSET IN FEET

C. ALL TRAFFIC CONTROL ITEMS SHOWN ON THIS SHEET SHALL BE PAID FOR UNDER MAINTENANCE OF TRAFFIC.

TABLE VI-1. GUIDELINES FOR LENGTH OF LONGITUDINAL BUFFER SPACE

✳✳ SPEED (MPH)	LENGTH (FEET)	
20	115	△
25	155	△
30	200	△
35	250	△
40	305	△
45	360	△
50	425	△
55	495	△
60	570	△
65	645	△

✳✳ POSTED SPEED, OFF-PEAK 85 PERCENTILE SPEED PRIOR TO WORK STARTING, OR THE ANTICIPATED OPERATING SPEED IN MPH.

△	SYN	BY
	REVISED TEXT	
	REVISION	
	12/17/25	
	DATE	

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
ROADWAY DESIGN DIVISION
STANDARD PLAN

TRAFFIC CONTROL DETAILS DRUM PLACEMENT AND SHOULDER CLOSURE

MDOT

WORKING NUMBER
TCP-16

ISSUE DATE: AUGUST 01, 2017

SHEET NUMBER
6366

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 8076 **CODE: (SP)**

DATE: **07/22/2026**

SUBJECT: **Contract Time**

PROJECT: **NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301**
Warren County

The completion of work to be performed by the Contractor for this project will not be a specified date but shall be when all allowable working days are assessed, or any extension thereto as provided in Subsection 108.06. It is anticipated that the Notice of Award will be issued no later than **September 08, 2026** and the date for Notice to Proceed / Beginning of Contract Time will be **October 08, 2026**.

Should the Contractor request a Notice to Proceed earlier than **October 08, 2026** and it is agreeable with the Department for an early Notice to Proceed, the requested date will become the new Notice to Proceed date. Regardless of whether or not an early Notice to Proceed is granted, contract time will start at the original Notice to Proceed date.

All requests for an early Notice to Proceed shall be sent to the Project Engineer who will forward it to the Contract Administration Division.

171 Working Days have been allowed for the completion of work on this project.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 8077

DATE: 07/172026

SUBJECT: Specialty Items

PROJECT: NHPP-0009-02(086)/108212301 & STBG-0009-02(094)/109575301 - WARREN

Pursuant to the provisions of Section 108, the following work items are hereby designated as "Specialty Items" for this contract. Bidders are reminded that these items must be subcontracted in order to be considered as specialty items.

CATEGORY: DISPOSAL OF BUILDINGS, RIGHT OF WAY CLEARING & GRUBBING

Line No	Pay Item	Description
0070	202-B240	Removal of Traffic Stripe

CATEGORY: EROSION CONTROL

Line No	Pay Item	Description
0120	237-A002	Wattles, 20"
0440	907-234-A001	Temporary Silt Fence

CATEGORY: GUARDRAIL, GUIDERAIL

Line No	Pay Item	Description
0200	606-B001	Guard Rail, Class A, Type 1
0210	606-C003	Guard Rail, Cable Anchor, Type 1
0220	606-D019	Guard Rail, Bridge End Section, Type H
0230	606-D022	Guard Rail, Bridge End Section, Type I
0240	606-E005	Guard Rail, Terminal End Section, Flared

CATEGORY: MISCELLANEOUS/ SPECIALTY WORK ITEMS

Line No	Pay Item	Description
0150	423-A001	Rumble Strips, Ground In

CATEGORY: PAVEMENT STRIPING AND MARKING

Line No	Pay Item	Description
0580	907-626-A010	6" Thermoplastic Traffic Stripe, Skip White
0590	907-626-B006	6" Thermoplastic Traffic Stripe, Continuous White
0600	907-626-E005	6" Thermoplastic Traffic Stripe, Continuous Yellow
0610	907-626-G004	Thermoplastic Detail Stripe, White
0620	907-626-G005	Thermoplastic Detail Stripe, Yellow
0630	907-626-H009	Thermoplastic Legend, White
0640	907-626-H010	Thermoplastic Legend, White
0650	907-627-J001	Two-Way Clear Reflective High Performance Raised Markers
0660	907-627-K001	Red-Clear Reflective High Performance Raised Markers
0670	907-627-L001	Two-Way Yellow Reflective High Performance Raised Markers

CATEGORY: SURVEY AND STAKING

Line No	Pay Item	Description
0410	699-A001	Roadway Construction Stakes

CATEGORY: TRAFFIC CONTROL - PERMANENT

Line No	Pay Item	Description
0380	630-F006	Delineators, Guard Rail, White
0390	630-F007	Delineators, Guard Rail, Yellow
0400	630-G005	Type 3 Object Markers, OM-3R or OM-3L, Post Mounted
0680	907-632-D001	Solid State Traffic Actuated Controller, Type 1
0690	907-632-G001	Malfunction Management Unit
0700	907-643-A004	Video Vehicle Detection Sensor, Type 1A
0710	907-643-A005	Video Vehicle Detection Sensor, Type 1B
0720	907-643-B001	Video Vehicle Detection Cable
0730	907-643-C002	Video Vehicle Detection Processor, Type 1
0740	907-650-A004	On Street Video Equipment, PTZ Type, Signal Monitoring
0750	907-662-D002	Radio Interconnect, Broadband, Short Range
0760	907-663-A001	Network Switch, Type A

CATEGORY: TRAFFIC CONTROL - TEMPORARY

Line No	Pay Item	Description
0270	619-A1001	Temporary Traffic Stripe, Continuous White
0280	619-A2001	Temporary Traffic Stripe, Continuous Yellow
0290	619-A3001	Temporary Traffic Stripe, Skip White
0300	619-A5001	Temporary Traffic Stripe, Detail
0310	619-A6001	Temporary Traffic Stripe, Legend
0320	619-A6002	Temporary Traffic Stripe, Legend
0330	619-F1002	Portable Median Barrier
0340	619-G5001	Free Standing Plastic Drums
0350	619-G7001	Warning Lights, Type "B"
0360	619-J1004	Impact Attenuator, 60 MPH
0560	907-619-B001	Temporary Portable Rumble Strips
0570	907-619-E3001	Changeable Message Sign

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 8078 **CODE: (SP)**

DATE: **7/08/2026**

SUBJECT: **Cooperation Between Contractors**

PROJECT: **NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301**
Warren County

The Bidder's attention is hereby called to Subsection 105.07, Cooperation between Contractors, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction.

The Bidder is advised that this project adjoins the following project that may be under construction before the completion of this contract:

IM-0020-01(286) / 109482301 – Warren County, Mill & Overlay I-20 from MS River Bridge to 0.65 mile East of MS 27 / US 61 Overpass

The Contractor shall cooperate in all respects and shall coordinate construction of all phases of work with the Contractor of the adjoining project. Failure to coordinate work schedules, such as but not limited to lane closures, shall not be reason to modify contract time.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 – NOTICE TO BIDDERS NO. 8079 **CODE: (SP)**

DATE: **7/08/2026**

SUBJECT: **Scope of Work**

PROJECT: **NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301**
Warren County

The contract documents do not include an official set of construction plans, but may, by reference, include some Standard Drawings when so specified in a Notice to Bidders entitled, "Standard Drawings."

US HIGHWAY 61 MILL & OVERLAY
FROM I-20 TO NORTH OF SR 465 IN WARREN COUNTY
LOG MILE 17.374 – 28.341
&
US HIGHWAY 61 SLIDE REPAIR
SOUTH OF REDWOOD

The work to be accomplished using the pay items and corresponding specifications set forth in the Contract is to mill and overlay with asphalt pavement approximately 11 miles of US 61 from the beginning of asphalt pavement north of I-20 to approximately 0.4 miles north of SR 465 in Warren County. This work shall include the US 61 / SR 3 Interchange.

&

The work to be accomplished using the pay items and corresponding specifications set forth in the Contract is to stabilize and repair one slide failure location on the 4-lane section of US Highway 61 between Marilyn Drive and Redwood Road in Warren County.

NOTE: Work requiring lane closures shall only be allowed at night from the BOP to the northernmost River Region hospital entrance, approximately log mile 17.374-19.200 and the ramps at the US 61 / SR 3 interchange.

NOTE: Work on the surface lift shall be delayed in the southbound lanes from approximately log mile 24.8-26.3 until slide repairs are complete or as directed by the Project Engineer.

Work on the Project shall consist of the following:

1. The Contractor shall erect and maintain construction signing, provide all signs, set up nighttime lane closures (if needed) and traffic handling devices in accordance with the Traffic Control Plan. The costs for this work shall be included in the price bid for pay item 907-618-A, Maintenance of Traffic. All traffic control devices on this project shall comply with the latest version of the MUTCD. Fluorescent orange sheeting shall be used on all construction and traffic control signs except for those designated in the standards to be black legend and border on white background. The Contractor shall be required to use free standing

plastic drums with 2 recycled truck tire ballasting collars per drum or 42-inch channelizer cones with 6-inch-wide reflective tape and 16-pound vertical panel bases for each channelizer cone.

NOTE: See TCP Signs BOP, TCP Signs EOP, and TCPQ-1 for additional details.

2. Log Mile 17.5-22.8: The Contractor shall remove the designated failed pavement, continuously reinforced concrete pavement overlaid with asphalt, areas from the main facility as directed by the Project Engineer (see Pavement Repair sheet).

   a. Saw cut through the failed pavement. (Asphalt and/or Concrete)

   b. Remove the failed pavement.

   c. Remove any unsuitable material in the subgrade as directed by the Project Engineer. Removal of this material shall be paid for as excess excavation.

   d. Install drilled and epoxied/grouted #5 tie bars (30" long) and #5 reinforcing bars at 24" O.C. (Transverse) or 12" O.C. (Longitudinal). The #5 reinforcing bars shall be welded to the #5 tie bars. Costs for the #5 reinforcing bars shall be absorbed in other items bid.

   e. Place 8" and variable continuously reinforced concrete pavement, broom finish to the top of the surrounding concrete. Any additional depth under the 8" concrete pavement shall be filled and paid under the concrete for base repair pay item.

   f. Backfill with 19-mm, ST, asphalt pavement, leveling to the surrounding asphalt grade. No lift of 19-mm, ST, asphalt pavement shall be greater than 3½" or as designated by the Project Engineer. Densities will not be required on this asphalt. The Contractor shall compact each lift to refusal or as directed by the Project Engineer. If final grade cannot be reached in a single workday closure, the Contractor will have to get the grade to an allowable drop-off depth for a long term (overnight) closure.

3. Log Mile 22.8-28.341: The Contractor shall remove the designated failed pavement areas from the main facility as directed by the Project Engineer (see Pavement Repair sheet).

   a. Saw cut through the failed pavement. (Asphalt and/or Concrete)

   b. Remove the failed pavement.

   c. Remove any unsuitable material in the subgrade as directed by the Project Engineer. Removal of this material shall be paid for as excess excavation.

   d. Backfill and stabilize the failed areas with 19-mm, ST, asphalt pavement, leveling. The final grade of the asphalt shall match the surrounding grade. No lift of 19-mm, ST, asphalt pavement shall be greater than 3½" or as designated by the Project Engineer. Densities will not be required on this asphalt. The Contractor shall compact each lift to refusal or as directed by the Project Engineer. All repairs must be complete by the end of the workday, and the lane closures must be removed from the roadway so that all lanes of travel are open to the public.

4. The Contractor shall remove and replace an existing 24" cross drain on Wells Road. The cross

drain is located approximately 520’ south of the US 61 / Wells Road intersection. The Contractor shall remove the old drainage structures and replace with 32 LF of 24” RCP and 2-FES. This work shall be paid under the provided pay items (see 24” RCP sheet for details). The Contractor shall submit a road closure plan for this work. All traffic control items for this work shall be absorbed in other items bid.

5. The Contractor shall underseal the roadway and shoulders adjacent to each end of the following bridges: BR No. 126.6 (Yazoo River) and BR Nos. 0.3 and 0.4 (SR 3 intersection). The undersealing shall extend from the bridge end out to 25 feet along the center line. The underseal method for this project will be the Deep Injection Process. This work is to be paid under the 907-420-A001 Undersealing pay item.

6. The Contractor shall fine mill, a depth of 1½” and variable, the main roadway from BOP to EOP on a 2% cross slope or the appropriate superelevation rate left and right of the centerline. Local roads, guardrail pads, paved shoulders, aprons, crossovers, and other variable width areas shall be milled to a depth of 1½” and variable or as directed by the Project Engineer. It is the Contractor’s responsibility to ensure the drainage of surface water from the milled areas including the use of shoulder cuts.

   NOTE: Temporary wedges of full lane width asphalt pavement shall be placed by the Contractor immediately after the milling process to allow the safe transition of traffic. The length of the wedges shall be 3 ft. for every ½" in height. These wedges shall be maintained in satisfactory condition by the Contractor until the permanent asphalt pavement is placed. All costs for placing and maintaining these wedges shall be absorbed in other pay items. Cold mix shall not be allowed.

7. The Contractor shall overlay the main roadway by placing a 1½” lift of 9.5-mm, HT, Asphalt Pavement on the main roadway having a 2% cross slope or the appropriate super elevation rate left and right of the centerline such that the overall width is 28’. The Contractor shall overlay outside shoulders wider than 2’ by placing a 1½” lift of 9.5-mm, ST, Asphalt Pavement having a 2% cross slope or the appropriate super elevation rate. Any work to control the laydown equipment for proper placement of the asphalt in the superelevated curves shall be absorbed by the Contractor at no additional cost to the State. Asphalt shall be placed in full lane width passes on the main roadway and in widths as necessary at intersections and other areas where the pavement width varies.

   Existing local roads are to be paved to the right of way or as directed by the Project Engineer. Construct any local road tie-ins and aprons that have not been paved by placing a minimum of three (3) inches of asphalt pavement as directed by the Project Engineer. Existing paved aprons crossovers, and guardrail pads are to be paved to match final mainline grades. Any site grading at local roads, aprons, crossovers, and guardrail pads shall not be measured for separate payment but shall be considered an absorbed item. All local roads, aprons, crossovers, and guardrail pads shall be paid under the 9.5-mm, ST, asphalt pavement pay item.

   NOTE: Where jointed concrete pavement is overlaid with asphalt, the existing transverse joints shall be sawed and sealed.

   NOTE: Guardrail pads are to be constructed according to the included guardrail post

installation drawing; granular material shall be used in place of crushed stone base. Pavement removal required for existing guardrail pads will be paid under the Sawcut and Removal of Asphalt Pavement pay items Removal of granular material needed for paving the pads will be paid under the Excess Excavation pay item only if material is removed from the project site.

8. Temporary striping shall conform to finished stripe specifications for alignment, reflectivity, straightness, and neatness. Temporary stripe shall be placed as needed for the safe movement of traffic. All permanent pavement markings are to be hot thermoplastic. The Contractor shall mill a 12-inch rumble strip along the edge of pavement and spray 6-inch thermoplastic on the rumble strip to create a "Rumble Stripe". The Contractor shall mill a 12-inch rumble strip along two-lane roadway centerlines and spray the appropriate 6-inch thermoplastic on the rumble strip (see Rumble Stripe Detail sheet).

   NOTE: The stripe removal pay item is for the removal of stripes from concrete surfaces. At the BOP, the Contractor shall stripe the existing white gore section (see Gore Stripe sheet).

9. The Contractor shall raise the grade of the shoulders to match the new asphalt pavement grade. The finished slope shall be a minimum of 4%. Vegetative material shall be removed prior to placement of material along the shoulders. Shoulders shall be bladed, shaped, and compacted throughout the length of the project regardless of whether new granular material is required.

   If a surplus of material occurs during the blading of the existing shoulder material, it shall be spread along the edge of the shoulders, fore slopes, or other adjacent areas as directed by the Project Engineer and shall be an absorbed item. Material which cannot be placed in the adjacent areas and is deemed to be excess by the Project Engineer shall be removed from the project site. Payment for the removal of excess material shall be paid under the Excess Excavation pay item.

   NOTE: Any existing low shoulders or at any time there is a differential more than two (2) inches, the Contractor shall raise the shoulder grade up to the current asphalt grade. The Contractor may pull up existing shoulder material if possible or place new granular material. Incidental work such as removing vegetation, shaping, and compacting shoulders including the base for paved aprons, and other incidental work that is necessary to complete the work shall not be measured for separate payment and the cost shall be included in other items bid.

10. The Contractor shall install guardrail on the project using the guardrail pay items provided (see Guardrail sheet). Guardrail pads are to be constructed according to the included guardrail post installation drawing; granular material shall be used in place of crushed stone base. Type 3 Post Mounted Object Markers shall be installed at these sites.

11. Raised pavement markers shall be placed at 80-foot intervals in tangents and 40-foot intervals in curves & urban areas along the centerline or roadway. Existing raised pavement markers shall be removed prior to placement of asphalt pavement. The removal shall be considered an absorbed item of work.

12. As a part of final cleanup, the Contractor shall sweep clean and remove all debris on all bridge decks within the project limits. All costs for this work shall be included in other items bid.

13. The Contractor shall make the following Traffic Signal upgrades to the 3 traffic signal locations on the project (Culkin Road, River Region Drive, and Oak Ridge Road). This work shall be

paid for using the pay items provided:

a. Replace the existing EPAC controllers and MMU units with new controllers. The existing controllers and MMU units are to be salvaged to the MDOT Signal Shop. MDOT Signal Shop phone number is (601)359-1454. The Contractor shall be responsible for transferring existing controller signal timings and communication data to the new controllers.

b. Install Video Detection sensors per the manufacturer recommendations. This will include setting up all detection units to communicate with the MDOT Network via the existing network switch in each signal cabinet. MDOT shall provide IP addresses. All video detection cameras on mast arms shall be mounted on 6 foot risers.

c. The Contractor may remove the existing detection loop cable, if necessary.

d. Cable quantities shall be adjusted based on the video detection locations as per the manufacturer recommendations.

e. MDOT shall install a Circuit Cabinet for communication. The Contractor shall be responsible for installing the connection from this circuit cabinet to the signal cabinet at US 61 & River Region Drive to set-up communication. Notify the Project Engineer when it is time for MDOT to install the circuit cabinet. MDOT IS Division shall provide all IP addresses.

14. The Contractor shall make the following Slide Repairs on US 61 Southbound approximately 0.9 miles south of Redwood Road. The limits of the work below shall extend from the first (0.4 miles south of Redwood Road) to the second (2.0 miles south of Redwood Road) median crossover. This work shall be paid for using the pay items provided.

NOTE: Any clearing and/or grubbing required for access shall be considered an absorbed item and not measured for separate payment. Any erosion control devices shall be installed before work can begin at each location. Work required to reestablish vegetation shall be absorbed in other items bid.

a. Traffic Control
   i. The Contractor shall place portable median barrier and an impact attenuator as shown on the included drawings to protect the work area if material and/or equipment are to be stored in the roadway overnight.
   ii. If material and/or equipment are stored outside the clear zone limits, an extended duration lane closure in accordance with the standard drawings shall be allowed.
   iii. All costs associated with the placement of stabilized construction entrances shall be absorbed in other items bid.

b. Steel Piling
   i. The Contractor shall install HP 14x73 at 45 LF steel piling at the offsets and spacing as shown on the included drawings, approximately STA 455+00 – 458+60. Piling shall be driven vertically with no splicing permitted. Piling shall be grade 50. The pile size is a minimum requirement; larger section piling may be used.
   ii. When driving steel piling, the Contractor shall leave a gap in the spacing to avoid damaging existing drainage structures. Any damage to existing drainage structures shall

be repaired as directed by the Project Engineer at no additional cost to the State.

iii. Following installation of the steel piling, the Contractor shall backfill and site grade as shown on the included drawing. All costs associated with the site grading shall be absorbed in other items bid.

NOTE: MDOT shall use existing piezometer holes to monitor ground movements throughout pile driving operations.

NOTE: The Contractor shall start driving the first row of piles from the center bore hole and then work to the north or south from the center bore hole.

NOTE: After driving steel piling, but prior to surface asphalt lift, the Contractor shall spot level as directed by the Project Engineer with 9.5-mm ST, Asphalt Pavement, Leveling to correct cross slopes in the area of the slide repair.

c. Drainage Improvements

i. The Contractor shall remove sand and/or debris from paved ditches in the median as directed by the Project Engineer. This work shall be paid under 202-B093 Removal of Debris, LF.

ii. The Contractor shall remove sand and/or debris from inlets in the median and inside shoulder of the southbound lane as directed by the Project Engineer. This work shall be paid under 202-B263 Removal of Debris and Sand from Inlet and Junction Box, All Types & Sizes, EA.

iii. The Contractor shall clean, inspect, and line 3-24” cross drains within the limits of the slide repair, approximately STA 455+00 – 458+60. This work shall be paid under 907-603-D003 24” Cured-In-Place Pipe.

iv. The Contractor shall remove sand and/or debris from all other existing drainage pipes within the limits described above in Section No. 14 as directed by the Project Engineer. This work shall be paid under 202-B114 Removal of Debris and Sand from Pipe, All Sizes, LF.

v. The Contractor shall repair an existing washout area, approximately 0.7 miles south of Redwood Rd. in the Northbound Lanes, by installing flowable fill and 300 lb Riprap with geotextile as directed by the Project Engineer, see Washout Repair sheet.

NOTE: Work on the Cured-In-Place Pipe shall not begin until all steel piling have been driven.

NOTE: Formwork shall be required for the flowable fill at the washout repair location.

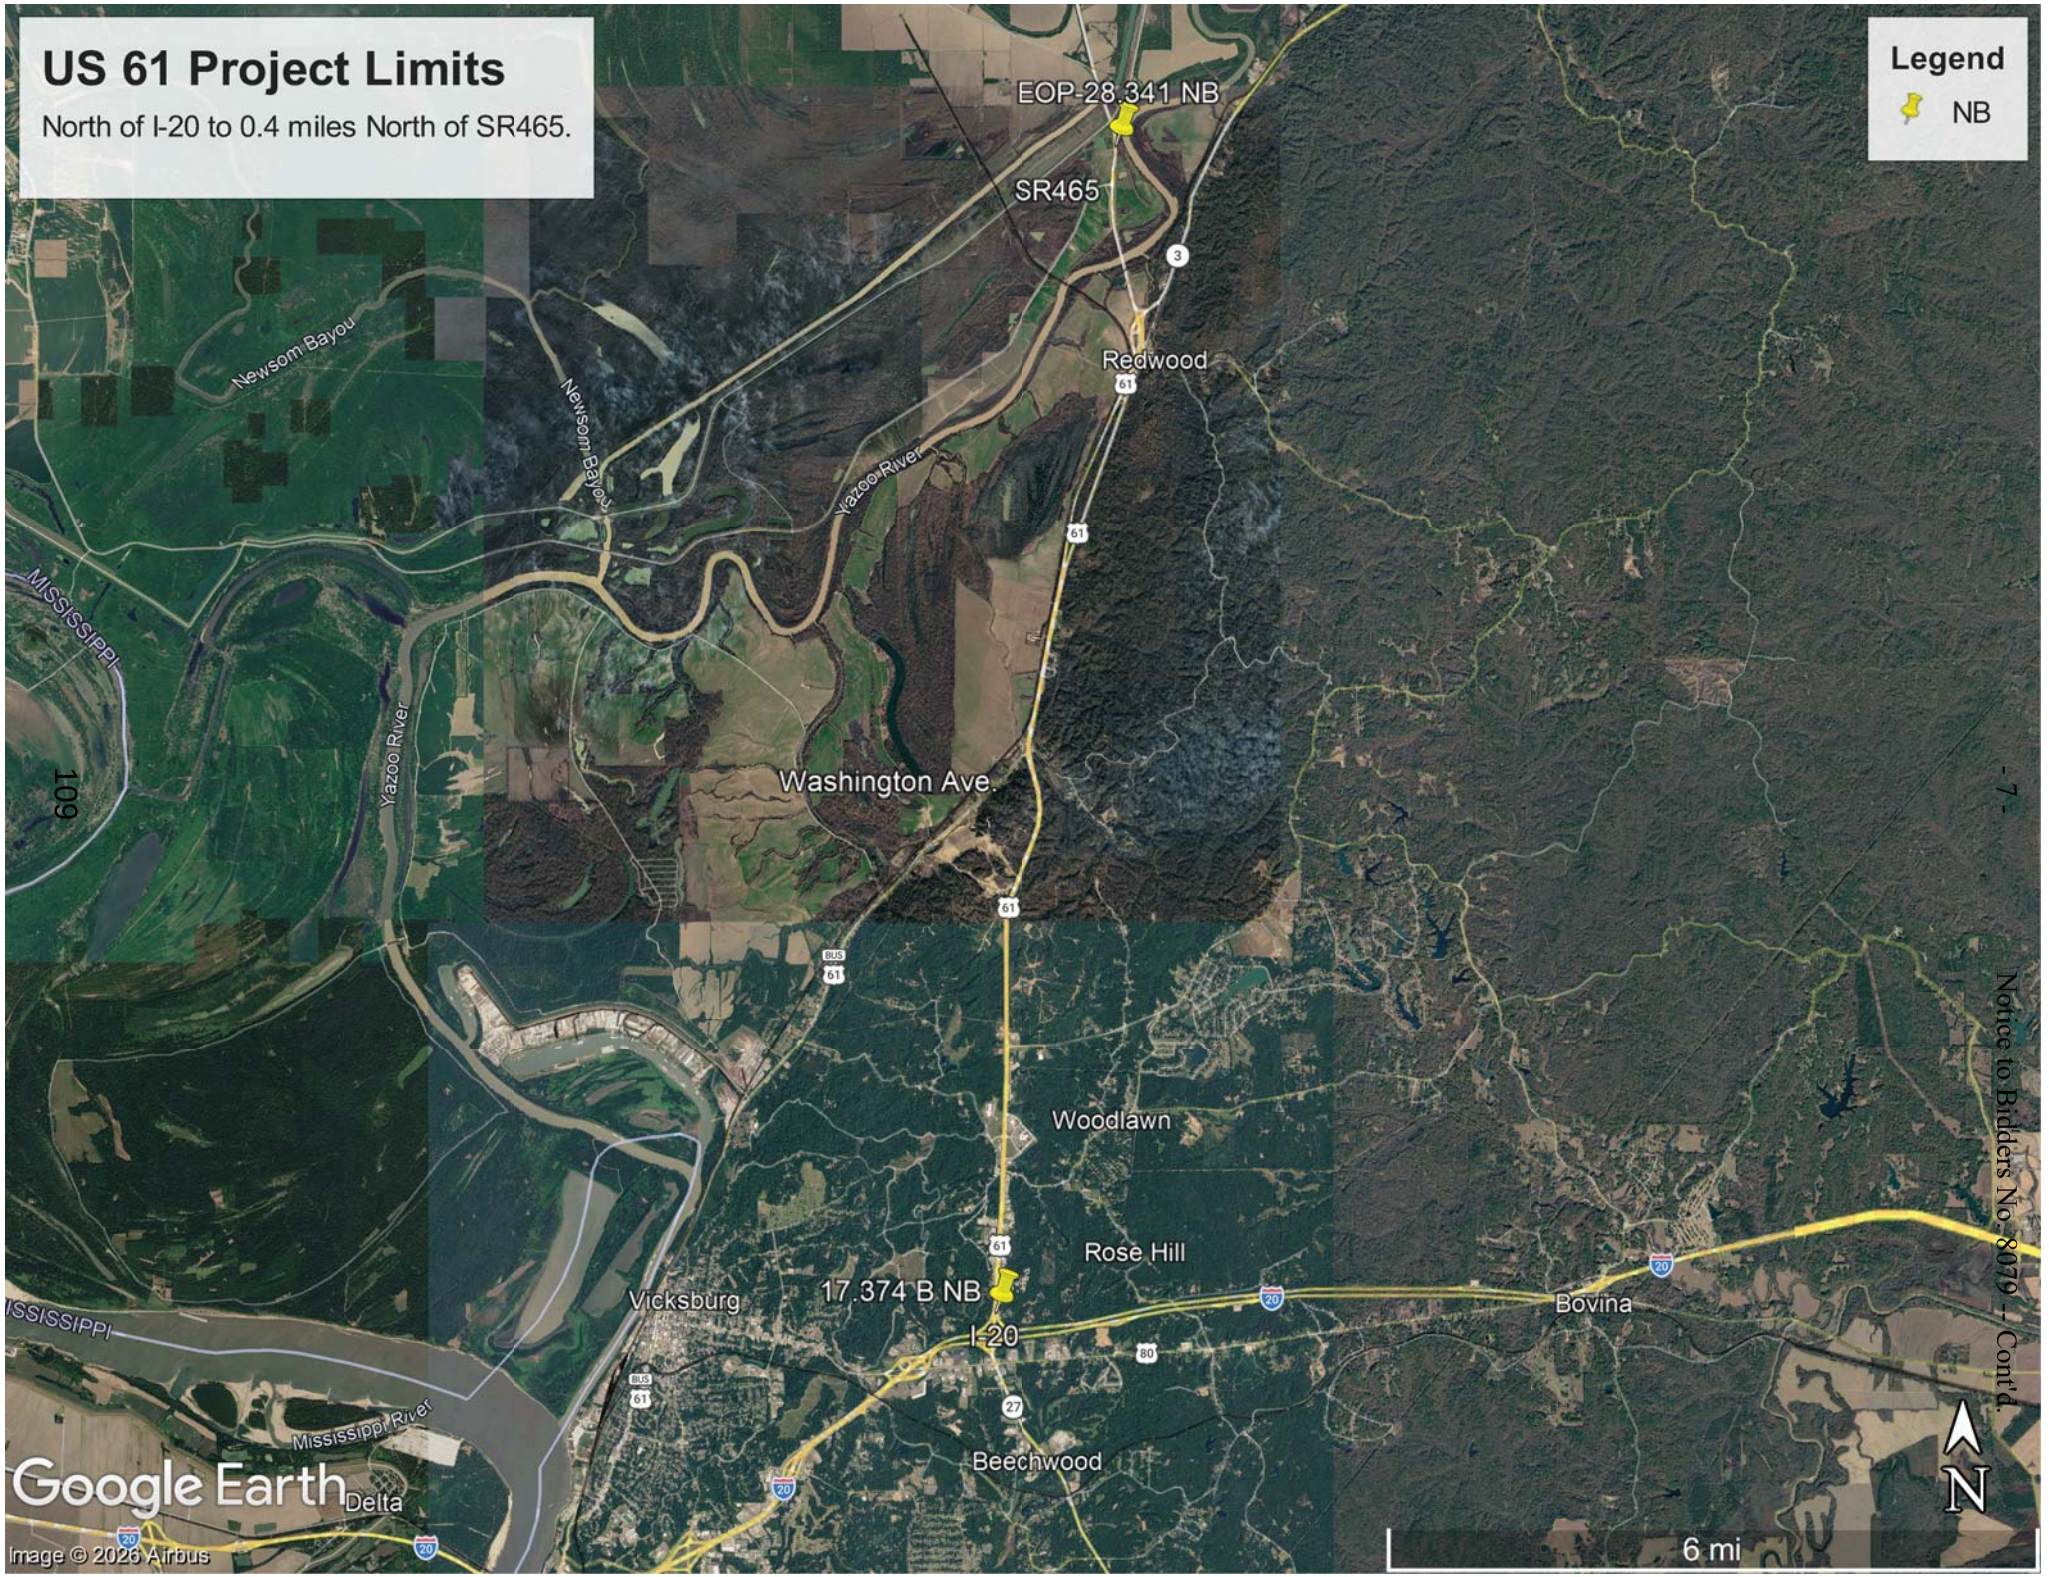
US 61 Project Limits
North of I-20 to 0.4 miles North of SR465.
Legend
NB
EOP-28.341 NB
SR465
Redwood
Newsom Bayou
Yazoo River
MISSISSIPPI
Washington Ave.
Woodlawn
Rose Hill
17.374 B NB
Vicksburg
Bovina
I-20
Beechwood
Delta
Mississippi River
Google Earth
Image © 2026 Airbus
6 mi
N

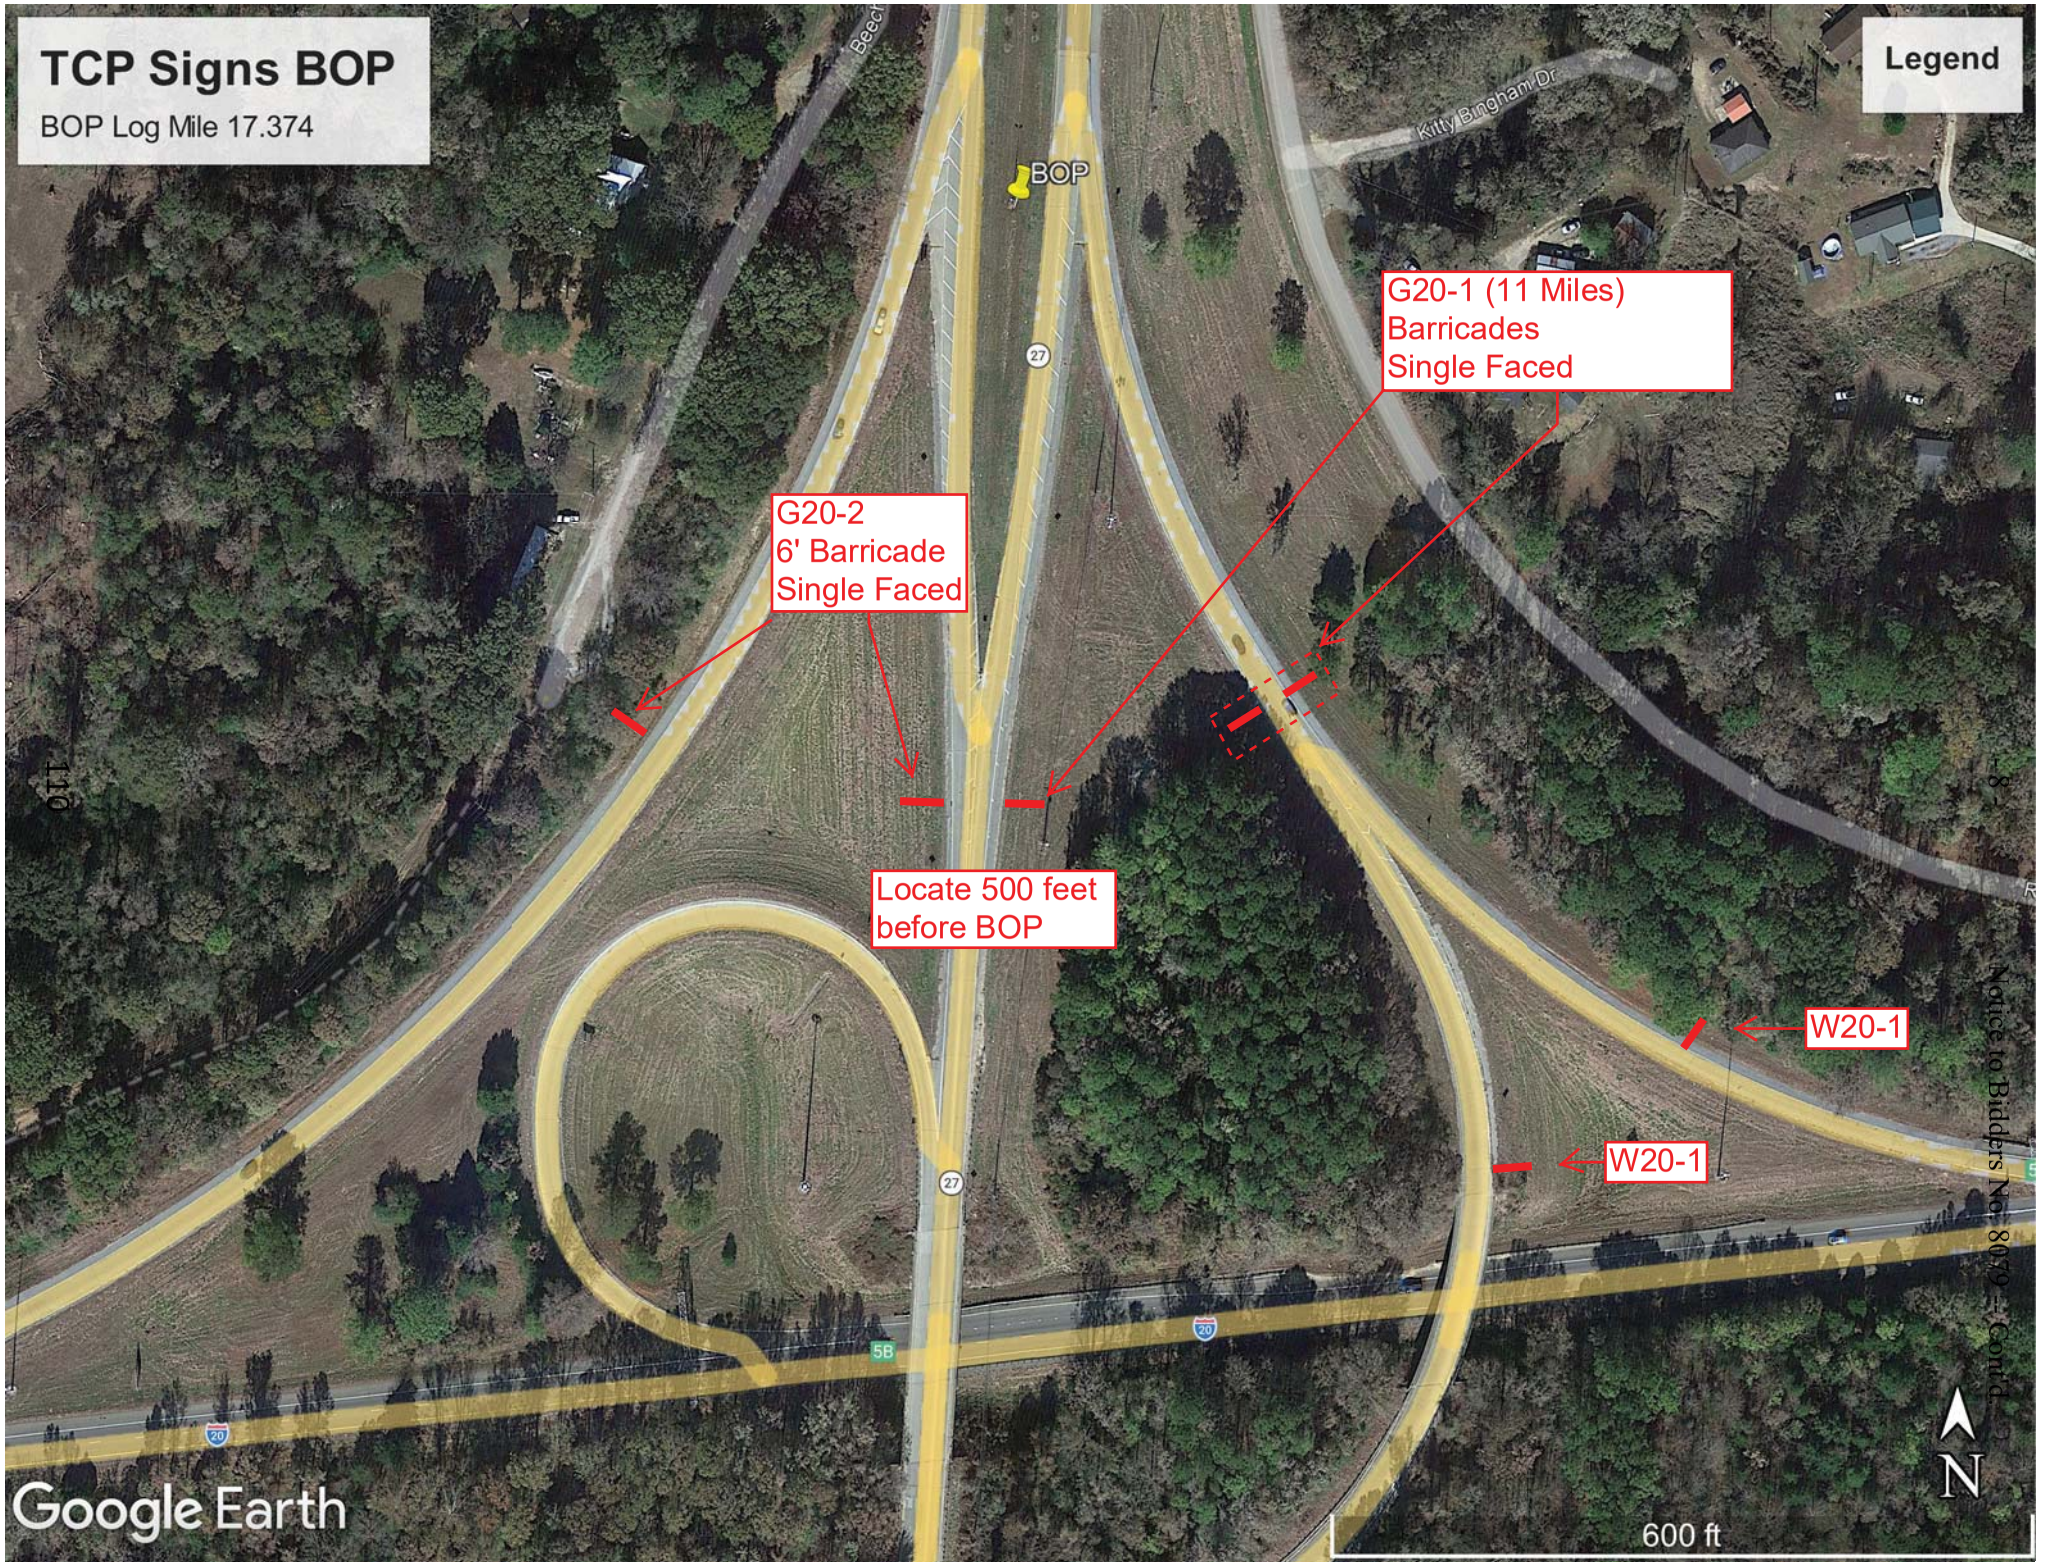
TCP Signs BOP
BOP Log Mile 17.374
Legend
BOP
Kitty Bingham Dr
G20-1 (11 Miles)
Barricades
Single Faced
G20-2
6' Barricade
Single Faced
Locate 500 feet
before BOP
W20-1
W20-1
110
27
5B
20
Google Earth
600 ft
N
Notice to Bidders No. 8079 - Cont'd.
8 -

US 61 TCP Signs EOP
Log Mile 28.341
Legend
Levee Maint Rd
Locate
500' beyond EOP
G-20-1 (11 Miles)
6' Barricade
(Double Faced)
G20-2
6' Barricade
(Double Faced)
Blues Hwy
Yazoo River
111
EOP
Google Earth
600 ft
N

SIGNS REQUIRED

	SIGN NO.	SIZE	UNIT AREA FT²	QUAN. REQ'D.	TOTAL SIGN AREA FT²	REMARKS
	G20 - 1	60" X 24"	10.00 ♦	4	40	ROAD WORK NEXT XX MILES
	G20 - 2	48" X 24"	8.00	3	24	END ROAD WORK
	G20 - 4	36" X 18"	4.50			PILOT CAR FOLLOW ME
1	M1 - 1	24" X 24"	4.00			1 OR 2 DIGIT
1	M1 - 1	30" X 24"	5.00			3 DIGIT
2	M1 - 4	24" X 24"	4.00			1 OR 2 DIGIT
2	M1 - 4	30" X 24"	5.00			3 DIGIT
3	M1 - 5	24" X 24"	4.00			1 OR 2 DIGIT
3	M1 - 5	30" X 24"	5.00			3 DIGIT
4	M3 - 1	24" X 12"	2.00			NORTH- 1 OR 2 DIGIT RTE. MARKER
4	M3 - 1	30" X 15"	3.13			NORTH- 3 DIGIT RTE. MARKER
4	M3 - 2	24" X 12"	2.00			EAST- 1 OR 2 DIGIT RTE. MARKER
4	M3 - 2	30" X 15"	3.13			EAST- 3 DIGIT RTE. MARKER
4	M3 - 3	24" X 12"	2.00			SOUTH- 1 OR 2 DIGIT RTE. MARKER
4	M3 - 3	30" X 15"	3.13			SOUTH- 3 DIGIT RTE. MARKER
4	M3 - 4	24" X 12"	2.00			WEST- 1 OR 2 DIGIT RTE. MARKER
4	M3 - 4	30" X 15"	3.13			WEST- 3 DIGIT RTE. MARKER
	M4 - 8	24" X 12"	2.00			DETOUR- 1 OR 2 DIGIT RTE. MARKER
	M4 - 8	30" X 15"	3.13			DETOUR- 3 DIGIT RTE. MARKER
	M4 - 9	48" X 36"	12.00 ♦			DETOUR ↑
	M4 - 9L	48" X 36"	12.00 ♦			DETOUR ←
	M4 - 9BL	48" X 36"	12.00 ♦			DETOUR
	M4 - 9SL	48" X 36"	12.00 ♦			DETOUR
	M4 - 9BSL	48" X 36"	12.00 ♦			DETOUR
	M4 - 9R	48" X 36"	12.00 ♦			DETOUR →
	M4 - 9BR	48" X 36"	12.00 ♦			DETOUR
	M4 - 9SR	48" X 36"	12.00 ♦			DETOUR
	M4 - 9BSR	48" X 36"	12.00 ♦			DETOUR
	M4 - 10L	48" X 18"	6.00			DETOUR
	M4 - 10R	48" X 18"	6.00			DETOUR
4	M4 - 5	24" X 12"	2.00			TO
4	M5 - 1L	21" X 15"	2.19			
4	M5 - 1R	21" X 15"	2.19			
4	M5 - 2L	21" X 15"	2.19			
4	M5 - 2R	21" X 15"	2.19			
4	M6 - 1L	21" X 15"	2.19			←
4	M6 - 1R	21" X 15"	2.19			→
4	M6 - 2L	21" X 15"	2.19			
4	M6 - 2R	21" X 15"	2.19			
4	M6 - 3	21" X 15"	2.19			↑

SIGNS REQUIRED (CONT'D)

	SIGN NO.	SIZE	UNIT AREA FT²	QUAN. REQ'D.	TOTAL SIGN AREA FT²	REMARKS
1	R1 - 1	36" OCTAGON	7.46			STOP
2	R1 - 1	48" OCTAGON	13.25 ♦			
2	R1 - 2	36" X 36" X 36"	3.90			YIELD
1	R1 - 2	48" X 48" X 48"	6.93			
2	R1 - 2	60" X 60" X 60"	10.83 ♦			
1	R1 - 3	18" X 9"	1.13			3-WAY, 4-WAY, ETC.
2	R1 - 3	24" X 12"	2.00			
1	R2-1	24" X 30"	5.00			SPEED LIMIT
2	R2-1	36" X 48"	12.00 ♦			
6	R2-1	48" X 60"	20.00 ♦			
1	R3-1	36" X 36"	9.00			
2	R3-1	48" X 48"	16.00 ♦			
1	R3-2	36" X 36"	9.00			
2	R3-2	48" X 48"	16.00 ♦			
1	R3-4	36" X 36"	9.00			
2	R3-4	48" X 48"	16.00 ♦			
	R3-5L	30" X 36"	7.50			ONLY
	R3-5R	30" X 36"	7.50			ONLY
	R3-6L	30" X 36"	7.50			
	R3-6R	30" X 36"	7.50			
	R3-7L	30" X 30"	6.25			LEFT LANE MUST TURN LEFT
	R3-7R	30" X 30"	6.25			RIGHT LANE MUST TURN RIGHT
1	R4-1	24" X 30"	5.00	6	30	DO NOT PASS
2	R4-1	48" X 60"	20.00 ♦			
1	R4-2	24" X 30"	5.00			PASS WITH CARE
2	R4-2	48" X 60"	20.00 ♦			
	R4-7	48" X 60"	20.00 ♦			
	R4-8	48" X 60"	20.00 ♦			
	R5-1	48" X 48"	16.00 ♦			DO NOT ENTER
	R5-1a	42" X 30"	8.75			WRONG WAY
	R6-1L	36" X 12"	3.00			ONE WAY
	R6-1R	36" X 12"	3.00			ONE WAY
	R6-2L	24" X 30"	5.00			ONE WAY
	R6-2R	24" X 30"	5.00			ONE WAY
	R11-2	48" X 30"	10.00 ♦			ROAD CLOSED
	R11-3a	60" X 30"	12.50 ♦			ROAD CLOSED XX MILES AHEAD
	R11-3b	60" X 30"	12.50 ♦			BRIDGE OUT XX MILES AHEAD
	R11-4	60" X 30"	12.50 ♦			ROAD CLOSED TO THRU TRAFFIC
	R12-1	36" X 48"	12.00 ♦			WEIGHT LIMIT XX TONS
7	R16-3	36" X 48"	12.00 ♦			WHEN WORKERS ARE PRESENT SPEEDING FINES DOUBLED
6 7	R16-3	48" X 60"	20.00 ♦			

SIGNS REQUIRED (CONT'D)

	SIGN NO.	SIZE	UNIT AREA FT²	QUAN. REQ'D.	TOTAL SIGN AREA FT²	REMARKS
	W1 - 1L	48" X 48"	16.00 ♦			
	W1 - 1R	48" X 48"	16.00 ♦			
	W1 - 2L	48" X 48"	16.00 ♦			
	W1 - 2R	48" X 48"	16.00 ♦			
	W1 - 3L	48" X 48"	16.00 ♦			
	W1 - 3R	48" X 48"	16.00 ♦			
	W1 - 4aL	48" X 48"	16.00 ♦			
	W1 - 4aR	48" X 48"	16.00 ♦			
	W1 - 5L	48" X 48"	16.00 ♦			
	W1 - 5R	48" X 48"	16.00 ♦			
1	W1 - 6L	48" X 24"	8.00			
2	W1 - 6L	60" X 30"	12.50 ♦			
1	W1 - 6R	48" X 24"	8.00			
2	W1 - 6R	60" X 30"	12.50 ♦			
1	W1 - 7	48" X 24"	8.00			
2	W1 - 7	60" X 30"	12.50 ♦			
1	W1 - 8L	18" X 24"	3.00			
2	W1 - 8L	36" X 48"	12.00 ♦			
1	W1 - 8R	18" X 24"	3.00			
2	W1 - 8R	36" X 48"	12.00 ♦			
	W1-9L	48" X 48"	16.00 ♦			
	W1-9L	48" X 48"	16.00 ♦			
	W2-6	36" X 36"	9.00			
	W3-1a	48" X 48"	16.00 ♦			
	W3-2a	48" X 48"	16.00 ♦			
	W3-3	48" X 48"	16.00 ♦			
	W3-5	48" X 48"	16.00 ♦			SPEED REDUCTION
	W4-1L	48" X 48"	16.00 ♦			
	W4-1R	48" X 48"	16.00 ♦			
	W4-2L	48" X 48"	16.00 ♦			
	W4-2R	48" X 48"	16.00 ♦			
	W4-3L	48" X 48"	16.00 ♦			
	W4-3R	48" X 48"	16.00 ♦			
	W4-6	48" X 48"	16.00 ♦			
	W5-1a	48" X 48"	16.00 ♦			PAVEMENT NARROWS
	W6-1	48" X 48"	16.00 ♦			
	W6-2	48" X 48"	16.00 ♦			
	W6-3	48" X 48"	16.00 ♦			
	W8-1	48" X 48"	16.00 ♦			BUMP
	W8-4	48" X 48"	16.00 ♦			SOFT SHOULDER
	W8-6	48" X 48"	16.00 ♦			TRUCK CROSSING

SIGNS REQUIRED (CONT'D)

	SIGN NO.	SIZE	UNIT AREA FT²	QUAN. REQ'D.	TOTAL SIGN AREA FT²	REMARKS
	W8-7	48" X 48"	16.00 ♦			LOOSE GRAVEL
	W8-9	48" X 48"	16.00 ♦			LOW SHOULDER
	W8-11	36" X 36"	9.00			UNEVEN LANES
	W8-12	48" X 48"	16.00 ♦			NO CENTER STRIPE
1	W10-1	36" DIA.	7.07			
2	W10-1	48" DIA.	12.56 ♦			
	W13-1	24" X 24"	4.00			XX MPH
1	W14-3	36" X 48" X 48"	5.56	2	11.12	NO PASSING ZONE
2	W14-3	48" X 64" X 64"	9.89			
	W16-2	24" X 18"	3.00			XXX FEET
	W19-2	48" X 48"	16.00 ♦			BRIDGE MAY ICE IN COLD WEATHER
1	W20 - 1	48" X 48"	16.00 ♦	29	464	ADVANCE ROAD WORK
2	W20 - 1	36" X 36"	9.00			
	W20 - 2	48" X 48"	16.00 ♦			ADVANCE DETOUR
	W20 - 3	48" X 48"	16.00 ♦			ADVANCE ROAD CLOSED
	W20 - 4	48" X 48"	16.00 ♦			ADVANCE ONE-LN. RD.
	W20 - 4b	48" X 48"	16.00 ♦			ADVANCE ONE-LN. BR.
	W20 - 5L	48" X 48"	16.00 ♦			ADVANCE LT. LN. CLOSED
	W20 - 5R	48" X 48"	16.00 ♦			ADVANCE RT. LN. CLOSED
	W20 - 7a	48" X 48"	16.00 ♦			
	W21 - 1	36" X 36"	9.00			WORKERS
	W21 - 1a	36" X 36"	9.00			
	W21-2	36" X 36"	9.00			FRESH OIL (TAR)
	W21-3	48" X 48"	16.00 ♦			ADVANCE ROAD MACHINERY
	W21-5	48" X 48"	9.00			SHOULDER WORK
	W21-6	36" X 36"	16.00 ♦			SURVEY CREW
	W24-1L	48" X 48"	16.00 ♦			
	W24-1R	48" X 48"	16.00 ♦			
	W24-1aL	48" X 48"	16.00 ♦			
	W24-1aR	48" X 48"	16.00 ♦			
	W24-1bL	48" X 48"	16.00 ♦			
	W24-1bR	48" X 48"	16.00 ♦			
	VP-1L	12" X 36"	3.00			
	VP-1R	12" X 36"	3.00			
5	OM-3L	12" X 36"	3.00			
5	OM-3R	12" X 36"	3.00			
	TOTAL SIGN AREA LESS THAN 10 SQ. FT.				65.12 SQ. FT.	
	TOTAL SIGN AREA GREATER THAN 10 SQ. FT. ♦				504 SQ. FT.	

NOTES

1. STANDARD
2. SPECIAL (USE WHERE WARRANTED)
1. INTERSTATE ROUTE MARKER
2. UNITED STATES ROUTE MARKER
3. STATE ROUTE MARKER
4. COLORS OF CARDINAL DIRECTION MARKERS AND DIRECTIONAL ARROWS SHALL BE APPROPRIATE TO MATCH ACCOMPANYING ROUTE MARKERS.
5. BLACK STRIPES ON YELLOW BACKGROUND
6. INTERSTATE USE ONLY
7. TOP OF SIGN - BLACK LETTERING ON ORANGE BACKGROUND, BOTTOM OF SIGN - BLACK LETTERING ON WHITE BACKGROUND

THE BACKGROUND OF ALL WARNING SIGNS ("W" SERIES) EXCEPT W10-1 SHALL BE ORANGE. THE W10-1 BACKGROUND SHALL BE YELLOW IN ALL CASES.

R4 -1 "DO NOT PASS", R4 -2 "PASS WITH CARE", and W14 -3 "NO PASSING ZONE" signs are required in accordance with Subsection 618.03.3 and as specified in the Manual on Uniform Traffic Control Devices. If no passing zones are 1,000 feet or more, install additional "DO NOT PASS" signs.

All Construction signing is included in the bid for Pay Item 618-A, Maintenance of Traffic. Fluorescent orange sheeting shall be used on all construction and traffic control signs except for R16-3, R4-1 and R4-2 signs which shall be black legend and border on white background.

PLAN SHEET

DATE 2:54:17 PM Special Designs.dgn

DEPARTMENT OF TRANSPORTATION STATE OF MISSISSIPPI

MDOT MISSISSIPPI DEPARTMENT OF TRANSPORTATION

DESIGNED BY: DISTRICT 7

DETAILED BY:

CHECKED BY:

DATE:

FMS CON: 108212/301000

PROJECT NO.: NHPP-0009-02(038) -

COUNTY: WARREN

TRAFFIC CONTROL SIGNS
SHEET 9 OF 9 -- Continued

WK. NO.
TCPD-1

SHEET NO.

Notice to Contractors

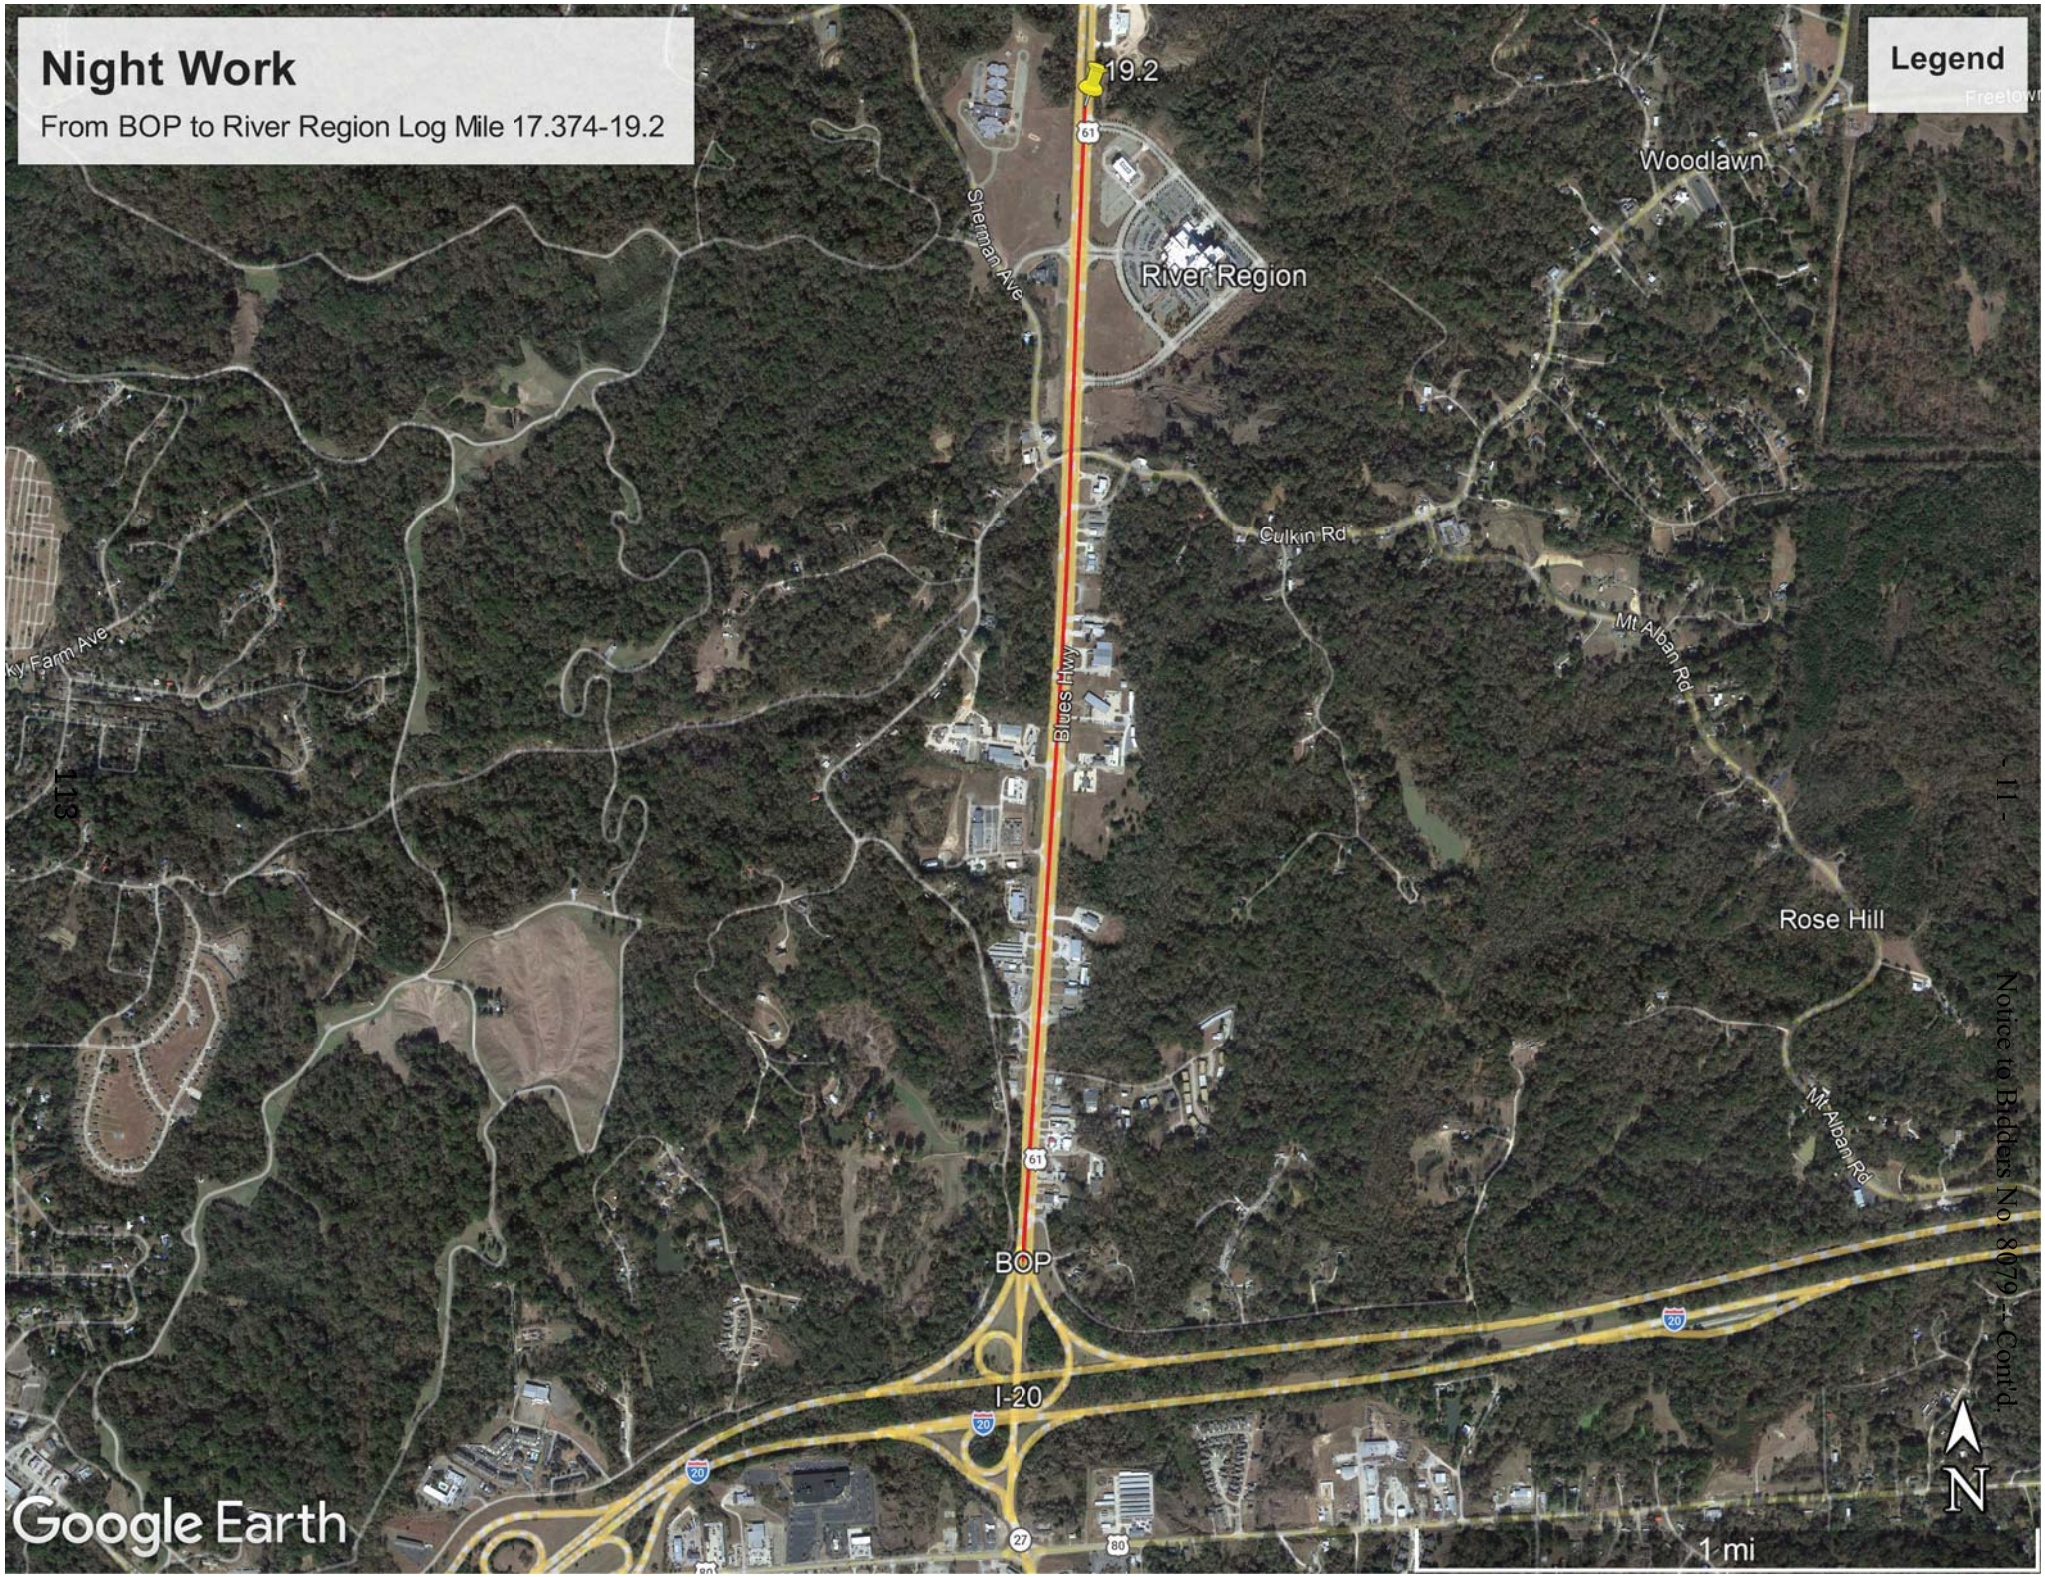
Night Work
From BOP to River Region Log Mile 17.374-19.2
Legend
19.2
Woodlawn
Sherman Ave
River Region
Culkin Rd
Mt Alban Rd
Blues Hwy
ky Farm Ave
113
Rose Hill
Mt Alban Rd
BOP
I-20
Google Earth
1 mi
N

PAVEMENT REPAIR

Northbound Lanes

No.	Log Mile	Location Lat.	Location Long.	Lane	Lane	Length(LF)	Width(LF)	Asphalt Removal Area(SY)	Concrete Removal Area(SY)	Excess Excava, (CY)	Sawcuts (LF)	8" Cont'l. Reinf. Conc. (SY)	Drilled Epoxy Bars (EA)	19-mm Asphalt Tons	Conc. For Base Rep. (CY)	
1	17.410	32.35154	-90.82900	NB	Both	6	28	19	19	3	62			11		*
2	19.531	32.38228	-90.82718	NB	Both	15	26	43	43	2	67	43	55	15	**2**	**
3	19.653	32.38405	-90.82715	NB	Both	14	26	40	40	2	66	40	55	14	**2**	**
4	20.041	32.38968	-90.82714	NB	Outside	6	12	8	8	0	36	8	27	3	**0**	**
5	21.261	32.40723	-90.82601	NB	Median	18	14	28	28	2	46	28	32	9	**2**	**
6	21.325	32.40807	-90.82556	NB	Both	14	24	37	37	2	76	37	55	13	**2**	**
7	22.264	32.42104	-90.82213	NB	Both	6	24	16	16	1	60	16	51	5	**1**	**
8	22.298	32.42152	-90.82229	NB	Both	20	24	53	53	3	88	53	57	18	**3**	**
9	22.362	32.42241	-90.82259	NB	Both	20	24	53	53	3	88	53	57	18	**3**	**
10	22.406	32.42302	-90.82279	NB	Both	11	24	29	29	2	70	29	53	10	**2**	**
11	22.449	32.42363	-90.82296	NB	Outside	15	12	20	20	1	54	20	31	7	**1**	**
12	22.454	32.42370	-90.82303	NB	Median	6	12	8	8	0	36	8	27	3	**0**	**
13	22.775	32.42830	-90.82310	NB	Both	6	24	16	16	1	60	16	51	5	**1**	**
14	22.939	32.43061	-90.82249	NB	Outside	30	3	10		2	66			3		
15	23.014	32.43167	-90.82221	NB	Outside	10	14	16		3	48			4		
16	23.123	32.43166	-90.82221	NB	Outside	10	6	7		1	22			2		
17	24.030	32.44612	-90.81874	NB	Both	6	28	19	19	3	62			13		*
18	24.881	32.45791	-90.81449	NB	Both	12	28	37	37	6	68			25		*
19	25.295	32.46355	-90.81205	NB	Outside	6	14	9	9	2	34			6		*
20	26.046	32.47381	-90.80767	NB	Outside	6	14	9	9	2	34			6		*
							Total	**477**	**444**	**41**	**1143**	**351**	**551**	**190**	**19**	

Souththbound Lanes

21	25.449	32.46575	-90.81293	SB	Outside	20	3	7		1	46			2		
22	25.280	32.46350	-90.81412	SB	Outside	25	3	8		1	56			2		
23	21.728	32.41334	-90.82324	SB	Outside	18	3	6		1	42			2		
24	20.523	32.39654	-90.82748	SB	Outside	25	3	8		1	56			2		
25	20.292	32.39319	-90.82749	SB	Outside	20	3	7		1	46			2		
26	19.996	32.38889	-90.82747	SB	Outside	20	3	7		1	46			2		
27	BOP	32.35165	-90.82934	SB	Shoulder	7	10	8	8	1	27			2		***
							Total	**51**	**8**	**7**	**319**	**0**	**0**	**14**	**0**	

*** Jointed reinforced concrete overlayed with asphalt**

**** Contiuously reinforced concrete overlayed with asphalt concrete overlayed with asphalt**

***** Outside shoulder, Jointed reinforced concrete pavement overlayed with asphalt.**

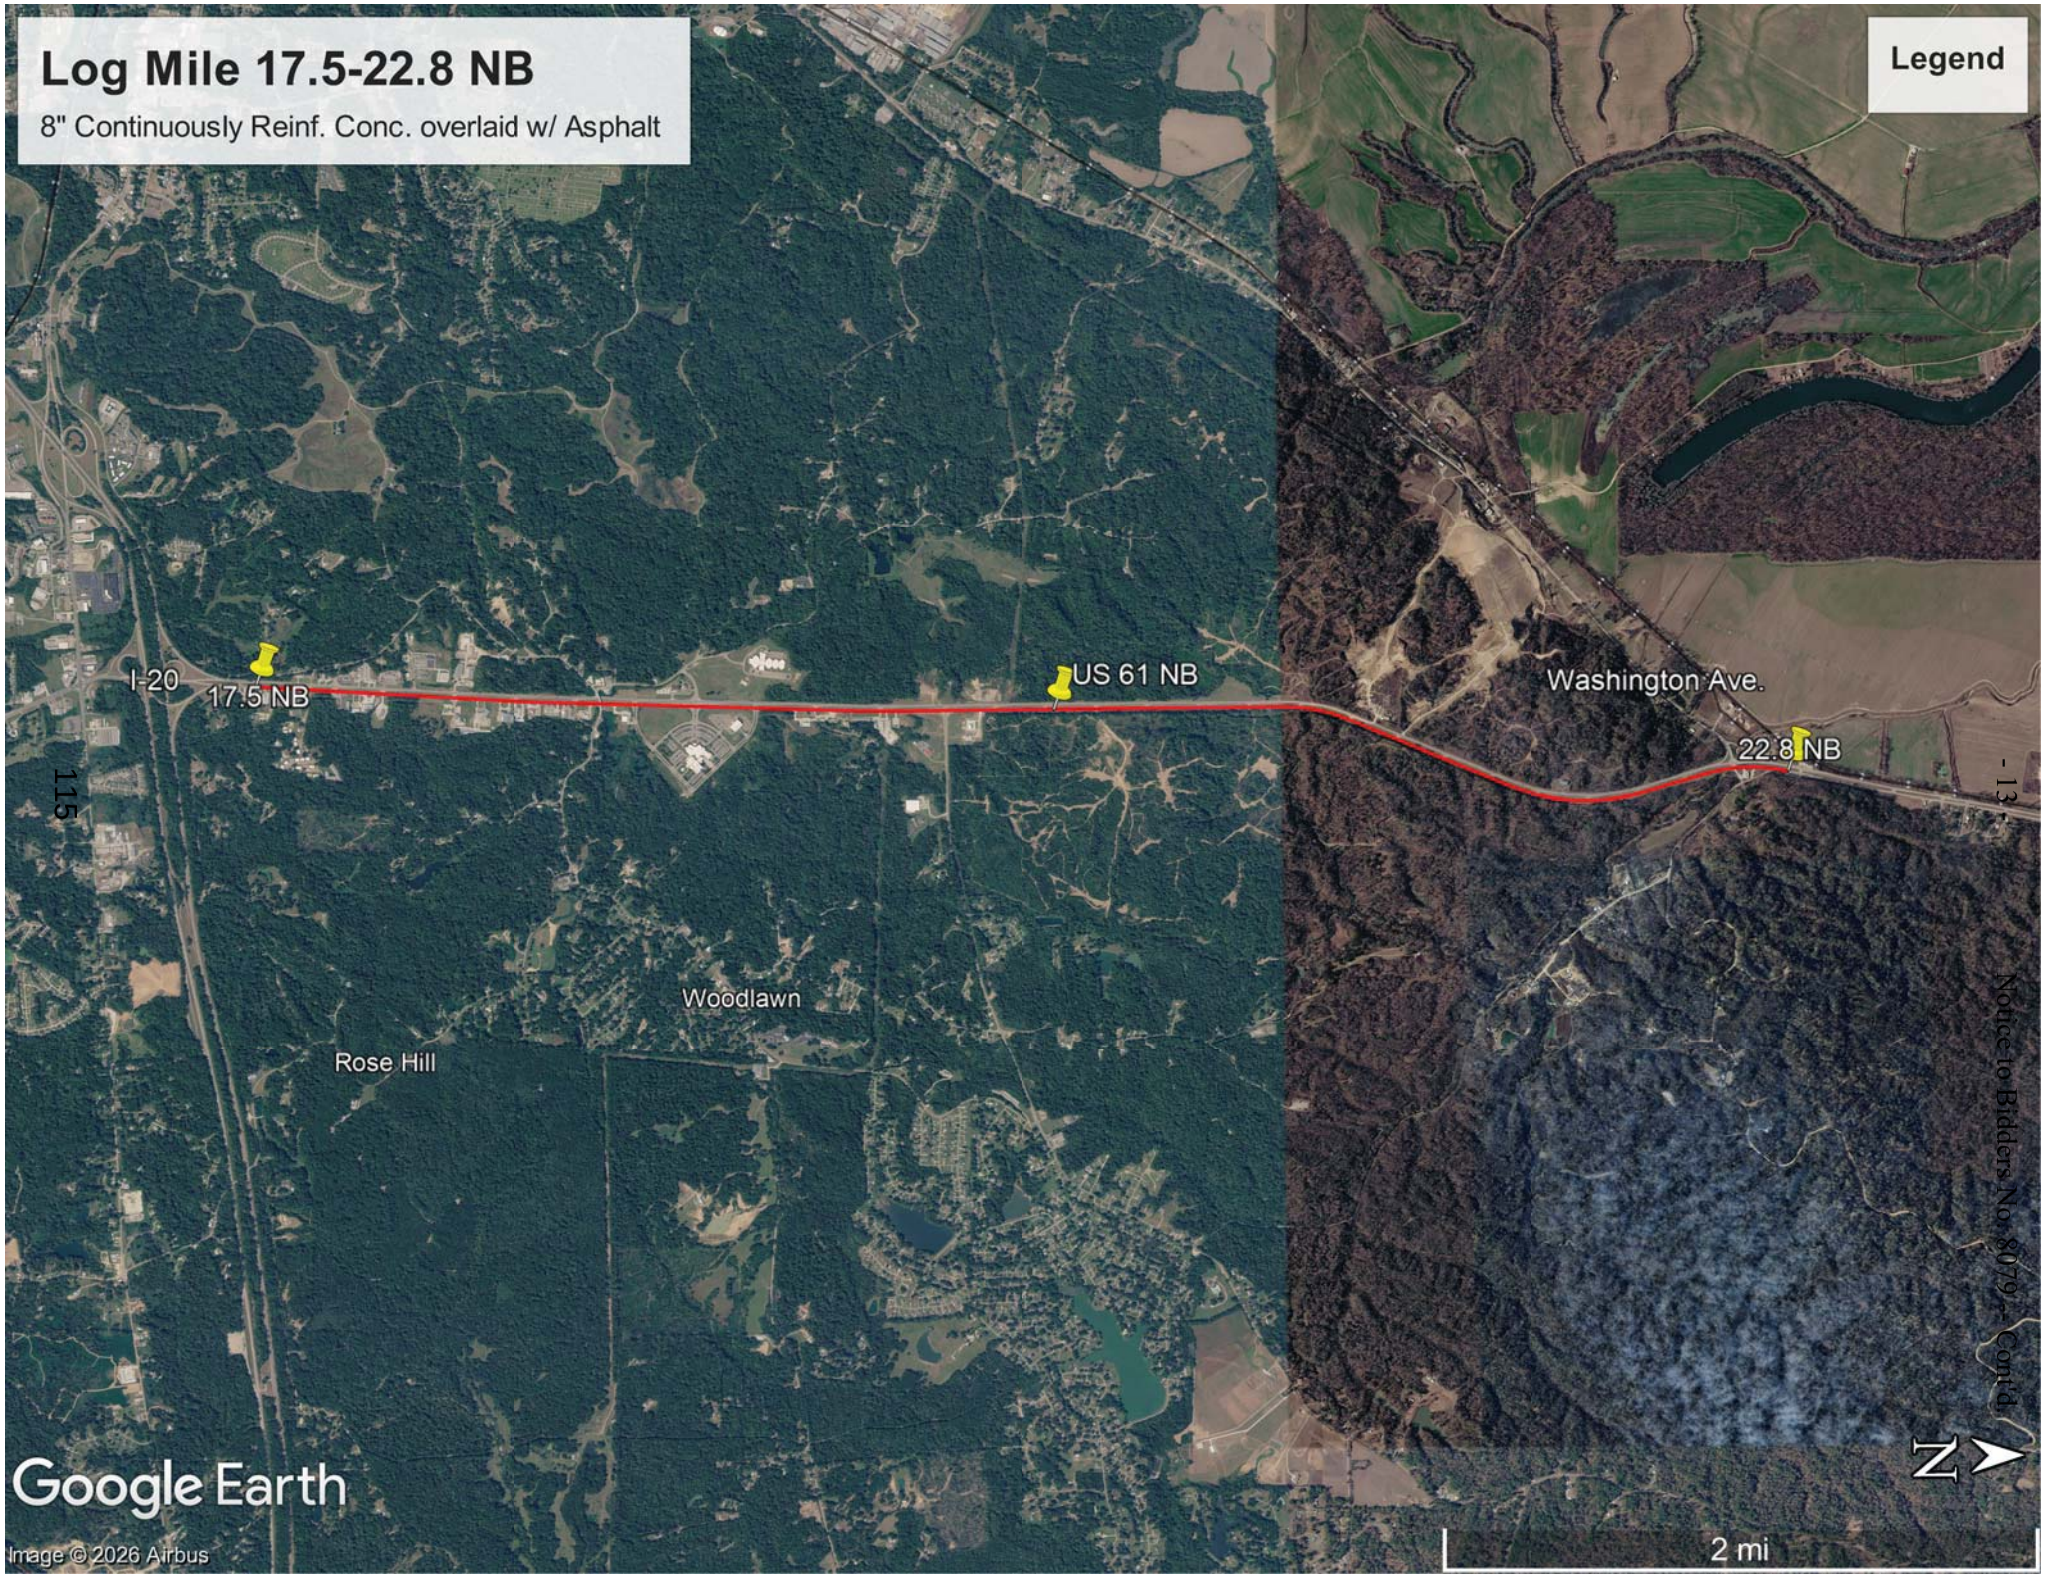
Log Mile 17.5-22.8 NB
8" Continuously Reinf. Conc. overlaid w/ Asphalt
Legend
I-20
17.5 NB
US 61 NB
Washington Ave.
22.8 NB
115
Woodlawn
Rose Hill
Google Earth
Image © 2026 Airbus
2 mi
N
Notice to Bidders No. 8079 - Cont'd.
- 13 -

			GUARD RAIL									
Station			Removal	w-beam	Terminals Flared	Br. End Sect. Type H	Br. End Sect. Type I	Type 1 Cable Anch.	Delinator White	Delinator Yellow	Type 3 Obj. Marks.	
		Lane	LF	LF	EA	EA	EA		EA	EA	EA	
BR. 126.6	SE	NB	221	162.50	1		1		7		1	
	SW	SB	108	50.00	1		1		4		1	
	NW	SB	221	162.50	1		1		7		1	
	NE	NB	221	162.50	1		1		7		1	
Br. 0.3	SE	NB	202	137.50	1	1			6		1	
	NW	SB	115	50.00	1	1			4		1	
Br. 0.4	SE	NB	202	137.50	1	1			6		1	
	NW	SB	202	137.50	1	1			6		1	
US 61	NW	SB	202	137.50	1	1			6		1	*
US 61	NE	SB	202	137.50	1	1				6	1	*
GR1	W	SB	1125	1081.00	1			1	28			**
GR2	W	SB		1025.00	1			1	27			***
GR3	E	NB		438.00	1			1				***
			3021	**3819**	**13**	**6**	**4**	**3**	**108**	**6**	**10**	

*** North end of the retaining wall section on the SB lanes of US 61. Located approximatley 0.8 miles south of the SR 3 Interchange at Redwood.**

**** Approximately 1 mile north of Washington St. (Old 61).**

***** Approximately 0.6 miles north of Washington St. (Old 61).**

Guard Rail No. 2 & 3
New guard rail sections located 0.6 miles north of Washington St.
Legend
GR2
GR3
22.975
22.754
117
Bliss Creek
Washington St.
Walnut Hills
Google Earth
Image © 2026 Airbus
N
1000 ft

24" RCP
24" Reinf. Conc. Pipe - 32 LF on Wells Rd.
Legend
Washington Ave.
Wells Rd.
US 61
24" RCP
118
16
Notice to Bidders No. 8070 – Contract
Google Earth
Image © 2026 Airbus
400 ft

Washout Repair
Use Riprap & Flowable Fill for repair located 0.7 miles south of Redwood Rd.
Legend
26.376 NB
Redwood Rd.
26.203 NB
25.667
Washout location
Google Earth
Image © 2026 Airbus
N
1000 ft

White Gore @ BOP
Legend
120
18
Notice to Bidders No. 8079 -- Cont'd.
N
200 ft
Google Earth
Image © 2024 Airbus

PAY ITEM NO.	PAY ITEM	UNIT	QUANTITY	Notes
907-632-D001	Solid State Traffic Actuated Controller, Type 1	EA	3	#1
907-632-G001	Malfunction Management Unit	EA	3	#1
907-643-A004	Video Vehicle Detection Sensor, Type 1A	EA	3	#2
907-643-A005	Video Vehicle Detection Sensor, Type 1B	EA	2	#2
907-643-B001	Video Vehicle Detection Cable	LF	1190	#3 #4
907-643-C002	Video Vehicle Detection Processor, Type 1	EA	3	
907-650-A004	On Street Video Equipment, PTZ Type, Signal Monitoring	EA	3	
907-663-A001	Network Switch, Type A	EA	3	#5
907-662-D002	Radio Interconnect, Broadband, Short Range	EA	4	

#1 Replace existing EPAC Controller and MMU units with new controller. Existing EPAC controllers and MMU units to be salvaged to MDOT Signal Shop (601-359-1454). Contractor shall be responsible for transferring existing controller signal timings and communication data to the new controller.

#2 Video detection sensors shall be mounted per manufacturer recommendations. Contractor shall be responsible for setting up all detection units to communicate with MDOT Network via existing network switch in each signal cabinet. MDOT shall provide the IP addresses. All video detection cameras on mast arms shall be mounted on 6 feet risers.

#3 Contractor may remove existing detection loop cable, if necessary.

#4 Cable quantities may be adjusted based on radar locations per manufacturer recommendations

#5 MDOT will install Circuit Cabinet for communication, Contractor shall be responsible for installing connection from circuit cabinet to the signal cabinet at US 61 and River Region Dr to setup communication.C MDOT IS Division to provide all IP addresses.

TRAFFIC SIGNAL VIDEO DETECTION CHART													
Intersection	**Detection Zone Location**	**Phase#**	**Detection Zone Size**	**Type 1A Video Sensor**	**Type 1B Video Sensor**	**Video Detection Cable (ft)**	**Video Detection Processor**	**PTZ Camera**	**Wireless Broadband Radios**	**MDOT Provided Communication Circuit**	**New Signal Controller Required**	**New MMU Conflict Monitor Required**	**Existing Pole Configuration**
US 61 at Culkin Road	SB Left Turn Lane	1	6'X50'		1	230	1	1	1		1	1	Woodpole Spanwire
	SB Thru Lane	6	330'										
	NB Thru Lane	2	330'										
	WB Left Turn Lane	4	6'X50'										
US 61 at River Region Dr	SB Left Turn Lane	1	6'X50'		1	110	1	1	2	1	1	1	Steel Strain Spanwire
	SB Thru Lane	6	330'										
	NB Left Turn Lane	5	6'X50'										
	NB Thru Lane	2	330'										
	WB Left Turn Lane	3	6'X50'										
	WB Thru Lane	3	6'X50'										
	EB Left Turn Lane	4	6'X50'										
	EB Thru Lane	4	6'X50'										
US 61 at Oak Ridge Road	SB Left Turn Lane	1	6'X50'	1		350	1	1	1		1	1	Mast Arm Signal
	SB Thru Lane	6	330'										
	NB Thru Lane	2	330'	1		150							
	WB Left Turn Lane	4	6'X50'	1		350							
			Total	**3**	**2**	**1190**	**3**	**3**	**4**	**1**	**3**	**3**	

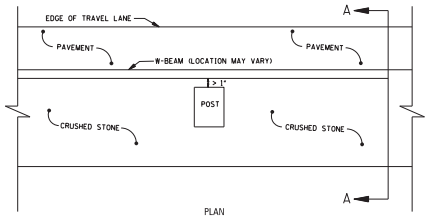

PLAN

PAVEMENT LEAVE–OUT AREA FOR GUARDRAIL POSTS
SINGLE–FACED GUARDRAIL (CRUSHED STONE OPTION)

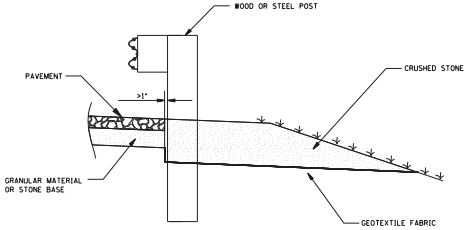

SECTION A–A

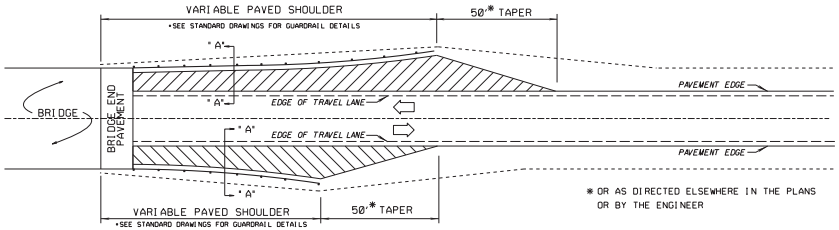

TYPICAL DETAIL OF PAVED SHOULDERS AT BRIDGE ENDS
(2-WAY TRAFFIC)
SEE SECTION "A"-"A"

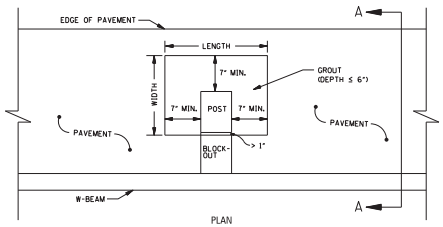

PLAN

PAVEMENT LEAVE–OUT AREA FOR GUARDRAIL POSTS
SINGLE–FACED GUARDRAIL (GROUT OPTION)

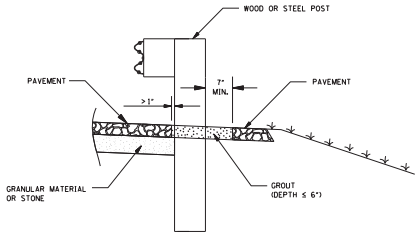

SECTION A–A

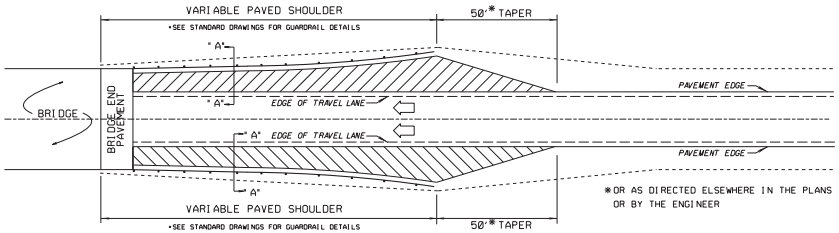

TYPICAL DETAIL OF PAVED SHOULDERS AT BRIDGE ENDS
(1-WAY TRAFFIC)
SEE SECTION "A"-"A"

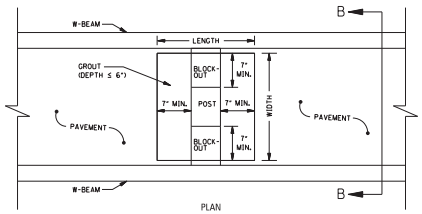

PLAN

PAVEMENT LEAVE–OUT AREA FOR GUARDRAIL POSTS
DOUBLE–FACED GUARDRAIL

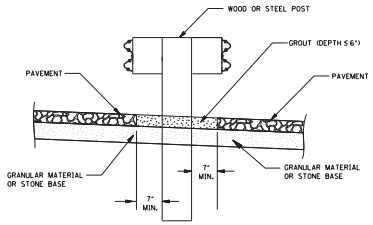

SECTION B–B

GENERAL NOTES FOR CRUSHED STONE OPTION

1. GUARDRAIL POSTS SHALL NOT BE COMPLETELY SURROUNDED BY PAVEMENT.
2. PAVEMENT LEAVE-OUT AREAS ARE REQUIRED FOR STEEL AND WOOD POSTS.
3. STANDARD EMBEDMENT DEPTHS STILL APPLY, MEASURED FROM THE TOP OF THE PROJECTED PAVEMENT SURFACE.
4. IMMEDIATELY PRIOR TO PLACING GEOTEXTILE FABRIC AND CRUSHED STONE ON THE GUARDRAIL PAD, THE ENTIRE AREA SHALL BE TREATED UNIFORMLY WITH A SOIL STERILANT. THE SOIL STERILANT SHALL BE APPLIED AT THE MAXIMUM RATE RECOMMENDED ON THE MANUFACTURER'S LABEL FOR PERENNIAL WEED CONTROL. ANY GRANULAR OR PELLETIZED SOIL STERILANT THAT IS APPROVED BY THE ENGINEER MAY BE USED. SEPARATE PAYMENT WILL NOT BE MADE FOR TREATING THE GUARDRAIL PAD AREA WITH SOIL STERILANT.

GENERAL NOTES FOR GROUT OPTION

1. GUARDRAIL POSTS SHALL NOT BE COMPLETELY SURROUNDED BY PAVEMENT. THE AREA BEHIND AND LATERAL OF THE POST SHALL HAVE A MINIMUM 7" CLEARANCE FROM THE PAVEMENT. THIS AREA SHALL BE FILLED WITH A LOW STRENGTH GROUT WITH A MAXIMUM 28 DAY COMPRESSIVE STRENGTH OF 120 PSI.
2. GROUT SHALL BE INSTALLED AT A DEPTH EQUAL TO THE SURROUNDING PAVEMENT, UP TO A MAXIMUM OF 6". IF SURROUNDING PAVEMENT IS GREATER THAN 6", THE DIFFERNCE SHALL BE FILLED IN WITH SHOULDER GRANULAR MATERIAL.
3. COST OF GROUT SHALL BE ABSORBED IN THE COST OF OTHER ITEMS BID.
4. PAVEMENT LEAVE-OUT AREAS ARE REQUIRED FOR STEEL AND WOOD POSTS.
5. STANDARD EMBEDMENT DEPTHS STILL APPLY, MEASURED FROM THE TOP OF THE PROJECTED PAVEMENT SURFACE.

MIN. PAV'T LEAVE-OUT AREA

POST	SINGLE-FACED		DOUBLE-FACED	
	LENGTH (IN.)	WIDTH (IN.)	LENGTH (IN.)	WIDTH (IN.)
6"x8" WOOD	20	15	20	22
8"x8" WOOD	22	15	22	22
10"x10" WOOD	24	17	24	24
W6x9 STEEL	18	13	18	20

NOTE: THE ALTERNATIVES SHOWN HEREIN APPLY TO ALL GUARDRAIL CONSTRUCTION WHERE MOW STRIPS ARE ADDED.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

DESIGNED BY:
DETAILED BY:
CHECKED BY:
DATE:

FMS CON: /
PROJECT NO.: - 21 -
COUNTY:

GUARDRAIL: POST INSTALLATION DETAILS

SHEET ID
SDGR-PI
SHEET NO.

Notice to Bidders, Specifications, and Contract Documents 18079 -- Combined

123

PLAN SHEET

7/15/2025 8:23:44 AM SDGR-PI-ORD.dgn

NOT TO SCALE

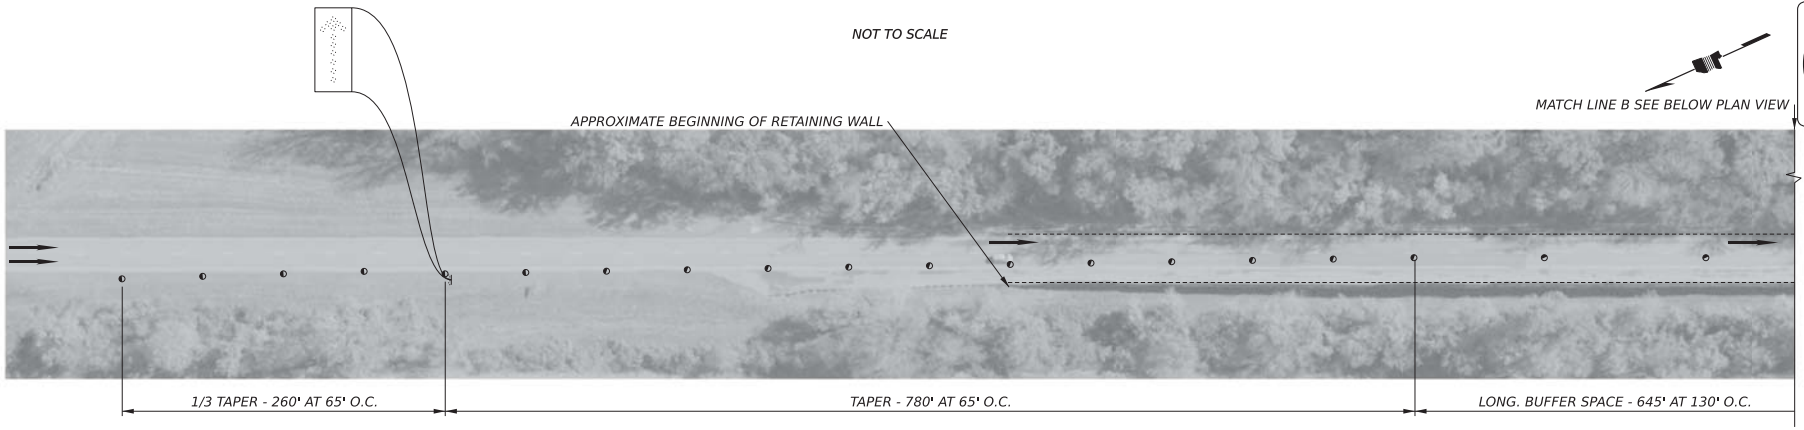

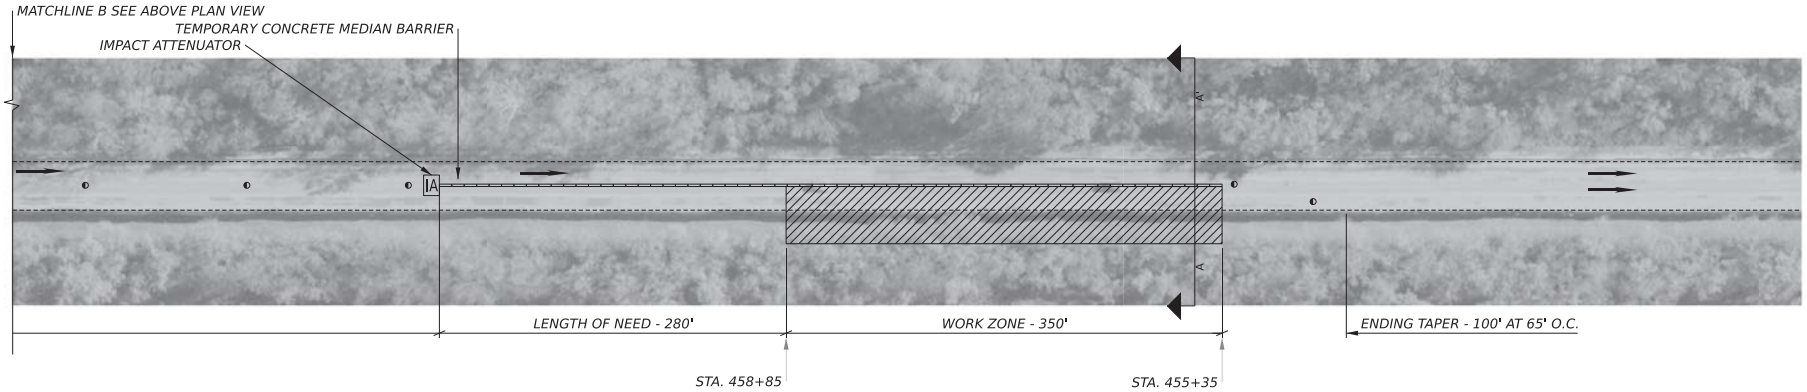

NOTES:

(1) PLASTIC DRUMS SHALL HAVE TYPE B WARNING LIGHTS MOUNTED ON EVERY DRUM IN THE TAPER THEN EVERY THIRD DRUM IN THE TANGENT SECTION.

(2) THE BARRIER SHALL NOT BE PLACED ALONG THE MERGING TAPER. THE LANE SHALL FIRST BE CLOSED USING PLASTIC DRUMS.

(1)



NOT TO SCALE

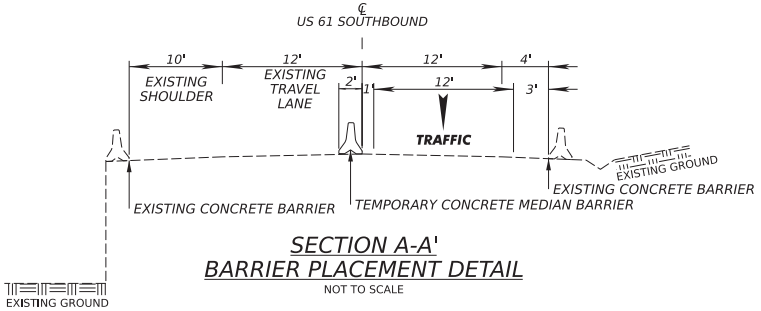

SECTION A-A'
BARRIER PLACEMENT DETAIL

NOT TO SCALE

DESIGNED BY: PKEITH
DETAILED BY: PKEITH
CHECKED BY:
DATE: 2026-02-05

FMS CON: 109575/301000
PROJECT NO.: STBG-0009-02(094)
COUNTY: WARREN

SHEET ID
TC2
SHEET NO.
2

Notice to Bidders No. 8079 -- Contract No. 22

PLAN SHEET

5/21/2026 9:25:45 AM TC_SH.dgn

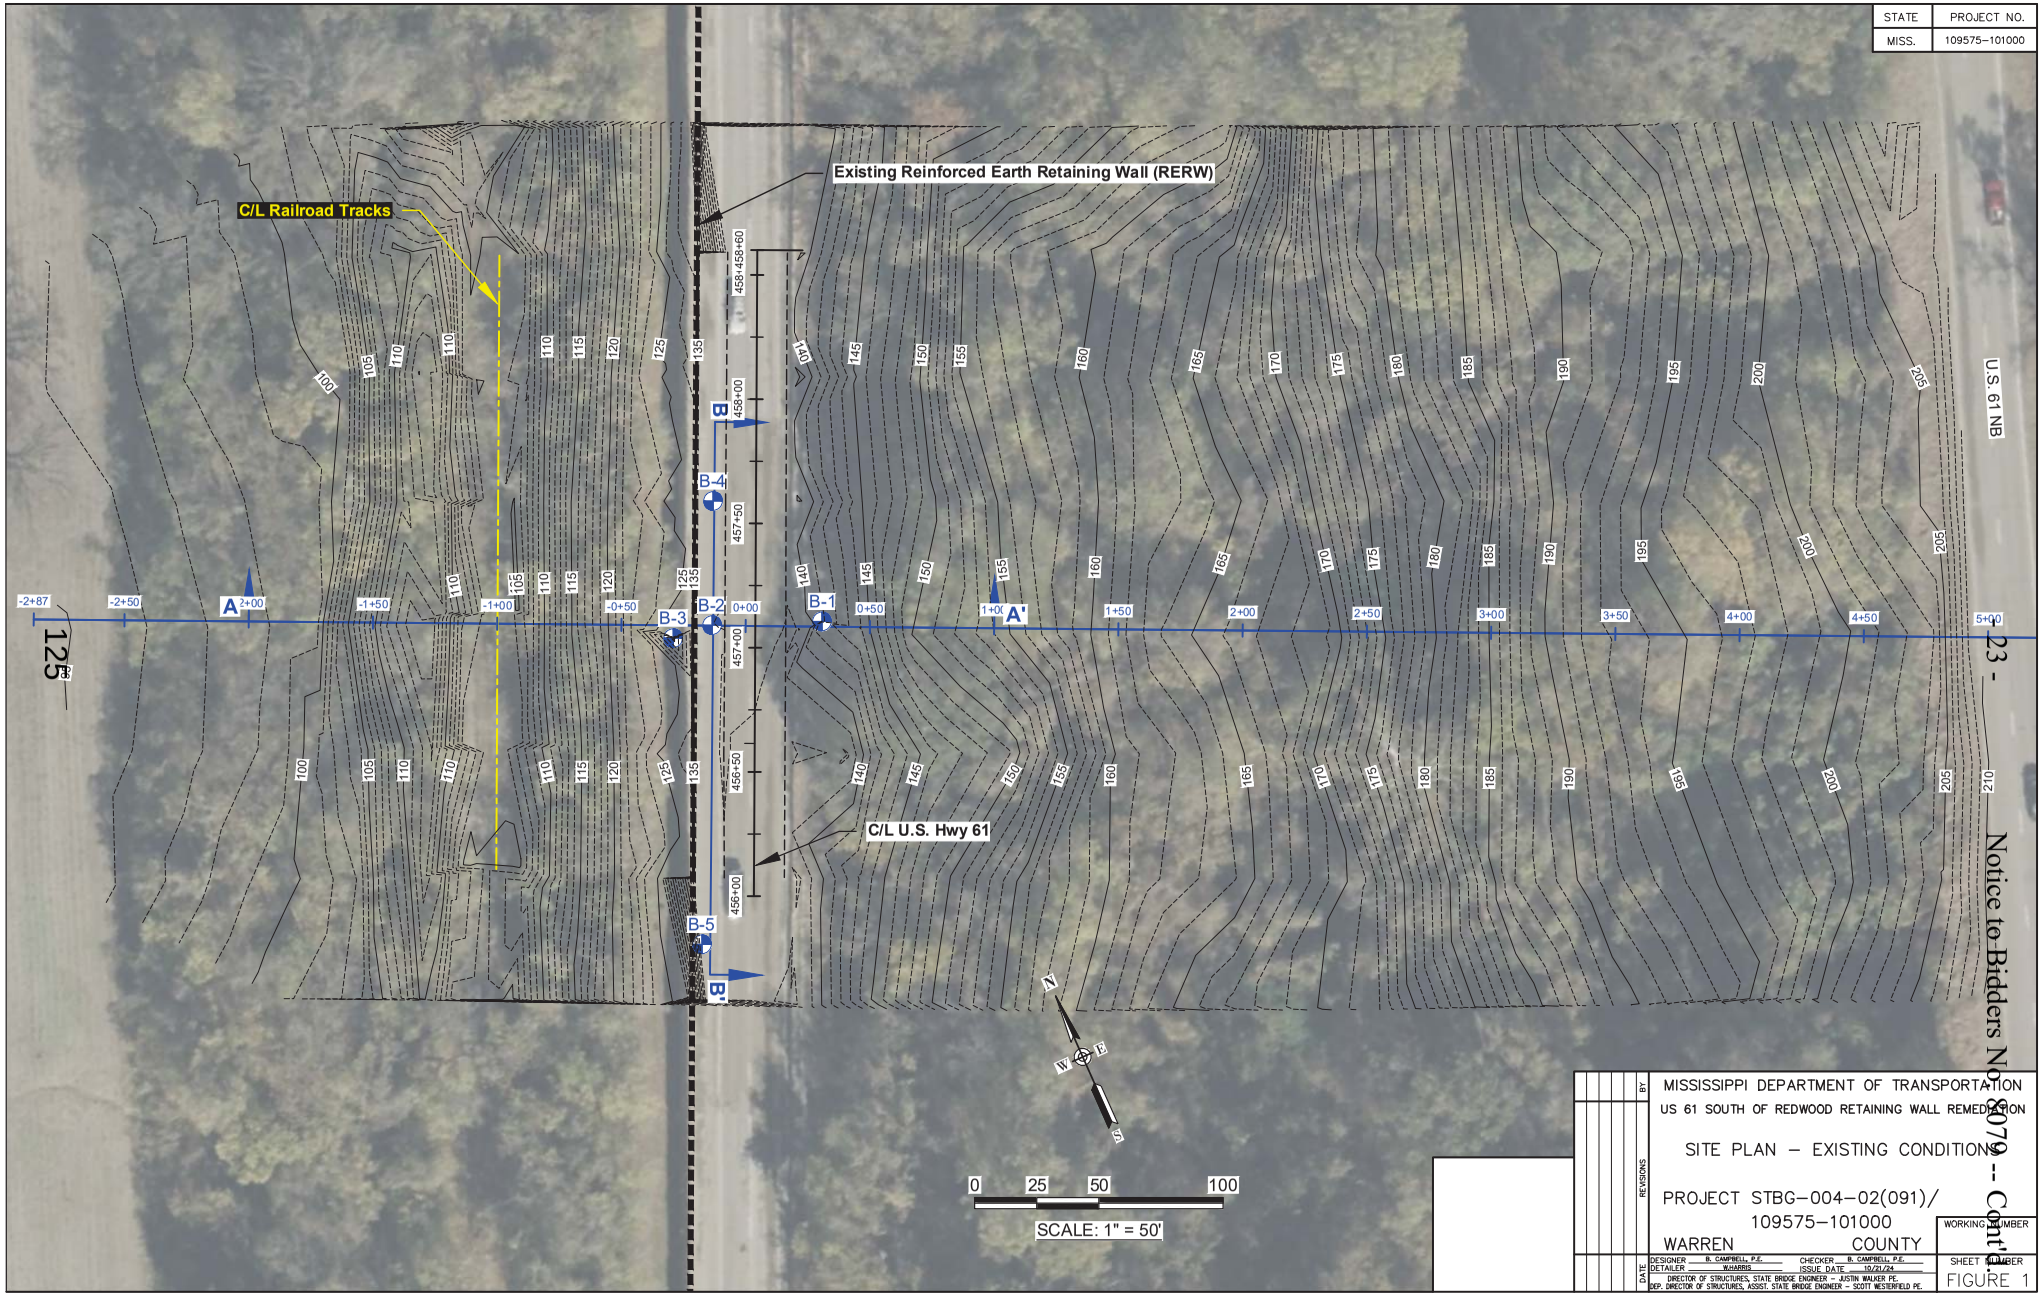

STATE	PROJECT NO.
MISS.	109575-101000

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION

SITE PLAN – EXISTING CONDITIONS

PROJECT STBG-004-02(091)/
109575-101000

WARREN COUNTY

WORKING NUMBER

SHEET NUMBER
FIGURE 1

DESIGNER B. CAMPBELL, P.E. CHECKER B. CAMPBELL, P.E.
DETAILER W.HARRIS ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER – JUSTIN WALKER PE.
DEP. DIRECTOR OF STRUCTURES, ASSIST. STATE BRIDGE ENGINEER – SCOTT WESTERFIELD PE.

REVISIONS BY DATE

Notice to Bidders Nos. 8079 -- Cont'd.
- 23 -

UNIFIED SOIL CLASSIFICATION SYSTEM

MAJOR DIVISIONS			SYMBOL & LETTER	DESCRIPTION
COARSE-GRAINED SOILS More than half of material larger than No. 200 sieve size	GRAVELS More than half of coarse fraction larger than No.4 sieve size	Clean Gravels (Little or no fines)	GW	WELL GRADED GRAVEL, GRAVEL-SAND MIXTURE
			GP	POORLY GRADED GRAVEL, GRAVEL-SAND MIXTURE
		Gravels with fines (Appreciable amount of fines)	GM	SILTY GRAVEL, GRAVEL-SAND-SILT MIXTURE
			GC	CLAYEY GRAVEL, GRAVEL-SAND-CLAY MIXTURE
	SANDS More than half of coarse fraction smaller than No.4 sieve size	Clean Sands (Little or no fines)	SW	WELL GRADED SAND, GRAVELLY SAND
			SP	POORLY GRADED SAND, GRAVELLY SAND
		Sands with fines (Appreciable amount of fines)	SM	SILTY SAND, SAND-SILT MIXTURE
			SP-SM	SLIGHTLY SILTY SAND
			SC	CLAYEY SAND, SAND-CLAY MIXTURE
FINE-GRAINED SOILS More than half of material smaller than No. 200 sieve size	SILTS AND CLAYS	Liquid limit less than 50	ML	SILT WITH LITTLE OR NO PLASTICITY
			ML	CLAYEY SILT, SILT WITH SLIGHT TO MEDIUM PLASTICITY
			ML	SANDY SILT
			CL	SILTY CLAY, LOW TO MEDIUM PLASTICITY
			CL	SANDY CLAY, LOW TO MEDIUM PLASTICITY (30% TO 50% SAND)
	SILTS AND CLAYS	Liquid limit greater than 50	MH	SILT, FINE SANDY OR SILTY SOIL WITH HIGH PLASTICITY
			CH	CLAY, HIGH PLASTICITY
			OH	ORGANIC CLAY OR SILT OF MEDIUM TO HIGH PLASTICITY
HIGHLY ORGANIC SOILS			PT	PEAT, HUMUS, SWAMP SOIL
SEDEMENTARY ROCK TYPES:			LS	LIMESTONE
			MARL	MARL

TERMS CHARACTERIZING SOIL STRUCTURE

Slickensided	- Clays with polished and striated planes created as a result of volume changes related to shrinking, swelling and/or changes in overburden pressure.
Fissured	- Clays with a blocky or jointed structure generally created by seasonal shrinking and swelling.
Laminated	- Composed of thin alternating layers of varying color and texture.
Calcareous	- Containing appreciable quantities of calcium carbonate.
Parting	- Paper thin (less than 1/8 inch).
Seam	- 1/8 inch to 3 inch thickness.
Layer	- Greater than 3 inches in thickness.

DENSITY AND CONSISTENCY

COARSE-GRAINED SOILS

DENSITY	PENETRATION RESISTANCE, N Blows per Foot
Very Loose	0 - 4
Loose	5 - 10
Medium Dense	11 - 30
Dense	31 - 50
Very Dense	>50

FINE-GRAINED SOILS

CONSISTENCY	COHESION Kips/Sq. Ft	PENETRATION RESISTANCE, N Blows per Foot
Very Soft	<0.25	0 - 1
Soft	0.25 - 0.50	2 - 4
Medium Stiff	0.50 - 1.00	5 - 8
Stiff	1.00 - 2.00	9 - 15
Very Stiff	2.00 - 4.00	16 - 30
Hard	>4.00	>30

PARTICLE SIZE IDENTIFICATION

Cobbles	- Greater than 3 inches
Gravel	- Coarse - 3/4 inch to 3 inches Fine - 4.76 mm to 3/4 inch
Sand	- Coarse - 2 mm to 4.76 mm Medium - 0.42 mm to 2 mm Fine - 0.074 mm to 0.42 mm
Silt & Clay	- Less than 0.074 mm

RELATIVE COMPOSITION

Slightly	5 - 15%
With	16 - 29%
Sandy	30 - 50%
(or Gravelly)	

PLASTICITY CHART

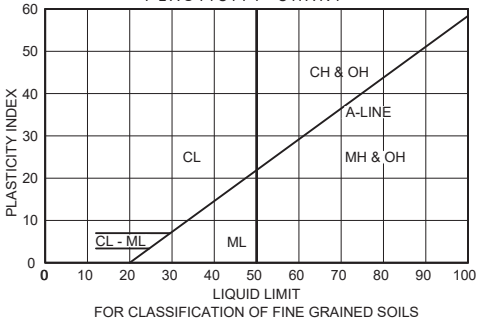

FOR CLASSIFICATION OF FINE GRAINED SOILS

SAMPLE TYPES
(Shown in Sample Column)

Shelby Tube

Split Spoon

No Recovery

Auger

Dennison Barrel

CLASSIFICATION, SYMBOLS AND TERMS USED ON GRAPHICAL BORING LOGS

BURNS COOLEY DENNIS, INC.

FIGURE 2

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 1	PROJECT NO.: PROJECT NO STBG-009-02(91)/109575-101000		
BORING TYPE: AUGER/ROTARY	COMPLETION DEPTH: 60.0 ft	COMPLETION DATE: 6/25/2024	
LOGGED BY: J. SHIVERS	ALIGNMENT NAME: US-61 SOUTH OF REDWOOD RETAINING WALL		
COUNTY: WARREN	DEPTH TO WATER: N/A ft	STATION: 457+11	OFFSET: 26.8' RT
LATTITUDE: N 32° 27' 58.5"	LONGITUDE: W 90° 48' 45.2"	SURFACE ELEVATION: 140.9 ft	

DEPTH, FT	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT
0	Very stiff tan silty clay (CL) with calcareous nodules (COLLUVIUM)	4A		
	- with silt partings below 1'			
	- with gravel below 4'			
5	Very stiff tan and light gray clay (CH) with sand and shell fragments (MARL)	5		112
10				
15				82
20	Hard, slightly broken, weathered gray limestone	5		132
	Very stiff light gray clay (CH) with shell fragments (MARL)	5		91
	Hard light gray sandy clay (CL) with shell fragments (MARL)	5		
25	Hard, slightly broken, slightly weathered limestone with clay seams (MARL)	5		145
	Very stiff light gray clay (CH) (MARL)	5		142
	Hard light gray sandy clay (CL) with shell fragments (MARL)	5		
30	Hard, slightly broken, highly to slightly weathered limestone, iron stained joints, with shell fragments	5	50/4"	95
	- unbroken below 32.5'			

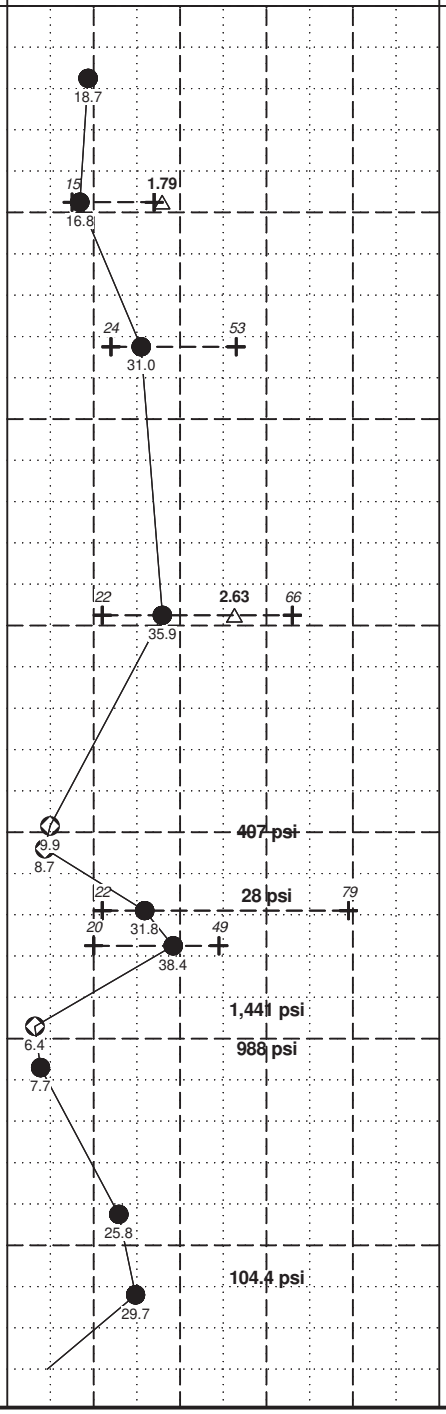

% PASSING NO. 200 SIEVE
64.5
71.9

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 3

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 1 (Continued)

140.9 ft

DEPTH, FT	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT	○ - UC, COHESION, KSF, △ - UU; SPT (N_{60}) ⊗, PLASTIC LIMIT +, WATER CONTENT % ●, LIQUID LIMIT +	% PASSING NO. 200 SIEVE
35	Very broken, medium hard weathered limestone, iron stained joints	5	40/3"	147	6.4, 20.8, 1,963 psi	
40	Very dense green and light gray silty fine sand (SM) with shell fragments and cemented seams (MINT SPRING)	6		39	26 31, 25.3	38.5
45			24		24, 33.3	
50	Medium dense tan silty fine sand (SM) (FOREST HILL) - very dense below 48' - gray and tan 48 - 53'	7A	78		78, 27.9, 78	19.4
55	- gray with clay pockets and mica below 53'		78		78, 27.4	
60	Dense gray clayey fine sand (SC) with clay pockets, lignite and mica (FOREST HILL)	7A	31		21 31 41, 25.5	28.1

Note: SPT performed using a calibrated Auto-Hammer. An energy correction factor of 1.42 is applied to calculate the plotted N_{60} values.

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 4

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 2	PROJECT NO.: PROJECT NO STBG-009-02(91)/109575-101000		
BORING TYPE: AUGER/ROTARY	COMPLETION DEPTH: 60.0 ft	COMPLETION DATE: 6/19/2024	
LOGGED BY: J. SHIVERS	ALIGNMENT NAME: US-61 SOUTH OF REDWOOD RETAINING WALL		
COUNTY: WARREN	DEPTH TO WATER: N/A ft	STATION: 457+09	OFFSET: 17.4' LT
LATTITUDE: N 32° 27' 58.6"	LONGITUDE: W 90° 48' 45.7"	SURFACE ELEVATION: 139.0 ft	

DEPTH, FT	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT	% PASSING NO. 200 SIEVE
	Asphalt Pavement (10.5")				
5	Very dense tan fine sand (SP-SM), slightly silty with trace of gravel (MSE WALL BACKFILL) - medium dense 4' - 8' - fine to coarse below 4' - dense 8' - 13'	1	60, 28, 43, 111		5.7, 5.2, 7.1
20	Stiff light gray and tan clay (CH) (COLLUVIUM) - with calcareous nodules below 23'	4B		102	
30	Stiff tan and light gray sandy clay (CL) with limestone fragments (COLLUVIUM)	4B		82	
35	Loose tan and light gray clayey fine sand (SC) with shell fragments (MINT SPRING)	6	7		
40	Hard light gray and tan sandy clay (CL) with sand pockets and seams (MINT SPRING)	6		92	
45	Dense tan fine sand (SP-SM), slightly silty (FOREST HILL) - very dense, with clay partings below 48'	7A	37, 101		8.9
55	Very dense gray silty fine sand (SM) with clay partings and seams (FOREST HILL)	7A	75		24.8
60	Hard gray silty clay (CL) with sand and lignite seams and mica (FOREST HILL)	7B	40		

○ - UC COHESION, KSF △ - UU (1 2 3 4)

SPT (N_{60}) ⊗ PLASTIC LIMIT + WATER CONTENT % ● LIQUID LIMIT + (20 40 60 80)

Note: SPT performed using a calibrated Auto-Hammer. An energy correction factor of 1.42 is applied to calculate the plotted N_{60} values.

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 5

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 3	PROJECT NO.: PROJECT NO STBG-009-02(91)/109575-101000		
BORING TYPE: AUGER	COMPLETION DEPTH: 40.0 ft	COMPLETION DATE: 6/17/2024	
LOGGED BY: J. SHIVERS	ALIGNMENT NAME: US-61 SOUTH OF REDWOOD RETAINING WALL		
COUNTY: WARREN	DEPTH TO WATER: 24.2 ft	STATION: 457+04	OFFSET: 33.0' LT
LATTITUDE: N 32° 27' 58.7"	LONGITUDE: W 90° 48' 45.8"	SURFACE ELEVATION: 125.2 ft	

DEPTH, FT	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT	% PASSING NO. 200 SIEVE
0	Stiff tan silty clay (CL) with silt pockets (COLLUVIUM)	4A			
5	Stiff tan clay (CH) (COLLUVIUM) - with trace of gravel below 6' - with calcareous nodules below 8'	4A		92	
10		4A		97	
15		4B			
20	- very stiff below 18'	4B		106	
25		4B			
30	Medium dense tan and light gray silty fine sand (SM) with shell fragments (MINT SPRING)	6			12.6
35	Dense tan fine sand (SP-SM), slightly silty with mica (FOREST HILL)	7A	41		5.8
40	Dense gray silty fine sand (SM) with clay partings and seams and mica (FOREST HILL)	7A	36		30.5

○ - UC COHESION, KSF △ - UU

1 2 3 4

SPT (N_{60}) ⊗ PLASTIC LIMIT + WATER CONTENT % ● LIQUID LIMIT +

20 40 60 80

21 42 17.6

18 1.26 62 28.8

17 1.51 50 26.3

20 59 27.5

17 2.15 51 19.4

17 55 22.9

25.1

41 29.8

36 33.2

Note: SPT performed using a calibrated Auto-Hammer. An energy correction factor of 1.42 is applied to calculate the plotted N_{60} values.

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 6

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 4	PROJECT NO.: PROJECT NO STBG-009-02(91)/109575-101000		
BORING TYPE: AUGER	COMPLETION DEPTH: 60.0 ft	COMPLETION DATE: 6/18/2024	
LOGGED BY: J. SHIVERS	ALIGNMENT NAME: US-61 SOUTH OF REDWOOD RETAINING WALL		
COUNTY: WARREN	DEPTH TO WATER: N/A ft	STATION: 457+59	OFFSET: 17.3' LT
LATTITUDE: N 32° 27' 59.1"	LONGITUDE: W 90° 48' 45.4"	SURFACE ELEVATION: 139.6 ft	

DEPTH, FT	SYMBOL	SAMPLES	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT	% PASSING NO. 200 SIEVE
			Asphalt Pavement (11")				
			Medium stiff tan clay (CH), slightly silty				
5			Medium dense tan fine sand (SP) with trace of gravel (MSE WALL BACKFILL)	1	16		3.3
10			Medium dense tan fine to coarse sand (SP-SM), slightly silty (MSE WALL BACKFILL) - very dense below 13'	1	27 84		5.8 6.9
20			Very stiff tan clay (CH) with sand seams (COLLUVIUM)	4B	16		67.9
25			Very stiff tan and light gray clay (CH) with calcareous nodules and shell fragments (COLLUVIUM)	4B		87	
30			Hard tan and light gray silty clay (CL) with limestone fragments (MARL) - with wood below 32'	5	6-14-50/6"		
40			Medium dense gray clayey fine sand (SC) with shell fragments (MINT SPRING) - tan below 43'	6	34 50		47.0 34.5
50			Medium dense gray silty fine sand (SM) with clay partings (FOREST HILL) - dense below 53'	7A	20 48		24.7
60			Hard gray clay (CH) with sand partings and mica (FOREST HILL)	7B	38		65.8

○ - UC COHESION, KSF △ - UU

1 2 3 4

SPT (N_{60}) ⊗ PLASTIC LIMIT + WATER CONTENT % ● LIQUID LIMIT +

20 40 60 80

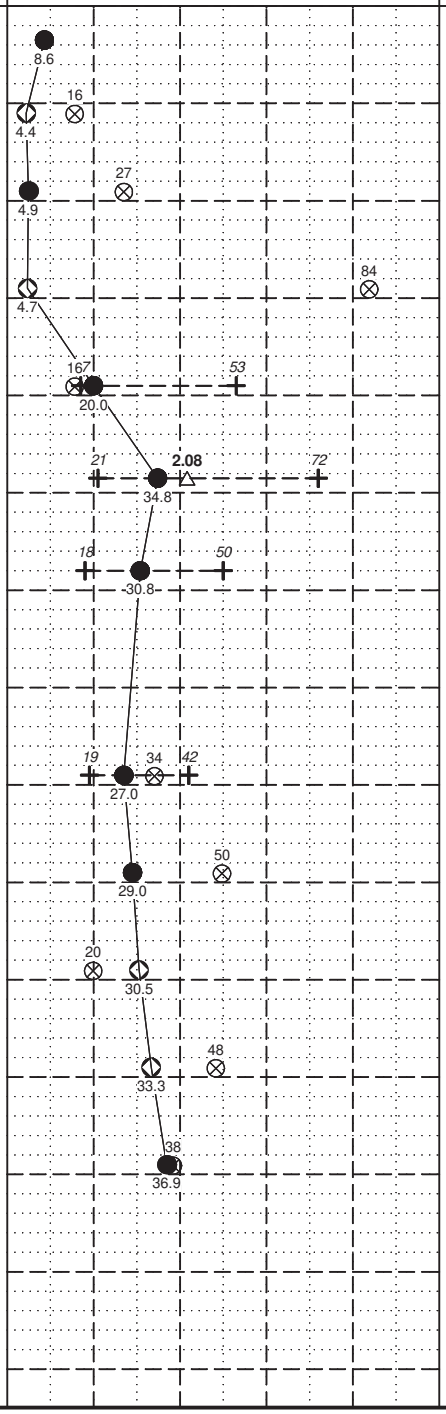

Note: SPT performed using a calibrated Auto-Hammer. An energy correction factor of 1.42 is applied to calculate the plotted N_{60} values.

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 7

BURNS COOLEY DENNIS, INC. for MDOT

BORING NO.: 5	PROJECT NO.: PROJECT NO STBG-009-02(91)/109575-101000		
BORING TYPE: AUGER/ROTARY	COMPLETION DEPTH: 60.0 ft	COMPLETION DATE: 6/21/2024	
LOGGED BY: J. SHIVERS	ALIGNMENT NAME: US-61 SOUTH OF REDWOOD RETAINING WALL		
COUNTY: WARREN	DEPTH TO WATER: N/A ft	STATION: 455+81	OFFSET: 20.8' LT
LATTITUDE: N 32° 27' 57.5"	LONGITUDE: W 90° 48' 46.3"	SURFACE ELEVATION: 139.0 ft	

DEPTH, FT	SYMBOL	SAMPLES	DESCRIPTION OF MATERIAL	ZONE	SPT (N_{60})	DRY DENSITY LBS/CU FT
			Asphalt Pavement (11")			
			Medium dense tan silty fine sand (SM) with gravel	1	20	
5			Dense tan fine to coarse sand (SP-SM), slightly silty with trace of gravel (MSE WALL BACKFILL)		37	
10				1	37	
15			- very dense below 13'		85	
20			Stiff tan clay (CH) (COLLUVIUM)	4A	13	
25			Very stiff tan sandy clay (CL) (COLLUVIUM)	4A		101
30						110
35			Medium dense tan and light gray clayey fine sand (SC) with clay seams and shell fragments (MINT SPRING)			89
40			- dense 38' - 43'	6	36	
45					20	
50			Very dense gray and tan fine sand (SP-SM), slightly silty (FOREST HILL)		77	
55			- with clay partings below 53'	7A	65	
60			Hard gray clay (CH) with sand partings and seams (FOREST HILL)	7B	36	

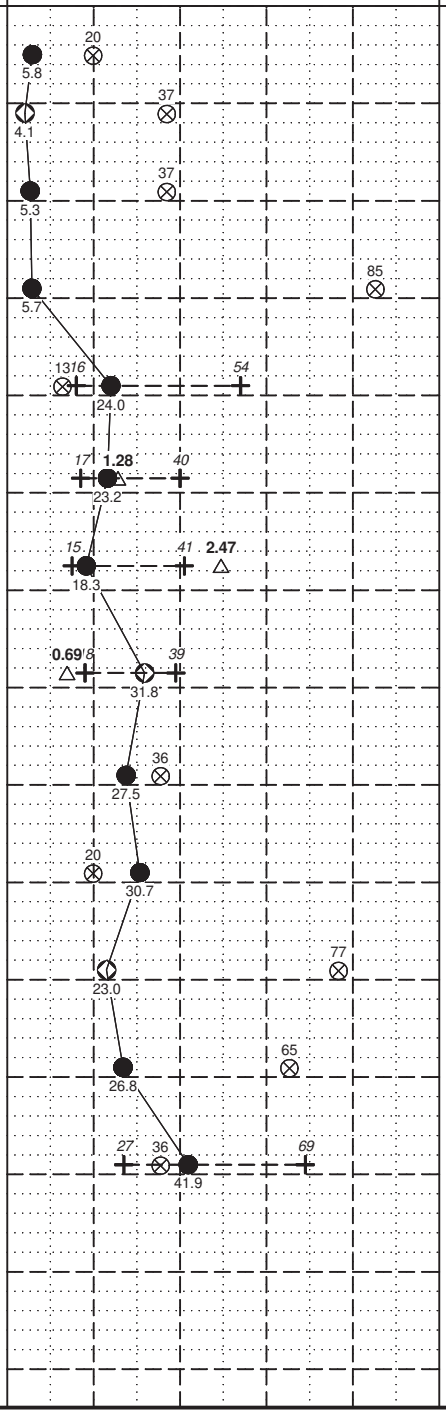

% PASSING NO. 200 SIEVE
18.9
5.6
8.9
38.3
29.2
9.4

Note: SPT performed using a calibrated Auto-Hammer. An energy correction factor of 1.42 is applied to calculate the plotted N_{60} values.

220107-7

BURNS COOLEY DENNIS, INC.
GEOTECHNICAL AND MATERIALS ENGINEERING CONSULTANTS

FIGURE 8

STATE	PROJECT NO.
MISS.	109575-101000

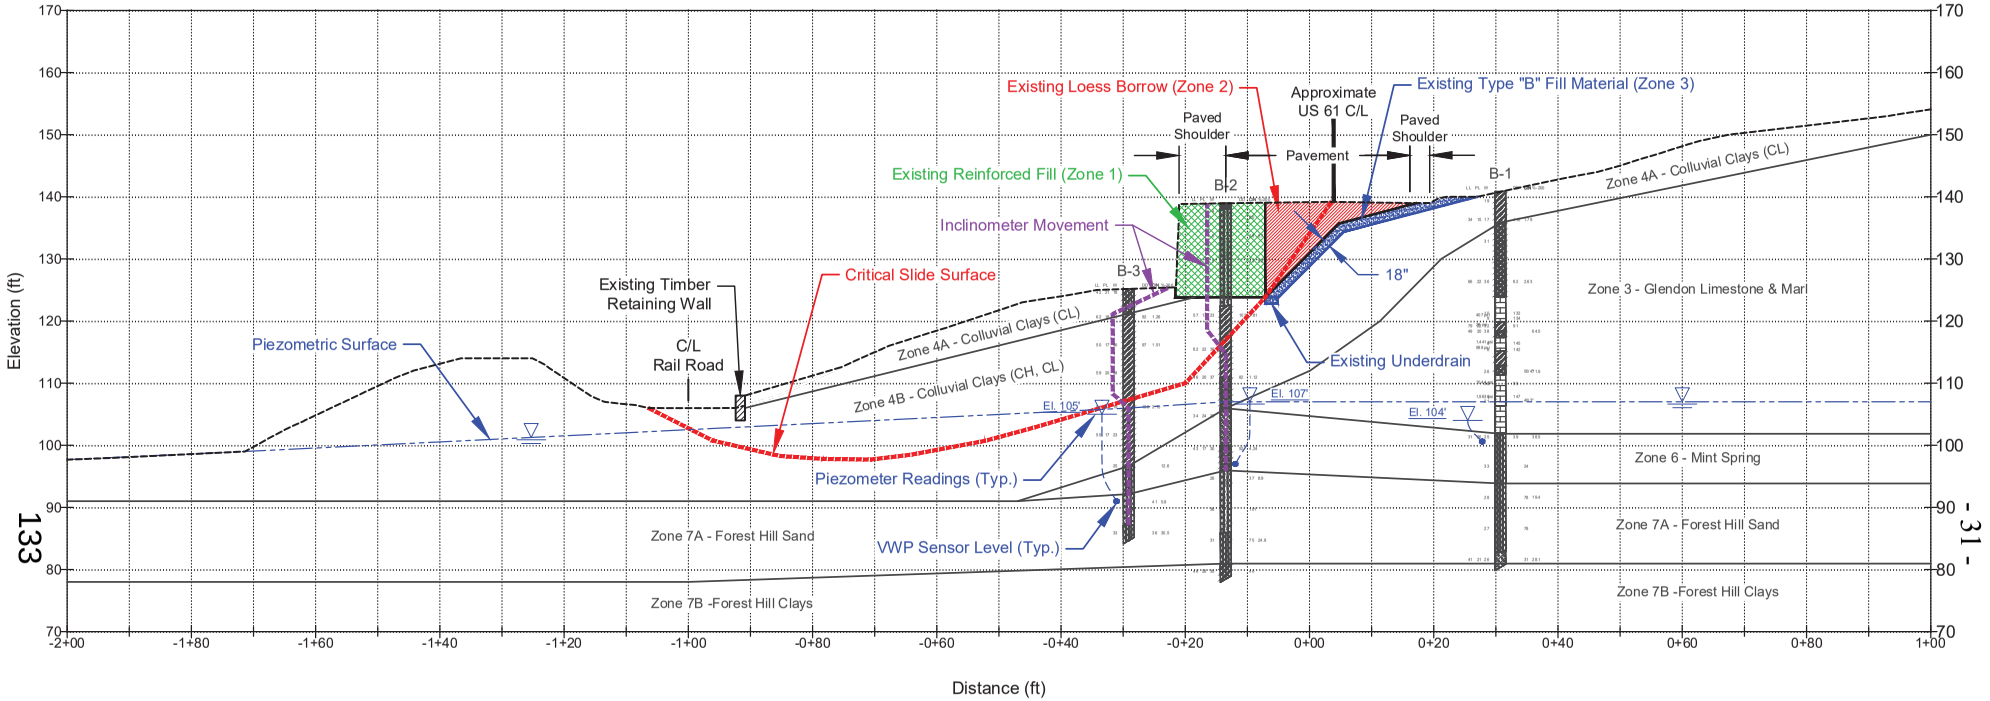

Section A - A'
Existing Conditions

0 10 20 40

SCALE: 1" = 20'

Zone	Formation	Description
1	Reinforced Fill	Medium dense to very dense slightly silty sand (SP-SM)
2	Loess Borrow Fill	Medium dense to dense silt (ML)
3	MDOT Type B Filter Material	Medium dense slightly silty sand (SP-SM)
4A	Colluvial Clays (CL)	Stiff to very stiff silty clays (CL)
4B	Colluvial Clays (CH, CL)	Stiff to very stiff clays (CH) & sandy clays (CL)
5	Glendon Limestone & Marl	Very stiff to hard clays (CH), sandy clays (CL) (Marl) & hard broken limestone
6	Mint Spring	Loose to very dense silty or clayey fine sands (SM, SC) with shell fragments
7A	Forest Hill Sand	Medium dense to very dense silty fine sands (SM, SP-SM)
7B	Forest Hill Clays	Hard clays (CL, CH)

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION
SECTION A–A' – EXISTING CONDITIONS
PROJECT STBG-004-02(091)/ 109575-101000
WARREN COUNTY

REVISIONS | BY | DATE

DESIGNER B. CAMPBELL, P.E. CHECKER B. CAMPBELL, P.E.
DETAILER WHARRIS ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER – JUSTIN WALKER PE.
DEP. DIRECTOR OF STRUCTURES, ASSIST. STATE BRIDGE ENGINEER – SCOTT WESTERFIELD PE.

WORKING NUMBER
SHEET NUMBER
FIGURE 9

STATE	PROJECT NO.
MISS.	109575–101000

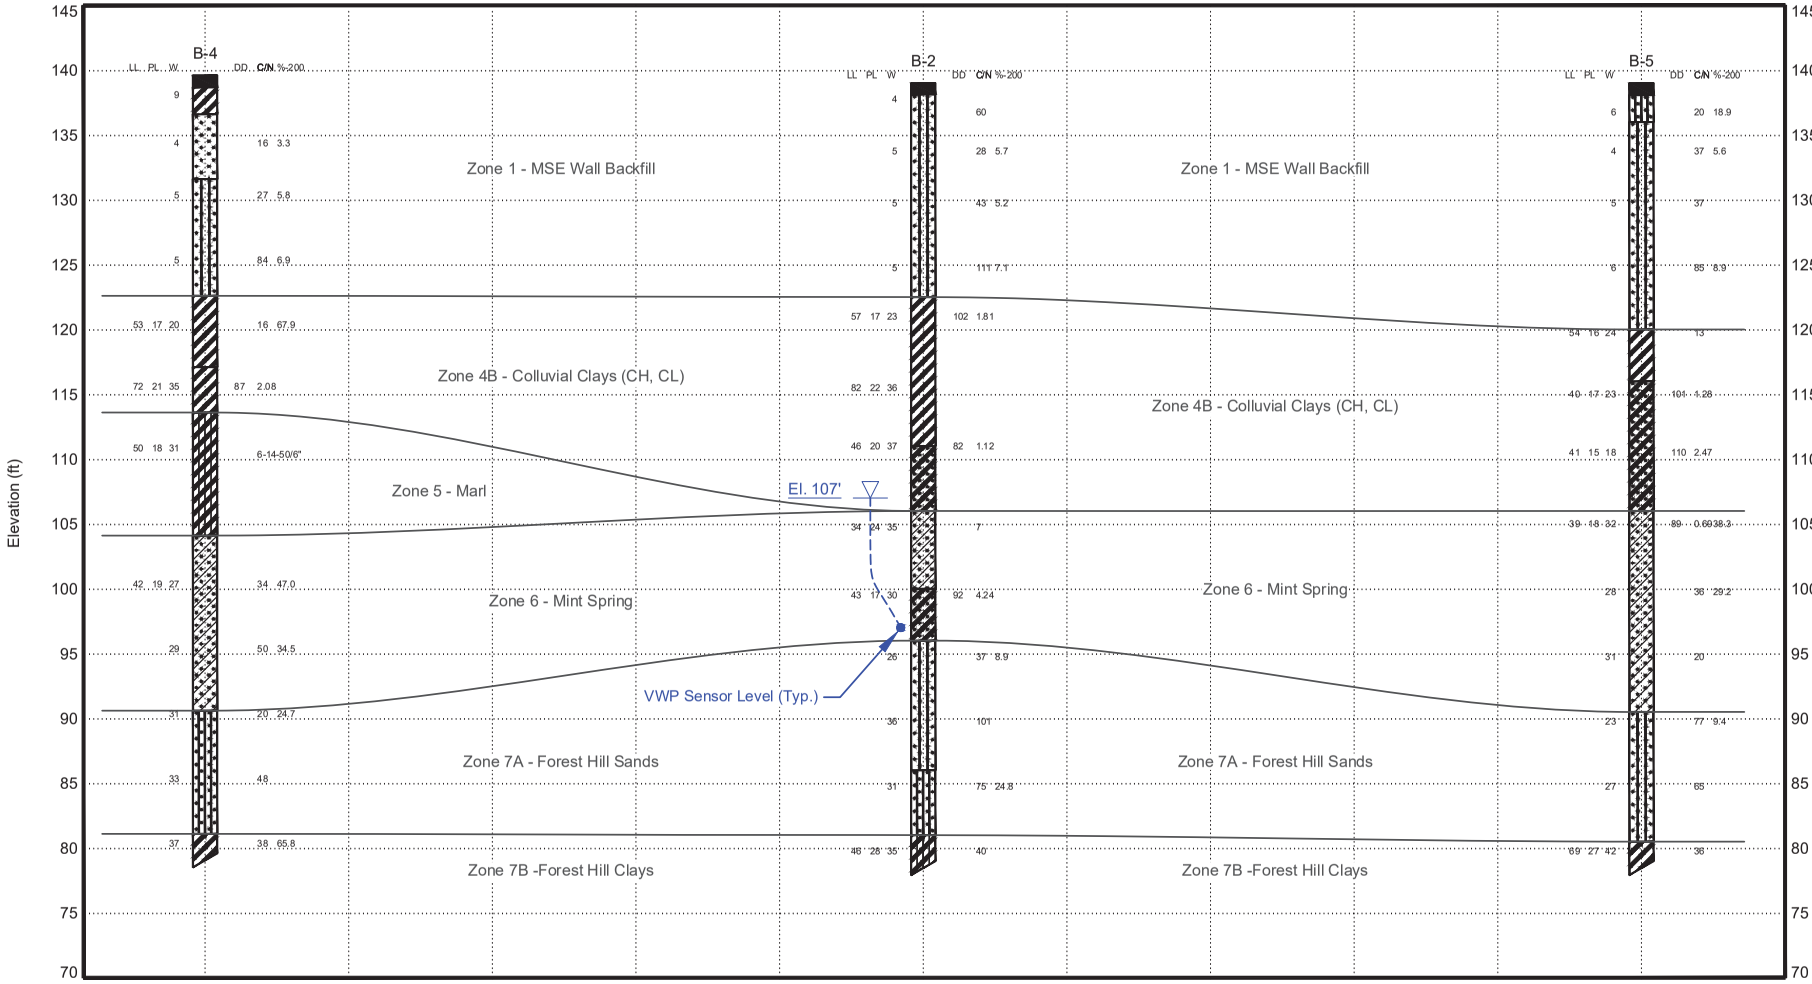

Zone	Formation	Description
1	Reinforced Fill	Medium dense to very dense slightly silty sand (SP-SM)
2	Loess Borrow Fill	Medium dense to dense silt (ML)
3	MDOT Type B Filter Material	Medium dense slightly silty sand (SP-SM)
4A	Colluvial Clays (CL)	Stiff to very stiff silty clays (CL)
4B	Colluvial Clays (CH, CL)	Stiff to very stiff clays (CH) & sandy clays (CL)
5	Glendon Limestone & Marl	Very stiff to hard clays (CH), sandy clays (CL) (Marl) & hard broken limestone
6	Mint Spring	Loose to very dense silty or clayey fine sands (SM, SC) with shell fragments
7A	Forest Hill Sand	Medium dense to very dense silty fine sands (SM, SP-SM)
7B	Forest Hill Clays	Hard clays (CH, CL)

NOTE: See Figure 2A for boring log legend.

Section B - B'
N.T.S.

LEGEND:
LL = Liquid Limit
PL = Plastic Limit
W = Water Content
DD = Dry Density (pcf)
C/N = Cohesion (ksf)/Penetration Resistance, N (blows per ft) in the same column
% -200 = % Passing No. 200 Sieve

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION
SECTION B–B'
PROJECT STBG–004–02(091)/ 109575–101000
WARREN COUNTY
WORKING NUMBER
SHEET NUMBER FIGURE 10
DESIGNER B. CAMPBELL, P.E. CHECKER B. CAMPBELL, P.E.
DETAILER W.HARRIS ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER – JUSTIN WALKER PE.
DEP. DIRECTOR OF STRUCTURES, ASSIST. STATE BRIDGE ENGINEER – SCOTT WESTERFIELD PE.
REVISIONS BY DATE

STATE	PROJECT NO.
MISS.	109575-101000

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION

SITE PLAN – PROPOSED CONDITIONS

PROJECT STBG-004-02(091)/
109575-101000

WARREN COUNTY

WORKING NUMBER

SHEET NUMBER
FIGURE 11

REVISIONS BY DATE

DESIGNER B. CAMPBELL, P.E. CHECKER B. CAMPBELL, P.E.
DETAILER W.HARRIS ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER – JUSTIN WALKER PE.
DEP. DIRECTOR OF STRUCTURES, ASSIST. STATE BRIDGE ENGINEER – SCOTT WESTERFIELD PE.

Notice to Bidders No. 8079 -- Cont'd.

STATE	PROJECT NO.
MISS.	109575-101000

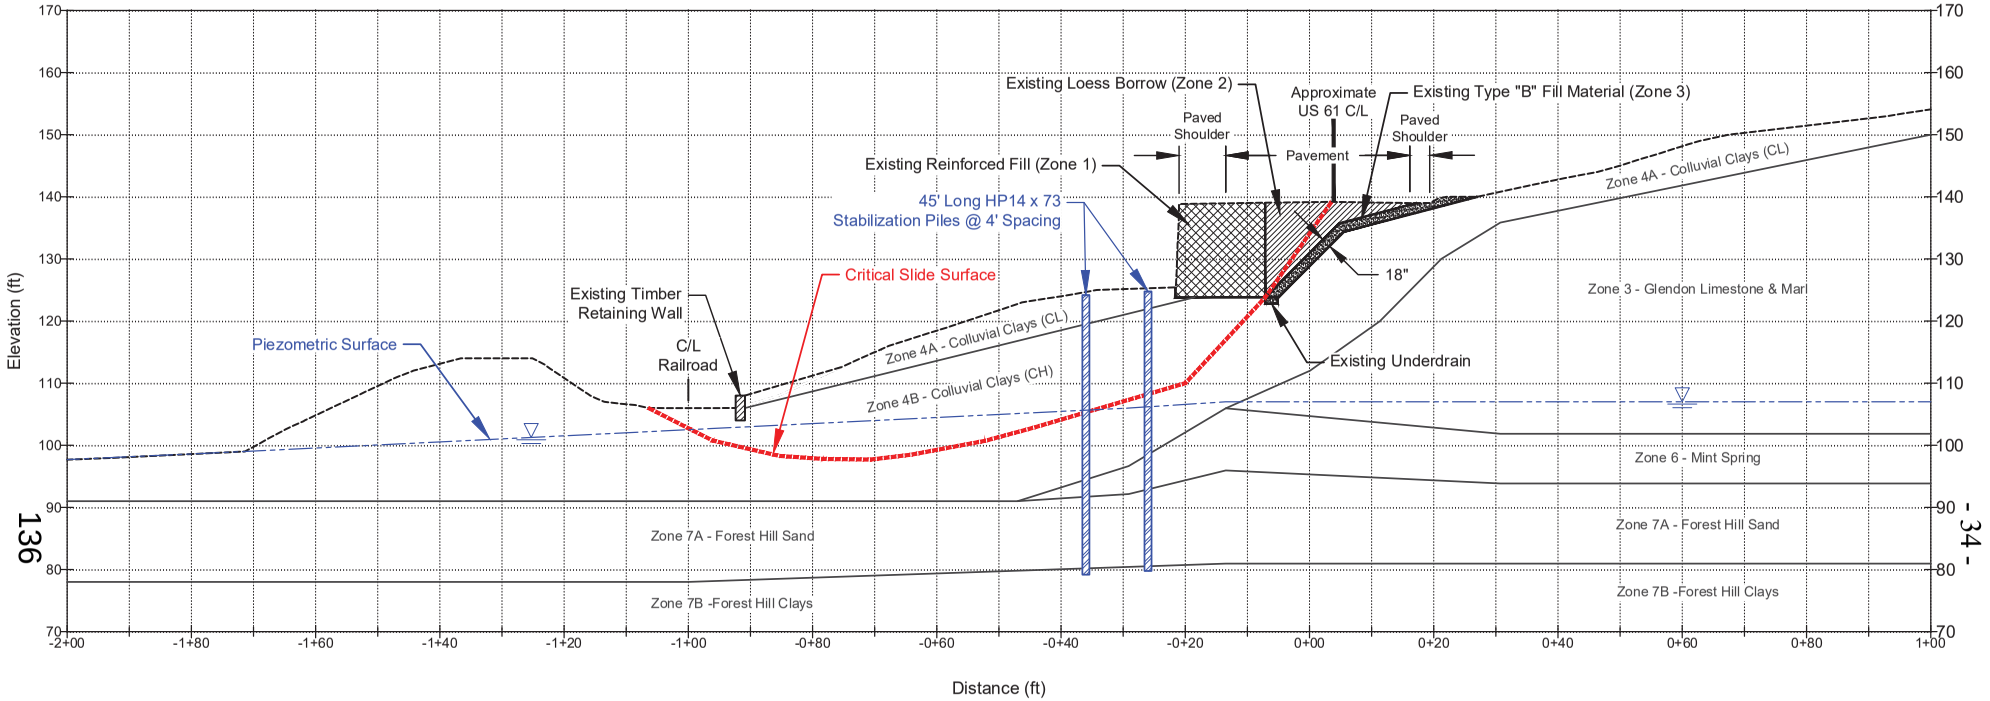

Section A - A'
Proposed Conditions

0 10 20 40

SCALE: 1" = 20'

Zone	Formation	Description
1	Reinforced Fill	Medium dense to very dense slightly silty sand (SP-SM)
2	Loess Borrow Fill	Medium dense to dense silt (ML)
3	MDOT Type B Filter Material	Medium dense slightly silty sand (SP-SM)
4A	Colluvial Clays (CL)	Stiff to very stiff silty clays (CL)
4B	Colluvial Clays (CH, CL)	Stiff to very stiff clays (CH) & sandy clays (CL)
5	Glendon Limestone & Marl	Very stiff to hard clays (CH), sandy clays (CL) (Marl) & hard broken limestone
6	Mint Spring	Loose to very dense silty or clayey fine sands (SM, SC) with shell fragments
7A	Forest Hill Sand	Medium dense to very dense silty fine sands (SM, SP-SM)
7B	Forest Hill Clays	Hard clays (CL, CH)

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION
SECTION A–A' – PROPOSED CONDITIONS
PROJECT STBG-004-02(091)/ 109575-101000
WARREN COUNTY
DESIGNER B. CAMPBELL, P.E. CHECKER B. CAMPBELL, P.E.
DETAILER WHARRIS ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER – JUSTIN WALKER PE
DEP. DIRECTOR OF STRUCTURES, ASSIST. STATE BRIDGE ENGINEER – SCOTT WESTERFIELD PE.
REVISIONS BY DATE
WORKING NUMBER
SHEET NUMBER
FIGURE 12

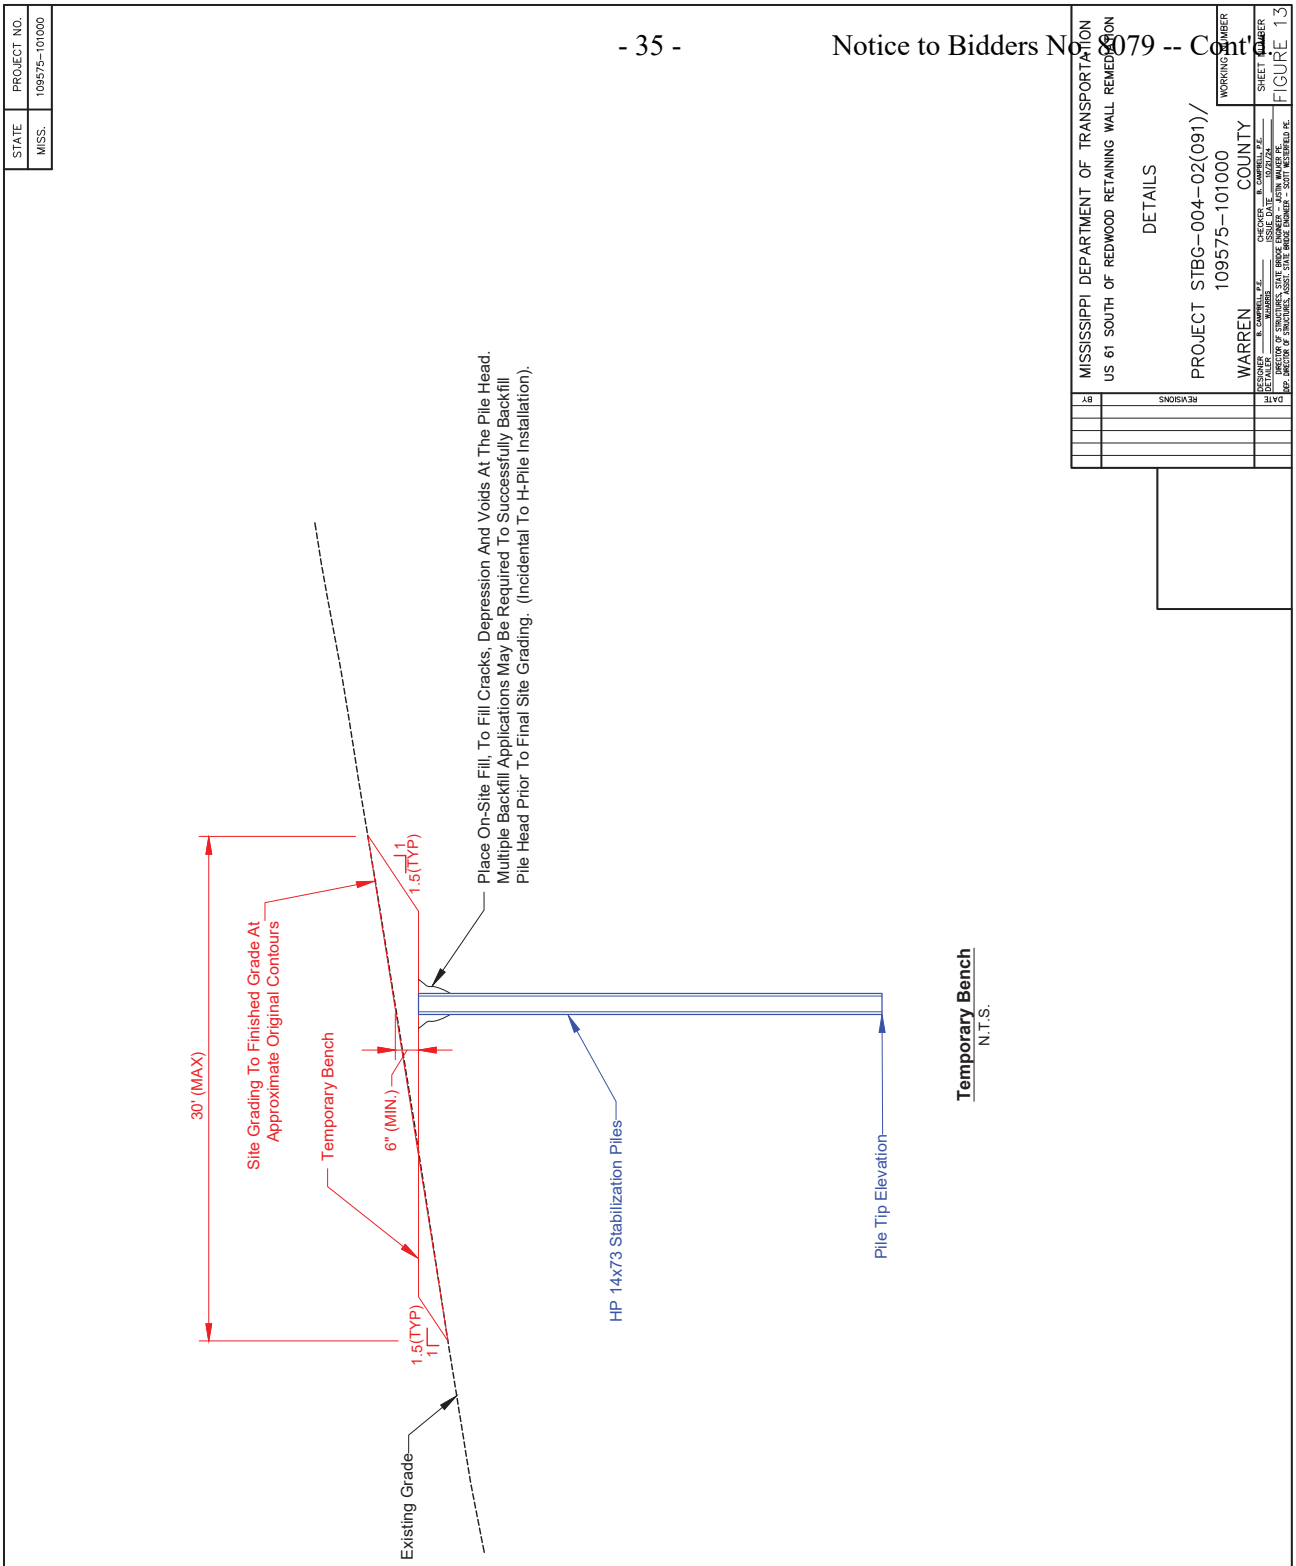
STATE
MISS.
PROJECT NO.
109575-101000
MISSISSIPPI DEPARTMENT OF TRANSPORTATION
US 61 SOUTH OF REDWOOD RETAINING WALL REMEDIATION
DETAILS
PROJECT STBG-004-02(091)/
109575-101000
WARREN COUNTY
WORKING NUMBER
SHEET NUMBER
FIGURE 13
REVISIONS
BY
DATE
DESIGNER R. CAMPBELL, P.E.
DETAILER KUMBRA
CHECKER R. CAMPBELL, P.E.
ISSUE DATE 10/21/24
DIRECTOR OF STRUCTURES, STATE BRIDGE ENGINEER JUSTIN MILLER PE
APP. DIRECTOR OF STRUCTURES, ASSOC STATE BRIDGE ENGINEER MATT REDFIELD PE
Place On-Site Fill, To Fill Cracks, Depression And Voids At The Pile Head.
Multiple Backfill Applications May Be Required To Successfully Backfill
Pile Head Prior To Final Site Grading. (Incidental To H-Pile Installation).
1
1.5(TYP)
30' (MAX)
Site Grading To Finished Grade At
Approximate Original Contours
Temporary Bench
6" (MIN.)
1.5(TYP)
1
Existing Grade
HP 14x73 Stabilization Piles
Pile Tip Elevation
Temporary Bench
N.T.S.

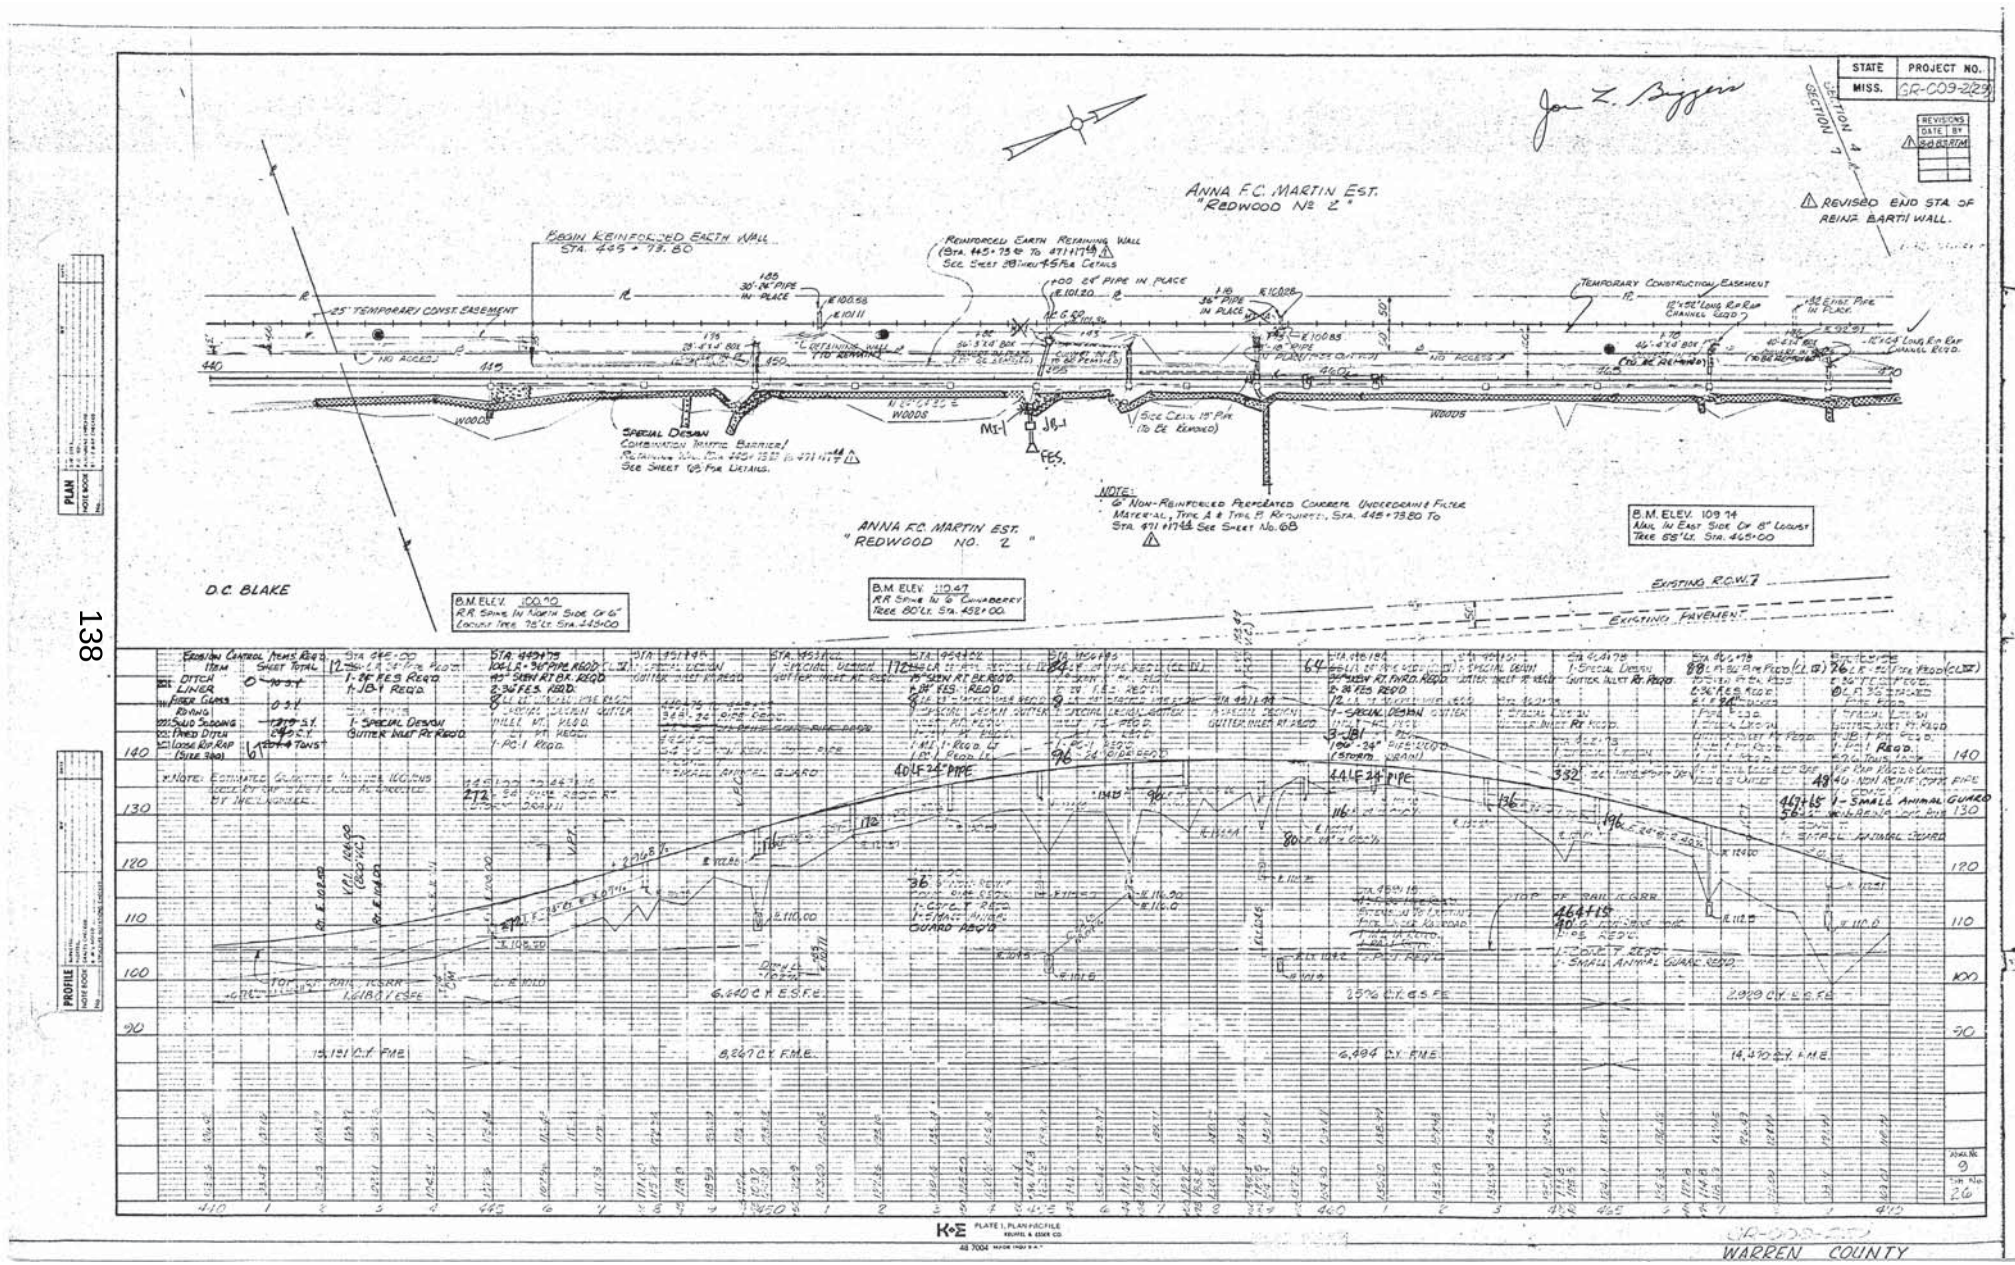
STATE MISS.
PROJECT NO. SR-009-2(29)
REVISIONS DATE BY
SHEET NO.
ANNA F.C. MARTIN EST. "REDWOOD Nº 2"
REVISED END STA OF REINF. EARTH WALL.
BASIN REINFORCED EARTH WALL STA. 445+78.80
REINFORCED EARTH RETAINING WALL (Sta. 445+73.80 To 471+17.80) See Sheet 28 thru 45 For Details
25' TEMPORARY CONST. EASEMENT
TEMPORARY CONSTRUCTION EASEMENT
SPECIAL DESIGN COMBINATION TRAFFIC BARRIER (Retaining Wall Sta 445+73.80 To 471+17.80) See Sheet 65 For Details.
NOTE: 6" Non-Reinforced Perforated Concrete Underdrain & Filter Material, Type A & Type B Reqd. Sta. 445+73.80 To Sta. 471+17.80 See Sheet No. 68
ANNA F.C. MARTIN EST. "REDWOOD NO. 2"
D.C. BLAKE
B.M. ELEV. 109.74 Nail In East Side Of 8" Locust Tree 65' Lt. Sta. 465+00
B.M. ELEV. 100.30 R.R. Spike In North Side Of 6" Locust Tree 78' Lt. Sta. 443+00
B.M. ELEV. 110.47 R.R. Spike In S. Cumberry Tree 80' Lt. Sta. 452+00
EXISTING R.O.W.
EXISTING PAVEMENT
WOODS
SPECIAL DESIGN COMBINATION TRAFFIC BARRIER
SIDE CELL 15" PIPE (To Be Removed)
PLAN
PROFILE
138
K&E PLATE 1. PLAN-PROFILE
WARREN COUNTY

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 8080 **CODE: (SP)**

DATE: **7/08/2026**

SUBJECT: **Lane Closure Restrictions**

PROJECT: **NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301**
Warren County

Bidders are hereby advised of the following restrictions on the above captioned project.

From **Log Mile 17.374 (BOP)-19.200 and the ramps at the US 61 and SR 3 interchange**, any day to include the weekend, work requiring a lane closure will only be allowed between the hours of 7:00 PM – 6:00 AM. Lane closures may be installed beginning at 7:00 PM and must be removed by 6:00 AM.

Exception for Full Depth Repair work only, lane closures may be installed beginning at 7:00 PM on Friday and must be removed by 6:00 AM Monday.

The Contractor will be charged a fee of **$500.00** for each full or partial 5-minute period until the roadway is back in compliance with the requirements stated above.

Official time can be obtained by calling the following Jackson area phone number: 601-355-9311.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 – NOTICE TO BIDDERS NO. 8081 **CODE: (SP)**

DATE: 7/22/2026

SUBJECT: Milestone Date

PROJECT: NHPP-0009-02(086) / 108212301 – Warren County

Milestone – Interim Completion Date. Bidders are advised that this project carries a Project Completion Milestone that is an interim completion date for the completion of all work from the BOP to the Vicksburg Corporate Limits, approximately 0.73 miles. The work includes failed area repairs; milling; all asphalt pavement to include crossovers, shoulders, aprons, and local roads; placement of granular shoulder material; placement of temporary traffic stripes; and all other incidentals necessary to complete the work. The Contractor will be assessed **$1,200.00** for each calendar day past the milestone completion date until the Milestone Work is complete.

The Milestone Completion Date shall be **March 9, 2027.** The Contractor will be allowed to work 24/7 to complete milestone work only but must still adhere to any lane closure restrictions.

Final Completion Date. Final completion date to complete all remaining work required in the contract shall be **171 Working Days** as referenced in Notice to Bidders 8076– Contract Time.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SECTION 904 - NOTICE TO BIDDERS NO. 8191 **CODE: (SP)**

DATE: 07/01/2026

SUBJECT: Obligation Date

With respect to the obligation date referenced in Special Provision No. 907-700-3 entitled "Materials and Tests", bidders are advised that this project will be obligated on or after October 1, 2025 and before October 1, 2026.

General Decision Number: MS20260119 05/18/2026

State: Mississippi

Construction Types: Highway

Counties: Mississippi Counties of
Warren

Modification Number	Publication Date
0	01/02/2026
1	05/18/2026

SUMS2010-042 08/04/2014

	Rates	Fringes
TRUCK DRIVER: SEMI/TRAILER TRUCK	$ 17.34	0.00
TRUCK DRIVER: DUMP TRUCK (ALL TYPES)	$ 13.14	0.00
TRUCK DRIVER: WATER TRUCK	$ 13.15	0.00
TRUCK DRIVER: OFF THE ROAD TRUCK	$ 12.31	0.00
TRUCK DRIVER: MECHANIC	$ 12.35	0.00
TRUCK DRIVER: LOWBOY TRUCK	$ 14.83	0.00
TRUCK DRIVER: FLATBED TRUCK	$ 13.29	0.00
OPERATOR: TRENCHER	$ 15.00	0.00
OPERATOR: TRACTOR	$ 9.98	0.00
OPERATOR: SCRAPER	$ 12.63	0.00
OPERATOR: ROLLER (ALL TYPES)	$ 11.05	0.00
OPERATOR: PILEDRIVER	$ 15.13	0.00
OPERATOR: PAVER (ASPHALT, AGGREGATE, AND CONCRETE)	$ 13.01	0.00
OPERATOR: OILER	$ 13.08	0.48
OPERATOR: MIXER	$ 14.85	0.00
OPERATOR: MILLING MACHINE	$ 15.38	0.00
OPERATOR: MECHANIC	$ 16.28	0.00
OPERATOR: LOADER	$ 11.73	0.00
OPERATOR: GRADER/BLADE	$ 13.84	0.00
OPERATOR: DRILL	$ 19.22	0.00
OPERATOR: DISTRIBUTOR	$ 11.70	0.00
OPERATOR: CRANE	$ 16.00	0.00
OPERATOR: CONCRETE SAW	$ 13.60	0.00
OPERATOR: BULLDOZER	$ 14.38	0.00
OPERATOR: BROOM/SWEEPER	$ 10.17	0.00
OPERATOR: BACKHOE/EXCAVATOR/TRACKHOE	$ 13.28	0.00
OPERATOR: ASPHALT SPREADER	$ 16.13	0.00
LABORER: LABORER-CONES/ BARRICADES/BARRELS - SETTER/MOVER/SWEEPER	$ 10.53	0.00
LABORER: PIPELAYER	$ 13.13	0.00
LABORER: MASON TENDER - CEMENT/CONCRETE	$ 11.69	0.00
LABORER: LANDSCAPE	$ 9.82	0.00
LABORER: GRADE CHECKER	$ 10.67	0.00
LABORER: FLAGGER	$ 9.83	0.00
LABORER: COMMON OR GENERAL, INCLUDING ASPHALT		

RAKING, SHOVELING, SPREADING AND CONCRETE WORK.....$ 10.60 0.00
IRONWORKER, REINFORCING.....$ 16.43 0.00
INSTALLER - SIGN.....$ 12.04 0.00
INSTALLER - GUARDRAIL.....$ 11.42 0.00
HIGHWAY/PARKING LOT STRIPING: TRUCK DRIVER (LINE
STRIPING TRUCK).....$ 12.63 0.00
ELECTRICIAN.....$ 22.64 7.73
CEMENT MASON/CONCRETE FINISHER.....$ 13.23 0.00
CARPENTER, EXCLUDES FORM WORK.....$ 14.21 0.00
CARPENTER (FORM WORK ONLY).....$ 12.26 0.12

--
WELDERS - Receive rate prescribed for craft performing
operation to which welding is incidental.
==========
Note: Executive Order (EO) 13706, Establishing Paid Sick Leave
for Federal Contractors applies to all contracts subject to the
Davis-Bacon Act for which the contract is awarded (and any
solicitation was issued) on or after January 1, 2017. If this
contract is covered by the EO, the contractor must provide
employees with 1 hour of paid sick leave for every 30 hours
they work, up to 56 hours of paid sick leave each year.
Employees must be permitted to use paid sick leave for their
own illness, injury or other health-related needs, including
preventive care; to assist a family member (or person who is
like family to the employee) who is ill, injured, or has other
health-related needs, including preventive care; or for reasons
resulting from, or to assist a family member (or person who is
like family to the employee) who is a victim of, domestic
violence, sexual assault, or stalking. Additional information
on contractor requirements and worker protections under the EO
is available at
https://www.dol.gov/agencies/whd/government-contracts.

Note: Executive Order 13658 generally applies to contracts subject
to the Davis-Bacon Act that were awarded on or between January 1,
2015 and January 29, 2022, and that have not been renewed or
extended on or after January 30, 2022. Executive Order 13658 does
not apply to contracts subject only to the Davis-Bacon Related Acts
regardless of when they were awarded. If a contract is subject to
Executive Order 13658, the contractor must pay all covered workers
at least $13.65 per hour (or the applicable wage rate listed on this
wage determination, if it is higher) for all hours spent performing on
the contract from May 11, 2026, through December 31, 2026. The
applicable Executive Order minimum wage rate will be adjusted annually.
Additional information on contractor requirements and worker
protections under Executive Order 13658 is available at
www.dol.gov/whd/govcontracts.

Unlisted classifications needed for work not included within
the scope of the classifications listed may be added after
award only as provided in the labor standards contract clauses
(29CFR 5.5 (a) (1) (iii)).

The body of each wage determination lists the classifications
and wage rates that have been found to be prevailing for the
type(s) of construction and geographic area covered by the wage
determination. The classifications are listed in alphabetical

order under rate identifiers indicating whether the particular rate is a union rate (current union negotiated rate), a survey rate, a weighted union average rate, a state adopted rate, or a supplemental classification rate.

Union Rate Identifiers

A four-letter identifier beginning with characters other than ◆SU◆, ◆UAVG◆, ◆SA◆, or ◆SC◆ denotes that a union rate was prevailing for that classification in the survey. Example: PLUM0198-005 07/01/2024. PLUM is an identifier of the union whose collectively bargained rate prevailed in the survey for this classification, which in this example would be Plumbers. 0198 indicates the local union number or district council number where applicable, i.e., Plumbers Local 0198. The next number, 005 in the example, is an internal number used in processing the wage determination. The date, 07/01/2024 in the example, is the effective date of the most current negotiated rate.

Union prevailing wage rates are updated to reflect all changes over time that are reported to WHD in the rates in the collective bargaining agreement (CBA) governing the classification.

Union Average Rate Identifiers

The UAVG identifier indicates that no single rate prevailed for those classifications, but that 100% of the data reported for the classifications reflected union rates. EXAMPLE: UAVG-OH-0010 01/01/2024. UAVG indicates that the rate is a weighted union average rate. OH indicates the State of Ohio. The next number, 0010 in the example, is an internal number used in producing the wage determination. The date, 01/01/2024 in the example, indicates the date the wage determination was updated to reflect the most current union average rate.

A UAVG rate will be updated once a year, usually in January, to reflect a weighted average of the current rates in the collective bargaining agreements on which the rate is based.

Survey Rate Identifiers

The ◆SU◆ identifier indicates that either a single non-union rate prevailed (as defined in 29 CFR 1.2) for this classification in the survey or that the rate was derived by computing a weighted average rate based on all the rates reported in the survey for that classification. As a weighted average rate includes all rates reported in the survey, it may include both union and non-union rates. Example: SUFL2022-007 6/27/2024. SU indicates the rate is a single non-union prevailing rate or a weighted average of survey data for that classification. FL indicates the State of Florida. 2022 is the year of the survey on which these classifications and rates are based. The next number, 007 in the example, is an internal number used in producing the wage determination. The date, 6/27/2024 in the example, indicates the survey completion date for the classifications and rates under that identifier.

◆SU◆ wage rates typically remain in effect until a new survey is conducted. However, the Wage and Hour Division (WHD) has the

discretion to update such rates under 29 CFR 1.6(c)(1).

State Adopted Rate Identifiers

The ◆SA◆ identifier indicates that the classifications and prevailing wage rates set by a state (or local) government were adopted under 29 C.F.R 1.3(g)-(h). Example: SAME2023-007 01/03/2024. SA reflects that the rates are state adopted. ME refers to the State of Maine. 2023 is the year during which the state completed the survey on which the listed classifications and rates are based. The next number, 007 in the example, is an internal number used in producing the wage determination. The date, 01/03/2024 in the example, reflects the date on which the classifications and rates under the ◆SA◆ identifier took effect under state law in the state from which the rates were adopted.

WAGE DETERMINATION APPEALS PROCESS

1) Has there been an initial decision in the matter? This can be:

a) a survey underlying a wage determination
b) an existing published wage determination
c) an initial WHD letter setting forth a position on a wage determination matter
d) an initial conformance (additional classification and rate) determination

On survey related matters, initial contact, including requests for summaries of surveys, should be directed to the WHD Branch of Wage Surveys. Requests can be submitted via email to davisbaconinfo@dol.gov or by mail to:

Branch of Wage Surveys
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

Regarding any other wage determination matter such as conformance decisions, requests for initial decisions should be directed to the WHD Branch of Construction Wage Determinations. Requests can be submitted via email to BCWD-Office@dol.gov or by mail to:

Branch of Construction Wage Determinations
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

2) If an initial decision has been issued, then any interested party (those affected by the action) that disagrees with the decision can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Requests for review and reconsideration can be submitted via email to dba.reconsideration@dol.gov or by mail to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

The request should be accompanied by a full statement of the interested party's position and any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210.

==========

END OF GENERAL DECISION

SUPPLEMENT TO FORM FHWA-1273

DATE: 07/26/2022

SUBJECT: Federal Contract Provisions for Subcontracts

Federal Contract Provisions for Subcontracts

All subcontracts shall be in writing and contain all pertinent provisions and requirements of the prime contract.

Each "Request for Permission to Subcontract" (Mississippi Department of Transportation Form CAD-720) shall include a copy of the subcontract. The federal contract provisions (FHWA-1273, SUPPLEMENT TO FORM FHWA-1273, NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY (EXECUTIVE ORDER 11246), DAVIS-BACON AND RELATED ACT PROVISIONS (WAGE RATES)) must be physically incorporated as part of the subcontract. A completed Mississippi Department of Transportation Form CAD-521 and Form CAD-725 must be attached to the CAD-720.

REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS

I. General
II. Nondiscrimination
III. Non-segregated Facilities
IV. Davis-Bacon and Related Act Provisions
V. Contract Work Hours and Safety Standards Act Provisions
VI. Subletting or Assigning the Contract
VII. Safety: Accident Prevention
VIII. False Statements Concerning Highway Projects
IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
X. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion
XI. Certification Regarding Use of Contract Funds for Lobbying
XII. Use of United States-Flag Vessels:

ATTACHMENTS

A. Employment and Materials Preference for Appalachian Development Highway System or Appalachian Local Access Road Contracts (included in Appalachian contracts only)

I. GENERAL

1. Form FHWA-1273 must be physically incorporated in each construction contract funded under title 23, United States Code, as required in 23 CFR 633.102(b) (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services). 23 CFR 633.102(e).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider. 23 CFR 633.102(e).

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services) in accordance with 23 CFR 633.102. The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in solicitation-for-bids or request-for-proposals documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract). 23 CFR 633.102(b).

2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract. 23 CFR 633.102(d).

3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.

4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. 23 U.S.C. 114(b). The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors. 23 U.S.C. 101(a).

II. NONDISCRIMINATION (23 CFR 230.107(a); 23 CFR Part 230, Subpart A, Appendix A; EO 11246)

The provisions of this section related to 23 CFR Part 230, Subpart A, Appendix A are applicable to all Federal-aid construction contracts and to all related construction subcontracts of $10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR Part 60, 29 CFR Parts 1625-1627, 23 U.S.C. 140, Section 504 of the Rehabilitation Act of 1973, as amended (29 U.S.C. 794), Title VI of the Civil Rights Act of 1964, as amended (42 U.S.C. 2000d et seq.), and related regulations including 49 CFR Parts 21, 26, and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding $10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR Part 60, and 29 CFR Parts 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with 23 U.S.C. 140, Section 504 of the Rehabilitation Act of 1973, as amended (29 U.S.C. 794), and Title VI of the Civil Rights Act of 1964, as amended (42 U.S.C. 2000d et seq.), and related regulations including 49 CFR Parts 21, 26, and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR Part 230, Subpart A, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

1. Equal Employment Opportunity: Equal Employment Opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (*see* 28 CFR Part 35, 29 CFR Part 1630, 29 CFR Parts 1625-1627, 41 CFR Part 60 and 49 CFR Part 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140, shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR Part 35 and 29 CFR Part 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract. 23 CFR 230.409 (g)(4) & (5).

b. The contractor will accept as its operating policy the following statement:

> "It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, sexual orientation, gender identity, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."

2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.

3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action or are substantially involved in such action, will be made fully cognizant of and will implement the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:

a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer or other knowledgeable company official.

b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.

c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.

d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.

e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.

a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.

b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.

c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.

5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, sexual orientation, gender identity, national origin, age or disability. The following procedures shall be followed:

a. The contractor will conduct periodic inspections of project sites to ensure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.

c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action

within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.

6. Training and Promotion:

a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.

b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs (i.e., apprenticeship and on-the-job training programs for the geographical area of contract performance). In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).

c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.

d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.

7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. 23 CFR 230.409. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:

a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.

b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, sexual orientation, gender identity, national origin, age, or disability.

c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.

d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, sexual orientation, gender identity, national origin, age, or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.

8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established thereunder. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.

9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, sexual orientation, gender identity, national origin, age, or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.

a. The contractor shall notify all potential subcontractors, suppliers, and lessors of their EEO obligations under this contract.

b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.

10. Assurances Required:

a. The requirements of 49 CFR Part 26 and the State DOT's FHWA-approved Disadvantaged Business Enterprise (DBE) program are incorporated by reference.

b. The contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate, which may include, but is not limited to:
(1) Withholding monthly progress payments;
(2) Assessing sanctions;
(3) Liquidated damages; and/or
(4) Disqualifying the contractor from future bidding as non-responsible.

c. The Title VI and nondiscrimination provisions of U.S. DOT Order 1050.2A at Appendixes A and E are incorporated by reference. 49 CFR Part 21.

11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.

a. The records kept by the contractor shall document the following:

(1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;

(2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women.

b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of more than $10,000. 41 CFR 60-1.5.

As prescribed by 41 CFR 60-1.8, the contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, sexual orientation, gender identity, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location under the contractor's control where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding $2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size), in accordance with 29 CFR 5.5. The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. 23 U.S.C. 113. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. 23 U.S.C. 101. Where applicable law requires that projects be treated as a project on a Federal-aid highway, the provisions of this subpart will apply regardless of the location of the project. Examples include: Surface Transportation Block Grant Program projects funded under 23 U.S.C. 133 [excluding recreational trails projects], the Nationally Significant Freight and Highway Projects funded under 23 U.S.C. 117, and National Highway Freight Program projects funded under 23 U.S.C. 167.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 “Contract provisions and related matters” with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages (29 CFR 5.5)

a. *Wage rates and fringe benefits.* All laborers and mechanics employed or working upon the site of the work (or otherwise working in construction or development of the project under a development statute), will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of basic hourly wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics. As provided in paragraphs (d) and (e) of 29 CFR 5.5, the appropriate wage determinations are effective by operation of law even if they have not been attached to the contract. Contributions made or costs reasonably anticipated for bona fide fringe benefits under the Davis-Bacon Act (40 U.S.C. 3141(2)(B)) on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.e. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics must be paid the appropriate wage rate and fringe benefits on the wage determination for the classification(s) of work actually performed, without regard to skill, except as provided in paragraph 4. of this section. Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: *Provided,* That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classifications and wage rates conformed under paragraph 1.c. of this section) and the Davis-Bacon poster (WH–1321) must be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

b. *Frequently recurring classifications.* (1) In addition to wage and fringe benefit rates that have been determined to be prevailing under the procedures set forth in 29 CFR part 1, a wage determination may contain, pursuant to § 1.3(f), wage and fringe benefit rates for classifications of laborers and mechanics for which conformance requests are regularly submitted pursuant to paragraph 1.c. of this section, provided that:

(i) The work performed by the classification is not performed by a classification in the wage determination for which a prevailing wage rate has been determined;

(ii) The classification is used in the area by the construction industry; and

(iii) The wage rate for the classification bears a reasonable relationship to the prevailing wage rates contained in the wage determination.

(2) The Administrator will establish wage rates for such classifications in accordance with paragraph 1.c.(1)(iii) of this section. Work performed in such a classification must be paid at no less than the wage and fringe benefit rate listed on the wage determination for such classification.

c. *Conformance.* (1) The contracting officer must require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract be classified in conformance with the wage determination. Conformance of an additional classification and wage rate and fringe benefits is appropriate only when the following criteria have been met:

(i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and

(ii) The classification is used in the area by the construction industry; and

(iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.

(2) The conformance process may not be used to split, subdivide, or otherwise avoid application of classifications listed in the wage determination.

(3) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken will be sent by the contracting officer by email to *DBAconformance@dol.gov*. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30–day period that additional time is necessary.

(4) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer will, by email to *DBAconformance@dol.gov*, refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Administrator for determination. The Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30–day period that additional time is necessary.

(5) The contracting officer must promptly notify the contractor of the action taken by the Wage and Hour Division under paragraphs 1.c.(3) and (4) of this section. The contractor must furnish a written copy of such determination to each affected worker or it must be posted as a part of the wage determination. The wage rate (including fringe benefits where appropriate) determined pursuant to paragraph 1.c.(3) or (4) of this section must be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.

d. *Fringe benefits not expressed as an hourly rate.* Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor may either pay the benefit as stated in the wage determination or may pay another bona fide fringe benefit or an hourly cash equivalent thereof.

e. *Unfunded plans.* If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, *Provided,* That the Secretary of Labor has found, upon the written request of the contractor, in accordance with the criteria set forth in § 5.28, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

f. *Interest.* In the event of a failure to pay all or part of the wages required by the contract, the contractor will be required to pay interest on any underpayment of wages.

2. Withholding (29 CFR 5.5)

a. *Withholding requirements.* The contracting agency may, upon its own action, or must, upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor so much of the accrued payments or advances as may be considered necessary to satisfy the liabilities of the prime contractor or any subcontractor for the full amount of wages and monetary relief, including interest, required by the clauses set forth in this section for violations of this contract, or to satisfy any such liabilities required by any other Federal contract, or federally assisted contract subject to Davis-Bacon labor standards, that is held by the same prime contractor (as defined in § 5.2). The necessary funds may be withheld from the contractor under this contract, any other Federal contract with the same prime contractor, or any other federally assisted contract that is subject to Davis-Bacon labor standards requirements and is held by the same prime contractor, regardless of whether the other contract was awarded or assisted by the same agency, and such funds may be used to satisfy the contractor liability for which the funds were withheld. In the event of a contractor's failure to pay any laborer or mechanic, including any apprentice or helper working on the site of the work all or part of the wages required by the contract, or upon the contractor's failure to submit the required records as discussed in paragraph 3.d. of this section, the contracting agency may on its own initiative and after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

b. *Priority to withheld funds.* The Department has priority to funds withheld or to be withheld in accordance with paragraph

2.a. of this section or Section V, paragraph 3.a., or both, over claims to those funds by:

(1) A contractor's surety(ies), including without limitation performance bond sureties and payment bond sureties;

(2) A contracting agency for its reprocurement costs;

(3) A trustee(s) (either a court-appointed trustee or a U.S. trustee, or both) in bankruptcy of a contractor, or a contractor's bankruptcy estate;

(4) A contractor's assignee(s);

(5) A contractor's successor(s); or

(6) A claim asserted under the Prompt Payment Act, 31 U.S.C. 3901–3907.

3. Records and certified payrolls (29 CFR 5.5)

a. *Basic record requirements* (1) *Length of record retention.* All regular payrolls and other basic records must be maintained by the contractor and any subcontractor during the course of the work and preserved for all laborers and mechanics working at the site of the work (or otherwise working in construction or development of the project under a development statute) for a period of at least 3 years after all the work on the prime contract is completed.

(2) *Information required.* Such records must contain the name; Social Security number; last known address, telephone number, and email address of each such worker; each worker's correct classification(s) of work actually performed; hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in 40 U.S.C. 3141(2)(B) of the Davis-Bacon Act); daily and weekly number of hours actually worked in total and on each covered contract; deductions made; and actual wages paid.

(3) *Additional records relating to fringe benefits.* Whenever the Secretary of Labor has found under paragraph 1.e. of this section that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in 40 U.S.C. 3141(2)(B) of the Davis-Bacon Act, the contractor must maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits.

(4) *Additional records relating to apprenticeship.* Contractors with apprentices working under approved programs must maintain written evidence of the registration of apprenticeship programs, the registration of the apprentices, and the ratios and wage rates prescribed in the applicable programs.

b. *Certified payroll requirements* (1) *Frequency and method of submission.* The contractor or subcontractor must submit weekly, for each week in which any DBA- or Related Acts-covered work is performed, certified payrolls to the contracting agency. The prime contractor is responsible for the submission of all certified payrolls by all subcontractors. A contracting agency or prime contractor may permit or require contractors to submit certified payrolls through an electronic system, as long as the electronic system requires a legally valid electronic signature; the system allows the contractor, the contracting agency, and the Department of Labor to access the certified payrolls upon request for at least 3 years after the work on the prime contract has been completed; and the contracting agency or prime contractor permits other methods of submission in situations where the contractor is unable or limited in its ability to use or access the electronic system.

(2) *Information required.* The certified payrolls submitted must set out accurately and completely all of the information required to be maintained under paragraph 3.a.(2) of this section, except that full Social Security numbers and last known addresses, telephone numbers, and email addresses must not be included on weekly transmittals. Instead, the certified payrolls need only include an individually identifying number for each worker (*e.g.,* the last four digits of the worker's Social Security number). The required weekly certified payroll information may be submitted using Optional Form WH–347 or in any other format desired. Optional Form WH–347 is available for this purpose from the Wage and Hour Division website at *https://www.dol.gov/sites/dolgov/files/WHD/legacy/files/wh347/.pdf* or its successor website. It is not a violation of this section for a prime contractor to require a subcontractor to provide full Social Security numbers and last known addresses, telephone numbers, and email addresses to the prime contractor for its own records, without weekly submission by the subcontractor to the contracting agency.

(3) *Statement of Compliance.* Each certified payroll submitted must be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor, or the contractor's or subcontractor's agent who pays or supervises the payment of the persons working on the contract, and must certify the following:

(i) That the certified payroll for the payroll period contains the information required to be provided under paragraph 3.b. of this section, the appropriate information and basic records are being maintained under paragraph 3.a. of this section, and such information and records are correct and complete;

(ii) That each laborer or mechanic (including each helper and apprentice) working on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in 29 CFR part 3; and

(iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification(s) of work actually performed, as specified in the applicable wage determination incorporated into the contract.

(4) *Use of Optional Form WH–347.* The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH–347 will satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(3) of this section.

(5) *Signature.* The signature by the contractor, subcontractor, or the contractor's or subcontractor's agent must be an original handwritten signature or a legally valid electronic signature.

(6) *Falsification.* The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under 18 U.S.C. 1001 and 31 U.S.C. 3729.

(7) *Length of certified payroll retention.* The contractor or subcontractor must preserve all certified payrolls during the course of the work and for a period of 3 years after all the work on the prime contract is completed.

c. *Contracts, subcontracts, and related documents.* The contractor or subcontractor must maintain this contract or subcontract and related documents including, without limitation, bids, proposals, amendments, modifications, and extensions. The contractor or subcontractor must preserve these contracts, subcontracts, and related documents during the course of the work and for a period of 3 years after all the work on the prime contract is completed.

d. *Required disclosures and access* (1) *Required record disclosures and access to workers.* The contractor or subcontractor must make the records required under paragraphs 3.a. through 3.c. of this section, and any other documents that the contracting agency, the State DOT, the FHWA, or the Department of Labor deems necessary to determine compliance with the labor standards provisions of any of the applicable statutes referenced by § 5.1, available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and must permit such representatives to interview workers during working hours on the job.

(2) *Sanctions for non-compliance with records and worker access requirements.* If the contractor or subcontractor fails to submit the required records or to make them available, or refuses to permit worker interviews during working hours on the job, the Federal agency may, after written notice to the contractor, sponsor, applicant, owner, or other entity, as the case may be, that maintains such records or that employs such workers, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available, or to permit worker interviews during working hours on the job, may be grounds for debarment action pursuant to § 5.12. In addition, any contractor or other person that fails to submit the required records or make those records available to WHD within the time WHD requests that the records be produced will be precluded from introducing as evidence in an administrative proceeding under 29 CFR part 6 any of the required records that were not provided or made available to WHD. WHD will take into consideration a reasonable request from the contractor or person for an extension of the time for submission of records. WHD will determine the reasonableness of the request and may consider, among other things, the location of the records and the volume of production.

(3) *Required information disclosures.* Contractors and subcontractors must maintain the full Social Security number and last known address, telephone number, and email address of each covered worker, and must provide them upon request to the contracting agency, the State DOT, the FHWA, the contractor, or the Wage and Hour Division of the Department of Labor for purposes of an investigation or other compliance action.

4. Apprentices and equal employment opportunity (29 CFR 5.5)

a. *Apprentices* (1) *Rate of pay.* Apprentices will be permitted to work at less than the predetermined rate for the work they perform when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship (OA), or with a State Apprenticeship Agency recognized by the OA. A person who is not individually registered in the program, but who has been certified by the OA or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice, will be permitted to work at less than the predetermined rate for the work they perform in the first 90 days of probationary employment as an apprentice in such a program. In the event the OA or a State Apprenticeship Agency recognized by the OA withdraws approval of an apprenticeship program, the contractor will no longer be permitted to use apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

(2) *Fringe benefits.* Apprentices must be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringe benefits must be paid in accordance with that determination.

(3) *Apprenticeship ratio.* The allowable ratio of apprentices to journeyworkers on the job site in any craft classification must not be greater than the ratio permitted to the contractor as to the entire work force under the registered program or the ratio applicable to the locality of the project pursuant to paragraph 4.a.(4) of this section. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated in paragraph 4.a.(1) of this section, must be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under this section must be paid not less than the applicable wage rate on the wage determination for the work actually performed.

(4) *Reciprocity of ratios and wage rates.* Where a contractor is performing construction on a project in a locality other than the locality in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyworker's hourly rate) applicable within the locality in which the construction is being performed must be observed. If there is no applicable ratio or wage rate for the locality of the project, the ratio and wage rate specified in the contractor's registered program must be observed.

b. *Equal employment opportunity.* The use of apprentices and journeyworkers under this part must be in conformity with

the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.

c. Apprentices and Trainees (programs of the U.S. DOT).

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. 23 CFR 230.111(e)(2). The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeyworkers shall not be greater than permitted by the terms of the particular program.

5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract as provided in 29 CFR 5.5.

6. Subcontracts. The contractor or subcontractor must insert FHWA-1273 in any subcontracts, along with the applicable wage determination(s) and such other clauses or contract modifications as the contracting agency may by appropriate instructions require, and a clause requiring the subcontractors to include these clauses and wage determination(s) in any lower tier subcontracts. The prime contractor is responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in this section. In the event of any violations of these clauses, the prime contractor and any subcontractor(s) responsible will be liable for any unpaid wages and monetary relief, including interest from the date of the underpayment or loss, due to any workers of lower-tier subcontractors, and may be subject to debarment, as appropriate. 29 CFR 5.5.

7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.

8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract as provided in 29 CFR 5.5.

9. Disputes concerning labor standards. As provided in 29 CFR 5.5, disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

10. Certification of eligibility. a. By entering into this contract, the contractor certifies that neither it nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of 40 U.S.C. 3144(b) or § 5.12(a).

b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of 40 U.S.C. 3144(b) or § 5.12(a).

c. The penalty for making false statements is prescribed in the U.S. Code, Title 18 Crimes and Criminal Procedure, 18 U.S.C. 1001.

11. Anti-retaliation. It is unlawful for any person to discharge, demote, intimidate, threaten, restrain, coerce, blacklist, harass, or in any other manner discriminate against, or to cause any person to discharge, demote, intimidate, threaten, restrain, coerce, blacklist, harass, or in any other manner discriminate against, any worker or job applicant for:

a. Notifying any contractor of any conduct which the worker reasonably believes constitutes a violation of the DBA, Related Acts, this part, or 29 CFR part 1 or 3;

b. Filing any complaint, initiating or causing to be initiated any proceeding, or otherwise asserting or seeking to assert on behalf of themselves or others any right or protection under the DBA, Related Acts, this part, or 29 CFR part 1 or 3;

c. Cooperating in any investigation or other compliance action, or testifying in any proceeding under the DBA, Related Acts, this part, or 29 CFR part 1 or 3; or

d. Informing any other person about their rights under the DBA, Related Acts, this part, or 29 CFR part 1 or 3.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

Pursuant to 29 CFR 5.5(b), the following clauses apply to any Federal-aid construction contract in an amount in excess of $100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchpersons and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek. 29 CFR 5.5.

2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph 1. of this section the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages and interest from the date of the underpayment. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or

mechanic, including watchpersons and guards, employed in violation of the clause set forth in paragraph 1. of this section, in the sum currently provided in 29 CFR 5.5(b)(2)* for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph 1. of this section.

* $31 as of January 15, 2023 (See 88 FR 88 FR 2210) as may be adjusted annually by the Department of Labor, pursuant to the Federal Civil Penalties Inflation Adjustment Act of 1990.

3. Withholding for unpaid wages and liquidated damages

a. *Withholding process.* The FHWA or the contracting agency may, upon its own action, or must, upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor so much of the accrued payments or advances as may be considered necessary to satisfy the liabilities of the prime contractor or any subcontractor for any unpaid wages; monetary relief, including interest; and liquidated damages required by the clauses set forth in this section on this contract, any other Federal contract with the same prime contractor, or any other federally assisted contract subject to the Contract Work Hours and Safety Standards Act that is held by the same prime contractor (as defined in § 5.2). The necessary funds may be withheld from the contractor under this contract, any other Federal contract with the same prime contractor, or any other federally assisted contract that is subject to the Contract Work Hours and Safety Standards Act and is held by the same prime contractor, regardless of whether the other contract was awarded or assisted by the same agency, and such funds may be used to satisfy the contractor liability for which the funds were withheld.

b. *Priority to withheld funds.* The Department has priority to funds withheld or to be withheld in accordance with Section IV paragraph 2.a. or paragraph 3.a. of this section, or both, over claims to those funds by:

(1) A contractor's surety(ies), including without limitation performance bond sureties and payment bond sureties;

(2) A contracting agency for its reprocurement costs;

(3) A trustee(s) (either a court-appointed trustee or a U.S. trustee, or both) in bankruptcy of a contractor, or a contractor's bankruptcy estate;

(4) A contractor's assignee(s);

(5) A contractor's successor(s); or

(6) A claim asserted under the Prompt Payment Act, 31 U.S.C. 3901–3907.

4. Subcontracts. The contractor or subcontractor must insert in any subcontracts the clauses set forth in paragraphs 1. through 5. of this section and a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor is responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs 1. through 5. In the event of any violations of these clauses, the prime contractor and any subcontractor(s) responsible will be liable for any unpaid wages and monetary relief, including interest from the date of the underpayment or loss, due to any workers of lower-tier subcontractors, and associated liquidated damages and may be subject to debarment, as appropriate.

5. Anti-retaliation. It is unlawful for any person to discharge, demote, intimidate, threaten, restrain, coerce, blacklist, harass, or in any other manner discriminate against, or to cause any person to discharge, demote, intimidate, threaten, restrain, coerce, blacklist, harass, or in any other manner discriminate against, any worker or job applicant for:

a. Notifying any contractor of any conduct which the worker reasonably believes constitutes a violation of the Contract Work Hours and Safety Standards Act (CWHSSA) or its implementing regulations in this part;

b. Filing any complaint, initiating or causing to be initiated any proceeding, or otherwise asserting or seeking to assert on behalf of themselves or others any right or protection under CWHSSA or this part;

c. Cooperating in any investigation or other compliance action, or testifying in any proceeding under CWHSSA or this part; or

d. Informing any other person about their rights under CWHSSA or this part.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System pursuant to 23 CFR 635.116.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).

a. The term “perform work with its own organization” in paragraph 1 of Section VI refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions: (based on longstanding interpretation)

(1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
(2) the prime contractor remains responsible for the quality of the work of the leased employees;

(3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and

(4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.

b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract. 23 CFR 635.102.

2. Pursuant to 23 CFR 635.116(a), the contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.

3. Pursuant to 23 CFR 635.116(c), the contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.

4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract. (based on long-standing interpretation of 23 CFR 635.116).

5. The 30-percent self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements. 23 CFR 635.116(d).

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR Part 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract. 23 CFR 635.108.

2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR Part 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704). 29 CFR 1926.10.

3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR Part 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 11, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT (42 U.S.C. 7606; 2 CFR 200.88; EO 11738)

This provision is applicable to all Federal-aid construction contracts in excess of $150,000 and to all related subcontracts. 48 CFR 2.101; 2 CFR 200.327.

By submission of this bid/proposal or the execution of this contract or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, subcontractor, supplier, or vendor agrees to comply with all applicable standards, orders or regulations issued pursuant to the Clean Air Act (42 U.S.C. 7401-7671q) and the Federal Water Pollution Control Act, as amended (33 U.S.C. 1251-1387). Violations must be reported to the Federal Highway Administration and the Regional Office of the Environmental Protection Agency. 2 CFR Part 200, Appendix II.

The contractor agrees to include or cause to be included the requirements of this Section in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements. 2 CFR 200.327.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost $25,000 or more – as defined in 2 CFR Parts 180 and 1200. 2 CFR 180.220 and 1200.220.

1**. Instructions for Certification – First Tier Participants:**

a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.

b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction. 2 CFR 180.320.

c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default. 2 CFR 180.325.

d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances. 2 CFR 180.345 and 180.350.

e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180, Subpart I, 180.900-180.1020, and 1200. “First Tier Covered Transactions” refers to any covered transaction between a recipient or subrecipient of Federal funds and a participant (such as the prime or general contract). “Lower Tier Covered Transactions” refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). “First Tier Participant” refers to the participant who has entered into a covered transaction with a recipient or subrecipient of Federal funds (such as the prime or general contractor). “Lower Tier Participant” refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction. 2 CFR 180.330.

g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the $25,000 threshold. 2 CFR 180.220 and 180.300.

h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. 2 CFR 180.300; 180.320, and 180.325. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. 2 CFR 180.335. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the System for Award Management website (https://www.sam.gov/). 2 CFR 180.300, 180.320, and 180.325.

i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default. 2 CFR 180.325.

* * * * *

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:

(1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency, 2 CFR 180.335;.

(2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State, or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property, 2 CFR 180.800;

(3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification, 2 CFR 180.700 and 180.800; and

(4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default. 2 CFR 180.335(d).

(5) Are not a corporation that has been convicted of a felony violation under any Federal law within the two-year period preceding this proposal (USDOT Order 4200.6 implementing appropriations act requirements); and

(6) Are not a corporation with any unpaid Federal tax liability that has been assessed, for which all judicial and administrative remedies have been exhausted, or have lapsed, and that is not being paid in a timely manner pursuant to an agreement with the authority responsible for collecting the tax liability (USDOT Order 4200.6 implementing appropriations act requirements).

b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant should attach an explanation to this proposal. 2 CFR 180.335 and 180.340.

* * * * *

3. **Instructions for Certification - Lower Tier Participants:**

(Applicable to all subcontracts, purchase orders, and other lower tier transactions requiring prior FHWA approval or estimated to cost $25,000 or more - 2 CFR Parts 180 and 1200). 2 CFR 180.220 and 1200.220.

a. By signing and submitting this proposal, the prospective lower tier participant is providing the certification set out below.

b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances. 2 CFR 180.365.

d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180, Subpart I, 180.900 – 180.1020, and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. “First Tier Covered Transactions” refers to any covered transaction between a recipient or subrecipient of Federal funds and a participant (such as the prime or general contract). “Lower Tier Covered Transactions” refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). “First Tier Participant” refers to the participant who has entered into a covered transaction with a recipient or subrecipient of Federal funds (such as the prime or general contractor). “Lower Tier Participant” refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated. 2 CFR 1200.220 and 1200.332.

f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the $25,000 threshold. 2 CFR 180.220 and 1200.220.

g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the System for Award Management website (https://www.sam.gov/), which is compiled by the General Services Administration. 2 CFR 180.300, 180.320, 180.330, and 180.335.

h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily

excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment. 2 CFR 180.325.

* * * * *

4. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

a. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals:

(1) is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency, 2 CFR 180.355;

(2) is a corporation that has been convicted of a felony violation under any Federal law within the two-year period preceding this proposal (USDOT Order 4200.6 implementing appropriations act requirements); and

(3) is a corporation with any unpaid Federal tax liability that has been assessed, for which all judicial and administrative remedies have been exhausted, or have lapsed, and that is not being paid in a timely manner pursuant to an agreement with the authority responsible for collecting the tax liability. (USDOT Order 4200.6 implementing appropriations act requirements)

b. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant should attach an explanation to this proposal.

* * * * *

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed $100,000. 49 CFR Part 20, App. A.

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:

a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.

2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than $10,000 and not more than $100,000 for each such failure.

3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed $100,000 and that all such recipients shall certify and disclose accordingly.

XII. USE OF UNITED STATES-FLAG VESSELS:

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, or any other covered transaction. 46 CFR Part 381.

This requirement applies to material or equipment that is acquired for a specific Federal-aid highway project. 46 CFR 381.7. It is not applicable to goods or materials that come into inventories independent of an FHWA funded-contract.

When oceanic shipments (or shipments across the Great Lakes) are necessary for materials or equipment acquired for a specific Federal-aid construction project, the bidder, proposer, contractor, subcontractor, or vendor agrees:

1. To utilize privately owned United States-flag commercial vessels to ship at least 50 percent of the gross tonnage (computed separately for dry bulk carriers, dry cargo liners, and tankers) involved, whenever shipping any equipment, material, or commodities pursuant to this contract, to the extent such vessels are available at fair and reasonable rates for United States-flag commercial vessels. 46 CFR 381.7.

2. To furnish within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, ‘on-board’ commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph (b)(1) of this section to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Office of Cargo and Commercial Sealift (MAR-620), Maritime Administration, Washington, DC 20590. (MARAD requires copies of the ocean carrier's (master) bills of lading, certified onboard, dated, with rates and charges. These bills of lading may contain business sensitive information and therefore may be submitted directly to MARAD by the Ocean Transportation Intermediary on behalf of the contractor). 46 CFR 381.7.

ATTACHMENT A - EMPLOYMENT AND MATERIALS PREFERENCE FOR APPALACHIAN DEVELOPMENT HIGHWAY SYSTEM OR APPALACHIAN LOCAL ACCESS ROAD CONTRACTS (23 CFR 633, Subpart B, Appendix B)
This provision is applicable to all Federal-aid projects funded under the Appalachian Regional Development Act of 1965.

1. During the performance of this contract, the contractor undertaking to do work which is, or reasonably may be, done as on-site work, shall give preference to qualified persons who regularly reside in the labor area as designated by the DOL wherein the contract work is situated, or the subregion, or the Appalachian counties of the State wherein the contract work is situated, except:

a. To the extent that qualified persons regularly residing in the area are not available.

b. For the reasonable needs of the contractor to employ supervisory or specially experienced personnel necessary to assure an efficient execution of the contract work.

c. For the obligation of the contractor to offer employment to present or former employees as the result of a lawful collective bargaining contract, provided that the number of nonresident persons employed under this subparagraph (1c) shall not exceed 20 percent of the total number of employees employed by the contractor on the contract work, except as provided in subparagraph (4) below.

2. The contractor shall place a job order with the State Employment Service indicating (a) the classifications of the laborers, mechanics and other employees required to perform the contract work, (b) the number of employees required in each classification, (c) the date on which the participant estimates such employees will be required, and (d) any other pertinent information required by the State Employment Service to complete the job order form. The job order may be placed with the State Employment Service in writing or by telephone. If during the course of the contract work, the information submitted by the contractor in the original job order is substantially modified, the participant shall promptly notify the State Employment Service.

3. The contractor shall give full consideration to all qualified job applicants referred to him by the State Employment Service. The contractor is not required to grant employment to any job applicants who, in his opinion, are not qualified to perform the classification of work required.

4. If, within one week following the placing of a job order by the contractor with the State Employment Service, the State Employment Service is unable to refer any qualified job applicants to the contractor, or less than the number requested, the State Employment Service will forward a certificate to the contractor indicating the unavailability of applicants. Such certificate shall be made a part of the contractor's permanent project records. Upon receipt of this certificate, the contractor may employ persons who do not normally reside in the labor area to fill positions covered by the certificate, notwithstanding the provisions of subparagraph (1c) above.

5. The provisions of 23 CFR 633.207(e) allow the contracting agency to provide a contractual preference for the use of mineral resource materials native to the Appalachian region.

6. The contractor shall include the provisions of Sections 1 through 4 of this Attachment A in every subcontract for work which is, or reasonably may be, done as on-site work.

NOTICE OF REQUIREMENTS FOR AFFIRMATIVE ACTION TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY (EXECUTIVE ORDER 11246)

1. The Offeror's or Bidder's attention is called to the "Equal Opportunity Clause" and the "Standard Federal Equal Employment Opportunity Construction Contract Specifications" set forth herein.

2. The goal for female participation, expressed in percentage terms for the Contractor's aggregate workforce in each trade on all construction work, is 6.9%.

Until further notice	Goals for minority participation for each trade (percent)
SHSA Cities:	
Pascagoula - Moss Point	16.9
Biloxi - Gulfport	19.2
Jackson	30.3
SMSA Counties:	
Desoto	32.3
Hancock, Harrison, Stone	19.2
Hinds, Rankin	30.3
Jackson	16.9
Non-SMSA Counties:	
George, Greene	26.4
Alcorn, Benton, Bolivar, Calhoun, Carroll, Chickasaw, Clay, Coahoma, Grenada, Itawamba, Lafayette, Lee, Leflore, Marshall, Monroe, Montgomery, Panola, Pontotoc, Prentiss, Quitman, Sunflower, Tallahatchie, Tate, Tippah, Tishomingo, Tunica, Union, Washington, Webster, Yalobusha	26.5
Attala, Choctaw, Claiborne, Clarke, Copiah, Covington, Franklin, Holmes, Humphreys, Issaquena, Jasper, Jefferson, Jefferson Davis, Jones Kemper, Lauderdale, Lawrence, Leake, Lincoln, Lowndes, Madison, Neshoba, Newton, Noxubee, Oktibbeha, Scott, Sharkey, Simpson, Smith, Warren, Wayne, Winston, Yazoo	32.0
Forrest, Lamar, Marion, Pearl River, Perry, Pike, Walthall	27.7
Adams, Amite, Wilkinson	30.4

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally assisted) performed in the covered area. If the contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the contractor also is subject to the goals for both its federally involved and nonfederally involved construction.

The Contractor's compliance with the Executive Order and the regulations in 41 CFR Part 60-4 shall be based on its implementation of the Equal Opportunity clause, specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4.3(a), and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the Contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the Executive Order and the regulations in 41 CFR Part 60-4.2(d). Compliance with the goals will be measured against the total work hours performed.

3. The Contractor shall provide written notification to the Director of the Office of Federal Contract Compliance Programs within 10 working days of award of any construction subcontract in excess of $10,000 at any tier for construction work under the contract resulting from this solicitation. The notification shall list the name, address and telephone number of the subcontractor, employer identification number of the subcontractor, estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the subcontract is to be performed.

4. As used in this Notice, and in the contract resulting from this solicitation, the "covered area" is to the county and city (if any), stated in the advertisement.

5. The notification required in Paragraph 3 shall be addressed to the following:

Contract Compliance Officer
Mississippi Department of Transportation
P.O. Box 1850
Jackson, Mississippi 39215-1850

(12/04/2018)

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-101-1 **CODE: (IS)**

DATE: 07/20/2023

SUBJECT: Definitions and Terms

Section 101, Definitions and Terms, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-101.01--Abbreviations. After the abbreviation API on page 1, add the following.

APL Approved Products List

Replace the abbreviation for AWPA on page 1 with the following.

AWPA American Wood Protection Association

907-101.02--Definitions. Delete the sentence after the list of holidays in Subsection 101.02 on page 6 under **holidays, legal**, and substitute the following.

When a legal holiday falls on a Saturday or Sunday, the succeeding Monday, or as proclaimed by the Governor, will be observed as a legal holiday.

Delete the definition for Notice to Proceed in Subsection 101.02 on page 8, and substitute the following.

Notice to Proceed - Written notice to the Contractor to proceed with the contract work.

Delete the definition for "Plans" in Subsection 101.02 on page 8, and substitute the following.

plans - The approved plans, profiles, typical cross-sections, working drawings and supplemental drawings, or exact reproduction thereof, that show the location, character, dimensions, and details of the work to be done. The plans may also include electronic files, referred to on the plans as Electronic Files Identified as Plans, which may include engineering models, spreadsheets, CADD files or other electronic files used to convey design intent. When the contract does not have an official set of plans, reference to the plans shall mean the contract documents.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-102-2 **CODE: (IS)**

DATE: 11/22/2017

SUBJECT: Bidding Requirements and Conditions

Section 102, Bidding Requirements and Conditions, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-102.01--Prequalification of Bidders. Delete the last sentence of the third paragraph of Subsection 102.01 on page 13, and substitute the following.

The Bidder's Certificate of Responsibility number must be on file with the Department's Contract Administration Division prior to request for permission to bid.

907-102.02--Contents of Proposal Forms. Delete the fourth paragraph in Subsection 102.02 on page 13, and substitute the following.

Prospective bidders must complete an online request for permission to be eligible to bid a project. Upon approval, the bidder will be authorized to submit a bid electronically using Bid Express at http://bidx.com.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-104-2 **CODE: (SP)**

DATE: 06/17/2025

SUBJECT: Minor Alteration to the Contract

Section 104, Scope of Work, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows:

907-104.02--Alterations of Plans or Character of Work.

907-104.02.3--Minor Alteration to the Contract. In the first paragraph of Subsection 104.02.3 on page 25, change $10,000.00 to $25,000.00.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-105-3 **CODE: (SP)**

DATE: 07/21/2026

SUBJECT: Control of Work

Section 105, Control of Work, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-105.01--Authority of the Engineer. Delete the first sentence of the second paragraph of Subsection 105.01 on page 31, and substitute the following.

The Engineer has the right to suspend the work wholly or in part and to withhold payments because of the Contractor's failure to correct conditions unsafe for workmen or the general public, for failure to carry out provisions of the Contract, or for failure to carry out orders.

907-105.02--Plans and Working Drawings. Delete the first paragraph of Subsection 105.02 on page 31, and substitute the following.

After the contract is executed by the Executive Director, the Contractor will receive, free of charge, two bound copies of the proposal and contract documents (one executed and one blank) and five half-scale copies of the Plans and Electronic Files Identified as Plans. The Contractor shall have one copy of the proposal and contract documents and one half-scale copy of the plans available at all times during work activity on the project.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-106-5 **CODE: (IS)**

DATE: 4/20/2026

SUBJECT: Control of Materials

Section 106, Control of Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

After Subsection 106.13 on page 47, add the following:

907-106.14--Buy America/Build America. Buy America (BABA) Materials Sourcing Requirements for Federal-Aid Projects.

The "Infrastructure Investment and Jobs Act" (the "Act"), or Bipartisan Infrastructure Law (BIL), was enacted on November 15, 2021 (See Public Law No. 117-58, Sections 70901-70953). The Build America, Buy America (BABA) provisions of the Act expand the previous Buy America requirements beyond what was currently required for steel and iron products.

Articles, materials, or supplies will only be classified under one of the following categories: iron or steel products, construction materials, manufactured products, or excluded materials (as further described in subsection 907-700.01.1). An article, material, or supply shall not be considered to fall under multiple categories. The applicable classification of the article, material, or supply being permanently incorporated into a construction project will be based on the status at the time the article, material, or supply is brought to the project work site.

Any iron or steel products, construction materials, and manufactured products that are permanently incorporated into a construction project, shall be domestically manufactured and compliant with current requirements of the Act, including 2 CFR 184, 2 CFR 200.322, 0MB 24-02 Memo and related requirements therein, and with the current requirements within 23 CFR 635.410.

It is the prime Contractor's responsibility to ensure all submittals and/or certifications required by the above listed Buy America/BABA provisions are submitted to the Project Engineer prior to the article, material, or supply being incorporated into the work.

Buy America/BABA provisions do not apply to temporarily used articles, materials, or supplies that: (1) are specified to be removed at the end of the project per the contract provisions, or (2) are specified to remain in place per the contract provisions and are also documented by the Department in the contract provisions to be removed in a subsequent imminent, near-term phased project.

The following categories, as described above, require Domestic Materials Self-Certification Form (as described within Subsection 907-700.01.2) on construction projects:

Iron or Steel Products
Construction Materials
Manufactured Products.

Buy America/BABA provisions do not apply to excluded materials.

A non-exclusive list of items that must comply with the above listed Buy America/BABA requirements and require the submittal of the Buy America Domestic Materials Self- Certification Form may be viewed at www.goMDOT.com under Business Center ➔ Engineering Standards/Guides/Manuals ➔ Construction Materials.

The list of items referenced above is not all-inclusive. All iron or steel products, construction material, and manufactured products permanently incorporated into the project shall comply with the applicable Buy America/Build America (BABA) requirements, regardless of whether such items are specifically Identified.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-108-4 **CODE: (SP)**

DATE: 10/07/2020

SUBJECT: Subletting of Contract

Section 108, Prosecution and Progress, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-108.01--Subletting of Contract.

907-108.01.1--General. Delete the third sentence of the tenth paragraph of Subsection 108.01.1 on the bottom of page 72.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-108-6 **CODE: (SP)**

DATE: 03/11/2025

SUBJECT: Default and Termination of Contract

Section 108, Prosecution and Progress, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-108.08--Default and Termination of Contract. At the end of the Subsection 108.08 on page 85, add the following.

907-108.08.1--Debarment of Contractor. If the Contractor is declared to be in default under this Subsection and the Contract terminated for the reason(s) indicated in Subsections 108.08 (d), (f), or (g) above, the Commission may, in its discretion and in addition to default and termination, declare the Contractor to be debarred from bidding on any other projects for a period of one (1) year from the date of the termination letter. If the debarred Contractor has multiple on-going Contracts with the Commission and receives a one (1) year debarment, the on-going Contract(s) may continue; however, the Contractor will not be allowed to bid another project until one (1) year has passed from date of the termination letter.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-109-5 **CODE: (IS)**

DATE: 11/14/2023

SUBJECT: Measurement and Payment

Section 109, Measurement and Payment, of the 2017 Edition of the Mississippi StandardSpecifications for Road and Bridge Construction is hereby amended as follows.

907-109.01--Measurement of Quantities. Delete the sixth full paragraph of Subsection 109.01on page 88, and substitute the following.

If appropriate based on the specific circumstances of the project, the Contractor may request that material specified to be measured by the cubic yard or ton be converted to the other measure. The Contractor must submit this request to the Engineer. The Engineer will provide an approval or denial in writing. The decision is in the sole discretion of the Engineer. If approved, factors for this conversion will be determined by the District Materials Engineer and agreed to by the Contractor. The conversion of the materials along with the conversion factor will be incorporated into the Contract by supplemental agreement. The supplemental agreement must be executed before such method of measurement is used.

907-109.04--Extra Work.

907-109.04.1--Supplemental Agreement. Delete the second paragraph of Subsection 109.04.1 on page 90.

907-109.04.2--Force Account Agreement. Delete the last sentence of subparagraph (c) in Subsection 109.04.2 on page 91, and substitute the following.

An amount will be added equal to fifteen percent (15%) of the sum thereof, excluding sales tax.

Delete subparagraph (d) in Subsection 109.04.2 on pages 91 & 92, and substitute the following.

(d) **Equipment.** Equipment used for force account work shall be of sufficient size and type necessary to perform the required work in an economic and expeditious manner. The Contractor must provide the manufacturer, make, model, year, type of fuel and other necessary information to determine proper hourly payment rates. Subject to advance approval of the Engineer, actual transportation cost for a distance of not more than 200 miles will be reimbursed for equipment not already on the project.

For equipment authorized by the Engineer for use on the force account work, the Engineer will use the equipment rental rates from the "*Rental Rate Blue Book*" as published on the Equipment Watch website www.equipmentwatch.com for the time period the force account work is authorized to determine payment to the Contractor. The maximum allowable rates

are determined as follows:

1. The hourly equipment rate will equal the FHWA total hourly rate. This rate takes into account adjustment factors for age and region.
2. The hourly estimated operating costs have been included in the FHWA total hourly rate.
3. The idle and standby rates shall be as listed in the "*Rental Rate Blue Book*" as reported by *Equipment Watch*.
4. These rates include the basic machine plus any necessary attachments.

Standby rates shall apply when equipment is not in operation and is approved by the Engineer to standby for later use to complete the work. Idle rates shall apply to equipment located on the project and the engine is burning fuel but no ground engaging or other components are actively engaged in meaningful work. In general, idle or standby rates shall apply when equipment is not in use, but will be needed again to complete the work and the cost of moving the equipment will exceed the accumulated standby cost. If the idle standby cost should exceed the equipment moving cost to or from the work site, the Contractor will be entitled to the moving cost only. Idle or standby rates will be used under the following conditions:

1. The equipment is totally dedicated to the force account work and not used intermittently on other work.
2. Idle or standby cost will be considered only after equipment has been operated on force account work.
3. The sum of idle or standby time and operating time shall not exceed eight (8) hours per day or 40 hours in a week.
4. Idle or standby payment will not apply to days not normally considered to be work days such as holidays, weekends, or days of inclement weather when no other work is taking place.

The Department will not pay for idle or standby time when equipment is inoperable, for time spent repairing equipment, or for the time elapsed after the Engineer has advised the Contractor that the equipment is no longer needed. The Department will determine if it will be more cost effective to pay standby time on approved equipment on site or for multiple mobilizations.

If equipment is needed, which is not included in the *Rental Rate Blue Book* as reported by *Equipment Watch*, the Department and Contractor will agree upon reasonable rental rates in writing before the equipment is used.

All equipment shall be subject to approval from day to day in accordance with the requirements of Subsection 108.05.

907-109.06--Partial Payment.

907-109.06.2--Advancement on Materials.
Delete the next to last paragraph of Subsection 109.06.2 on page 95, and substitute the following.

Materials for which an advanced payment has been allowed must be paid for by the Contractor within 30 days of the estimate on which the advanced payment was first allowed and proof of said payment must be verified by the supplier. If proof of payment is not furnished within the allowable 30 days, the advanced payment will be deducted on subsequent current estimates until such time that proof of payment is furnished.

907-109.07--Changes in Material Costs. After the fifth paragraph of Subsection 109.07 on page 96, change the web address to the following.

https://mdot.ms.gov/portal/current_letting

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-234-1 **CODE: (SP)**

DATE: 10/13/2021

SUBJECT: Silt Fence

Section 234, Silt Fence, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-234.02--Materials. Delete the first paragraph of Subsection 234.02 on page 181, and substitute the following.

Materials used in silt fence and super silt fence may be accepted by certification per Subsection 700.05.1. Geotextile fabric, posts, staples and woven wire backing, when required, shall meet the requirements of Subsection 714.13.

907-234.05--Basis of Payment. Add the "907" prefix to the pay items listed on page 183.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-401-4 **CODE: (IS)**

DATE: 03/02/2026

SUBJECT: Asphalt Pavement - General

Section 401, Asphalt Pavement - General, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows..

907-401.02--Materials.

907-401.02.6--Standards of Acceptance.

907-401.02.6.4—Acceptance Procedure for Density.

Delete the paragraph and Lot Determination table of Subsection 401.02.6.4 and substitute the following:

Each completed lift will be accepted with respect to compaction on a lot to lot basis from density tests performed by the Department. For normal production days, every 350 tons will be considered a lot. When cores are being used for the compaction evaluation, randomly obtain one core from each lot. When the nuclear density gauge is being used for compaction evaluation, obtain two random readings from each lot and average the results. See Chapter 7 of the latest edition of MDOT's Field Manual for Asphalt Mixtures for more details. Additional tests may be required by the Engineer to determine acceptance of work appearing deficient. The Contractor shall furnish and maintain traffic control for all compaction evaluations, including coring, required in satisfying specified density requirements.

907-401.02.6.4.1 –Roadway Density.

Delete the last sentence in section 1 of Subsection 401.02.6.4.1 on page 250 and substitute the following:

For all other leveling, no density shall be required but the pavement shall be rolled to refusal densification as defined in Subsection 907-401.02.6.4.3.

907-401.02.6.4.3—Roll to Refusal Densification.

Roll to refusal densification is defined as the number of roller passes to maximize the in-place unit weight of the mixture. A density gauge shall be used to determine the number of passes to achieve the maximum in-place unit weight.

907-401.02.6.4.4—Irregular Areas.

Irregular areas are defined as a mat where an established rolling pattern cannot be obtained. Irregular areas include areas with a width of less than 8 feet or shorter than 300 feet in length, pre-leveling, wedging [less than fifty percent (50%) of width greater than minimum lift thickness], ramp pads, median crossovers, turnouts, and other areas where an established rolling pattern cannot be obtained.

907-401.02.6.8--Acceptance Procedure for Pavement Smoothness Using Mean Roughness Index (MRI). Delete the third sentence of the second paragraph of Subsection 401.02.6.8 on page 253, and substitute the following.

The surface shall be tested and corrected to a smoothness index as described herein except those locations or specific projects that are excluded from smoothness testing with an IPS.

Delete the third, fourth and fifth paragraphs of Subsection 401.02.6.8 on pages 253 & 254, and substitute the following.

The smoothness of the surface lift will be determined for traffic lanes, auxiliary lanes, climbing lane and two-way turn lanes. Areas excluded from a smoothness test with the IPS are acceleration and deceleration lanes, tapered sections, transition sections for width, shoulders, crossovers, ramps, side street returns, etc. The roadway pavement on bridge replacement projects having 1,000 feet or less of pavement on each side of the structure will be excluded from a smoothness test. Smoothness testing shall exclude 264 feet from each transverse joint that separates the pavement from a bridge deck, bridge approach slab or existing pavement not constructed under the contract. This can apply to any other exceptions including, but not limited to, railroad crossings and manholes. Segments containing a considerable number of encroachments such as intersections, manholes, curb and gutter sections, etc. may be excluded at the Engineer's discretion.

Once paving has concluded, one final smoothness measurement shall be performed for both pay adjustments and corrective action. Multiple smoothness measurements for pay adjustments and correction can still be performed at the Engineer's discretion. These measurements must be performed at the posted speed limit or 50 miles per hour (±5 miles per hour), whichever is lower. Measurements will be made in both wheel paths of exterior and interior lanes. The wheel paths shall be designated as being located three feet (3') and nine feet (9') from centerline or longitudinal joint, respectively. Testing will also be required on sections that have been surface corrected. No smoothness testing shall be performed when there is any residual moisture on the pavement surface. Any additional testing shall meet the requirements of Subsection 907-403.03.2.

The surface lift will be accepted on a continuous interval basis for pavement smoothness. Continuous reporting is based upon all MRI values for a specified running interval. These values are averaged and presented at the midpoint of the specified running interval.

Delete the last sentence of the last paragraph of Subsection 401.02.6.8 on page 254, and substitute the following.

All tests and corrections shall be in accordance with AASHTO R 54, Accepting Pavement Ride Quality When Measured Using Inertial Profiling Systems.

Delete Subsection 401.02.6.9 on pages 254 & 255, and substitute the following.

907-401.02.6.9--Inertial Profiling System.

907-401.02.6.9.1--General. The Inertial Profiling System (IPS), furnished and operated by the Contractor under the supervision of the Engineer or the Engineer's representative, shall be a dual-line laser on a high speed vehicle meeting the requirements of AASHTO M 328, Standard Specification for Inertial Profiler. Additionally, each IPS should be equipped with a GPS to ensure distance measurement accuracy. The profiler system and operator shall be certified at an MDOT approved regional calibration facility in accordance with AASHTO R 56, Standard Practice for Certification of Inertial Profiler Systems and AASHTO R 57, Operating Inertial Profiler Systems.

907-401.02.6.9.2--Computer Requirements. The computer measurement program must be menu driven, Windows compatible, and able to produce unfiltered profiler runs in the Pavement Profile (*.ppf) file format. The computer shall have the ability to display and print data on site for verification and shall have the ability to save and transfer data via Universal Serial Bus (USB) flash drive, which shall be provided by the Contractor.

All runs must be stored in a directory named in the following format for acceptance by the Project Engineer:

Project_County_Route

All profiler runs must be named in the following format for acceptance by the Project Engineer:

Direction_Lane_BeginStation_EndStation

In addition to manufacturers' software; the latest version of FHWA's ProVAL software shall be installed on the IPS computer.

907-401.03--Construction Requirements.

907-401.03.1--Specific Requirements.

907-401.03.1.2--Tack Coat. Delete the fourth sentence of Subsection 401.03.1.2 and substitute the following:

A hand wand will only be allowed for applying tack coat on irregular areas as defined in Subsection 907-401.02.6.4.4 if the distributor bar is not a feasible option.

907-401.03.1.4--Density. Delete the first sentence of the first paragraph of Subsection 401.03.1.4 and substitute the following.

The lot density for all dense graded pavement lifts, except for irregular areas as defined in Subsection 907-401.02.6.4.4, shall not be less than the specified percent (92% or 93%) of the maximum density based upon AASHTO T 209 for the day's production..

Delete the third paragraph of Subsection 401.03.1.4 and substitute the following.

Irregular areas as defined in Subsection 907-401.02.6.4.4 shall be compacted to roll to refusal densification as defined in Subsection 907-401.02.6.4.3.

907-401.03.9--Material Transfer Equipment. In the third sentence of Subsection 401.03.9 on page 261, change "include:" to "include".

907-401.03.14--Shoulder Wedge. In the second sentence of the first paragraph of Subsection 401.03.14 on page 263, change "cross roads" to "crossroads".

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-403-4 **CODE: (SP)**

DATE: **03/19/2025**

SUBJECT: **Asphalt Pavements**

Section 403, Asphalt Pavements, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows:

907-403.03--Construction Requirements.

907-403.03.2--Smoothness Tolerances. In the tenth paragraph of Subsection 403.03.2 on page 283, change "Sections(s)" to "Segment(s)".

907-403.03.2.1--Smoothness Tolerances for Mean Roughness Index (MRI). After the second paragraph of Subsection 403.03.2.1 on page 283, add the following.

For all projects, smoothness data shall be reported by two MRI methods:

1. A continuous long interval MRI report
2. A continuous 25-foot short interval MRI report

At the bottom of page 283 and top of 284 in Subsection 403.03.2.1, delete the paragraphs for Category, A, Category B, and Category C, and substitute the following.

Category A projects shall have a long interval surface MRI of not more than 60 inches per mile.

Category B projects shall have a long interval surface MRI of not more than 70 inches per mile.

Category C projects shall have the existing surface profiled at no additional cost to the State. These projects shall be measured by a long fixed interval (528-foot) surface MRI and meet the following requirements:

A 50% improvement in MRI from the existing surface
or
80 inches per mile (whichever value is higher)

Delete the first, second, and third full paragraphs on page 284, and substitute the following.

For all projects, areas of the surface lift with localized roughness greater than 160 inches per mile as determined by the continuous short interval (25') report will be identified for correction by the Contractor.

When a project has multiple lifts, the intermediate lift shall meet the short interval requirement of 200 inches per mile. Corrective action must be taken on those segments that do not meet this requirement. No unit price adjustment will be applied on the underlying lift.

Delete the table at the bottom of page 284, and substitute the following.

Mean Roughness Index (inches / mile)	Contract Price Adjustment Percent of Asphalt Unit Bid Price
Above 20.0 Over	REMOVE AND REPLACE *
15.1 to 20.0 Over	80
10.1 to 15.0 Over	85
5.1 to 10.0 Over	90
0.1 to 5.0 Over	95
Required Surface MRI	100

* In lieu of removal and replacement, segments may be brought into compliance through corrective action at the discretion of the Project Engineer.

Delete the table and footnote at the top of page 285, and substitute the following.

Mean Roughness Index (inches/mile) Percent Improvement	Contract Price Adjustment Percent of Asphalt Unit Bid Price
Below 30.1 Percent	80 **
30.1 to 35.0 Percent	80
35.1 to 40.0 Percent	85
40.1 to 45.0 Percent	90
45.1 to 50.0 Percent	95
Above 50%	100

** Segments that show less than 30 percent improvement as well as a final surface MRI greater than 100 inches/mile will be subject to removal.

Before the last paragraph on Subsection 403.03.2.1 on page 285, add the following.

Corrective action for all categories must be taken on those segments that exceed the localized roughness or the 'Remove and Replace' threshold. All locations must be located and marked by the Contractor and approved by the Project Engineer before corrective action shall take place. The minimum remove and replace length will be 528 feet (0.1 mile). Additional smoothness testing shall be required on segments following corrective action and/or replacement and will be required to meet *at least* the maximum surface MRI short of 'Remove and Replace' tolerance.

907-403.05--Basis of Payment.

907-403.05.2--Pay Items. Add the "907" prefix to the list of pay items on page 291.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-407-1 **CODE: (SP)**

DATE: **01/16/2026**

SUBJECT: **Tack Coat**

Section 407, Tack Coat, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-407.03—Construction Requirements.

907-407.03.3—Application of Bituminous Material.

Delete the second sentence of the first paragraph of Subsection 407.03.3 and substitute the following.

A hand wand will only be allowed for applying tack coat on irregular areas as defined in Subsection 907-401.02.6.4.4.

907-407-05-- Basis of Payment.

Add the "907" prefix to the pay item listed on page 309.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-413-2 **CODE: (SP)**

DATE: 05/09/2023

SUBJECT: Cleaning and Sealing Joints and Cracks

Section 413, Cleaning and Sealing Joints and Cracks, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-413.03--Construction Requirements.

907-413.03.3--Sawing and Sealing Transverse Joints in Asphalt Pavement.

907-413.03.3.4--Sealing. Delete the last sentence of the last paragraph of Subsection 413.03.3.4 on page 333, and substitute the following.

Poured joint sealing material shall only be placed when the air temperature is within the limits specified by the manufacturer.

907-413.05--Basis of Payment. Delete the last pay item listed on page 336, and substitute the following.

907-413-E: Sawing and Sealing Transverse Joints in Asphalt Pavement - per linear foot

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-420-1 **CODE: (SP)**

DATE: 01/17/2017

SUBJECT: Undersealing

Section 907-420, Undersealing, is hereby added to and made a part of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as follows:

SECTION 907-420 -- UNDERSEALING

907-420.01--Description. This work shall consist of raising, filling voids, undersealing, or densification of base soils under concrete pavement or other locations by furnishing, hauling and injecting polyurethane material through tubes placed at the horizontal and vertical locations determined by the Contractor and approved by the Project Engineer into the base soils, which most effectively and efficiently complete the desired repairs. All work will be monitored at the surface to insure that the pavement is raised to the desired elevations or soils are at the desired degree of densification. This work shall be performed using The URETEK Method™ and The URETEK Deep Injection Process™ by URETEK USA, Inc., Tomball, Texas, or an approved equal.

907-420.02--Material.

907-420.02.1--General. The material for raising and undersealing shall be a water blown, closed cell, high density polyurethane system with the following physical characteristics and properties:

Technical Property	Requirement	Test Method
Density, minimum	3.69 lbs / ft^3	ASTM D1622 (air rise)
Compressive strength, minimum	53 psi	ASTMD 1621
Density, maximum	4.2 lbs / ft^3	ASTM D1622 (air rise)
Volume Change, maximum shrinkage (10 years)	5.0 %	
Curing Rate	90 percent of compressive strength within 15 minutes after injection	

The material used for raising and/or undersealing shall be a high-density polyurethane material, such as URETEK 486 Star or equivalent, as approved by the Engineer. The material shall be a polyurethane-forming mixture, having a water insoluble diluent, that permits the formation of polyurethanes in excess water. The presence of these water insoluble diluents provides polyurethane foam with improved dimensional stability properties. This formula and these

characteristics must be certified by the manufacturer.

The material shall have a warranty against shrinkage and deterioration for a period of ten years. During the warranty period, the manufacturer shall replace by injection any failed material at the manufacturer's expense.

Acceptance of the polyurethane material will be based on certification and results from tests required by the Engineer.

The Contractor shall provide to the Engineer certification from the manufacturer stating that the material provided is in accordance with this special provision. The MSDS for all pertinent production material shall be included with the certification.

When requested by the Engineer, pumping units in service shall perform a product density test by injecting a sample of the unit's polyurethane material into a test cylinder of known volume. The sample's density shall be in accordance with this special provision.

When requested by the Engineer, the Contractor, in the presence of the Engineer, shall inject the ambient temperature (70º - 90º F) polyurethane material into a container holding 40 gallons of ambient temperature water at 70º F. The resulting product shall demonstrate consistent, closed cell polyurethane material.

All stored polyurethane material shall be sealed and protected from contamination of dust or any foreign material.

907-420.02.2--Contractor Pre-Qualification Requirements. The Contractor shall have a minimum of three years of experience in performing this type of work and a minimum of 20 projects on which the Contractor has successfully done this type of work. Prior to beginning work, the Contractor shall submit certification to the Engineer that the Contractor meets the minimum required experience. The certification shall include a listing of previous clients with contact names and phone numbers.

Prior to being approved for performing this type of work, the following documents shall be supplied by the Contractor to the Engineer and found to be acceptable:

(a) A report from an industrial hygienist who has conducted a personnel, production vehicle and typical jobsite safety review of the Contractor's implementation procedures involving the polyurethane material.
(b) A copy of the Contractor's Employee Safety Manual specific to polyurethane pavement raising and undersealing work.

907-420.02.3--Equipment Requirements. The Contractor shall provide at minimum, the following equipment:

(a) A truck-mounted pumping unit capable of injecting the high density polyurethane material beneath the pavement. The pumping unit shall be equipped with a dial gauge in increments of 0.10 pound and shall be capable of controlling the rate of flow of material

as well as the rate of rise of the pavement.

(b) Pressure and temperature control devices capable of maintaining proper temperature and proportionate mixing of the polyurethane component materials.

(c) Pneumatic or electric drills capable of efficiently drilling 9/16 to 3/4-inch diameter injection holes through the pavement without damaging the structural integrity of the existing pavement.

(d) Laser levels or dial indicator devices capable of monitoring and verifying that the pavement is raised to an even plane and to the required elevation.

(e) All necessary electric generators, compressors, heaters, hoses, containers, valves and gauges to efficiently conduct and control the work.

907-420.03--Construction Requirements. The Contractor shall provide a profile from laser level readings or string lines of each area that needs to be raised or undersealed. Each profile shall be accepted by the Engineer prior to performing the work at the profile location.

At locations where pavement is to be raised or undersealed, a series of 9/16-inch to 3/4-inch diameter holes shall be drilled through the pavement and underlying base at the appropriate locations and depths as determined by the Contractor. The pavement surrounding each hole shall not be damaged.

The polyurethane material shall be injected through the drilled holes until all known or encountered voids under the pavement are filled. The rate and amount of material injection shall be determined by the Contractor.

The pumping unit shall be calibrated daily or as directed by the Engineer. If calibration results show inconsistencies from calibration to calibration, the work shall be stopped until the cause for the inconsistencies are corrected to the satisfaction of the Engineer.

Injection nozzles shall prevent leakage during injection and shall be removed at completion of the injection or driven into the injection hole to a minimum of 1¼ inches below the surface. Any excessive material on the surface shall be removed from the area and the holes shall be sealed with polyurethane material or a non-expansive cementitious grout approved by the Engineer.

907-420.03.1--Raising or Undersealing Roadway Pavements. All drill tailings, excess polyurethane material and other debris shall be cleaned up at the end of each working day or before the lane is opened to traffic. When adjacent lanes are open to traffic, provisions shall be made to prevent material from encroaching onto the open lane or squirting onto passing vehicles. Polyurethane material shall not enter into gutters or closed drainage systems. Suitable means to restrict the infiltration of the residue into a closed drainage system shall be provided. Polyurethane material shall be removed from the pavement surface before any residue is blown by traffic action or wind. All removed material shall be disposed of in an environmentally acceptable manner in accordance with all federal, state and local regulations.

Corrections to the grade of adjacent slabs, if necessary, or as determined by the Engineer, shall be made in accordance with this special provision. All raised pavement shall match the existing grade of adjacent slabs to provide positive drainage. Final elevations of raised pavement areas shall be within 1/4 inch of the required elevations as determined by the profile or the Engineer.

The Contractor will be responsible for any pavement blowouts, excessive pavement lifting or pavement damage that may occur as a result of the Contractor's work. The Contractor shall repair any subject areas to the satisfaction of the Engineer at the Contractor's expense.

The roadway may be open to traffic when the polyurethane material has reached 90 percent of the material's designed compressive strength.

The Contractor shall transfer all warranties on the polyurethane material to the client upon acceptance of the work by the Engineer.

907-420.03.2--Undersealing Bases. For soil densification and compaction of unconsolidated base soils, a series of 9/16-inch to 1 3/8-inch diameter holes (as required for tube placement) shall be drilled at approximately 3 to 4-foot intervals through the pavement above the area requiring soil remediation. The exact location, spacing, hole size and depth shall be determined by the Contractor and approved by the Engineer.

The polyurethane material shall be injected through injection tubes inserted into the drilled holes to the proper depth or depths as determined by on-site soils analysis, or dynamic cone penetrometer testing. The rate and amount of material injected shall be determined by the Contractor.

Continuous laser level or dial indicator micrometer readings shall be in place and monitored by the Contractor during injection to determine sufficient material usage and soils densification as indicated by pavement movement of 1/16 of an inch.

907-420.04--Method of Measurement. Undersealing, complete and accepted, will be measured by the pound. The quantity will be based on the supplier's packaging information for the material delivered and incorporated into the project.

907-420.05--Basis of Payment. Undersealing concrete pavement, as measured above, will be paid for at the contract price per pound, which price shall include all mobilization, labor, equipment, materials, and incidentals necessary to complete the required work.

Payment will be made under:

907-420-A: Undersealing * - per pound

* Type of Undersealing may be specified

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-503-1 **CODE: (IS)**

DATE: 11/21/2023

SUBJECT: Replacement of Concrete Pavement

Section 503, Replacement of Concrete Pavement, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-503.02--Materials. In the list of materials and subsections in Subsection 503.02 on page 362, make the following changes.

Change:
"Cement" to "Portland Cement" ..... 701.01 and 701.02

Add:
Blended Cement ..... 701.01 and 701.04

After the list of materials and subsections in Subsection 503.02 on page 362, add the following.

907-503.02.1--Hydraulic Cement Concrete Mixture. The hydraulic cement concrete mixture design shall meet the requirements in Section 907-799 for Class PO.

907-503.05--Basis of Payment. Delete pay items 503-A and 503-D on page 367, and substitute the following.

907-503-A: ___" and Variable Type Concrete Pavement, Type Finish - per square yard

907-503-D: Concrete for Base Repair - per cubic yard

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-603-2 **CODE: (SP)**

DATE: 01/17/2017

SUBJECT: Cured-In-Place Pipe

Section 603, Culverts and Storm Drains, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as modified by this special provision, is applicable to Cured-In-Place Pipe Only.

907-603.01--Description. This work shall consist of the installation of a resin-impregnated flexible tube, which is formed to the original conduit by use of a hydrostatic head. The resin is cured using hot water under hydrostatic pressure within the tube. The Cured-In-Place Pipe (CIPP) will be continuous and tight fitting. This work shall meet the requirements of ASTM Designations: F 1216, F 1743 and D 790, as modified by this specification.

The Contractor is advised that the liquid flowing through the pipe is storm water.

907-603.01.1--Qualification of Contractor. The person(s) or firm performing the work described in this specification shall be knowledgeable of trenchless rehabilitation products and installation procedures in accordance with the following minimum experience requirements:

The rehabilitation product must have a minimum of 1,000,000 linear feet or 4,000 manhole-to-manhole line sections of successful drainage collection system installation. In addition, at least 50,000 linear feet of the product shall have been in successful service within the State for a minimum of five years.

The manufacturer of the rehabilitation product must provide third party test results supporting the long term performance and structural strength of the product and such data shall be satisfactory to the State. Test samples shall be prepared so as to simulate installation methods and trauma of the product. No product will be approved without independent third party testing verification.

The person(s) or firm performing the work must have had at least five (5) years of active experience in the commercial installation of the product. In addition, the person(s) or firm must have successfully installed at least 50,000 feet of the product in drainage collection systems.

Both the rehabilitation manufacturing and installation processes shall operate under a quality management system which is third-party certified to ISO 9000 or other internationally recognized organization standards. Proof of certification shall be required.

At the preconstruction conference or prior to starting CIPP installation, the Contractor shall furnish evidence of the following requirements.

(A) A signed statement from the person(s) or firm performing the work that the project site has been visited, and that the drainage system has been inspected.

(B) Ability of the Contractor/firm responsible for installation of the CIPP to complete a project of this type. This is to be supported by a list containing a detailed description of the requirements listed above. This list shall include project locations and names/phone numbers of the project owner's representatives who can verify the Contractor/firm's participation on the project, and the names of the person(s) who were in charge of the Contractor's operations.

907-603.02--Materials.

907-603.02.1--Tube. The sewn tube shall consist of one or more layers of absorbent non-woven felt fabric and meet the requirements of ASTM Designation: F 1216 or F 1743, Section 5. The tube shall be constructed to withstand installation pressures, have sufficient strength to bridge missing pipe, and stretch to fit irregular pipe sections.

The wet out tube shall have a uniform thickness that when compressed at installation pressures will meet or exceed the Design thickness.

The tube shall be sewn to a size that when installed will tightly fit the internal circumference and length of the original pipe. Allowance should be made for circumferential stretching during inversion. Overlapped layers of felt in longitudinal seams that cause lumps in the final product shall not be utilized.

The outside layer of the tube, before wet out, shall be coated with an impermeable, flexible membrane that will contain the resin and facilitate monitoring of resin saturation during the resin impregnation (wet out) procedure.

The tube shall be homogeneous across the entire wall thickness containing no intermediate or encapsulated elastomeric layers. No material shall be included in the tube that may cause delamination in the cured CIPP. No dry or unsaturated layers shall be evident.

The wall color of the interior pipe surface of CIPP after installation shall be a light reflective color so that a clear detailed examination with closed circuit television inspection equipment may be made.

Seams in the tube shall be stronger than the non-seamed felt.

The outside of the tube shall be marked for distance at regular intervals along its entire length, not to exceed five feet. Such markings shall include the Manufacturers name or identifying symbol.

907-603.02.2--Resin. The resin system shall be a corrosion resistant polyester, vinyl ester, or epoxy and catalyst system that when properly cured within the tube composite meets the

requirements of ASTM Designations: F1216 and F 1743, the physical properties herein, and those which are to be utilized in the Design of the CIPP for this project. The resin shall produce CIPP which will comply with the structural and chemical resistance requirements of this specification.

907-603.02.3--Design Requirements. The CIPP shall be designed as per ASTM Designation: F 1216, Appendix X.1. The CIPP design shall assume no bonding to the original pipe wall.

The Contractor must have performed long-term testing for flexural creep of the CIPP pipe material. Such testing results are to be used to determine the Long-term, time dependent flexural modulus to be utilized in the product design. This is a performance test of the materials (Tube and Resin) and general workmanship of the installation and curing. A percentage of the instantaneous flexural modulus value, as measured by ASTM Designation: D 790, will be used in design calculations for external buckling. The percentage, or the long-term creep retention value utilized, will be verified by this testing. Values in excess of 50% will not be applied unless substantiated by qualified third party test data. The materials utilized for the contracted project shall be of a quality equal to or better than the materials used in the long-term test with respect to the initial flexural modulus used in Design.

The Enhancement Factor, K, to be used in 'Partially Deteriorated' Design conditions shall be assigned a value of seven (7). Application of Enhancement Factors (K) in excess of seven shall be substantiated through independent test data.

The layers of the cured CIPP shall be uniformly bonded. It shall not be possible to separate any two layers with a probe or point of a knife blade so that the layers separate cleanly or the probe or knife blade moves freely between the layers. If separation of the layers occur during testing of field samples, new samples will be cut from the work. Any reoccurrence may cause rejection of the work.

The cured CIPP pipe material shall conform to the following structural properties.

MINIMUM PHYSICAL PROPERTIES

Property	Test Method	Cured Composite *	Cured Composite **
Modulus of Elasticity	ASTM D 790 (short term)	250,000 psi	400,000 psi
Flexural Stress	ASTM D 790	4,000 psi	4,500 psi

* minimum per ASTM Designation: F 1216
** 400,000 psi Resin

The required structural CIPP wall thickness shall be based as a minimum, on the physical properties above and in accordance with the Design Equations in the Appendix of ASTM Designation: F 1216, and the following design parameters:

Design Safety Factor 2.0
Retention Factor for Long-Term Flexural Modulus
to be used in Design *as determined by Long-Term tests* ..... assume 70%
Ovality .....vitrified clay - assume 2%
Enhancement Factor, k ..... Subsection 907-603.02.3
Groundwater Depth, above invert of the existing pipe ..... 0.0 feet
Soil Depth, above crown of the existing pipe ..... 0 to 6 feet
Soil Modulus ..... Assume sand - 3,000 PSI
Soil Density ..... assume 120 lbs. per ft^3
Live Load ..... H20 Highway

Any layers of the tube that are not saturated with resin prior to insertion into the existing pipe shall not be included in the structural CIPP wall thickness computation.

907-603.02.4--Testing Requirements. The CIPP shall meet the chemical resistance requirements of ASTM Designation: F 1216, Appendix X2. CIPP samples for testing shall be of tube and resin system similar to that proposed for actual construction. It is required that CIPP samples with and without plastic coating meet these chemical testing requirements.

Overall, the hydraulic profile shall be maintained as large as possible. The CIPP shall have a minimum of the full flow capacity of the original pipe before rehabilitation. Calculated capacities may be derived using a commonly accepted roughness coefficient for the existing pipe material taking into consideration its age and condition.

The Contractor may be required to submit test results from field installations of the same resin system and tube materials as proposed for the actual installation. These test results must verify that the CIPP physical properties specified have been achieved in previous field applications. Samples for this project shall be made and tested as described in Subsection 907-603.03.3.

The Contractor shall furnish the Engineer with three (3) copies of the manufacturer's certification stating that the materials used meets the requirements of this specifications.

907-603.02.5--Bypassing. The Contractor, when required, shall provide for the flow around the pipe designated for repair. Plugging the line at an existing upstream manhole and pumping the flow into a downstream manhole or adjacent system shall make the bypass. The pump(s) and bypass line(s) shall be of adequate capacity to accommodate the flow.

907-603.03--Construction Requirements.

907-603.03.1--Installation.

907-603.03.1.1--Cleaning. All pipe which is scheduled to be lined-in-place shall be cleaned prior to lining.

Lines designated for cleaning shall be scheduled with the Engineer. Daily logs shall be maintained to record the location of the lines cleaned, the lengths of the lines cleaned, the volume and type of

debris removed from the line, and other pertinent information to assist the Engineer with regard to the condition of the line.

Cleaning shall generally be accomplished from the upstream manhole. If an obstruction prevents cleaning from the upstream manhole, the Contractor shall attempt to remove the obstructions from the downstream manhole. If obstructions prevent the proper cleaning, the Engineer may order a point repair as hereinafter specified.

Acceptable cleaning method are:

Bucket Machine: Rod the line with power driven steel rods of sufficient length, gauge and augers to loosen all solids and materials. Remove the loosened solids by means of a clam-shell bucket or other acceptable means dragged through the line. Brush the line with mechanically driven power brushes. Flush the line with clean water.

Hydraulic Cleaning: High velocity clean water shall be pumped through the line at 800 to 1000 psi. The hydraulic cleaning shall be accomplished with self-propelled nozzles specifically designed to clean and flush the lines. The cleaning shall be accomplished with as many passes as necessary to properly clean the system.

The Contractor shall be responsible for removing and disposing of all debris collected during the cleaning operation in accordance to the applicable solid waste disposal regulations in the State of Mississippi.

The Contractor shall have equipment available to remove roots which have penetrated the pipe.

The selection of the equipment necessary to perform the cleaning operation shall be the sole responsibility of the Contractor. If the equipment fails to properly clean the pipe, the Contractor shall replace the equipment at his own expense.

907-603.03.1.2--Video Inspection. All pipe which is scheduled to be lined-in-place shall be televised after pipe cleaning but prior to lining.

Video inspection shall be performed by experienced personnel trained in locating breaks, obstacles and service connections using closed-circuit color television camera pulled through the selected line. The Contractor's inspector shall view the video during the inspection and shall verbally identify the sources and estimated quantity and location of infiltration into the system.

A written video report log and video CD shall be furnished on each line inspected. The observations are to be recorded on a video inspection report form. This log shall indicate the internal condition of the line, the deviations in line and grade, abnormal conditions of the pipe barrel and joints, and the location and quantity of each source of infiltration and inflow. The distance from the beginning manhole shall be noted for each observation made on the report form. Photographs of each defect shall be made from the video monitor for further study and justification for rehabilitation.

907-603.03.2--Installation. CIPP installation shall be in accordance with ASTM F1216, Section 7, or ASTM F1743, Section 6, with the following modifications.

907-603.03.2.1--Resin Impregnation. The quantity of resin used for tube impregnation shall be sufficient to fill the volume of air voids in the tube with additional allowances for polymerization shrinkage and the potential loss of resin during installation through cracks and irregularities in the original pipe wall.

The Contractor shall designate a location where the tube will be impregnated with resin using distribution rollers and vacuum to thoroughly saturate the tube felt fiber prior to installation. The Contractor shall allow the Engineer to inspect the materials and impregnation procedure.

907-603.03.2.2--Tube Insertion. The tube shall inserted through an existing manhole or other approved access point.

The tube can be installed in the pipe using either inversion or a pull-in method as defined within the relevant ASTM standards and fully extend to the next designated manhole or termination point.

If pulled into place, a power winch or its equivalent should be utilized and care should be exercised not to damage the tube as a result of pull-in friction.

Temperature gauges shall be placed between the tube and the host pipe's invert position to monitor the temperatures during the cure cycle.

Curing shall be accomplished by utilizing hot water under hydrostatic pressure or steam pressure in accordance with the Resin Manufacturer's recommended cure schedule.

A cool-down process shall be conducted that complies with the Resin Manufacturer's specification.

907-603.03.2.3--Sealing at Manholes. If the CIPP fails to make a tight seal at a manhole, the Contractor shall apply a seal at that point. The seal will be of a material compatible with the CIPP material.

907-603.03.2.4--Reinstatement Of Connections. It is the intent of these specifications that lateral connections be re-opened without excavation, utilizing a remotely controlled cutting device, monitored by a closed circuit television.

Contractor shall certify a minimum of two complete functional cutters plus key spare components are on the job site before each installation or are in the immediate area of the jobsite and can be quickly obtained.

Unless otherwise directed by Engineer, all laterals will be reinstated. No additional payment will be made for cutting or excavation for the purpose of reopening connections. The Contractor will be responsible for all costs and liability associated with such cutting/excavation and restoration

work.

907-603.03.3--Field Control. CIPP samples shall be prepared for each installation designated by the Engineer or approximately 20 percent of the project's installations. Pipe physical properties will be tested in accordance with ASTM F1216 or ASTM F1743, Section 8, using either method. The flexural properties must meet or exceed the values listed in this specification, Table 1 of ASTM F1216 or the values submitted to the Engineer for this project's CIPP wall design, whichever is greater.

Wall thickness of samples shall be determined as described in paragraph 8.1.6 of ASTM F1743. The minimum wall thickness at any point shall not be less than 87.5 percent of the submitted minimum design wall thickness based on the design information provided in paragraph 1.4.3 of this specification.

Visual inspection of the CIPP shall be in accordance with ASTM F1743, Section 8.6.

907-603.03.4--Clean-Up. The Contractor shall maintain the project site in a reasonable neat and orderly condition, free from accumulations of waste materials and rubbish during the entire CIPP installation period. Crates, cartons, trash, and flammable waste materials shall be remove from the work areas by the end of each working day. Trash or debris shall not be disposed of by burning on project site.

Upon acceptance of the installation work and testing, the Contractor shall restore the project area affected by the operations to a condition at least equal to that existing prior to the work.

907-603.04--Method of Measurement. Cured-in-place pipe of the sizes designated, completed and accepted, will be measured by the linear foot.

907-603.05--Basis of Payment. Cured-in-place pipe, measured as prescribed above, will be paid for at the contract unit price per linear foot, which shall be full compensation for all labor, tools, equipment, testing, design requirements, bypass construction, video inspection, lateral connections, and all other incidentals necessary to complete the work.

Payment will be made under:

907-603-D: ___" Cured-In-Place Pipe - per linear foot

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-618-12 **CODE: (SP)**

DATE: 05/03/2024

SUBJECT: Traffic Control Management

Section 618, Maintenance of Traffic and Traffic Control Plan, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-618.01--Description.

907-618.01.2--Traffic Control Management. Delete subparagraph (g) of Subsection 618.01.2 on page 441, and substitute the following.

g) Perform a minimum of once-a-week inspections from the Notice to Proceed until a Partial or Final Maintenance Release is obtained. Once work begins, daily daytime inspections and weekly nighttime inspections are required on projects with predominantly daytime work, and daily nighttime inspections and weekly daytime inspections are required on projects with predominantly nighttime work. Weekly inspections will be allowed for periods outside of active construction. When lane closures are present or any non-fixed signs or traffic handling devices such as cones or barrels are in place, inspections shall be performed daily whether work is being performed or not.

907-618.05--Basis of Payment. Delete pay item 618-A on page 449 and substitute the following.

907-618-A: Maintenance of Traffic - lump sum

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-619-5 **CODE: (IS)**

DATE: 01/17/2018

SUBJECT: Traffic Control for Construction Zones

Section 619, Traffic Control for Construction Zones, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-619.02--Materials.

907-619.02.8--Traffic Signals and Flashers. Delete Subsection 619.02.8.1 on pages 452 thru 455, and substitute the following.

907-619.02.8.1-Portable Traffic Signals. Portable traffic signals shall be trailer or pedestal mounted units that provide for easy, legal transportation and quick setup and deployment. Each unit shall be self-contained. The types of portable traffic signals are as follows.

- Type 1 portable traffic signal shall include two signal heads per trailer with one signal head mounted on an overhead mast arm that can be extended over the travel lane, and the other signal head shall be mounted on the vertical upright of the trailer.

- Type 2 portable traffic signal shall include one signal head that is mounted on the vertical upright of the pedestal/cart or trailer. Pedestal/Cart mounted shall be designated as Type 2A and Trailer mounted shall be designated as Type 2B. Type 2 portable traffic signals shall be tested to MASH Standards or NCHRP Test Level 3 crash testing requirements by an accredited independent test facility, with supporting documentation available upon request.

- Type 3 portable traffic signal shall be the same as Type 1 mentioned above but with enhanced capabilities as mentioned in each applicable section below.

The portable traffic signals shall be MUTCD Compliant and utilize standard ITE signal heads, and adhere to the ITE Specifications and Standards for Vehicle Traffic Control Signal Heads, Light Emitting Diode (LED) Circular Signal Supplement. The units shall be battery powered with a solar charging system, and be equipped with an onboard battery charger capable of being used with a 120V AC power source. Portable traffic signals shall be able to communicate with other portable signals via 900 MHz or other accepted wireless communications. If wireless connectivity is not feasible, hardwired connectivity shall be an acceptable alternative, as approved by the Engineer. Portable Traffic Signals shall include all the major components listed below or be able to perform the functions of these components. The major components of the unit shall include, but are not limited to, the trailer or pedestal/cart, telescoping mast arm (on Type 1 and 3), signal head(s) and back plates, traffic signal controller with operating software, solar charging system with batteries, input and output devices, vehicle detection, flasher units, conflict monitor, relays,

communications system and other equipment required for the safe operation and installation of the unit.

907-619.02.8.1.1--Signal Heads. The signal heads and all applicable components of the portable traffic signal shall meet the physical display and operational requirements of conventional traffic signals as specific in the Manual on Uniform Traffic Control Devices (MUTCD). The signal heads shall be cast aluminum or polycarbonate and shall meet the requirements laid out in the Mississippi Standard Specification for traffic signal heads and associated MDOT material specifications for traffic signal heads. The signal heads shall accommodate standard 12-inch LED indications meeting the ITE Specification "Vehicle Traffic Control Signal Heads" and ITE Specifications and Standards for Vehicle Traffic Control Signal Heads, Light Emitting Diode (LED) Circular Signal Supplement.

For Type 1, Type 2 and Type 3 portable traffic signals, the signal heads shall have the ability to be rotated 180 degrees to face in the opposite direction and shall have the ability to rotate and lock in approximately 10 degree increments to position the signal head for the optimum visibility to motorists.

For Type 1 portable traffic signals, each unit shall contain two signal heads with one signal head mounted on an overhead mast arm that can be extended over the travel lane with a minimum clearance of 17 feet measured from the bottom of the signal head unit to the road surface. The lower signal head shall be mounted to the vertical upright of the trailer at a minimum height of eight feet (8') from the bottom of the signal head unit to the road surface.

For Type 2 portable traffic signals, the signal head shall be mounted to the vertical upright of the trailer at a minimum height of eight feet (8') from the bottom of the signal head unit to the road surface.

For Type 3 portable traffic signals, each unit shall be the same as Type 1 mentioned above but with enhanced capabilities as mentioned below.

907-619.02.8.1.2--Controller and Operating Requirements. The portable traffic signal (Types 1, 2, and 3) shall include a solid state Controller Unit (CU) that is in compliance with NEMA TS 5 Performance Standard. The CU shall have an easy to read front panel backlit display for viewing and programming the configuration settings and CU status. The CU shall be capable of operating the portable traffic signal system in a fixed time, traffic actuated or manual control mode. Multiple portable traffic signals shall have the capability to be interconnected to form a portable traffic signal system. Each portable traffic signal within a connected system shall have the capability to serve as either the master or remote signal. Each portable traffic signal shall include a Conflict Monitor Unit (CMU), or Malfunction Management Unit (MMU) to ensure phase conflicts do not exist during operation.

For Type 1 and Type 2 portable traffic signals, a minimum of five (5) automatic time-of-day timing plans within a 24-hour period should be available in fixed time mode. The CU should have the ability to control a minimum of four (4) traffic phases with programmable cycle time adjustments and user adjustable red, amber, minimum green and maximum green times. The CU shall have

the capability of programming green and red times from 1 to 999 seconds and yellow times up to 15 seconds in one-second increments. The CU shall also have the capability of facilitating standby modes of red, red flash and yellow flash.

For Type 3 portable traffic signals, a minimum of ten (10) automatic time-of-day timing plans within a 24-hour period should be available in fixed time mode. The CU should have the ability to control a minimum of 16 traffic phases with programmable cycle time adjustments and user adjustable red, amber, minimum green and maximum green times. The CU shall have the capability of programming green and red times from 1 to 999 seconds and yellow times up to 15 seconds in one-second increments. The CU shall also have the capability of facilitating standby modes of red, red flash and yellow flash.

The system shall also have the ability to operate in vehicle actuation mode when vehicle detection components are used. The operating system shall have the capability to allow the Portable Traffic Signal to be connected to and controlled by a standard NEMA controller.

The system shall have the capability to be controlled remotely using a hardwired or wireless remote. The wireless radio remote shall be capable of communicating at a clear line of site distance up to ¼ mile from the master.

The CU shall have the capability of interfacing with a Remote Monitoring System (RMS) capable of reporting signal location, battery voltage, and system faults. The RMS shall include a password-protected web site, viewable via an internet connection. In the event of a system fault, the RMS shall provide specific information concerning the cause of the system fault (example: "red lamp on signal number 1 out"). The RMS shall immediately contact previously designated individuals via SMS text messaging or email, upon a fault event.

The active timing program operating the PTS system shall be available and viewable through the RMS website at all times. The RMS shall maintain a history of the operating system in each signal including total operating hours, alerts, and the location of the PTS trailer.

907-619.02.8.1.3--Wireless Communications. The portable traffic signals shall communicate with other portable traffic signals within the signal system via license-free wireless 900 MHZ radio link communications as specified in Subsection 662.02.2 of the radio Interconnect System specification. The radio units shall maintain communications at a minimum distance of one (1) mile. The radio system shall conform to the applicable Federal Communications Commission requirements and all applicable state and local requirements.

The portable traffic signals shall be in direct communication at all times either by wireless or hardwire connection to provide for the required conflict monitoring / malfunction management system.

907-619.02.8.1.4--Power Requirements. Each Portable Traffic Signal shall be equipped with a power source consisting of a solar collection array, solar controller and/or charging unit and batteries sufficient to operate the signal system. The number and size of batteries shall be sufficient to operate the Type 1 and Type 3 signals for a minimum of 30 days and Type 2A signals for

minimum of five (5) days, and Type 2B signals for minimum of 15 days without additional charging or assist from the solar array. An on-board battery charger shall be compatible with both the solar array and with a 120V AC power source.

For Type 1 signals, the solar panel array shall provide for a minimum of 440 watts of solar collection capability.

For Type 2A signals, the solar panel array shall provide for a minimum of 90 watts of solar collection capability.

For Type 2B signals, the solar panel array shall provide for a minimum of 110 watts of solar collection capability.

For Type 3 signals, the solar panel array shall provide for a minimum of 480 watts of solar collection capability and shall include a tilt and rotate system to optimally position the panels.

All instrumentation for the electrical system and battery compartment shall be contained in a lockable weatherproof enclosure. Solar panels shall be secured to the mounting brackets for theft prevention.

907-619.02.8.1.5--Trailer and Lift System. The trailer or pedestal/cart and all mounted components shall conform to the wind loading requirements as follows: 100 mph minimum for Type 1 portable traffic signals, 55 mph minimum for Type 2A portable traffic signals, 75 mph minimum for Type 2B portable traffic signals, and 90 mph minimum for Type 3 portable traffic signals as described in the AASHTO *Standard Specifications for Highway Signs, Luminaries and Traffic Signals*, as specified in the plans including all interims and updates. At the request of the Engineer, proof of conformance to these wind load ratings shall be verified by a third-party. No additional loose ballast shall be used to meet these wind load requirements. The trailer shall be made of structural steel and shall include four (4) leveling/stabilizer jacks capable of lifting the trailer a minimum of six inches (6").

The trailer or pedestal shall be equipped with a mechanical, hydraulic or electric lift system sufficient for one person to be able to raise and lower the vertical upright and/or horizontal mast arm to and from the operating position.

For Type 1, 2B, and Type 3 signals, the trailer shall be equipped to provide legal and safe transport on the public highway system at speeds up to 55 mph.

All exterior metal surfaces, except signal heads and back plates, shall be powder-coat painted highway safety orange.

907-619.02.9--Impact Attenuators. Delete the sentence in the first paragraph of Subsection 619.02.9 on page 455, and substitute the following.

Impact attenuators must be listed on the Department's APL.

907-619.02.11--Snap-Back Delineators. Delete the sentence in the paragraph of Subsection 619.02.11 on page 456, and substitute the following.

Snap-back delineators shall be selected from the list of surface mounted flexible delineator posts as shown on the Department's APL.

907-619.02.14--Changeable Message Sign.

907-619.02.14.5--PCMS Controller and Storage Cabinets. Delete the fifth sentence in the first paragraph of Subsection 619.02.14.5 on pages 462 and 463, and substitute the following.

The controller cabinet shall be illuminated.

907-619.05--Basis of Payment. Add the following to the list of pay items ending on page 480.

907-619-E3: Changeable Message Sign ***** - per each

907-619-H2: Traffic Signal, Portable, Type ___ - per each

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-619-6 **CODE: (SP)**

DATE: 03/21/2018

SUBJECT: Temporary Portable Rumble Strips

Section 619, Traffic Control for Construction Zones, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-619.02--Materials. After Subsection 619.02.15 on page 472, add the following.

907-619.02.16--Temporary Portable Rumble Strips. Temporary portable rumble strips shall be RoadQuake manufactured by PSS and meet the following requirements:

- capable of being installed without adhesives or bolts,
- have a minimum weight of 100 pounds,
- have a minimum overall length of 11 feet,
- have a minimum width of 12 inches, and
- have a maximum height of 3/4 inch.

Temporary portable rumble strips shall be installed in accordance with the attached details, or as directed by the Engineer.

907-619.03--Construction Requirements. After Subsection 619.03.11 on page 476, add the following.

907-619.03.16--Temporary Portable Rumble Strips. Temporary portable rumble strips shall be placed at locations shown on the traffic control plans, attached drawing, or as directed by the Engineer. The rumble strips shall be removed when lane closures are removed, relocated when lane closures are relocated, or as directed by the Engineer.

Prior to placement of the rumble strips, the roadway shall be cleaned to be free of dust, sand, and other materials that may cause slippage. The minimum roadway temperature at the time of installation shall be in accordance with manufacturer recommendations.

A minimum of three (3) temporary portable rumble strips shall be arranged in an array. The spacing of temporary portable rumble strips in each array shall be on 15-foot centers. One array of three (3) strips shall be used in each lane. The rumble strips shall be regularly monitored and maintained to ensure they stay in place under traffic.

907-619.04--Method of Measurement. At the end of Subsection 619.04 on page 478, add the following.

Temporary Portable Rumble Strips will be measured for payment by the linear foot only when a pay item for temporary portable rumble strips is included in the contract. Otherwise, temporary portable rumble strips will be included in the cost of pay item 618-A, Maintenance of Traffic. The quantity of temporary portable rumble strips will be the length of rumble strips approved by the Engineer to be in-place on the project at any one time.

907-619.05--Basis of Payment. After the fifth paragraph of Subsection 619.05 on page 478, add the following.

Temporary Portable Rumble Strips measured as prescribed above, will be paid for at the contract unit price per linear foot, which price shall be full compensation for cleaning the roadway surface, installing the rumble strips, maintenance and repair of the strips, cleaning and resetting of the strips, removal and replacement, and for all labor, equipment, tools, and incidentals necessary to complete the work.

After the last pay item listed on page 480, add the following.

907-619-B: Temporary Portable Rumble Strips - per linear foot

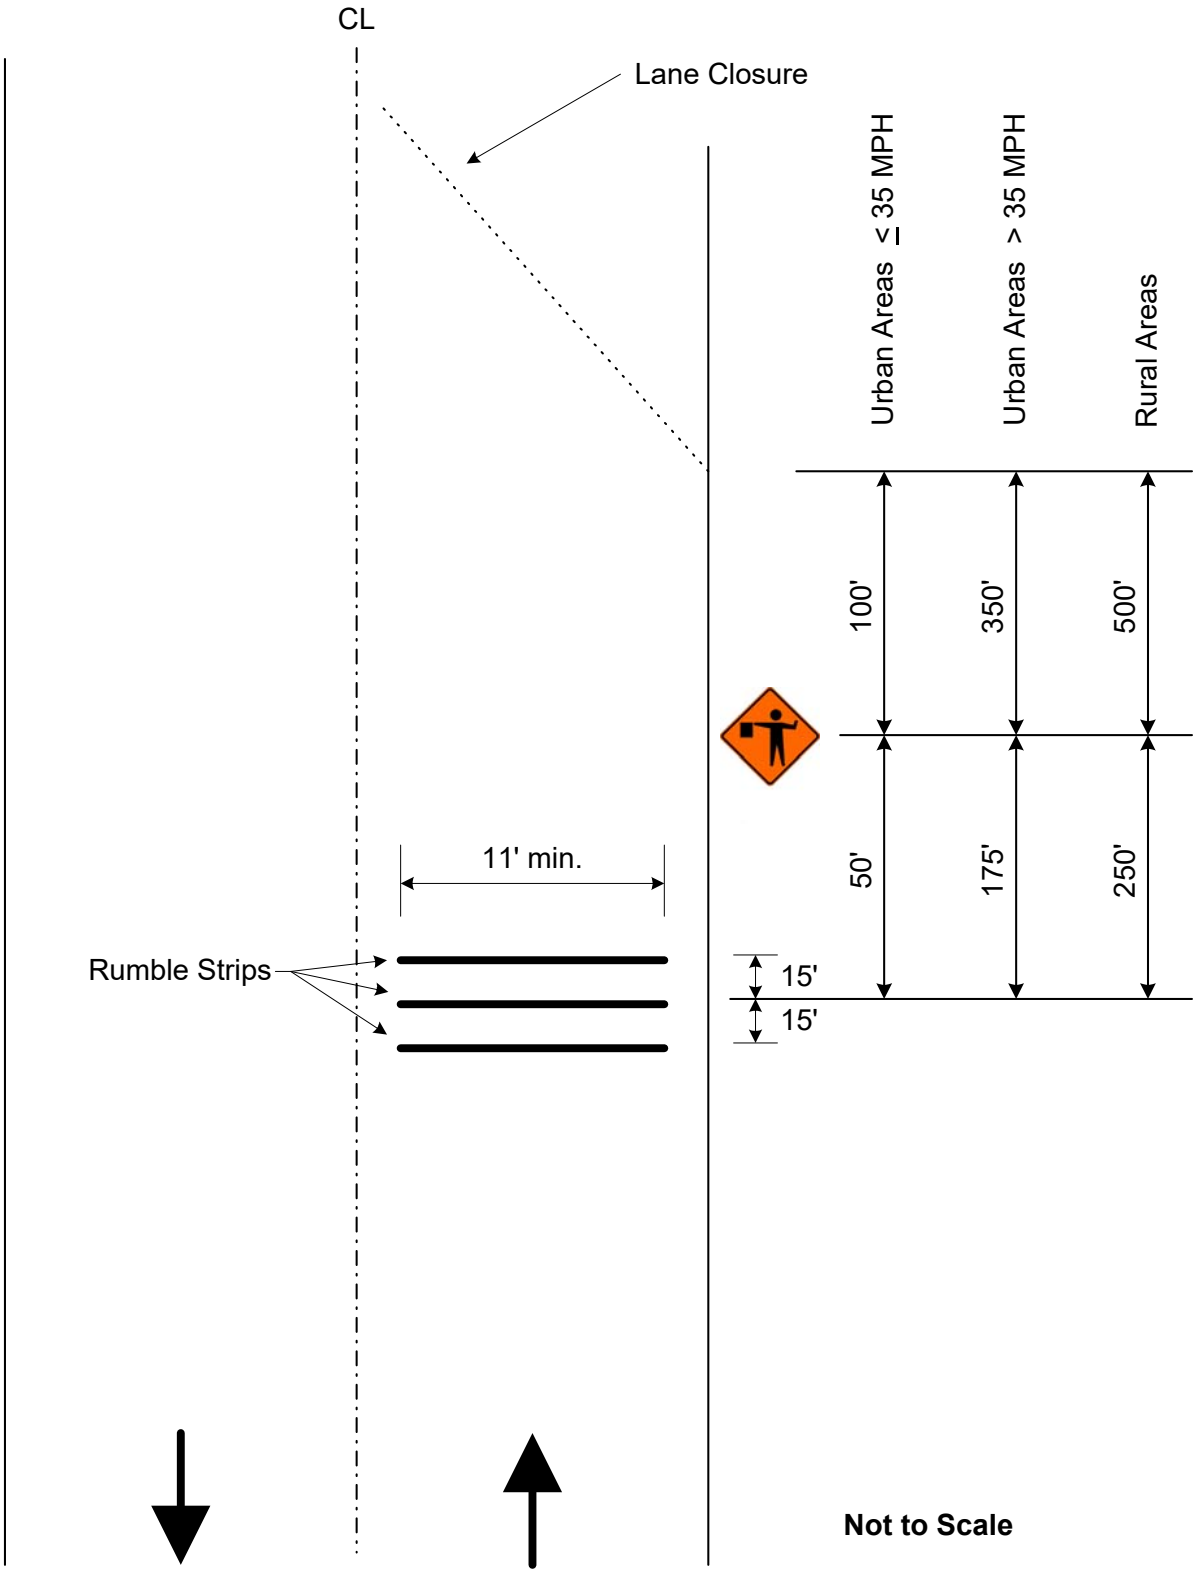

Detail of Temporary Portable Rumble Strips

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-626-12 **CODE: (IS)**

DATE: 06/17/2025

SUBJECT: Thermoplastic Traffic Markings

Section 626, Thermoplastic Traffic Markings, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete Section 626 on pages 492 thru 496, and substitute the following.

SECTION 626 - THERMOPLASTIC TRAFFIC MARKINGS

907-626.01--Description. This work consists of furnishing materials and placing thermoplastic pavement markings of the type specified in conformity with these specifications and the details shown on the plans or established. All hot-applied thermoplastic pavement markings shall be coated with a double-drop combination of optics.

This work may also consist of placing an audible bump or puck style marking system on the edge line that provides an audible and vibratory warning when driven over. The marking system shall be a road marking system of the dimensions indicated at regular and predetermined intervals.

This work may also consist of placing a profile or raised shape marking system on centerline or edge line that provides audible and vibratory warning when driven over. The marking system shall be a road marking system of the dimensions indicated and at regular and predetermined intervals. When placed on centerline, the markings system shall consist of an extruded black transverse thermoplastic bar of the dimensions indicated at regular and predetermined intervals.

This work may also consist of placing high contrast thermoplastic markings. High contrast thermoplastic markings shall consist of placing thermoplastic pavement markings over a black thermoplastic pavement marking to enhance the marking's visibility.

All pavement marking material, excluding lines over rumble strips, shall be applied using the extrusion/ribbon method. Lines placed over rumble strips shall be applied using the atomization/spray method, unless the extrusion/ribbon method can be demonstrated to perform adequately and is approved by the Engineer.

Permanent pavement marking tape (permanent cold plastic tape) may be used in lieu of hot applied thermoplastic markings. Substitution will only be allowed for pay items 907-626-A through H. Substituted pavement marking tape shall be of the same color and width as that required for the hot applied thermoplastic. Unless otherwise specified, the markings, whether hot applied or pavement marking tape, shall be of the same type of material for the entire project. Stop bars and crosswalks shall not be substituted with pavement marking tape and shall be alkyd hot-applied thermoplastic markings or heat-fused preformed pavement markings. Material and construction

requirements for substituted pavement marking tape shall meet the requirements of Special Provision 907-628. The layout and spacing for substituted pavement markings will remain as shown in the plans, or in the contract documents, for hot applied thermoplastic markings. Measurement of adhesive substituted pavement markings shall be made in accordance with Special Provision 907-628. Payment for adhesive substituted pavement markings shall be made at the unit price for the appropriate hot applied thermoplastic marking.

When thermoplastic pavement markings are used on bridge decks or concrete surfaces, the surface shall be sealed with an epoxy sealer prior to the application of thermoplastic.

907-626.02--Materials. All pavement marking materials shall meet the requirements of Special Provision 907-720.

907-626.02.1--Audible Bumps. Audible bumps shall have a profile such that the leading and trailing edges are sloped at a sufficient angle to create an audible and vibratory warning.

Audible bumps shall be at least 0.45 inches above the pavement surface at the highest point of the bump. The height shall be measured after the application of drop-on material. The bumps shall have a minimum dimension of two and one-half inches (2½") in both transverse and longitudinal directions. The bumps may have a drainage channel. The width of each drainage channel shall not exceed one-quarter of an inch (¼") at the bottom of the channel.

907-626.02.2--Audible Transverse Bars. The length of transverse bars is the measurement lateral to the direction of travel, also known as transverse width. The width of transverse bars is the measurement parallel to the travel way.

Transverse bars on centerline shall have a length of 10 inches, a width of three inches (3"), and a height of 350 mils. Transverse bars on centerline shall be placed on 2-foot centers through no-passing zones and 5-foot centers through passing zones. Transverse bars on centerline shall be placed in advance of permanent thermoplastic markings.

Transverse bars on edge lines shall have a length of six inches (6"), a width of three inches (3"), and a height of 350 mils. Transverse bars on edge lines shall be placed on 2-foot centers. Tolerance for the longitudinal and transverse measurements shall be one quarter of an inch (¼") and the tolerance for height shall be 50 mils. The above dimensions are based on 6-inch strip application.

Thermoplastic material for edge line transverse bars shall be as specified on the Plans and meet the requirements of Special Provision 907-720 or as specified on the plans. Thermoplastic material for centerline transverse bars shall be black and shall meet the requirements of Special Provision 907-720.

907-626.02.3--High Contrast Markings. High contrast markings shall be black with the pertinent marking color overlaid on top and shall meet the requirements of Special Provision 907-720.

907-626.03--Construction Requirements.

907-626.03.1--Equipment. Equipment for hot application shall be of sufficient size and stability to ensure smooth, uniform, properly aligned markings of the dimensions specified. The equipment shall be suitably equipped for heating and controlling the flow of the material. The equipment shall be constructed to provide continuous mixing and agitation of the material. The conveying parts of the equipment, between the main material reservoir and applicator, shall be so constructed as to prevent accumulation and clogging. The equipment shall be constructed so that all mixing and conveying parts, up to and including the applicator, maintain the material at the plastic temperature. The thermoplastic material shall be dispensed at a temperature recommended by the manufacturer. The applicator shall include a cutoff device remotely controlled to provide clean, square stripe ends and to provide a method for applying skip lines. The thermoplastic reservoir shall be insulated and equipped with an automatic thermostatic control to maintain the proper temperature of the material.

The application equipment shall be capable of automatic placement of intermittent and continuous line patterns in single or double line applications simultaneously. The intermittent timer mechanism shall provide a variable ratio of materials applied and variable cycle length such that accurate placement of new patterns, or replacement of existing patterns can be achieved.

The equipment shall also be capable of applying the top dressing of optics (beads) in a manner that firmly embeds them into the surface of the thermoplastic material for at least one half of the diameter of the larger gradation sizes of the optics. The dispensing equipment shall be equipped with an automatic cut-off control for the application of the optics that is synchronized with the cut-off of the thermoplastic material.

Optics applied to the surface of the completed stripe shall be applied by an automatic dispenser attached to the pavement marking equipment in such a manner that the optics are immediately dispensed upon the completed line. The dispenser shall be equipped with an automatic cutoff control, synchronized with the cutoff of the pavement marking equipment. The double-drop optics as defined in 907-720 shall be automatically applied at a uniform rate to achieve the minimum retroreflectivity requirements of 907-626.

907-626.03.2--Construction Details. The thermoplastic compound shall be screed or ribbon extruded to the pavement surface. Heat-fused, pre-formed pavement markings shall be fusible to asphalt surfaces by means of the normal heat of a propane weed-burner type of torch or other heating device as recommended by the manufacturer. Heat-fused, pre-formed pavement markings shall be instantly highly reflective without the application of additional optics.

Thermoplastic markings shall not be applied to the pavement surface when the pavement surface temperature is less than 55°F. The pavement surface shall be dry, to the satisfaction of the Engineer, before application will be permitted. Unless otherwise specified by the manufacturer, thermoplastic pavement marking material shall be applied to the surface between 400°F and 450°F with a recommended application temperature being 420°F.

Immediately before application, all areas to be marked shall be thoroughly cleaned. Cleaning may be done by rotary brooms, air blast, scrapers, or whatever combination of equipment is necessary to clean the pavement thoroughly without damage to the pavement surface. On areas of pavement

cured with compound, the membrane shall be removed completely by shot blasting, sand blasting or other approved method. Before edge striping, particular care shall be taken to remove all vegetation, loose soil, and the like from the area to be marked. Should other methods fail, the surface shall be wetted with a water jet and scrubbed as necessary to dislodge all foreign material. After washing, the surface shall be allowed to dry thoroughly, and all films of dried mud apparent after surface drying shall be removed before application of markings. Marking shall follow as closely as practicable after the surface has been cleaned and dried, but no markings shall be applied until the surface has been inspected and permission given to proceed. The cost for preparing the surface shall be included in the contract unit prices for the marking items.

Unless otherwise directed by the Engineer, traffic stripes that are conflicting with the thermoplastic stripe shall be removed prior to placement of the thermoplastic material. Removal of pavement markings shall be done by a means that will not gouge the surface of the pavement in a manner that requires patching to ensure the integrity of the pavement. Temporary paint stripe may be left in place when satisfactorily placed in the proper location. Any temporary stripe not covered shall be removed. Payment for removal of stripe, except temporary stripe, will be made under Section 202.

On newly constructed asphalt pavements, any sand, grit, or other surface contaminants shall be removed using compressed air and/or sweeping. Water blasting may be necessary to remove surface contaminants which cannot be removed by the use of compressed air and/or sweeping. This work is considered surface preparation.

The finished lines shall have well defined edges and the thickness of thermoplastic markings above the roadway surface shall be no less than 90 mils for edge lines, center lines, lane lines, barrier lines, and detail stripe including gore markings, and no less than 120 mils for crosswalks, stop lines, and railroad, word and symbol markings. The minimum thickness, as required above, will be measured in the center of the line when gauged. The minimum thickness one-half inch (½") from the edges shall not be less than 75% of the thickness required in the center.

Any thermoplastic traffic marking less than the required thickness shall be corrected by recapping at no additional costs to the Department. Although a thickness tolerance of 25 percent from center to edge is allowed, a consistent underrun of any amount in thickness as determined by the Engineer will not be acceptable.

The length and width of lines shall be within a tolerance of ±3 inches and ±1/8 inch, respectively. For skip markings, the tolerance for intervals shall not exceed the line length tolerance. On curves, unsightly variations from the normal curvature will not be permitted unless specifically shown on the plans or ordered by the Engineer.

Heat-fused, pre-formed pavement markings shall be supplied with a minimum average thickness of 90 mils before application on the roadway surface.

All newly applied thermoplastic material shall be protected from traffic until the material is sufficiently dry so as not to sustain damage from vehicle tires. Any material so damaged by traffic shall be repaired, and the thermoplastic material tracked onto the pavement shall be removed and

replaced.

907-626.03.3--Reflectivity Requirements. The longitudinal pavement markings shall meet the following retroreflectivity values when measured within 10 to 30 calendar days of placement, after removing loose beads.

Table 1. Minimum Dry Retroreflectivity

Color	All Stripe without Rumble mcd/m²/lx	Rumble Stripe mcd/m²/lx
White	375	250
Yellow	225	150

For projects with less than two miles between the BOP and EOP, retroreflectivity measurements will not be required.

907-626.03.3.1--Measuring Devices. Retroreflectivity measurements are required to be taken using a vehicle mounted mobile retroreflectometer using 30-meter geometry with video and mapping capabilities as per AASHTO T-398. The retroreflectometer and operator shall be certified by the manufacturer, authorized representative of the manufacturer, or an MDOT approved program such as the Texas A&M Transportation Institute (TTI) Mobile Retroreflectometer Certification Program. The Contractor shall provide copies of current certifications for the operator(s) and the device(s) to the Engineer.

907-626.03.3.2--Acceptance Procedure. Averages of the mobile measurements shall be provided for every 0.1 miles unless otherwise specified or approved. Take measurements on each section of roadway for each series of markings (i.e., edge line, center skip line, each line of a double line, etc.) and for each direction of traffic flow. Measure each line in both directions for centerlines on two-way roadways (i.e., measure both double solid line in both directions and measure all center skip lines in both directions). Furnish measurements in compliance with the below requirements. Use all equipment in accordance with the manufacturer's recommendations and directions. Inform the Engineer at least 24 hours before taking any measurements.

A marking meets the retroreflectivity requirements if:

- The combined average retroreflectivity value for a one-mile segment meets the minimum retroreflectivity values specified, and
- Within the one-mile segment, no more than three consecutive 0.1 mile intervals shall have an average retroreflectivity value below the minimum required value.

The one-mile segment will start from the beginning of the data collection and end after a mile worth of measurements have been taken; each subsequent mile of measurements will be a new segment. If the remainder is 0.5 miles or less, it shall be included in the previous mile segment, otherwise the remaining segment of greater than 0.5 mile shall be its own segment. Centerlines with 2 stripes (either solid or broken) will result in 2 miles of data for each mile segment. Each centerline stripe must be tested for compliance as a stand-alone stripe.

The Contractor may elect to restripe with a minimum of 0.060 in. (60 mils) at no cost to the Department each one-mile segment that failed to meet the minimum retroreflectivity requirements.

Measurements shall be retaken within 10 to 30 calendar days after the second application for the mile segment for that series of markings. If the markings do not meet minimum retroreflectivity after the second application, the Engineer may require removal of all existing markings, a new application as initially specified, and a repeat of the application process until minimum retroreflectivity requirements are met.

907-626.03.3.3--Mobile Retroreflectivity Data Collection. Mobile Retroreflectivity Data Collection (MRDC) shall be conducted on dry pavement only and when the ambient air temperature is greater than 40°F. Data shall be submitted to the Engineer no later than 3 working days after the day the data is collected. Submit all raw data collected in addition to all other data submitted. Provide data files in Microsoft Excel format or a format approved by the Engineer. The data file and video must contain the following information.

907-626.03.3.3.1--Data File. Data files shall be provided with the following:

- Date;
- District;
- County;
- Name of mobile retroreflectometer operator;
- Route number with reference markers or other reference information provided by the Engineer to indicate the location of beginning and end data collection points on that roadway;
- Cardinal direction;
- Line type (single solid, single broken, double solid, etc.);
- Line color;
- File name corresponding to video;
- Data for each centerline listed separately;
- Average reading taken for each 0.1-mi. interval (or interval designated by the Engineer);
- Accurate GPS coordinates (within 20 ft.) for each interval;
- Color-coding for each interval indicating passing or failing, unless otherwise directed by the Engineer (passing and failing thresholds provided by the Engineer);
- Graphical representation of the MRDC (y-axis showing retroreflectivity and x-axis showing intervals) corresponding with each data file;
- Distance in miles driven while measuring the pavement markings;
- Event codes (pre-approved by the Engineer) indicating problems with measurement;
- Upper validation threshold (may be included separately with the raw data but must be clearly identified with the data collected using that threshold).

907-626.03.3.3.2--Map. A map shall be provided in an electronic format approved by the Engineer with each MRDC submission that includes the following information:

- Date;
- District number;
- County;

- Color-coded 1-mi. intervals (or interval length designated by the Engineer) for passing and failing retroreflectivity values or retroreflectivity threshold values provided by the Engineer; and
- Percentage of passing and failing intervals, if required by the Engineer.

907-626.03.3.3.3--Video. A high-quality video file shall be provided with the following information:

- Date and corresponding data file name on label;
- District number;
- County;
- Route number with reference markers or other designated reference information to indicate the location of beginning and end collection points on that roadway; and
- Retroreflectivity values presented on the same screen with the following information:
    - Date;
    - Location;
    - Starting and ending mileage;
    - Total miles;
    - Retroreflectivity readings; and
    - Upper validation thresholds (may be included separately with the raw data but must be clearly identified with the data collected using that threshold).

907-626.03.4--Reflectivity Verification Testing. The Engineer or a third party may perform retroreflectivity verification testing on any project. At a minimum, each Contractor performing work for the Department will be verified on an annual basis. The Contractor-submitted retroreflectivity data will be compared to the verification test data to determine acceptability of the Contractor's mobile retroreflectometer data. Comparison of the data will result in one of the two scenarios below:

- Contractor's Data is Validated – If the difference between Contractor's and Engineer/third party data is 20% or less, then the Contractor's data is validated. The Contractor's data will be used for acceptance.
- Contractor's Data is not Validated – If the difference between the Contractor's and Engineer/third party data is more than 20%, then the Contractor's data is not validated. The Engineer/third party data will be used for acceptance and the Contractor will be required to take corrective action prior to additional Contractor data collection and may require re-certification of the mobile retroreflectometer.

907-626.04--Method of Measurement. Thermoplastic stripe completed in accordance with the plans and specifications will be measured by the mile or by the linear foot, as indicated, from end-to-end of individual stripes. In the case of skip lines the measurement will include skip intervals. The length used to measure centerline, lane lines, and edge stripes will be the horizontal length computed along the roadway.

Detail traffic stripe will be measured by the linear foot from end-to-end of individual stripes. Measurements will be made along the surface of each stripe and will exclude skip intervals where

skips are specified. Stripes more than six inches (6") in width will be converted to equivalent lengths of 6-inch stripe.

Hot-applied legend, which is to include railroad markings, pedestrian crosswalks, and stop lines, will be measured by the square foot or linear foot. Pay areas of individual letters and symbols will usually be shown on the plans and measured by the square foot. Transverse railroad bands, pedestrian crosswalks and stop lines will generally be measured by the linear foot, in which case, stripes more than six inches (6") in width will be converted to equivalent lengths of 6-inch widths.

Pre-formed legend which is to include railroad markings and pedestrian crosswalks will be measured and paid for by each.

The length measured for thermoplastic audible bump edge stripe will not include the permanent thermoplastic edge stripe. Permanent thermoplastic edge stripe will be measured for payment under a separate pay item.

Thermoplastic audible bar centerline skip stripe will be measured by the linear foot or mile. Measurements will be made along the surface from end-to-end of the stripe and will include skip intervals. The length used to measure audible bar centerline stripe will be the horizontal length computed along the roadway. The length measured for thermoplastic audible bar centerline skip stripe will not include the permanent centerline continuous or skip stripe. Permanent centerline continuous and skip stripe will be measured for payment under separate pay items.

Thermoplastic audible bar edge stripe will be measured by the linear foot or mile. Measurements will be made along the surface from end-to-end of the stripe. The length used to measure thermoplastic audible bar edge stripe will be the horizontal length computed along the roadway. The length measured for thermoplastic audible bar edge stripe will not include the permanent thermoplastic edge stripe. Permanent thermoplastic edge stripe will be measured for payment under a separate pay item.

907-626.05--Basis of Payment. Thermoplastic traffic markings will be paid for at the contract unit price per mile, linear foot, square foot or each as applicable. Any deductions for non-satisfactory material test results will be made after final testing has been performed.

Payment will be made under:

907-626-A:	6" Thermoplastic Traffic Stripe, Skip White	- per linear foot or mile
907-626-B:	6" Thermoplastic Traffic Stripe, Continuous White	- per linear foot or mile
907-626-C:	6" Thermoplastic Edge Stripe, Continuous White	- per linear foot or mile
907-626-D:	6" Thermoplastic Traffic Stripe, Skip Yellow	- per linear foot or mile
907-626-E:	6" Thermoplastic Traffic Stripe, Continuous Yellow	- per linear foot or mile

907-626-F:	6" Thermoplastic Edge Stripe, Continuous Yellow	- per linear foot or mile
907-626-G:	Thermoplastic Detail Stripe, Color *	- per linear foot
907-626-H:	Thermoplastic Legend, Color *	- per linear foot, square foot, or per each
907-626-Q:	Thermoplastic Audible Bump Edge Stripe	-per linear foot or mile
907-626-R:	Thermoplastic Detail Audible *** Stripe, Color **,	-per mile
907-626-AA:	6" High Contrast Thermoplastic Traffic Stripe, Skip White	- per linear foot or mile
907-626-BB:	6" High Contrast Thermoplastic Traffic Stripe, Continuous White	- per linear foot or mile
907-626-CC:	6" High Contrast Thermoplastic Edge Stripe, Continuous White	- per linear foot or mile
907-626-DD:	6" High Contrast Thermoplastic Traffic Stripe, Skip Yellow	- per linear foot or mile
907-626-EE:	6" High Contrast Thermoplastic Traffic Stripe, Continuous Yellow	- per linear foot or mile
907-626-FF:	6" High Contrast Thermoplastic Edge Stripe, Continuous Yellow	- per linear foot or mile
907-626-GG:	High Contrast Thermoplastic Detail Stripe, Color *	- per linear foot
907-626-HH:	High Contrast Thermoplastic Legend, Color *	- per linear foot, square foot, or each

* Indicate Blue - ADA if applicable
** Indicate White or Black
*** Indicate Centerline - Passing Zone, Centerline - No-Passing Zone, or Edge Line

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-627-1 **CODE: (IS)**

DATE: 06/24/2024

SUBJECT: Raised Pavement Markers

Section 627, Raised Pavement Markers, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows:

Delete Subsection 627.02 on page 496, and substitute the following.

907-627.02--Materials. Pavement and jiggle markers of the types specified shall conform to the applicable requirements of Subsection 907-720.06 and shall be listed on the Department's APL.

Type B through G High Performance reflective markers shall be listed on the Department's APL for high performance raised pavement markers.

The bituminous adhesive for pavement markers shall meet the requirements of Subsection 907-720.07.3.

907-627.05--Basis of Payment. Add the "907" prefix to the pay items listed on page 498.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO SPECIAL PROVISION NO. 907-631-1

DATE: 08/27/2024

SUBJECT: Traffic Signal Systems - General

Before Subsection 907-631.02.4 on page 1, add the following.

907-631.02.3--Regulations and Code. At the end of the second paragraph, add the following.

The Certified IMSA Traffic Signal Construction Technician Level II employee is not required to be on-site during construction. Proof of this certification shall be provided prior to award of contract.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-631-1 **CODE: (IS)**

DATE: 11/15/2017

SUBJECT: Traffic Signal Systems - General

Section 631, Traffic Signal Systems - General, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-631.02--Materials.

907-631.02.4--Operations. Delete the second paragraph in Subsection 631.02.4 on page 513 and substitute the following.

The Contractor shall conduct the work at all times in such a manner as to ensure the least possible inconvenience to the traveling public, and to property owners on the streets, alleys, and other public places where the construction will take place.

907-631.02.5--Electrical Service. Delete the first paragraph in Subsection 631.02.5 on page 515 and substitute the following.

It shall be the Contractor's responsibility to make the necessary arrangements with the local power company to provide the electrical service for any new installation. The Contractor shall pay for, at no cost to the Department, all deposits, hook-up charges, or other service fees required by the power company for the establishment of new service. The cost of all such fees shall be considered incidental and absorbed within existing pay items. The Department or the local agency will be responsible for payment of the monthly service bill for the new power service installation. It shall be the responsibility of the Contractor to swap the electrical service account over to the Department or local agency.

907-631.03--Construction Requirements.

907-631.03.2--Electrical Service Equipment. Delete the paragraphs of Subsection 631.03.2 on pages 515 and 516, and substitute the following.

The power supply assembly shall consist of all equipment mounted in a Power Service Pedestal as described in Subsection 722.13 or as otherwise shown in the plans. The configuration and installation of the equipment mounted on the assembly shall meet the safety requirements and approval of the utility company or municipality furnishing power for operation.

When required, service poles shall be provided by the Contractor and consist of wood poles with required pole line hardware, conduit, ground rods, guy wires and anchors and all other accessories and appurtenances mounted on the pole, except those items furnished by the utility company or

municipality, or as specified separately in the contract or plans. Costs of service poles shall be included in other items bids.

Main disconnect switches shall be separately housed on the power supply assembly. Circuit breaker cabinets and meters shall not be installed on the street or walk side of the pole or pedestal.

907-631.03.3--Performance Tests. Delete the second sentence of Subsection 631.03.3 on page 516.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-632-1 **CODE: (IS)**

DATE: 11/15/2017

SUBJECT: Traffic Signal Cabinet Assemblies

Section 632, Traffic Signal Cabinet Assemblies, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete Section 632 on pages 517 thru 538, and substitute the following.

SECTION 907-632 - TRAFFIC SIGNAL CABINET ASSEMBLIES

907-632.01--Description. This work consists of furnishing, assembling, configuring and installing all component materials and software required to form completed traffic signal controller assemblies, closed loop master controller assemblies and signal system installation of the types specified, in conformity with these specifications, to ensure fully operational traffic signal installations as shown on the plans.

907-632.02--Materials.

907-632.02.1--Cabinet Assembly. Cabinet Assemblies shall meet the NEMA 3R requirements and be constructed principally of 0.125-inch thick, 5052-H32 aluminum. The aluminum shall have a mill finish per NEMA TS 2 7.7.3. Intermittent welds may be used for construction and any un-welded cabinet seams shall be sealed with clear RTV silicone. All external fasteners shall be stainless steel and no holes will be allowed in top of cabinet.

The door handles shall be stainless steel or cast aluminum. Door hinges shall be of the continuous type with a stainless steel hinge pin. Rivets are not be used to attach the hinge. The main door stop rod shall be constructed using stainless steel. The door stop mechanism shall be adjustable and capable of being securely latched in multiple opened positions including 90 degrees and a maximum of 120 degrees. The brackets attaching the stop rod to the door and cabinet shall be aluminum and welded in place. The main door cylinder lock shall be a #2 key type lock. Two (2) traffic industry standard No. 2 keys shall be provided with each cabinet and shall be made using heavy duty key blanks.

Extruded aluminum channels permanently attached to the right and left cabinet sides shall be provided for attaching adjustable shelving and mounting of other component panels. The cabinet shall have two (2) shelves installed. Both shelves shall be provided with the front edge pre-drilled with 0.25-inch holes located twelve (12) inches apart.

907-632.02.2--Physical Features.

907-632.02.2.1--Pull Out Drawer. A pull out drawer shall be installed and centered under the

bottom shelf. The drawer shall be made of 0.080-inch thick, 5052-H32 aluminum and come out on full extension drawer slides. The pull out drawer shall provide an approximate 16-inch x 14-inch working area and have the ability to bear a constant 25 pound burden. There shall be a compartment for document storage. The lid shall be hinged at the rear, to gain access to the storage area. The drawer will be used to store documents as well as support a notebook computer. The drawer slides shall be of the full extension ball bearing type. Dimensions of the drawer shall be large enough to support a notebook computer and a drawer of sufficient size to hold at least two (2) copies of the cabinet drawings and other related cabinet documentation. The surface of the lid shall have a non-slip surface.

907-632.02.2.2--Cabinet Lighting. Cabinets shall be provided with a minimum of two (2) white light LED modules. One (1) lighting module shall be installed along the front top section of the cabinet and the second lighting module shall be installed underneath the bottom cabinet shelf in such a location as to provide direct lighting of the load bay area of the cabinet but must not interfere with the cabinet drawer operation.

Both LED lighting modules shall be controlled by a NEMA rated, commercial quality, pushbutton door switch. The cabinet lighting shall turn on when the cabinet main door is opened and shall turn off when the main door is closed or an ON/OFF NEMA rated, commercial quality, toggle switch mounted on the inside cabinet door service panel shall be provided to turn both LED lighting modules on or off.

907-632.02.2.3--Police Panel Switches. Police panel switches shall be provided with all controller cabinets. All switches shall be hard wired and labeled as to their function.

NORMAL-FLASH: When this switch is in the FLASH position, all signal indications shall transfer to the flashing mode. AC power shall be removed from the load switches when the signal indications transfer to the flashing mode.

The controller unit shall operate in accordance with appropriate specifications during the flashing mode. When the switch is placed in the NORMAL position, transfer from the flash mode to normal operation shall be made in accordance with uniform code flash requirements.

SIGNAL ON-OFF: AC power shall be removed from the signal heads and the intersection will become dark when this switch is in the OFF position.

MANUAL CONTROL ON-OFF: When this switch is in the ON position, a logic ground shall be applied to the manual control enable input of the controller unit.

INTERVAL ADVANCE INPUT JACK: A manual jack shall be installed on the police panel. The jack shall inter-mate with a 3-circuit, ¼-inch diameter phone plug. The tip and ring (middle) circuits of the jack shall be connected to the logic ground and the interval advance inputs of the controller unit. When the manual hand cord is plugged into the jack and the pushbutton is pressed, logic ground shall be connected to the interval advance input of the controller unit.

When specified in the contract documents, an interval advance cord shall be provided. The cord

shall have a minimum length of three (3) feet. It shall have a ¼-inch diameter, three circuit plug connected to one end and a manual pushbutton enclosed in a hand-held enclosure at the other end. A complete cycle (push-release) of the manual pushbutton shall terminate the controller unit interval which is active except the vehicular yellow and red clearance intervals. Cycling the push-button during the vehicular yellow or all red clearance intervals shall not terminate the timing of those intervals.

907-632.02.2.4--Service Panel Switches. Service panel switches shall be hard wired and clearly labeled to identify as to their functions. Service panel switches shall be mounted on the service panel located on the inside of the main cabinet door. Alternate switch locations may be described in the plans or contract documents but final switch design and location shall be approved by the Engineer prior to cabinet fabrication.

NORMAL-FLASH: When this switch is in the FLASH position, all signal indications shall transfer to the flashing mode. AC power shall be removed from the load switches when the signal indications transfer to the flashing mode.

The controller unit shall operate in accordance with appropriate specifications during the flashing mode. When the switch is placed in the NORMAL position transfer from the flash mode to normal operation shall be made in accordance with uniform code flash requirements.

CONTROLLER ON-OFF: When this switch is in the OFF position, AC power shall be removed from the controller. When this switch is returned to the ON position, the controller unit shall perform normal start up functions and resume normal operation in accordance with the applicable specification.

STOP TIME-RUN-NORMAL: A 3-position manual switch shall be provided which places the controller into Stop Time mode manually or through remote input.

VEHICLE DETECTORS: A 3-position switch shall be provided for each vehicle and pedestrian detector circuit. All switches shall be located on a panel mounted on the inside of the main cabinet door. The switch panel shall be labeled CALL SWITCH. Labeling of phase number and intended function (vehicles or pedestrian calls) shall be provided for each switch.

The vehicle detector switch functions are defined as follows:

Locked Call	Call is continually placed into the controller unit.
Off (center)	Vehicle detector is connected to the controller unit vehicle detector input, i.e. normal detector operation.
Momentary Call	Call is continuous as long as the switch is manually held in this position.

907-632.02.2.5--Police and Service Panel Locations. The police and service panels shall be constructed of 5052-H32 0.125-inch thick aluminum.

The police panel shall be located behind the police door which is enclosed within the main door.

The police door shall be hinged and provided with a neoprene gasket seal. Access to any portion or equipment contained behind the main cabinet door shall not be accessible through any part of the police panel. The police panel shall be of appropriate dimensions to accommodate all switch or devices described within this specification, the plans or contract document. The police door shall be provided with a treasury #2 key type lock and two (2) keys for the police door lock shall be provided with each cabinet.

The service panel shall be mounted on the inside portion of the main cabinet door, adjacent to the back side of the police panel or on the left hand side of the cabinet.

907-632.02.2.6--Cabinet Ventilation. Cabinets shall be vented to allow dissipation of the heat generated by the equipment contained within. All cabinets shall have a thermostatically controlled exhaust fan located at the top of the cabinet that is capable of 100 cubic feet per minute air displacement. The thermostat shall be mounted on the inside top of the cabinet and shall have a nominal temperature range from 80°F to 170°F.

The intake vent shall be louvered or equivalent design to prevent rain infiltration. The vent area will be located along the bottom portion of the cabinet door. A 16-inch x 12-inch x 1-inch disposable pleated air filter shall be provided on the inside portion of the cabinet and shall fully cover the vent area.

907-632.02.2.7--Air Filter Assembly. Air filters shall be one piece and shall be held firmly in place against the cabinet door in order to prevent dust from bypassing the perimeter of the filter and shall fully cover the vent area. Wing nuts or thumbscrews are preferred. Air filter shall be a 16-inch x 12-inch x 1-inch disposable pleated filter.

907-632.02.2.8--Cabinet Sizes.

907-632.02.2.8.1--Type I Cabinet. A Type I cabinet, 51"H x 30"W x 18"D, may be used for both pole and base mounted cabinets that require a maximum eight (8) position load bay. Pole mounted cabinets do not require rear access.

907-632.02.2.8.2--Type II Cabinet. A Type II cabinet, 51"H x 36"W x 18"D, may be used for both pole and base mounted cabinets that require a maximum twelve (12) position load bay. Pole mounted cabinets do not require rear access.

907-632.02.2.8.3--Type III Cabinet. A Type III cabinet, 56"H x 44"W x 27"D, shall be used for base mount installations and shall require a sixteen (16) position load bay and rear access door.

907-632.02.2.8.4--Type IV Cabinet. A Type IV dual chamber cabinet, 56"H x 57"W x 29"D, shall be used for base mount installations and shall require a sixteen (16) position load bay, rear access door, and external generator plug. When called for in the plans, a UPS shall be housed inside this cabinet.

907-632.02.2.8.5--Type V Cabinet. A Type V cabinet, 77"H x 44"W x 27"D, shall be used for base mount installations and shall require a sixteen (16) position load bay and rear access door.

907-632.02.3--Power Distribution Panel. The power panel shall be wired to provide the necessary power to all equipment. It shall be manufactured from 0.125-inch thick, 5052- H32 aluminum. The power panel shall house the following components: Main Breaker, Auxiliary Breakers, and Terminal Block. The panel shall be of such design so as to allow a technician to easily access the main and auxiliary breakers.

A 3-position terminal block with a removable insulated cover accepting up to AWG #4 stranded wire shall be supplied for accepting only the incoming power lines. This terminal block shall be in advance of and supply only the 30-amp main breaker, 10-amp and 5-amp Auxiliary breakers, AC neutral buss and earth ground buss.

907-632.02.3.1--Ground and Neutral Busbars. Cabinet grounding shall meet the requirements set forth in Subsection 722.09 for grounding and ground rods. A solid copper ground busbar shall be mounted on the side of the cabinet wall adjacent to the power panel for the connection of chassis ground wires. If more than one (1) ground busbar is used in a cabinet, a minimum of an AWG #6 copper wire shall be used to bond them.

The copper ground busbar shall have a minimum of thirteen (13) connector points, each capable of securing at least one (1) AWG #6 conductor.

A solid copper neutral busbar shall be mounted on the side of the cabinet wall adjacent to the power panel for the connection of AC neutral wires.

The copper neutral busbar shall have a minimum of thirteen (13) connector points, each capable of securing at least one (1) AWG #6 conductor.

907-632.02.3.2--Terminal Strips. Conductors shall be terminated on terminal strips with insulated terminal lugs. When two (2) or more conductors are terminated on field wiring terminal strip screws, a terminal ring lug shall be used for termination of those conductors. The voltage and current rating of terminal strips shall be greater than the voltage and current rating of the wire which is terminated on the terminal strip.

907-632.02.3.3--Cabinet Receptacles. A 3-wire 115 Volt AC (15A) Ground Fault Circuit Interrupt (GFCI) duplex receptacle shall be provided in the cabinet for maintenance use. It shall be securely mounted near the bottom right side of the cabinet and easily accessible.

Two (2) 3-wire 115 Volt AC (15A) non-GFCI protected outlets shall be installed, one on each side of the cabinet. These two (2) outlets are used for communication or other auxiliary equipment.

907-632.02.3.4--Operating Line Voltage. All equipment shall be designed to operate from a 120 volt, 60 cycle AC supply. Operation shall be satisfactory at voltages from 105 volts to 130 volts. All operating voltages into and out of the controller shall be NEMA level DC voltages except for the controller AC power source (Connector A, Pin p – AC-Control and Pin U – AC Common).

907-632.02.3.5--Circuit Breakers. Circuit breakers shall meet the requirements set forth in

Subsection 722.07. A 30-amp main breaker, with a minimum of 10,000 amp interrupting capacity, shall be provided for all cabinets to supply power to the controller, MMU, signals, and rack power supply.

Two (2) auxiliary breakers shall be provided. The first breaker, 10-amp, shall supply power to the fan, light, GFCI utility receptacle and two (2) auxiliary standard receptacles. The second breaker, 5-amp, shall be installed to supply power for the Controller Unit and MMU2. The above circuit breakers line side shall be jumpered together and will be fed from an external main circuit. A third 5-amp breaker shall be required if an ITS camera panel is called for in the plans.

907-632.02.3.6--Main Line Arrestors. Surge protection shall be provided that meets the requirements set forth in Subsection 722.12. A main line arrestor shall be provided to reduce the effects of voltage transients on the AC power line. It shall be installed after the circuit breaker. The main line arrestor shall be sufficient to protect all equipment and devices as per the plans and the following minimum specifications.

- Multi-stage Hybrid Design
- Series induction filtering
- Thermally protected Metal Oxide Varistors (TMOV's)
- Operating Voltage: 120 VAC
- Clamping Voltage: 395 VAC
- Operating Current: 15 A
- Peak Surge Current: 50 kA/Mode, 100 kA/Phase
- Operating Frequency: 47-63Hz
- EMI Attenuation: 40 dB Typ
- SPD Technology: TMOV's w/ W-C Filter
- Modes of Protection: L-N, L-G, N-G
- Status Indication: Power On & TMOV's Functional
- Connection Type: ¼-20 Stainless Steel Stud
- Operating Temperature: -40°F to +185°F

907-632.02.3.7--Solid State Main Line Relay (SSR). A normally-open, 75-amp, hybrid SSR shall be provided on the power distribution panel. The relay shall include a LED indicator to verify circuit power.

907-632.02.4--Terminal Facilities Board. The Terminal Facility shall be a hardwired load bay for NEMA TS 2 Type 1 actuated controllers. The load bay shall include either eight (8), twelve (12) or sixteen (16) load switch positions, as specified by the plans, and shall be centered along the back of the cabinet below the bottom shelf.

All wires terminated behind the backboard, as well as any additional panels, shall be soldered. No pressure or solderless connectors shall be used, unless they are soldered to the wire and tab after connection.

907-632.02.4.1--Load Switches and Flashers. Solid State Load Switches, compatible with low

wattage LED signals, shall be provided for the sequence called for on the plans. The load switch sockets shall be wired for triple-signal load switches conforming to NEMA TS 1-1994 and NEMA TS 2-2003 requirements.

The flasher socket shall be wired for and provided with a Type 3, two (2) circuit Solid State Flasher conforming to NEMA TS 1-1994 and NEMA TS 2-2003 requirements. It shall be possible to flash either the amber or red indication on any load switch outputs. It shall be possible to easily change the flash indication from the front side of the panel using readily available tools such as a screwdriver. A nominal flash rate of 50 to 60 FPM shall be provided. Flash rate shall be stable when used with generators or inverters.

Support(s) shall be provided to support the Flasher and Load Switches at some point approximately half of the total length from the panel surface. Sufficient area beneath the Load Switch or Flasher shall be clear in order to allow for free flow of air across the Load Switches or Flasher. Load Switches and Flashers must be provided with LED indicator lights on the side facing the cabinet door.

907-632.02.4.2--Flash Transfer Relay. All flash transfer relays, as a minimum, shall meet NEMA TS 1 requirements. The number of relays that shall be supplied with each cabinet shall accommodate the number of signal phases as indicated in the project plans. The coil of the flash transfer relay must be de-energized for flash operation.

907-632.02.5--Cabinet Wiring. Controller cabinets shall be wired in accordance with the signal phasing plans. If phases are indicated as omitted for future use, or if phases are not shown to be used in the plans, the cabinet shall be wired for use of the phases shown as future or unused. Load Switches shall not be provided for future or unused phases.

Wiring in the cabinets shall conform to the requirements of the National Electrical Code (NEC) and all of these specifications. All conductors in the cabinet shall be stranded copper. All wiring shall be laced. All wiring shall be in accordance as specified by Section 636 and Subsection 722.03 for Electric Cable and IMSA Specification 19 and/or 20 for Signal Wiring.

Connector harnesses for controller, conflict monitor, vehicle detectors, and accessory equipment (including NEMA defined Card Rack with power supply and pre-wired optical detection slots) shall be provided and wired into the cabinet circuitry. Connecting cables for controller and conflict monitor harnesses shall be sleeved in a braided mesh. All wires shall be securely terminated on terminal strips. The lay of the interconnect cable between the components must be such that when the door is closed, it does not press against the cables or force the cables against the various components inside the cabinets.

All communication wiring shall be bundled and routed independently of all other wiring. All live conductors shall be covered with suitable insulating material. All equipment grounds shall run directly and independently to the grounding bus.

All wires shall be cut and terminated as close as possible to the proper length before assembly. Consideration of equipment location adjustments must be made when determining appropriate

wire lengths. Excessive lengths of wire or cable shall not be allowed. All line voltage conductors used in controller cabinet shall conform to the following color code:

AC Neutral: White
AC Hot: Black
Safety Ground: Green

907-632.02.5.1--Signal Terminal Arrestor Grounding Bar. A field terminal arrestor grounding bar shall be provided along the back portion of the cabinet for the installation of signal arrestors. This bar shall be attached using an AWG #10 stranded copper to the earth ground circuitry.

907-632.02.5.2--Signal Terminal Arrestors. The field terminal arrestor shall be a three (3) circuit protective device intended for use on traffic control load relay outputs. The arrestor shall be furnished with three (3) leads and a grounding stud which will be used to attach the arrestor to the grounding bar. The field terminal arrestor shall meet the following minimum specifications:

- Operating Voltage: 120 VAC
- Clamping Voltage: 475 VAC
- Peak Surge Current: 10 kA
- Operating Frequency: 47 – 63 Hz
- SPD Technology: MOV's
- Connection Type: Wire Leads
- Lead Wire: 14 AWG 12" Length
- Ground Stud: 10 x 32 5/8" Length
- Operating Temperature: -40°F to +185°F

907-632.02.6--Accessory Components.

907-632.02.6.1--Traffic Actuated Controller Unit. The fully actuated controller unit shall, at a minimum, meet the requirements of both NEMA TS 1–1989 and NEMA TS 2-2003 requirements for actuated controller units. The controller shall be of the TS 2 Type 2 configuration. The controller shall be provided with the multiple communication interface devices or properties as defined below.

- 10 Base-T Ethernet with front panel RJ-45 connector
- IEEE defined MAC address
- EIA-232 port
- External Serial Fiber options for both single and multi-mode (optional as per plans)
- External FSK 1200 bps modem (optional as per plans)
- D connector with 37 pin configuration for TS 1 compatibility
- USB port for signal controller database upload/download to the controller flash
- Controller
- ECOMM Compatible

The controller unit must have an alphanumeric backlit LCD display with a minimum of sixteen

(16) lines at 40 characters per line. The controller must be air-cooled with sufficient ventilation openings and capable of operating between -30°F and 165°F. The controller unit must be provided with a time-of-day clock, automatic daylight savings time adjustment and a power supply for maintaining SRAM during a power outage. The controller unit shall be capable of being used in a Closed-Loop System and must be capable of operating in the role of master controller in a Closed Loop System. The controller unit firmware shall be fully compatible with the Department's existing Traffic Signal Management Software. The Contractor shall ensure all controller firmware versions are compatible with the existing Traffic Signal Management Software that the Regional Department staff currently utilizes prior to submitting the controller for approval. The Contractor shall notify the Department if any special controller configuration or firmware is needed prior to submitting the controller for approval based on project requirements.

Where Flashing Yellow Arrow (FYA) operations are being used, all traffic signal controller firmware shall be capable of delaying the onset of the flashing yellow arrow.

All operator entered data shall be stored and backed up on to a flash memory device provided with the controller unit at no cost. This flash memory device shall require no battery to support value storage. No internal components of circuitry shall require battery support. The database shall be able to be backed up to a USB drive via the USB drive on the controller.

Traffic Actuated Controllers shall be of the Type shown on the plans. Type 1 Controllers shall have a Linux based processor and a minimum of one (1) USB port. Type 2 Controllers shall have the same features as Type 1 Controllers with the addition of an ATC backplane.

Type 3 Controllers shall have all features of the Type 2 Controller with the addition of the ATC module. All three (3) types of actuated controllers shall have Master controller capability, and if required shall be designated with 'M' in the plans.

907-632.02.6.2--Closed Loop Master Controller Unit. When called for in the plans, this work also consists of furnishing, installing and configuring the equipment, software and accessories necessary to connect one (1) traffic Closed-Loop Master Controller to its corresponding central or portable PC-based Traffic Computer Facility Control System via a communications connection. The communications or network connection device will be either existing or provided by the Contractor.

907-632.02.6.2.1--General. The Master shall monitor intersections in the system, display status and operational state and provide traffic flow data from intersection vehicle detectors. The Master shall include all communications equipment and software necessary to provide reporting to a remote terminal as well as upload/download of all local intersection data and provide timing synchronization. Communications to local controllers from the Master and from the Master to the central-office computer facility shall be by FSK, 900 MHz Radio, Broadband Radio, Serial Fiber, Ethernet, Fiber, Cell Modem or Leased Line, as indicated in the plans. The Master shall be able to run on the same controller simultaneously operating the intersection, with the local signal control software, on any given controller unit.

907-632.02.6.2.2--System Configuration. The system architecture shall be designed to minimize

the effect of equipment failures on system operation and performance. The system consists of four (4) principal elements:

- Local System Intersection Controllers
- Communication (Telemetry Links)
- On-Street Master(s)
- Central-Office Computer Software

907-632.02.6.2.3--Local System Intersection Controller. The local system intersection controllers connected to the Master controller unit shall be capable of controlling a fully actuated two (2) to sixteen (16) phase intersection and shall meet or exceed NEMA TS 1-1989 and TS 2-2003 standards for fully actuated traffic control units. The local controller shall have internal communication capability with direct access to the data memory. The local system controller shall be capable of processing controller and detector data and provide all necessary intersection control functions. The local system intersection controller shall meet the requirements of the Traffic Actuated Controller Unit.

907-632.02.6.2.4--Communications (Telemetry) Links. The communications links for the "Closed-Loop" System shall perform the following functions:

- Provide the medium (radio/fiber/hardwire/etc.) for two-way communications between the On-Street Master and the local intersection controllers.
- Provide the medium for two-way communication between the On-Street Master and the central-office computer facility.
- Error checking shall be included in both mediums to assure transmission and reception of valid data.

907-632.02.6.2.5--On-Street Master. The On-Street Master may be located at an intersection and connected via the communication network to at least 32 local intersection controllers. The Master shall be capable of implementing Traffic Responsive Control, Time Base Control, Manual Control or Remote Control modes of operation.

Analysis of sampling sensor data from at least 64 system detectors and corresponding selection of the best Traffic Responsive timing pattern shall be provided by the On-Street Master during the Traffic Responsive mode of operation.

Automatic and continuous monitoring of system activity shall be provided by the On-Street Master to include both Master and intersection alarm conditions.

System parameter entry shall be provided via the On-Street Master including all Master and local intersection assignment and group parameters. Master parameters shall include:

- System coordination setup and pattern data entry by group
- System time base event scheduler
- System traffic responsive computational and pattern selection setup by group
- Intersection system group and detector assignments

The On-Street Master shall provide comprehensive system report generation including, as a minimum: system, intersection, detector and failure status and history reports in addition to system performance reporting.

A RS-232C interface shall be provided on the On-Street Master to allow for printing of reports or for interconnecting to a remote central site.

To enhance overall system operation and increase system management flexibility, the On- Street Master shall also support two-way dial-up communications to a central office computer for control, monitoring, data collection and for timing pattern updating purposes, all from a remote central office location. Continuous, seven (7) days/week - 24 hours/day, system monitoring shall be enhanced by the On-Street Master's capability to automatically dial-up the central office computer upon detection of user defined critical alarm conditions.

907-632.02.6.2.6--System Functional Requirements.

907-632.02.6.2.6.1--Operator Interface. In order to provide ease in programming and operation, the system shall provide a simplified user-friendly menu format at each local, master and central office facility. No special programming skills shall be required for the user to fully access and operate this control and monitoring system at any level.

All programming, both of the local intersection controllers and the On-Street Master(s) shall be via a front panel keyboard and display, driven by English Language menus. All data change entries will be automatically verified against established ranges prior to acceptance to prevent programming data errors. Data access shall be controlled by user- definable access controls.

907-632.02.6.2.6.2--System Traffic Control. The system shall have the capability of controlling a minimum of sixteen (16) vehicle phases and eight (8) pedestrian phases. The system shall have the capability of implementing a minimum of four (4) timing rings, fifteen (15) alternate sequences, and sixteen (16) offsets.

The system shall provide the capability of selecting any of the following operational modes on a group basis:

- Traffic Responsive
- Time Base (Time-of-Day/Day-of-Week)
- Remote (External Command)
- Manual (Operator Entry)

The system shall be capable of implementing system FLASH and system FREE operation. The system shall have the capability to command, on/off based on time, up to eight (8) independent special functions.

907-632.02.6.2.6.3--Detectors. The system shall have the capability of accepting and processing data from at least 632 system detectors for Traffic Responsive program selection.

907-632.02.6.2.6.4--Pattern Selection. In addition to providing Manual and Remote program selection capability, the Master shall provide for Traffic Responsive and Time Base modes of operation for timing pattern selection.

907-632.02.6.2.6.4.1--Traffic Responsive Mode. Traffic plan selection in the Traffic Responsive mode shall be user-enabled and supplied with the controller, per the plans and specifications. The pattern selection shall be based on sampling detector volume and occupancy analysis by the On-Street Master.

907-632.02.6.2.6.4.2--Time Base Mode. The system shall provide the capability of implementing time-of-day, day-of-week and week-of-year control for each of the two (2) groups using an internal time clock referenced to the 60-Hz AC power line frequency for its time base. The Time Base mode shall contain automatic adjustment for leap year and daylight savings time changes.

The system Time Base mode shall provide, as a minimum, 100 events each capable of requesting any of the 48 traffic control patterns along with Traffic Responsive override enable or auxiliary events consisting of enable/disable any of up to four (4) system-wide special functions and setting sample and log interval time periods.

907-632.02.6.2.6.5--System Control Priority. The system coordination control (program-in-effect) for each group shall be selected on a priority basis. The priority from highest to lowest shall be as follows:

- Manual Control Entry
- External Control (Remote Command)
- Time Base Control (Time-of-Day/Day-of-Week) (Traffic Responsive control will prevail whenever Traffic Responsive Override Enable is active and the selected cycle length is greater than that being commanded by Time Base)
- Traffic Responsive Control

907-632.02.6.2.6.6--Measures of Effectiveness. The system shall have the capability to report selected Measures of Effectiveness (MOE's) on an intersection basis. MOE calculations shall be made on all phases by the local system intersection controller and as a minimum shall include measures such as: volume, number of stops, delays and green utilization. These measures shall be calculated on the basis of the active timing plan. Alternate ways of reporting MOE'S may be approved on a case-by-case review.

907-632.02.6.2.6.7--Uploading and Downloading. The system shall provide, for any selected local system intersection controller, the capability of uploading and downloading any or all, new or modified local intersection parameters from the central-office computer and the Department Central Traffic Signal Management Software, and shall include, as a minimum, all: Phase Timing and Unit Data; Coordination Data, Time Base Data; Preemption Data, System Communication Parameters, System Traffic Responsive Data, and any other System Data residing at the intersection such as Detector Diagnostic Values, Report Parameters and Speed Parameters.

During either uploading or downloading operations, normal traffic control operations shall not be suspended. All data shall be continually accessible and may be displayed at the On- Street Master or the central office computer.

907-632.02.6.2.6.8--System Monitoring and Diagnostics. The system shall automatically and continually monitor system activity and log/report occurrences of Master and intersection alarm conditions. All alarm condition events shall include at the intersection, (Master and central-office computer) an alpha-numeric description of the event as well as the time and date of occurrence.

As a minimum, monitored master alarms conditions shall include:

- Insufficient or Improper Data
- Failed Computational Channels
- Failed System Detectors
- Intersection Communication Failure
- Failed Controllers
- Minimum of six (6) special user defined alarms for user application flexibility
- Monitored intersection alarms conditions shall include as a minimum:
- Cycle Faults and Failures
- Coordination Failures
- Voltage Monitor
- Conflict, Local and Remote Flash Conditions
- Preempt
- Local Free
- Minimum of six (6) special user defined alarms for additional user flexibility.

When the Master detects a critical alarm condition, as defined by the user, it shall automatically dial-up the central office computer and report the condition. On a BUSY or NO ANSWER, the system may be programmed, at user option, to alert a secondary computer.

The system shall also automatically and continually monitor, verify and attempt to correct Sync Pulse, Time Base Clock and Pattern-In-Effect. The system shall provide capabilities to perform diagnostics on system and local detectors, communications and intersection operations. When a fault has been detected, an indication shall be provided. It shall be possible to isolate the fault to the failed unit from controls and indicators available on the Master unit. Auxiliary equipment such as a data terminal or CRT shall not be required to identify the failure.

907-632.02.6.2.6.9--Real Time Display. The Master shall provide for any selected local system intersection controller, real-time status information on its front panel. Real-time intersection status information shall include simultaneous display of: vehicle and pedestrian signal and detector status by phase, overlap signal status and cars waiting count by phase. Real-time controller status information shall include simultaneous display of: two (2) Ring Active timers, On/Next, Call/Recall and Hold/Omit Status by phase, Coordination, Preempt and Stop Time Status.

907-632.02.6.2.6.10--System Management. The system, without hardware changes but with its

ability to directly modify Master and intersection parameters, shall provide the user system configuration and operational controls of the following functions: add/delete controllers and system detectors, enable Traffic Responsive mode, assign intersections to groups, assign system detectors to computational channels and channels to pattern select routines, and assign special and/or standard detectors as system detectors for use with computational channels or to track activity.

907-632.02.6.2.6.11--System Logging and Reports. The system shall automatically and continually process system data and log/report on occurrence of changes in intersection status, system detector status, communications status, controller status and local detector status in addition to system program changes, Traffic Responsive computations, measures of effectiveness and performance.

907-632.02.6.2.6.12--Security. The On-Street Master shall provide for a user-specified security code entry before any data may be altered. In order to view any parameter, security code entry shall not be required. Security access shall be automatically rescinded approximately ten (10) minutes after either access was gained or the last parameter change was entered. The Master and local controller shall have the ability via keyboard to disable security code requirements, allowing for perpetual access without requiring hardware changes.

907-632.02.6.2.7--Design Characteristics. The On-Street Master shall be designed to operate in either an office or field environment and shall be suitably housed in a separate enclosure or in a local intersection cabinet. The Master shall be designed to meet the following electrical and mechanical requirements:

907-632.02.6.2.7.1--Programming and Security. Operator programmable data entry shall be accomplished through panel keyboard(s). The Master shall prevent the alteration of keyboard set variables prior to the user having entered a specific access code through the keyboard. The Master shall maintain user-programmable variables in non-volatile memory with a battery-backed RAM to assure continued efficient system operation.

907-632.02.6.2.7.2--Test and Repair. To enhance maintenance and trouble-shooting activities, On-Street Masters shall include resident diagnostics as a standard. No extender- cards, special tools or PROMs shall be necessary to fully maintain these components. The Master unit design shall ensure that all printed circuit boards be readily accessible for maintenance testing purposes. All fuses, connectors and controls shall be accessible from the front of the Master unit.

907-632.02.6.2.8--Traffic Signal System Software. All Traffic Signal System Software shall be compatible with the latest version of the Department's existing Master and local controllers and existing Traffic Signal Management Software for the Department region.

907-632.02.6.2.8.1--Traffic Signal Closed Loop Software. The Traffic Signal Closed-Loop Software shall provide the ability to manage Master and local controller databases including the uploading and downloading of data parameters. The software shall provide status information and provide reporting capabilities for Master and local controller data, alarms and logs.

907-632.02.6.2.8.2--Traffic Signal System Workstation Software. The Traffic Signal System Workstation shall provide the ability to manage Master and local controller databases including the uploading and downloading of data parameters. The software shall provide status information and provide reporting capabilities for Master and local controller data, alarms and logs.

The Traffic Signal System Workstation Software shall also be capable of operating as a network-connected user workstation to existing centralized signal systems and their associated databases.

When disconnected from the centralized signal system, the software shall be capable of running as a standalone system similar to the Closed-Loop Software. Under this mode, the software shall provide management, report and status functions for Master and local controllers. Under Standalone Mode of operation the software shall allow for its own database(s) for data management without the need for connecting to a centralized signal system database.

907-632.02.6.2.9--Services. Technical services shall be provided, as required, to assist in installation and initial setup of the Closed-Loop Master System and its sub-components. Technical assistance with database migration and/or setup, as well as the development of graphics (such as master maps and local intersection depictions) and the assignment of associated attributes such as detectors, phasing, signals, etc., shall be provided as required. Additionally, training shall be provided on a basic or advanced target user level, as required.

907-632.02.6.3--Malfunction Management Unit (MMU2). The Malfunction Management Unit (MMU2) shall be a shelf-mountable, sixteen (16) channel, solid-state, IP addressable MMU. The MMU2 shall accomplish the detection of, and response to, improper and conflicting signals and improper operating voltages in a traffic signal controller assembly, including support for four (4) section Flashing Yellow Arrow (FYA) left turn displays. The MMU2 shall be capable of running a minimum of twelve (12) different modes of FYA operation.

The MMU2 shall meet or exceed Section 4 requirements of the NEMA Standards Publication No. TS 2-2003 including NEMA TS 2 Amendment #4-2012 and provide downward compatibility to NEMA Standards Publication No. TS 1-1989: Type 12 Operation, in addition to those specifications set forth in this document.

The MMU2 shall include a graphics based Liquid Crystal Display (LCD) to view the current monitor status and navigate the unit's menus. An RJ-45 Ethernet Port shall be provided for communications.

A built-in Diagnostic Wizard shall be provided that displays detailed diagnostic information regarding the fault being analyzed. This mode shall provide a concise view of the signal states involved in the fault, pinpoint faulty signal inputs and provide guidance on how the technician should isolate the cause of the malfunction. The Diagnostic Wizard shall be automatically invoked when the MMU2 is in the fault mode and the HELP button is pressed. It shall also be automatically invoked when the MMU2 is in the Previous Fail (PF) event log display and the HELP button is pressed.

A built-in Setup Mode shall be provided that automatically configures the Dual Indication Enable, Field Check Enable, Red Fail Enable and Minimum Yellow Plus Red Clearance Enable parameters from user input consisting only of channel assignment and class (vehicle, ped, pp-turn, FYA, etc.) responses.

The MMU2 shall be capable of operating in the Type 12 mode with SDLC communications enabled on Port 1. The Channel Status display shall operate in the Type 12 configuration and provide the Field Check function for up to four (4) Pedestrian Walk inputs.

In the interest of reliability and repair ability, printed circuit board mounted MS connectors shall not be acceptable. Internal MS harness wire shall be a minimum of nineteen (19) strand AWG 22 wire.

907-632.02.6.4--NEMA defined Card Rack and Power Supply. A minimum of one (1) NEMA compliant detector card rack with five (5) slot positions (first slot for power supply and four (4) available slots) shall be provided in each cabinet. The detector rack shall be installed on the bottom shelf of the cabinet. The power supply for the NEMA defined card slots shall be provided as a 175W minimum with four (4) independent regulated channels of 24 VDC each rated at 0.75 amps over the full NEMA operating temperature range of -30°F to +165°F. The output should be regulated to 24 VDC +/- 15%. Each of the four (4) outputs shall be independently fused, each with a separate LED for displaying output and fuse status for each of the four (4) outputs. Each of the four (4) outputs shall be protected against voltage transients by a minimum 1500 watt suppressor. All card racks shall be wired for the type detection shown in the plan sheets.

Card Guides shall be provided on the top and bottom of the card rack for each connector position.

907-632.02.6.5--In-Cabinet Network.

907-632.02.6.5.1--Communications Arrestor. The Controller Cabinet network shall consist of an SDLC connection between the Controller Unit and MMU2. Surge suppression for this network shall meet the requirements set forth in Subsection 722.12 and the following minimum requirements below:

- Operating Voltage: 5 VDC
- Clamping Voltage: 8 VDC
- Operating Current: 1.5 A
- Peak Surge Current: 47 A (10x1000 μs)
- Frequency Range: 0 to 20 MHz
- Insertion Loss: < 0.1 dB at 20 MHz
- SPD Technology: SAD
- Connection Type: DB-15
- Operating Temperature: -40°F to +185°F

907-632.02.6.6--System Communications.

907-632.02.6.6.1--Traffic Signal Ethernet Switch. When specified in the plans or contract

documents, a traffic signal Ethernet switch shall be installed in the cabinet assembly. It shall meet the requirements for the type specified in Section 907-663. Ethernet patch cables of sufficient length shall be provided for all supplied Ethernet ready cabinet components. The switch and all components shall be connected and configured.

907-632.02.6.6.2--Fiber Optic Patch Panel. When specified in the plans or contract documents, fiber optic attenuator patch cords shall be installed in the cabinet assembly as specified in Section 907-661.

907-632.02.6.6.3--Wireless Communications. When specified in the plans or contract documents, wireless communication components shall be installed in the cabinet assembly and shall be as specified in Section 907-662.

907-632.02.6.6.4--Serial Port Server or Terminal Server. When specified in the plans or contract documents, serial port servers shall be installed in the cabinet assembly and shall be as specified in Subsection 907-663.02.2.

907-632.02.6.6.5--GPS Clock. This work includes furnishing a Global Positioning System (GPS) Synchronization clock that can be used to sync the internal clocks in traffic signal controllers when coordination is desired, but communication is not necessary. The GPS Clock System shall provide GPS based time and date synchronization to provide coordination of traffic controllers to a common time base. The system shall process GPS Time data using a tamper/vandal resistant GPS antenna and correct for Time Zone, Daylight Savings Time, Leap Years, and GPS Leap Seconds. The processed time information shall be sent to the traffic controller in the native format for the respective controller. A contact closure synchronization pulse with variable pulse width shall be available for a once per day update. If the GPS antenna is blocked for up to one (1) hour prior to scheduled time of synchronization, the system shall synchronize the traffic controllers with less than 0.4 seconds variance from the accuracy provided under normal operation with GPS satellites in view.

- The GPS Clock shall also meet the following minimum specifications:
- Input Voltage: 9-24 VDC
- Current Draw: 150 mA (max) at 12 VDC: 125 mA (max) at 24 VDC
- Contact Closure: 750 mA at 30 VDC
- Temperature Rating: -29.4°F to +167°F

GPS unit shall be mounted to the traffic signal controller cabinet as per the manufacturer's recommendation. Any and all holes created in the cabinet for the purpose of mounting the GPS unit shall be sealed to the satisfaction of the Engineer at no direct pay.

907-632.02.6.6.6--Power-Over-Ethernet Arrestor. Surge suppression that meets the requirements set forth in Subsection 722.12 shall be provided. In addition, the following minimum specifications shall be supplied for loads that require Power-Over-Ethernet with isolated shielded or non-shielded cable:

- Operating Voltage: 48 VDC
- Clamping Voltage: 68 VDC
- Operating Current: 0.75 A per Pin Continuous
- Peak Surge Current: 10 kA
- Insertion Loss: < 0.1 dB
- SPD Technology: GDT, SAD, with series PTC
- Modes of Protection: All Lines (1-8) Protected (L-L) and (L-G): Signal High- Low; High-Ground; Low-Ground
- Transmission Speeds: 10BaseT; 100BaseT; 1000BaseT
- Connection Type: RJ-45
- Operating Temperature: -40°F to +185°F

907-632.02.7--Detector Panel. A vehicle detector harness shall be provided to connect the detector panel to the card rack. The detector panel shall accept the connection of sixteen (16) field loop inputs and four (4) pedestrian detector inputs.

907-632.02.7.1--Detector Input Arrestors. Field Loop and Pedestrian input arrestors shall meet the requirements set forth in Subsection 722.12. Field loop arrestors shall have differential and common mode protection and be provided with the following minimum specifications:

- Operating Voltage: 75 VDC
- Clamping Voltage: 130 VDC
- Peak Surge Current: 250 A
- SPD Technology: Silicon Break-Over
- Operating Temperature: -40°F to +185°F

Pedestrian input arrestors shall be a four (4) circuit device provided with the following minimum specifications:

- Operating Voltage: 30 VDC
- Clamping Voltage: 36 VDC
- Operating Current: 0.15 A
- Peak Surge Current: 10 kA (8 x 20 μs)
- Frequency Range: 0 to 20 MHz
- Insertion Loss: < 0.1 dB at 20 MHz
- SPD Technology: GDT, SAD, with Series PTC
- Connection Type: Terminal Block with compression lugs; Terminals accept up to
- 10 AWG
- Operating Temperature: -40°F to +185°F

907-632.02.8--System Detectors. The controller shall have the ability to receive input data from up to eight (8) special system detectors in addition to the normal actuated controller unit phase detectors. The user shall have the option to assign any of the phase detectors as "system detectors".

907-632.02.9--Preemption. The cabinet shall be completely wired to accept and service calls from preemption phase selector modules, associated optical detector units and GPS units. Optical detector units and GPS unit cabinet components shall be as specified in Section 639. Provision for two (2) standard card modules shall be accommodated in a separate card rack for preemption. The preemption card rack shall provide a minimum of eight (8) channels.

Provisions shall also be made in the cabinet to accommodate Railroad Preemption when specified in the plans or contract documents. Railroad Preemption shall meet the requirements set forth in Section 639. While it is not necessary that a Railroad Preemption interface board be provided with the cabinet, the cabinet and back panel shall be designed so that a Railroad Preemption interface panel that uses a relay to isolate the track switch from the controller cabinet circuitry can be installed. Preempt 1 and 2, in the case of gate down preemption, shall be reserved for Railroad Preemptions; all subsequent preemptions shall be reserved for Emergency Vehicle, Fire Station, or Police Preemption.

907-632.02.10--Uninterruptable Power Supply. When specified in the plans or contract documents an Uninterruptable Power Supply (UPS) System shall be installed in the cabinet assembly. The UPS shall be installed in the cabinet and meet the requirements set forth in Section 633.

907-632.02.11--Power Service Pedestal. A Power Service Pedestal shall be provided as described in Section 631.03.2.

907-632.03--Construction Requirements.

907-632.03.1--Mounting. Traffic Signal Cabinet Assemblies shall be wall or pole mounted, base mounted on a concrete cabinet pad, or base mounted using a composite enclosure as specified below and as shown in the plans.

Power Service Pedestal shall be base mounted on a concrete cabinet pad or on a composite enclosure as specified below and as shown in the plans.

907-632.03.1.1--Wall or Pole Mounted. Wall or pole mount hardware shall be provided for mounting cabinets in specific installations as indicated in the design plans. Wall or pole mounted cabinets shall be manufactured with rigid tabs, rigid brackets or other acceptable configuration for attachment of the cabinet to the wall or pole support. Rigid attachment devices must allow for field alignment of cabinet to the wall or pole support.

907-632.03.1.2--Concrete Cabinet Pad. Concrete foundations shall be constructed of Class B concrete in specific installations as indicated in the design plans.

Cabinets for installation on a concrete base shall be manufactured with rigid tabs, rigid brackets or other acceptable configuration for attachment of the cabinet bottom to its flat support structure. Rigid attachment devices must allow for field alignment of cabinet with the support base. Concrete base construction details shall be provided in the design plan drawings.

907-632.03.1.3--Composite Enclosure. Cabinets for installation on a composite enclosure base shall be manufactured with rigid tabs, rigid brackets or other acceptable configuration for attachment of the cabinet bottom to its' flat support structure. Rigid attachment devices must allow for field alignment of cabinet with the composite enclosure. Composite enclosure attachment details shall be provided as shown in the plans.

907-632.03.2--Documentation. Documentation packages shall be delivered for each unit at the same time as the equipment to which it pertains.

A minimum of two (2) sets of complete schematic drawings and equipment documentation shall be supplied with each cabinet. The first copy shall be placed in a clear re-sealable print pouch of sufficient size to accommodate one (1) complete set of folded cabinet prints and placed in the pull-out drawer of the cabinet and the second copy shall be provided to the Department. Comprehensive controller data shall be included as part of the cabinet documentation package and shall be placed in the cabinet drawer pouch. Digital copies of all cabinet documentation shall be provided to the Department before final acceptance.

The documentation packages shall contain a schematic wiring diagram of the controller cabinet assembly and all auxiliary equipment. The schematic wiring diagram, including a symbols legend, shall show in detail all integrated circuits, transistors, resistors, capacitors, inductors as well as switches and indicators. All parts shown shall be easily identified on both in the cabinet and on the schematic diagram. Model numbers shall be used on schematic diagram when available.

A complete physical description of the signal cabinet assembly shall be provided to include at least the physical dimensions of the unit, weight, temperature ratings, voltage requirements, power requirements, material of construction, and complete performance specifications.

A complete set of operation guides, user manuals, and performance specifications shall be provided.

Detailed programming instructions, preventative maintenance requirements, and troubleshooting procedures shall also be provided for the controllers. These documents shall fully cover all programming procedures and programmable options capable of being made to the controllers and associated traffic control equipment. Instructions for modifications within the range of the capabilities of the unit such as changes in phases or sequences and programming matrix boards shall be included.

An intersection diagram shall be provided on the cabinet door showing geometric configuration, lane use assignments, controller cabinet and signal pole locations, vehicle and pedestrian signal head locations, vehicle and pedestrian detector zone locations, ring-barrier phasing diagram, and detector channel assignments. The intersection diagram shall be labeled with, at a minimum, a North Arrow, main street name(s), side street name(s), signal pole numbers, vehicle and pedestrian head type(s), detector zone designations, volume density and phase recall requirements, flash sequence. All field wires within the cabinet shall be labeled to coincide with those shown on the intersection diagram.

907-632.04--Method of Measurement. Traffic Signal Cabinet Assembly will be measured as a unit per each.

Remove and Replace Existing Traffic Signal Cabinet Assembly will be measured as unit per each.

Modify Existing Traffic Signal Cabinet will be measured as a unit per each.

Solid State Traffic Actuated Controller, of the type specified in the project plans, will be measured as a unit per each.

Signal Software License, of the type specified in the project plans, will be measured as a unit per each.

Malfunction Management Unit, of the type specified in the project plans, will be measured as a unit per each.

Card Rack, of the type specified in the project plans, will be measured as a unit per each.

GPS Clock, as specified in the project plans, will be measured as a unit per each.

Power Service Pedestal, as specified in the project plans, will be measured as a unit per each.

All pay items shall be inclusive of all materials, work, system integration, testing and incidentals necessary for a complete and operable unit in place and accepted. All removal, turn on, and acceptance of equipment, devices, traffic signals, and traffic signal assemblies shall follow Section 631 - Traffic Signal Systems-General prior to payment.

907-632.05--Basis of Payment. Traffic Signal Cabinet Assembly, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for furnishing, installing, configuring, wiring, testing, and mounting foundation construction, cabinets, relays, terminals, circuit breakers, modules, coordination and time base control programs, connectors wiring, overlap equipment, load switches, power cables, power supplies, controller mechanism and housing, MMU2, mounting material, all other materials, and all equipment, labor, tools, and incidentals necessary to complete the work.

Remove and Replace Existing Traffic Signal Cabinet Assembly, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for furnishing, installing, configuring, wiring, testing, cabinets, relays, terminals, circuit breakers, modules, coordination and time base control programs, connectors wiring, overlap equipment, load switches, power cables, power supplies, controller mechanism and housing, MMU2, mounting material, all other materials, removal, disposal, transfer, storage, and/or resetting of components that are existing, all other components included in the traffic signal cabinet, and all equipment, labor, tools, and incidentals necessary to complete the work.

Modify Existing Traffic Signal Cabinet, measured as prescribed above, will be paid for at the

contract unit price per each, which price shall be full compensation for furnishing, installing, configuring, and mounting all components, wiring, and devices; rewiring, reconfiguring, removal, disposal, transfer, storage, and/or resetting of existing components and devices, installing or changing coordination and time base control programs in the traffic signal cabinet assemblies, testing, final cleanup, all equipment, labor, tools, and incidentals necessary to complete the work.

Solid State Traffic Actuated Controller, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for all labor, equipment, tools, materials inclusive of the controller mechanism(s) and housing(s), all power cables, power supplies, wiring, factory and manufacturing inspection, attachment hardware, testing, storage, packaging, shipping, warranty, and all work, equipment, and appurtenances, and all incidentals necessary to provide a fully functional traffic controller ready for use. It shall also include all documentation including operations and maintenance manuals and other material necessary to document the operation of the traffic controller.

Signal Software Licenses, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for all labor, equipment, tools, materials inclusive of furnishing, installing and configuring the Signal Software, all power cables, power supplies, wiring, factory and manufacturing inspection, testing, storage, packaging, shipping, warranty, appurtenances, and all incidentals necessary to provide fully functional Signal Software ready for use. It shall also include all documentation including operations and maintenance manuals and other material necessary to document the operation of the Signal Software.

Malfunction Management Unit, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for all labor, equipment, tools, materials inclusive of furnishing, installing and configuring the Malfunction Management Unit (MMU2), all power cables, power supplies, wiring, attachment hardware, factory and manufacturing inspection, testing, storage, packaging, shipping, warranty, and all work, equipment, and appurtenances, and all incidentals necessary to provide a fully functional Malfunction Management Unit (MMU2) ready for use. It shall also include all documentation including operations and maintenance manuals and other material necessary to document the operation of the Malfunction Management Unit (MMU2).

Card Rack, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for all labor, equipment, tools, materials inclusive of furnishing, installing and configuring the Card Rack, all power cables, power supplies, wiring, attachment hardware, factory and manufacturing inspection, testing, storage, packaging, shipping, warranty, and all work, equipment, and appurtenances, and all incidentals necessary to provide a fully functional Card Rack ready for use. It shall also include all documentation including operations and maintenance manuals and other material necessary to document the operation of the Card Rack.

GPS Clock, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for all labor, equipment, tools, materials inclusive of furnishing, installing and configuring the Global

Positioning System (GPS) Clock(s), all power cables, power supplies, wiring, attachment hardware, factory and manufacturing inspection, testing, storage, packaging, shipping, warranty, and all incidentals necessary to provide a fully functional GPS Clock ready for use. It shall also include all documentation including operations and maintenance manuals and other material necessary to document the operation of the GPS Clock.

Power Service Pedestal, measured as prescribed above, will be paid for at the contract unit price per each for each type(s) specified in the contract, which price shall be full compensation for furnishing, installing, configuring, wiring, testing, and mounting foundation construction, cabinets, circuit breakers, connectors wiring, mounting material, all other materials, and all equipment, labor, tools, and incidentals necessary to complete the work.

Payment will be made under:

907-632-A:	Solid State Traffic Signal Cabinet Assembly, Type __ Cabinet, Type __ Controller	- per each
907-632-B:	Remove and Replace Existing Traffic Signal Cabinet Assembly, Type __ Cabinet, Type __ Controller	- per each
907-632-C:	Modify Existing Traffic Signal Cabinet Assembly	- per each
907-632-D:	Solid State Traffic Actuated Controller, Type ____	- per each
907-632-E:	Single-user Workstation Signal Software License	- per each
907-632-F:	Single-user Server Signal Software License	- per each
907-632-G:	Malfunction Management Unit	- per each
907-632-H:	Card Rack, ___ Position	- per each
907-632-I:	GPS Clock	- per each
907-632-J:	Power Service Pedestal	- per each

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-643-5 **CODE: (SP)**

DATE: **10/03/2023**

SUBJECT: **Video Vehicle Detection**

Section 643, Video Vehicle Detection System, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete Section 643 on pages 601 through 628 and substitute the following.

SECTION 907-643 - VIDEO VEHICLE DETECTION

907-643.01--Description. This section specifies the minimum requirements for Video Vehicle Detection and Multi-Sensor Vehicle Detection furnished and installed in accordance with the design(s) for the location(s) designated on the project plans, in any related notice to bidders, or as directed. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, test, and operate the system. The video vehicle detection system shall at a minimum use one or more sensors recommended by the manufacturer and video analytics hardware and software to detect vehicle presence, provide a detection output, and generate volume, occupancy, and speed data.

Type 1 Video Vehicle Detection shall provide presence or pulse detection of vehicles, bicycles, and pedestrians for Traffic Signal Controller inputs and be an AI Based Traffic Monitoring and Management System which detects, classifies, and tracks vehicles, pedestrians and bicyclists in areas of interest via processing of video feed from any IP, CCTV, Analog, or Fisheye Camera, on a GPU powered edge server/processor and provides a suite of outputs including NTCIP and SDLC detection calls to the controller and advanced traffic analytics. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, and test the Video Vehicle Detection equipment, complete and ready for service. The Sensor and Processor shall be paid for separately under different pay items. Type 1A Sensor shall be a fixed bullet style camera. Type 1B Sensor shall be a fisheye style camera.

Type 2 Video Vehicle Detection shall provide presence or pulse detection of vehicles, bicycles, and pedestrians for Traffic Signal Controller inputs utilizing a camera with independent video detection processor. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, and test the Video Vehicle Detection equipment, complete and ready for service.

Type 3 Video Vehicle Detection shall provide presence or pulse detection and tracking of vehicles, bicycles, and pedestrians for Traffic Signal Controller inputs. Type 3 Video Vehicle Detection shall be a single (multiple may be required for large intersections) fisheye lens camera, designed to be mounted on signal pole or mast arm, with included detection processor. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish,

install, and test the Video Vehicle Detection equipment, complete and ready for service. The Sensor and Processor shall be paid for separately under different pay items.

Multi-Sensor Vehicle Detection will provide detection of vehicles on a roadway using a Multi-Sensor Detection for Traffic Signal Controller inputs. The Multi-Sensor shall utilize two (2) different sensors of different technologies, video imaging and radar, to detect and track vehicles. The module shall process information from both video imaging and radar sensors simultaneously in real-time. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, and test the Multi-Sensor Vehicle Detection equipment, complete and ready for service. The Sensor and Processor shall be paid for separately under different pay items.

907-643.02--Materials.

907-643.02.1--Materials for Type 1 Video Vehicle Detection. Type 1 Video Vehicle Detection shall consist of a GPU server/processor, deep learning-based object detection and classification algorithms, tracking algorithms, application software, and all associated equipment required to setup and operate in a field environment.

Type 1 Video Vehicle Detection shall utilize video input from any IP, CCTV and/or Analog camera to collect video image data for the GPU server for purposes of detecting and classifying vehicles, pedestrians and bicyclists and generating traffic data. Type 1 Video Vehicle Detection shall be able to communicate detection calls to the traffic controller using NTCIP and SDLC standard.

Type 1 processor shall utilize either multiple fixed view cameras or a single fisheye camera depending on the layout of the intersection. When using a fisheye lens camera, the processor must be able to provide advanced detection for each approach utilizing a single camera. The processor shall utilize and demonstrate tracking-based algorithms (in lieu of trip-line) to provide real-time vehicle, pedestrian, and bicyclist detection outputs. The processor shall be able to detect either approaching or departing vehicles in multiple traffic lanes simultaneously. The processor shall be able to issue detection calls based on vehicle class (car, light truck, heavy truck, bus, motorcycle, bicyclist, pedestrian). The processor shall be able to communicate detection calls to the traffic controller using NTCIP and SDLC standard. The processor shall provide flexible detection placement anywhere within the field of view of the camera. A single detection template shall be able to replace one or more conventional detector loops. The processor shall operate at a level of performance comparable to properly operating inductive loops, excluding issues of occlusion due to limitations imposed by camera placement. The processor shall trigger a state of "all call" to the controller in the event of an equipment failure or system malfunction.

The Type 1 processor shall be rack or shelf mountable and shall be designed to operate reliably in the adverse environment found in the typical roadside traffic cabinet. The processor shall operate at 120-240 VAC, requiring 30W or less power. The processor shall not require shielding from other electronic devices, such as power supplies and communication equipment and shall feature LAN, HDMI, and USB interface ports on the front surface of the unit. The processor shall be able to interface with analog cameras via built-in analog camera adapter and BNC connector (4 channel). The processor shall be able to communicate via both NTCIP and SDLC with traffic

controllers.

The Type 1 software shall support the creation and modification of at least thirty (30) object detection templates within the graphical user interface. The application software shall show images of the object detection templates superimposed on the video image of traffic. The application software shall support the assignment of a phase and detector number to each road and crosswalk lane. These assignments can be modified at any time through the software. The application software shall support direction of travel assignment within detection template. The application software shall place a detection box around all detected and tracked objects (cars, pedestrians, etc.). The application software shall calculate and display speed for each detected object. The application software shall calculate wait times for all detected objects when stopped. The application software shall maintain a database of current and historical traffic data and allow for the user to run reports against this data to include traffic counts, turn movement counts, average speed, 85th percentile speed, vehicle classification by lane, wait times, arrivals on green, queue length, level of service and total delay.

Type 1A sensor shall be a fixed bullet style camera. Type 1A sensors shall be full featured network cameras with a minimum of 5-megapixel resolution. Single fixed view cameras shall be optimized to capture images in challenging light conditions including low light and strong backlight. Single fixed view cameras shall be outdoor rated with a wide temperature range and shall be impact resistant and ready for extreme temperatures. Zoom and focus shall be remotely controlled. Mounting hardware shall be included with the sensor.

Type 1B sensor shall be a Fisheye style camera. Type 1B sensors shall deliver video in any light condition using forensic WDR, IR and Lightfinder technologies. The sensor shall offer a minimum of 12 MP resolution and offer 360 degrees of viewing. The Sensor shall offer a 360-degree overview, de-warped panorama, double panorama and corridor and quad views. All views shall be able to be streamed simultaneously up to 12 fps. The sensor shall be password protected and IP based with network access control. The sensor shall be designed to operate reliably in an operating temperature ranging from -40°F to +131°F degrees at 5 percent to 95 percent relative humidity, non-condensing. Mounting hardware shall be included with the sensor.

Power and communications cable shall either be Cat-5E or Cat-6, outdoor rated, shielded cable.

907-643.02.2--Materials for Type 2 Video Vehicle Detection. Type 2 Video Vehicle Detection shall consist of a power supply, video camera, mounting brackets, lightning protection, and a separate processor capable of processing the number of camera and phase combination video sources shown on the project plans.

Type 2 processor shall have a minimum of 24 detection zones per camera input and each detection zone shall be capable of being sized to suit the site and the desired vehicle detection area. Six (6) additional count zones for bicycles shall be provided to accumulate bicycle counts at user specified intervals. Type 2 processor shall have up to six (6) detection zones per camera view that have the capability to count the number of vehicles detected, measure classification, occupancy, and speed.

Type 2 processor shall be shelf mounted and shall be capable of sending high-resolution

streaming video to a traffic management center. Type 2 processor shall have one or more video inputs and one (1) video output, responding to specific site applications, camera locations and detection zones shown on the project plans. The system shall be NTCIP compliant utilizing either Ethernet or SDLC communications with the controller.

The Type 2 processor shall be able to detect vehicles and bicycles in real time as they travel across each detection zone and detect in multiple lanes using only the video image. Detection zones shall be programmed utilizing either a wireless connection or via ethernet with a laptop or tablet. The menu shall facilitate placement of detection zones and setting of zone parameters or to view system parameters. The video detection processor shall default to a safe condition, such as minimum recall, fixed recall or a constant call on each active detection channel, in the event of unacceptable interference with the video signal, low visibility conditions, or power failure. The Processor shall be capable of automatically detecting a low-visibility condition such as fog and respond by placing all defined detection zones in a constant call mode. The system shall automatically revert to normal detection mode when the low-visibility condition no longer exists.

Type 2 sensors shall be completely compatible with the video detection processor and shall be certified by the manufacturer to ensure proper system operation. Type 2 sensors shall produce accurate detector outputs under all roadway lighting conditions, regardless of time of day. The minimum illumination of the sensor shall be 1.0 Lux. The lens shall have a minimum of 12x optical zoom and shall have a maximum power consumption of 10 watts. The sensor shall have a maximum weight of 4.8 pounds. The field of view shall be adjustable from ground level. The Sensor shall include mechanisms to compensate for changing of lighting by using an electronic shutter and/or auto-iris lens. The sensor shall be housed in a weather-tight sealed enclosure and shall be equipped with a sunshield. The sunshield shall include a provision for water diversion to prevent water from flowing in the camera's field of view. The sensor enclosure shall include a thermostatically controlled heater to assure proper operation of the lens shutter at low temperatures and prevent moisture condensation on the optical faceplate of the enclosure. The sensor enclosure shall be equipped with weather-tight connections for power/communications. The sensor shall meet the regulatory requirements of NEMA TS-2, FCC part 15, Class A.

Power and communications cable shall either be Cat-5E or Cat-6, outdoor rated, shielded cable.

907-643.02.3--Materials for Type 3 Video Vehicle Detection. Type 3 Video Vehicle Detection processor shall support one or more fisheye camera sensors. If equipped with one sensor, the processor shall be capable of simultaneously supporting up to four (4) additional sensors for special requirements, such as advance detection or underpass detection.

The processor shall comply with NEMA standards, TS1, TS2 Type 1 and Type 2, 170/2070 and ITS.

The processor will have at a minimum four (4) USB 3.0 ports for expansion flexibility and have an optional, built-in modem, and shall not exceed 8.5" x 11.5" x 1.75" and weigh no more than 5.2 pounds. The unit shall have flexible mounting options including the ability to lie flat on a cabinet shelf, be mounted in a standard traffic cabinet rack with optional mounting ears or be installed vertically with optional base. The outer enclosure shall be a powdered-coated aluminum.

A surge protection junction unit shall be provided for each sensor.

An Ethernet protection module shall be provided for each sensor and installed in the traffic signal cabinet.

The Type 3 Video Vehicle Detection shall have at least one downward-facing fisheye sensor capable of seeing the center of the intersection and have an omnidirectional line of site to track vehicles entering and exiting the intersection. The sensor shall be a color sensor and shall require no adjustment for focus. The sensor shall have a thermostatically controlled heater residing inside the enclosure to reduce the effects of ice and condensation. Any plastics used on or in the enclosure shall have ultraviolet inhibitors. A waterproof and dust tight aluminum enclosure shall be utilized. The weight of the sensor including the enclosure shall not exceed eight pounds.

The sensor's mounting bracket shall utilize a two (2) piece, ten (10) foot 90º mounting pole. The sensor junction box should mount at the base of the vertical pole and allow for the installer to adjust the sensor's horizontal position with one hand and tighten the bracket without having to support the sensor simultaneously.

The Type 3 Video Vehicle Detection configuration shall be for a system that views, captures, and derives data based on the objects that pass within the sensor field of view along a highway, road, ramp, or other commonly used transit pathway via processing video images. Signal Performance Metrics shall be captured by the system.

The system shall have a modular electrical design and use Ethernet to connect and network with the different system components. Streaming video images, alerts, and data shall be transmitted from the field back to a Traffic Operations Center (TOC) via the systems client software.

The Type 3 Video Vehicle Detection shall provide real time vehicle detection (within 500 milliseconds (ms) of vehicle arrival). The system should detect the presence of vehicles for up to 64 detection zones per sensor. The detection zones shall be sensitive to the direction a vehicle travels and the direction to be detected by each detection zone shall be programmable by a client software user. The system should provide a flexible detection zone placement anywhere within one hundred (150) feet of the sensors. Advanced detection zones may be placed up to three hundred (300) feet from a Fisheye sensor when mounted at least forty (40) feet high.

Placement of detection zones will be done by means of a graphical interface using the MJPEG image of the roadway. The client software displays images of the detection zones overlaid on the video image of traffic while the processor is running. The detection zones, when operating, shall display outlined or filled, with a visible change indicating activation.

A laptop should be used to draw detection zones. Alternatively, a mouse, keyboard, and monitor may be connected directly to the processor to configure a site. The detection zones should be capable of being sized and shaped to provide optimal road coverage and detection.

When a vehicle occupies a detection zone, the detection zone on the live video will indicate the

presence of a vehicle, thereby verifying proper operation of the system.

The presence of the vehicle as well as the signal states will be indicated via colored LED lights on the front panel of the processor.

Equipment failure, either sensor or the processor, shall result in constant vehicle detection on the affected detection zones.

The sensors will use five (5) watts nominally and a maximum of fifty (50) watts with active heaters. The sensors will be Power over Ethernet (POE) and will only require a single shielded, burial grade, gel filled CAT5e cable for both power and data, or composite fiber cable**.** Each sensor shall have its own surge protector junction unit and EPM surge protection unit in the traffic cabinet. The processor shall operate within a range of 89 to 240 VAC, 60Hz single phase. Power to the processor is from the transient protected side of the AC power distribution system in the traffic control cabinet where the processor is installed.

907-643.02.4--Materials for Multi Sensor Vehicle Detection. Multi-Sensor Vehicle Detection Sensor assembly shall utilize two (2) different sensors of different technologies, video imaging and radar, to detect and track vehicles at distances up to 600 feet. The detector shall fuse vehicle information from the two sensors to provide highly accurate and precise detection for special or advanced applications. The system shall include a video imaging sensor and radar sensor, and a separate detection processor.

The Multi-Sensor Vehicle Detector processor shall be a shelf mounted unit. The processor shall process information from both video imaging and radar sensors simultaneously in real-time. An LED indicator shall be provided to indicate the presence of the sensor signal. The LED shall illuminate upon valid sensor synchronization and turn off when the presence of a valid sensor signal is removed. For multi-channel video input configurations, a momentary push-button shall be provided on the front panel to cycle through each input video channel. The real-time video output shall have the capability to show text and graphical overlays to aid in system setup. A communications port shall be provided on the front panel that allows the user to remotely configure the system and/or to extract calculated vehicle/roadway information. Each MVD shall have the capability to be addressable. Additionally, the processor shall allow the use of extension modules to provide up to 24 open collector contact closures per camera input. Each open collector output shall be capable of sinking 30 mA at 24 VDC. Open collector outputs will be used for vehicle detection indicators as well as discrete outputs for alarm conditions. The processor shall utilize non-volatile memory technology to store on-board firmware and operational data. The processor shall not consume more than 20 watts.

Detection zones shall be programmed via a laptop or tablet. The menu shall facilitate placement of detection zones and setting of zone parameters or to view system parameters. The processor shall store up to three (3) different detection zone patterns in non-volatile memory. The processor shall detect vehicles in real time as they travel across each detection zone and shall default to a safe condition, such as a constant call on each active detection channel, in the event of unacceptable interference or loss of the sensor signal. Up to 24 detection zones per camera input shall be supported and each detection zone can be sized to suit the site and the desired

vehicle detection region.

The video imaging camera sensor shall be supplied by the Multi-Sensor Vehicle Detection manufacturer. The camera enclosure shall utilize technology for the heating element of the front glass cable terminations at the data combiner for video and power shall not require crimping or special tools and shall have a weatherproof protective cover. The camera sensor shall allow the user to set the focus and field of view via Wi-Fi connectivity. The camera shall produce a useable video image of vehicles under all roadway lighting conditions, regardless of time of day. The camera electronics shall include automatic gain control (AGC) and shall be digital signal processor (DSP). The camera sensor shall include an electronic shutter control and auto-iris lens that operates in tandem with the electronic shutter. The lens shall be a minimum 10X zoom lens with a variable focal length. The camera shall be housed in a weather-tight sealed enclosure conforming to IP-67 specifications. The housing shall allow the camera to be rotated to allow proper alignment between the camera and the traveled road surface. The camera enclosure shall be equipped with a sunshield. The sunshield shall include a provision for water diversion to prevent water from flowing in the camera's field of view. The glass face on the front of the enclosure shall have an anti-reflective coating to minimize light and image reflections.

The radar sensor shall operate in the 24 GHz frequency band. The detection range shall be 600 feet minimum. The sensor shall be able to track up to 20 independent objects simultaneously in one (1) to four (4) traffic lanes. Object speed detection shall be within a range of zero (0) to 150 mph. The radar sensor shall be housed in a weather-tight sealed enclosure conforming to IP-67 specifications. The housing shall allow the radar to be adjusted to allow proper alignment between the sensor and the traveled road surface. The radar sensor shall communicate with and acquire power from the sensor data combiner. Data and power cables between the radar sensor and sensor data combiner shall be fully isolated from the sensor enclosure.

Multi-Sensor Vehicle Detection Sensor assembly shall be housed in an overall, single enclosure. The maximum power consumption for the assembly shall be less that ten (10) watts typical, twenty (20) watts peak.

The power/communications cable to be used between the Multi-Sensor Vehicle Detection Sensor assembly and the processor shall be a single Cat-5E or Cat-6 outdoor rated cable.

907-643.02.5--Functional Requirements. Detection shall be at least 98% accurate in all weather conditions, with slight degradation acceptable under adverse weather conditions (e.g., rain, snow, or fog) which reduce visibility. Detection accuracy is dependent upon site geometry, camera placement, camera quality and detection zone location, and these accuracy levels do not include allowances for occlusion or poor video due to camera location or quality. For presence detection, the detection zone shall be active as long as a vehicle or pedestrian occupies the zone. Detection accuracy of the system shall be comparable to properly operating inductive loops. Detection accuracy should include the presence of any vehicle in the defined detection zone regardless of the lane the vehicle is occupying.

907-643.02.6--Physical and Environmental Specifications.

907-643.02.6.1--Type 1 Video Vehicle Detection. The GPU server shall be designed to operate reliably in an operating temperature ranging from -29°F to +165°F degrees at 0 percent to 95 percent relative humidity and have vibration and shock parameters of at least 5 G RMS 10 to 500 Hz and 50 G, half sine 11 ms, respectively. System components comply with the environmental requirements detailed in the NEMA TS 2 standard.

907-643.02.6.2--Type 2 Video Vehicle Detection. The interface shall operate in a temperature range from -31°F to +165°F and a humidity range from 0% to 95% relative humidity. The video vehicle detection processor shall operate reliably in a typical roadside traffic cabinet environment. Internal cabinet equipment and a video vehicle detection processor shall be provided that meets the environmental requirements of NEMA TS-2-2003 Section 2. If the processor is located in the sensor, it shall meet the same requirements.

The sensor(s) shall operate in a temperature range of -30°F to 140°F. Additionally, a heater shall be included to prevent the formation of ice and condensation in cold weather. The heater shall not interfere with the operation of the video camera sensor electronics, or cause interference with the video signal.

Vibrations shall meet the requirements of NEMA TS 2-2003 Section 2.1.9.

Shock shall meet the requirements of NEMA TS 2-2003 Section 2.1.10.

The sensor and enclosure shall withstand 150 dB for 30 minutes continuously, with no reduction in function or accuracy.

907-643.02.6.3--Type 3 Video Vehicle Detection. The processor will meet or exceed the NEMA TS-2 standard of -29º F - 165º F (-34º C - 74º C) and meet or exceed a 5-30Hz vibration test as well as a 10G shock test. The processor shall operate properly in an environment with 0% to 95% relative humidity, non-condensing.

The sensor(s) shall operate properly in an environment with 0% to 100% relative humidity.

907-643.02.6.4--Multi-Sensor Vehicle Detection. When mounted outdoors in the enclosure, the sensor assembly shall operate in a temperature range from -29°F to +165°F and a humidity range from 0% RH to 100% RH.

The processor shall operate satisfactorily in a temperature range from -40°F to +165°F and a humidity range from zero (0) %RH to 95 %RH, non-condensing as set forth in NEMA specifications.

907-643.03--Construction Requirements.

907-643.03.1--Installation. Installation of the Video and Multi-Sensor Vehicle Detection shall be as recommended by the manufacturer and performed by a Contractor trained and certified by the supplier. Where time does not reasonably permit training of the installing Contractor, a supplier factory representative shall supervise and assist a Contractor during installation of the

Video and Multi-Sensor Vehicle Detection.

The Contractor shall perform the following:

1) Install all sensors, system processors and associated enclosures and equipment at the locations specified in the plans, in any related notice to bidders, per manufacturer's recommendations, or as directed.
2) Install all cabinet-mounted equipment in the intersection equipment cabinet or as specified in the plans.
3) Cabling from all sensors shall be installed in accordance with the manufacturer's recommendations.
4) Make all necessary adjustments and modifications to the system prior to requesting inspection for system/device acceptance.
5) Mount the sensors as per manufacturer's recommendations or as shown in the plans.
6) Mount the sensors to view approaching traffic unless otherwise directed.
7) Optimize the sensor's location and zone of detection as directed by the Engineer, or authorized designee.
8) Adjust the sensor zoom lens to match the width of the road/detection area and minimize lane vehicle occlusion.
9) Fasten all other cabinet components, with hex-head or Phillips-head machine screws insulated with nuts (with locking washer or insert) or into tapped and threaded holes. Do not use self-tapping or self-threading fasteners.
10) Provide electrical cables for video, communications signaling and power supply between the cabinet and the sensor as recommended by the manufacturer, and as required for a fully functional System.

907-643.03.2--Testing. All equipment associated with the Video and Multi-Sensor Vehicle Detection system shall undergo testing to verify conformance to requirements of the plans and these special provisions. All costs associated with testing shall be included in the overall contract price; no separate payment will be made for any testing.

If requested by the Project Engineer, Standalone Acceptance Testing (SAT) shall include videos of the approach with detection zones overlaid showing detector activations. A one (1) hour video shall be made of each approach and compared to actual detection calls. 30-minute videos shall be made starting 15 minutes prior to sunrise and sunset for each approach and compared to actual detection calls. All videos shall be date and time stamped. All videos shall be provided to the Engineer with a summary of the results including total calls, missed calls and false calls. All test results must meet a 98% accuracy requirement. The Contractor must demonstrate the accuracy requirements at selected intersections after a (30) day burn in period. The intersections to be tested will be randomly selected by the Project Engineer.

907-643.03.3--Warranty. The Video and Multi-Sensor Vehicle Detection shall be warranted to be free of manufacturer defects in materials and workmanship for a period of one (1) year from the date of final acceptance. Equipment covered by the manufacturer's warranties shall have the registration of that component placed in the Department's name prior to final inspection. The Contractor is responsible for ensuring that the vendors and/or manufacturers supplying the

components and providing the equipment warranties recognize the Department as the original purchaser and owner/end user of the components from new. During the warranty period, the supplier shall repair or replace with new or refurbished material, at no additional cost to the State, any product containing a warranty defect, provided the product is returned postage-paid by the Department to the supplier's factory or authorized warranty site. Products repaired or replaced under warranty by the supplier shall be returned prepaid by the supplier.

907-643.03.4--Training. When called for in the plans, the Contractor shall submit to the Project Engineer for approval a detailed training plan including course agendas, detailed description of functions to be demonstrated and a schedule. The Contractor must also submit the trainer's qualifications to the Project Engineer for approval prior to scheduling any training. The training must include both classroom style training and hands-on training in the field of the maintenance and troubleshooting procedures required for each component. The training should also consist of a hands-on demonstration of all software configuration and functionality where applicable.

The supplier of the detection system shall, at a minimum, provide a 16-hour operations and maintenance training class with suitable documentation for up to eight (8) people selected by the Department. The operations and maintenance class shall be scheduled at a mutually acceptable time and location.

907-643.03.5--Maintenance and Technical Support. The supplier shall maintain an adequate inventory of parts to support maintenance and repair of the detection system. Spare parts shall be available for delivery within 30 days of placement of an acceptable order at the supplier's current pricing and terms of sale of said spare parts.

The suppliers shall maintain an ongoing program of technical support for the detection system. This technical support shall be available via telephone or via personnel sent to the installation site upon placement of an acceptable order at the supplier's then current pricing and terms of sale of said technical support services.

The installation or training support shall be provided by a factory-authorized representative and shall be a minimum IMSA-Level II Certified Traffic Signal Technician.

All product documentation shall be written in the English language.

907-643.04--Method of Measurement. Video and Multi-Sensor Vehicle Detection Sensor of the type specified will be measured as a unit per each.

Video and Multi-Sensor Vehicle Detection Processor of the type specified will be measured as a unit per each.

Video and Multi-Sensor Vehicle Detection Cable and/or Power Cable will be measured by the linear foot, measured horizontally along the conduit, messenger cable or mast arm and vertically along the pole.

Video and/or Multi-Sensor Vehicle Detection Training will be measured as a lump sum after the

completion of all training.

907-643.05--Basis of Payment. Video and Multi-Sensor Vehicle Detection Sensor, measured as prescribed above, will be paid for at the contract unit price per each, which price shall be full compensation for installation, system integration, documentation, system software, and testing of a complete video detection sensor site including video camera sensor, the sensor environmental enclosure, attachment hardware and brackets, completion of all testing requirements, warranties and all work, equipment and appurtenances as required to provide and install a complete video detection system. The price bid shall also include all system documentation including shop drawings, operations, and maintenance manuals, wiring diagrams, block diagrams and other materials necessary to document the operation of the Video and Multi-Sensor Vehicle Detection Sensor. This price shall be full compensation for all labor, tools, materials, equipment, and incidentals necessary to complete the work and quality assurance.

Video and Multi-Sensor Vehicle Detection Processor, measured as prescribed above, will be paid for at the contract unit price per each, which price shall be full compensation for installation, system integration, documentation, system software, and testing of a complete video detection processor site including video detection processor, completion of all testing requirements, warranties and all work, equipment and appurtenances as required to provide and install a complete video detection system. The price bid shall also include all system documentation including shop drawings, operations, and maintenance manuals, wiring diagrams, block diagrams and other materials necessary to document the operation of the Video and Multi-Sensor Vehicle Detection Processor. This price shall be full compensation for all labor, tools, materials, equipment, and incidentals necessary to complete the work and quality assurance.

Video and Multi-Sensor Vehicle Detection Cable and/or Power Cable will be paid at the contract unit price per linear foot, which price shall be full compensation for all labor, materials, equipment tools, furnishing, installing, system integration, connections, testing, and all incidentals necessary to complete the work.

Video and/or Multi-Sensor Vehicle Detection Training, measured as prescribed above, will be paid for at the contract unit lump sum price, which price shall be full compensation for all training costs including all coordination, materials, labor, training location costs, and all incidentals required to complete the training.

Payment will be made under:

907-643-A:	Video Vehicle Detection Sensor, Type ____	- per each
907-643-B:	Video Vehicle Detection Cable	- per linear foot
907-643-C:	Video Vehicle Detection Processor, Type ____	- per each
907-643-D:	Video and/or Multi-Sensor Vehicle Detection Training	- lump sum
907-643-E:	Multi-Sensor Vehicle Detection Sensor	- per each

907-643-F: Multi-Sensor Vehicle Detection Cable - per linear foot

907-643-G: Multi-Sensor Vehicle Detection Processor - per each

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-650-5 **CODE: (SP)**

DATE: **05/04/2023**

SUBJECT: **On-Street Video Equipment**

Section 907-650, On-Street Video Equipment, is hereby added to and made part of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as follows.

SECTION 907-650 - ON-STREET VIDEO EQUIPMENT

907-650.01--Description. This work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, test, train, and operate CCTV Camera Systems. CCTV Camera System shall provide TMC personnel with live streaming video of the roadway network via CCTV Camera Systems including both fixed and PTZ cameras. PTZ Signal Monitoring Camera shall provide Traffic Engineering personnel with live streaming video of the roadway network via CCTV Camera Systems utilizing a PTZcamera.

907-650.02--Materials. All materials furnished, assembled, fabricated or installed shall be new, corrosion resistant.

Support equipment for the CCTV Camera Systems shall be provided in a Type B ITS Equipment Cabinet as described in Section 660. For PTZ Signal Monitoring Camera, support equipment shall be house in existing or new Traffic Signal Cabinet.

The CCTV Camera System shall comply with the following minimum materials specifications:

907-650.02.1--General Capabilities and Performance Requirements. Overall CCTV Camera System capabilities and performance requirements include the following:

1) CCTV PTZ Cameras shall be placed and installed at fixed locations to provide full coverage of the mainline travel lanes and shoulders.
2) CCTV Fixed Cameras shall be placed and installed at fixed locations to provide coverage of the mainline travel lanes. The cameras shall be provided with a varifocal lens which shall be adjusted by the Contractor for the desired view of the mainline. At major intersections fixed cameras shall also be adjusted to the desired view of the surface streets.
3) The CCTV Camera System components shall be compatible with each other and be of rugged design and suitable for reliable operation when mounted in their fixed locations.
4) All new PTZ and the Fixed cameras shall be provided as Ethernet IP-based or as indicated in project plan sheets or Notice to Bidders. If analog cameras are required, they shall conform to requirements detailed in Subsection 650.02.2, Analog Camera Unit.
5) The CCTV Camera System shall be capable of attended and unattended, continuous 24 hours per day operation at fixed sites.

6) The Contractor shall ensure that the installed equipment provides unobstructed video of the roadway, traffic, and other current conditions around a roadside CCTV field site; that it responds to camera control signals from an operator of the system; and that the video images can be transmitted to remote locations interfaced to the system for observation.
7) PTZ and IP based cameras shall be capable of being remotely controlled and programmed.
8) All PTZ enclosures shall be provided with the ability to be pressurized for environmental protection.
9) PTZ Dome type cameras shall be mounted together with the zoom lens and integrated into the pan and tilt device within the dome enclosure forming a totally integrated, easily removable assembly.
10) All cameras shall include a high quality integrated camera/lens combination.
11) The camera shall also be equipped with an auto-iris lens capability compatible with the zoom lens supplied.
12) Iris capability shall include a provision for manual override via software.
13) The PTZ camera shall be capable of auto-focus during zoom-in or zoom-out, with provisions for override via software.
14) Overexposure protection shall be provided - the camera shall not be degraded or damaged under normal reasonable operating conditions.
15) The capability for local control of pan, tilt and zoom functions shall be provided at the roadside cabinet using vendor-supplied software installed on a laptop computer.
16) All IP Based CCTV cameras shall support the NTCIP 1205 v1.08 or later version if backward compatible communication protocol.

907-650.02.2--Analog Camera Unit. The minimum Camera Unit requirements include:

1) The camera unit shall incorporate solid-state design and provide digital signal processing (DSP) capable of providing clear and low-bloom color video pictures during daylight hours and monochrome video at night when the roadway is illuminated with minimal roadway lighting.
2) The Analog Camera shall be fully compliant with all aspects of the National Television Standards Committee (NTSC) specification, and produce NTSC compatible video.
3) The Analog camera shall operate over wide dynamic light conditions ranging from low light/dusk to full sunlight having day (color)/night (monochrome) switchover and iris control, with user-selectable manual and automatic control capabilities.
4) The camera unit shall be equipped with a low light level sensor to automatically switch the camera to monochrome mode.
5) The camera unit shall be equipped with an override capability to allow the camera to be manually switched via software to turn off the automatic low light level sensor switch feature for Color or Monochrome operation.
6) Image sensor: 1/3 inch charge-coupled device (CCD) employing digital video signal processing (DSP) technology with a minimum Effective Picture Elements of 768 horizontal x 494 vertical pixels.
7) The camera unit shall include integrated image stabilization.
8) Sensitivity: The camera shall maintain usable video under both day and nighttime lighting conditions.
9) Video output synchronization shall be 2 to 1 interlace and will observe the NTSC (color) and EIA RS-170 (black and white) standards.

10) Resolution: 470 lines horizontal and 350 TV lines vertical, NTSC equivalent.
11) Signal-to-noise ratio: 48 dB, minimum with AGC off, un-weighted, and 4.5MHz filter.
12) Video Signal Format: National Television Standards Committee (NTSC) composite video output of 1 $Volt_{p-p}$ at 75 ohms, unbalanced.

907-650.02.3--Internet Protocol IP Camera Unit. IP cameras shall provide the same functionality as the analog camera units specified in subsection 907-650.02.2, in addition to the following minimum requirements:

1) Power over Ethernet or 24 VAC Power Input.
2) Open Architecture.
3) Shall utilize H.264 (Video Coding Experts Group (VCEG)/Moving Picture Experts Group)Video Compression Technology types as directed by the Intelligent Transportation Systems Program Manager
4) Standard Definition (SD) Units Shall be capable of 2 simultaneous H.264 video streams.
    a. The primary stream shall provide 480p at 30 fps and the ability to be reduced to D1 resolution at 30 fps.
    b. The secondary stream shall provide a minimum CIF resolution 30fps.
5) High Definition Units (HD) Shall be capable of 2 simultaneous H.264 video streams.
    a. The primary stream shall provide 720p at 30 fps at a minimum and the ability to be reduced to D1 resolution at 30 fps.
    b. The secondary stream shall provide a minimum CIF resolution 30fps.
6) Image sensor: 1/3 inch charge-coupled device (CCD)
7) Shall be capable to take video snapshots in JPEG format and transfer image via FTP.
8) IP encoded streams and Video Compression Technology shall be compatible with the existing video streaming servers and decoders for the www.mdottraffic.com WEB site or as approved by the Intelligent Transportation Systems Program Manager.
9) Internet Protocols: TCP, UDP (Unicast, Multicast IGMP V2), UPnP, DNS, DHCP, RTP, NTP
10) Support Real Time Streaming Protocol (RTSP)
11) Multilevel Password Protection.
12) EDR (Extended Dynamic Range).
13) C/CS Lens Mount.
14) Backlight Compensation.
15) Low Profile Top/Bottom Mount.
16) BNC Service Connector. Tap shall be installed inside cabinet.

907-650.02.4--PTZ Camera Lens. The minimum camera lens requirements include:

1) The camera lens shall have a minimum F-Stop of 1.4 to 1.6.
2) Optical and Digital Zoom:
    a. Shall provide an optical zoom of 35X for analog dome cameras.
    b. Shall provide a minimum optical zoom of 18X and a minimum digital zoom of 6X for IP PTZ cameras.
3) Zoom Control: The zoom magnification shall be fully controllable via the remote PTZ mechanism. The time to pass through the full range of movement of Iris, Zoom and Focus shall in no case exceed 10 seconds.

4) Iris and Focus: Support automatic iris and focus control with manual override capability. The iris shall be in a closed position when there is no power.
5) White or Color Balance: Support automatic or set to yield optical results under various outdoor lighting conditions.
6) Shutter Speed: Support automatic or set to yield optimal results under low lighting conditions without blooming or smearing, auto-iris on. Provide electronic shutter that is selectable in steps.
7) The lens shall be equipped for continuous remote control of zoom, focus and iris.
8) Mechanical or electrical means shall be provided to protect motors from overrunning in extreme positions.
9) The zoom lens shall be an integrated camera/lens combination.
10) Vibration or ambient temperature changes shall not affect the automatic iris function, focus mechanism and zoom mechanism.
11) The lens shall be optically clear, impact resistant and acrylic. The acrylic lens shall not yellow and shall not introduce appreciable light loss or geometric distortion over a 10-year service life when exposed to the environment.
12) The zoom mechanism shall be designed for maintenance-free operations. All gearing and bearings shall be self-lubricating with lubrication and gearing tolerances compatible with the environmental specifications contained herein.

907-650.02.5--Character Generator. The minimum character generator requirements include:

1) The capability of generating and superimposing lines of English language text on the video image/stream shall be provided.
2) A minimum of 20 characters per line that are between 10 and 30 horizontal TV lines in height shall be provided.
3) Control (enable, disable and edit) of this feature shall be available remotely and at the field site using a laptop computer.
4) The text messages shall be stored in non-volatile memory.
5) Characters shall be white with a black border to ensure legibility in varied scenes.
6) The following minimum text insertion requirements shall be provided with the ability to individually turn each one on or off:
   a. Camera ID
   b. Sector Message
   c. Alarm Messages
   d. Pan/Tilt Azimuth/Elevation
   e. Compass Direction in 8 discreet zones

907-650.02.6--PTZ Enclosure. The minimum PTZ enclosure requirements include:

1) Sealed, pressurized dome enclosure that provides complete protection for the camera and lens assembly from moisture and airborne contaminants.
2) Environmental resistant and tamper proof meeting NEMA 4X or IP-67 rating requirements.
3) The dome enclosure shall be constructed in such a way that unrestricted camera views can be obtained at all camera and lens positions.
4) Dome environmental control shall be provided by nitrogen pressurization with a Schrader Valve for pressurization and purging. The enclosure shall be designed to be pressurized to

the manufactures recommended level with dry nitrogen. The notation "CAUTION – PRESSURIZED" shall be printed on the rear plate of the enclosure and shall be clearly visible and readable.

5) An alarm shall be displayed under low-pressure conditions and displayed on the camera video. The low-pressure alarm shall be on/off selectable by the operator at the TMC.
6) The PTZ dome enclosure shall consist of a two-piece (upper and lower half) dome.
7) A harness and cables shall be provided with each enclosure to extend the video, power and data from the CCTV Camera System to the field cabinet. No harness shall be exposed. All entry points shall have gaskets to prevent moisture entry. A sealed connector shall be at the top of the dome.
8) The dome enclosure shall assist in preventing lens fogging and effectively reduce internal temperatures.
9) The enclosure shall minimize glare and provide overexposure protection for the camera when pointed directly at the sun.
10) The enclosure shall be equipped with a heater, a defroster and a thermostat.
11) The camera equipment inside the dome enclosure shall meet all its specified requirements when operating under the following conditions:
    a. Ambient Temperatures: From -40ºC to +65ºC (-40ºF to +149ºF). A heater/blower shall be used to maintain internal dome temperatures within the manufacturer required operating temperatures for their equipment.
    b. Relative Humidity: 5% and 95%, non-condensing.
12) Total weight of CCTV cameras (including the housing, sunshield, and all internal components shall be less than 18 pounds.
13) At a minimum, dome enclosures shall be secured with a mounting plate/attachment designed to withstand a 90mph sustained wind speed with a 30% gust factor. For projects that are in areas with higher wind standards, the higher standard is required.

907-650.02.7--Pan and Tilt Unit (PTU). The minimum pan and tilt unit requirements include:

1) The motorized, remotely controlled Pan/Tilt unit shall be mounted within the dome enclosure. The unit shall be integrated with the CCTV control system.
2) For dome enclosed units, the unit shall provide a minimum continuous tilt (vertical) movement of 90 degrees from horizontal and continuous pan (horizontal) movement of 360 degrees.Tilt speed shall be variable from zero up to 40 degrees per second, minimum, and the pan speed shall be variable from zero up to 80 degrees per second, minimum.
3) For separately housed tilt motor units (non-Dome Cameras), the unit shall provide a minimum continuous tilt (vertical) movement of +90° to -90° from horizontal and continuous pan (horizontal) movement of 360 degrees.Tilt speed shall be variable from zero up to 34 degrees per second, minimum, and the pan speed shall be variable from zero up to 80 degrees per second, minimum.
4) The unit shall be capable of simultaneous pan, tilt movements and zoom on one camera
5) Drive motors shall be capable of instantaneous reversing, be corrosion resistant, not require lubrication, and have overload protection.
6) Braking shall be provided in both pan and tilt movements to enable fast stop and reversal and to prevent drifting.
7) The viewing limits shall be set by a minimum of eight (8) discreet privacy zones that are software selectable.

907-650.02.8--Camera Control Receiver – Driver. The minimum camera control receiver-driver requirements include:

1) The camera control receiver shall provide a single point interface for control, power and video communications.
2) The camera control receiver-driver shall be included within the dome enclosure and control the camera, pan/tilt and lens functions at each CCTV site.
3) The unit shall provide alphanumeric generation for on-screen titles.
4) The unit shall provide the ability to display diagnostic information on the screen in response to user commands.
5) The diagnostic information shall include current pan, tilt, zoom and focus positions, and error codes for power, communication, position and memory problems.
6) The capability for programmed tours shall be provided.
7) The camera control receiver shall use non-volatile memory to store the required information for presets, camera ID and sector text.
8) Presets shall meet the following requirements:
   a. A minimum of 64 presets shall be supported. Each preset shall consist of pan, tilt, zoom and focus positions.
   b. The Contractor shall develop and install ten (10) presets for each camera. The Contractor shall submit the preset locations to the MDOT ITS Engineer for review and approval.
9) Protocols: CCTV cameras shall support at a minimum the Pelco D and the NTCIP 1205 v1.08 communication protocol. No camera control receiver-driver shall use non-published protocols. The Contractor shall provide protocol documentation.
10) Communications Interface: The communications interface shall support communications compliant with RS- 232,and/or 485 (user selectable), or shall provide a network interface port.
11) Serial communications interface shall be compatible with the Video Encoder serial port as defined in Section 907-665 .
12) Standard interface connectors shall be provided.
13) The local video input and output connections shall be the BNC type for analog cameras. IP Based Cameras should stream video over the Ethernet connection but include a BNC type connection for local testing, configuration, and calibration.
14) Connector(s) shall also be used for connecting the control outputs from the control receiver-driver unit to the camera, lens and pan/tilt mechanisms.

907-650.02.9--Fixed Camera Lens. The fixed camera lens shall meet the following minimum requirements.

1) Type ..... Varifocal
2) Format Size ..... 1/3 Inch
3) Mount Type ..... CS
4) Focal Length 5-50
5) Zoom Ratio ..... 1.4 -360
6) Relative Aperture (F) 1.6-360
7) Iris ..... Auto (Direct Drive)
8) Focus ..... Manual

9) Zoom ..... Manual
10) Minimum Object Distance ..... 0.5 m
11) Back Focal Length ..... 10.05 mm
12) The camera lens shall have a minimum F-Stop of 1.4 to 1.6.
13) Shall provide a varifocal zoom of 5-50 mm.
14) Iris: Support automatic iris control with manual override capability. The iris shall be in a closed position when there is no power.
15) White or Color Balance: Support automatic or set to yield optical results under various outdoor lighting conditions.
16) Shutter Speed: Support automatic or set to yield optimal results under low lighting conditions without blooming or smearing, auto-iris on. Provide electronic shutter that is selectable in steps.
17) Vibration or ambient temperature change shall not affect the automatic iris function, focus mechanism or zoom mechanism.
18) The lens shall be optically clear, impact resistant and acrylic. The acrylic lens shall not yellow and shall not introduce appreciable light loss or geometric distortion over a 10-year service life when exposed to the environment.

907-650.02.10--Fixed Camera Enclosure. The fixed camera lens shall meet the following minimum requirements.

1) Designed for Outdoor Applications
2) Maintenance access for servicing
3) Environmental resistant and tamper proof meeting NEMA 4X or IP-66 rating requirements.
4) A harness and cables shall be provided with each enclosure to extend the video, power and data from the CCTV Camera System to the field cabinet. No harness shall be exposed. All entry points shall have gaskets to prevent moisture
5) The enclosure shall minimize glare and provide overexposure protection for the camera when pointed directly at the sun.
6) The enclosure shall be equipped with a heater, a defroster and a thermostat.
7) The camera equipment inside the enclosure shall meet all its specified requirements when operating under the following conditions:
   a. Ambient Temperatures: -10ºC to +50ºC (14ºF to +122ºF). A heater/blower shall be used to maintain internal temperatures within the manufacturer required operating temperatures for their equipment.
   b. Relative Humidity: 5% and 95%, non-condensing.
8) Total weight of CCTV cameras (including the housing, sunshield, and all internal components shall be less than 18 pounds.
9) The enclosure shall be secured with a mounting plate/attachment designed to withstand a 90mph sustained wind speed with a 30% gust factor. For projects that are in areas with higher wind standards, the higher standard is required.

907-650.02.11--Electrical. The minimum electrical requirements include:

1) The CCTV Camera System shall be furnished with any and all equipment required for a fully functional system, including all appropriate power and communications cables as defined by the manufacturer.

2) The power cables shall be sized to meet the applicable National Electrical Code (NEC) requirements.
3) Total power consumption shall not exceed 125 watts.
4) All devices supplied as system components shall accept, as a primary power source, 120 volts of alternating current (VAC) at an input of 60 hertz. Any device that requires source input other than 120 VAC at 60 hertz, such as cameras, PTUs, receiver/drives and dome heaters/blowers that operate at 24 volts or other, shall be furnished with the appropriate means of conversion.
5) IP fixed cameras shall receive Power over Ethernet (POE) with appropriate cabling.

907-650.02.12--Coaxial Cabling. The minimum coaxial interconnect cable requirements include:

1) The coaxial cable from the CCTV Camera System to the equipment cabinet shall be double braided (95% coverage) coaxial cable.
2) RG 59/U, 20AWG, bare copper conductor, polyethylene insulation.
3) 98% tinned copper, double braid shield, black polyethylene jacket.
4) Characteristic Impedance: 75 ohms, nominal.
5) Capacitance (conductor to shield): 21pF/ft; Inductance: 0.131uH/ft, nominal.

907-650.02.13--Surge Protection. All CCTV Camera System electrical interconnects shall be protected from voltage surges caused by lightning and external electromagnetic fields. Surge protection devices shall meet the requirements of the Notice to Bidders entitled "ITS General Requirements" as well as the requirements stated below.

1) Surge protectors shall be furnished for all non-dielectric cable and conductors (video, data/signal and device/assembly power) between the CCTV Camera System and the equipment cabinet.
2) The surge protectors shall have leads that are kept to a minimum length as recommended by the surge device manufacturer.
3) All surge protection devices shall be designed to meet the temperature and humidity requirements expected in this type of outdoor application.
4) All Surge protectors shall be U.L. listed (UL 1449, UL 497, 497A, 497B, etc., as appropriate) and bonded to the same single-point ground point.
5) Coaxial Cable. Surge protectors for coaxial cable shall meet/provide the following functionality:
   a. Attenuation: 0.1dB @10 MHz, typical
   b. Input/Output Impedance: 75 ohms nominal
   c. Operating Voltage of the surge protector shall match characteristics of the ITS device/assembly
   d. Peak Surge Current: 5,000-amperes for an 8x20 microsecond waveform
   e. Response Time: 1 nanosecond or less
6) Low Voltage/Signal Cable. Surge protectors for data/signal/control cable shall meet/provide the following functionality:
   a. Peak Surge Current: 10,000-amperes for an 8x20 microsecond waveform
   b. Response Time: 1 nanosecond or less
   c. Life Expectancy: Capable of surviving at a minimum of 25 occurrences at 2000-amperes

7) CCTV Power. Surge protectors for power from equipment cabinet power distribution to the CCTV Camera System shall meet/provide the following functionality:
   a. Frequency: DC to 10MHz
   b. Clamping Voltage: < 30VAC (rms) or 42VDC
   c. Insertion Loss: < 0.2dB
   d. Input/Output Impedance: 75 ohms, typical
   e. Peak Surge Current: 3000-amperes
   f. Response Time: 1 nanosecond or less
8) Surge protection for the IP Fixed cameras shall include provisioning for the Power over ETHERNET (POE) cabling and voltages.

907-650.02.14--PTZ Signal Monitoring Camera. The PTZ Signal Monitoring Camera shall meet the following minimum requirements.

1) Single housing with a Fixed Camera and PTZ Camera that allows for tandem viewing from both camera lens
2) Designed for outdoor locations
3) Environmental resistant and tamper proof meeting NEMA 4X or IP-66 rating requirements
4) Sealed, pressurized dome enclosure and fixed camera enclosure that provides complete protection for the camera and lens assembly from moisture and airborne contaminants
5) The dome enclosure shall be constructed in such a way that unrestricted camera views can be obtained at all camera and lens positions.
6) Total weight of CCTV cameras (including the housing, sunshield, and all internal components shall be less than 14 pounds
7) High Quality 4 MP Resolution Imaging or better
8) Shall provide Low-Light performance with expansive night view for up to 400 ft IR distance
9) Minimum of 32x Optical Zoom and 16x Digital Zoom
10) Minimum 1/1.8" progressive scan CMOS sensor
11) Shall provide semi-auto, manual and auto focus
12) Shall support 24 VAC and Hi-PoE
13) The enclosure shall be equipped with a heater, a defroster and a thermostat
14) The Fixed Camera Lens shall have a minimum 79° Horizontal FOV and 42° Vertical FOV with a focal length of f/1.0.
15) The PTZ Camera Lens shall have a minimum 60° to 2.3° (wide-tele) Horizontal FOV with a focal length of f/1.5
16) Smart Features shall include:
    a) Motion Detection
    b) Alarm inputs and outputs
    c) Region Entrance and Exit Detection
    d) Manual and Panorama Tracking
    e) Minimum of 32 Presets with Patrol and Pattern Scan
17) Up to 20 Simultaneous Live Views and 32 Users/Hosts
18) Shall support Internet Explorer, Chrome, Firefox and Safari Web Browsers
19) The camera equipment inside the enclosure shall meet all its specified requirements when operating under the following conditions:
    a) Ambient Temperatures: -30ºC to +65ºC (-22ºF to +149ºF).
    b) Relative Humidity: 5% and 95%, non-condensing.

c) Maximum 42 W Power Consumption including heater and IR light

907-650.03--Installation Requirements. All equipment shall be installed according to the manufacturer's recommendations, the Plans and as follows:

1) The Contractor shall provide the MDOT with a written inventory of items received and the condition in which they were received. Inventory shall be inclusive of make, model, and serial numbers, MAC address, and installation GPS coordinates. All equipment shall be installed according to the manufacturer's recommendations or as directed by the MDOT.
2) Materials and associated accessories/adapters shall not be applied contrary to the manufacturer's recommendations and standard practices.
3) Shall include all materials needed to permanently mount the CCTV camera to the support structure as indicated in the plans.
4) Furnish and install power, video, and data cables, and any and all ancillary equipment required to provide a complete and fully operational CCTV system site.
5) Verify all wiring meets NEC requirements where applicable.
6) All above requirements apply to both new CCTV sites as well as sites where an existing CCTV is being replaced.
7) Any new, additional or updated drivers required for the existing ATMS software to communicate and control new CCTV installed by the Contractor shall be the responsibility of the Contractor.

907-650.03.1--Testing. All equipment associated with the CCTV Camera Systems site shall undergo testing to verify conformance to requirements of the plans and these special provisions. The Contractor shall conduct a Project Testing Program as required in the Notice to Bidders entitled "ITS General Requirements." All costs associated with the Project Testing Program shall be included in the overall contract price; no separate payment will be made for any testing.

907-650.03.2--Submittals. The submittal requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with submittals shall be included in the overall contract price; no separate payment will be made for any documenting and submitting.

907-650.03.3--Quality Assurance. The quality assurance requirements defined in the Notice to Biddes entitled "ITS General Requirements" shall be met. All costs associated with the quality assurance requirements shall be included in the overall contract price.

907-650.03.4--Warranty. At a minimum, the warranty requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with the warranty requirements shall be included in the overall contract price.

907-650.03.5--Training. The minimum training requirements shall be as defined in the Notice to Bidders entitled "General ITS Requirements."

907-650.04--Method of Measurement. On-Street Video Equipment will be measured per each camera installation.

On-Street Video Equipment Training shall be measured as a lump sum which shall include all coordination, materials, labor, training location costs, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."

907-650.05--Basis of Payment. On-Street Video Equipment, measured as prescribed above, will be paid for at the contract unit price bid per each, which price shall be full compensation for furnishing all materials inclusive of camera unit, housing, pan/tilt drive, receiver/driver, software driver, mounting hardware, any necessary enclosures, items necessary to mount the camera unit from a mast arm pole, steel strain pole, pole extension pipe, etc., for all installing, connecting, cutting, pulling and testing and for all equipment, tools, labor, all documentation and submittals, quality assurance, warranties, and incidentals necessary to complete the work and quality assurance.

Required cabinet facilities, including transformer and/or disconnects, will not be measured for separate payment.

Progress payments for the On-Street Video System will be paid as follows:

1) 50% of the contract unit price upon delivery of equipment and approval of any bench and/or pre-installation test results, as prescribed in Project Testing Program;

2) An additional 40% of the contract unit price upon approval of Stand Alone Acceptance Test results; and

3) Final 10% of the contract unit price upon Final Project Acceptance.

On-Street Video Equipment Training, measured as prescribed above, will be paid for at the contract unit lump sum price, which price shall be full compensation for all training costs including coordination, materials, labor, training location costs, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."

Payment will be made under:

907-650-A: On-Street Video Equipment Type _*_ - per each

907-650-B: On-Street Video Equipment Training - lump sum

* PTZ, Fixed, Analog, IP Based, PTZ Signal Monitoring, etc.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-662-2 **CODE: (IS)**

DATE: **05/25/2021**

SUBJECT: **Radio Interconnect System**

Section 662, Radio Interconnect System, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-662.02--Materials.

907-662.02.1--General Requirements. Delete the first sentence of the fourth paragraph in Subsection 662.02.1 on page 669, and substitute the following.

The Contractor shall obtain and reserve necessary frequencies, and apply for all required licenses by the FCC.

Delete the first sentence of the seventh paragraph in Subsection 662.02.1 on page 669, and substitute the following.

The Mean Time Between Failures (MTBF) shall be at least 87,658 hours.

Delete subparagraph e. under Network Feature in Subsection 662.02.1 on page 670, and substitute the following.

e. The wireless radio shall be a Layer 2 device by operating similar to a switch or bridge device and meeting all requirements of a Layer 2 switch as specified in the MDOT Networking Equipment Special Provision No. 907-663. The wireless radio shall be capable of connecting to the MDOT Network via an RJ-45 port.

907-662.02.3--Radio Interconnect System, Broadband. Delete subparagraphs 4) and 5) in Subsection 662.02.3 on page 671, and substitute the following.

4) The short range and long range broadband radios shall provide a minimum data rate of 150 Mbps as tested by bandwidth speed test.
5) The short range and long range broadband radios shall provide reliable communication and sufficient bandwidth (i.e., greater than the cumulative minimum bandwidth of each device that will utilize the link) for all devices utilizing the wireless link(s).
6) Short range and long range broadband radios shall support 802.11 a/n wireless standards.
7) Short range and long range radios shall have 2 or more Gigabit Ethernet ports.
8) Short range and long range radios shall be capable of a TX power of 24 dBm or better.
9) The Contractor may propose the use of multiband (dual band, tri band, etc.) radios using licensed 4.9 GHz and unlicensed 5.8 GHz and 2.4 GHz bands if bandwidth requirements and path interference warrants the use of such radios and approved by the Project Engineer.

907-662.02.4--Radio Interconnect System, Television Broadcast Radio (TVBR).

907-662.02.4.1--Specific Requirements. Delete the first sentence of subparagraph 7) in Subsection 662.02.4.1 on page 672, and substitute the following.

The MTBF shall be at least 43,829 hours for Type Short Range TVBR and 87,658 hours for Type Long Range TVBR.

907-662.03--Construction Requirements.

Delete Subsections 662.03.2 and 662.03.3 on pages 673 thru 675, and substitute the following.

907-662.03.2--Testing. All equipment associated with the Radio Interconnect System at each site shall undergo testing to verify conformance to requirements of the plans and these special provisions. The Contractor shall conduct a Project Testing Program as required in the Notice to Bidders entitled "ITS General Requirements." All costs associated with the Project Testing Program shall be included in the overall contract price; no separate payment will be made for any testing.

907-662.03.2.1--Standalone Acceptance Test (SAT). In addition to the requirements set forth in the Notice to Bidders entitled "ITS General Requirements", successful communications shall demonstrate, at minimum, the ability of a wireless transceiver to send clear, uninterrupted video if the radio is intended to carry a video signal or an error-free data message of at least 200 KB if the radio will not carry video signals, to the receiving station and have it processed for viewing and confirmation. A minimum of 30 test transmissions .shall be attempted at each test site. If a failure occurs at the locations selected, it will be the responsibility of the Contractor to re-check the test area to determine if a problem exists. When problem(s) occur, it will be the Contractor's responsibility to perform additional tests as required to define the cause of the problem and confirm the final working functionality. If areas of non-performance represent more than the Contractor's predicted link reliability it will be the Contractor's responsibility to correct such problems at the sole expense of the Contractor. Additional costs associated with the repeated tests will be the sole responsibility of the Contractor.

The Contractor shall prepare and execute a detailed system acceptance test plan, including detailed system acceptance test procedures. The Contractor shall submit a copy of all system acceptance test plans and link reliability predictions to the Project Engineer through the standard Department submittal process, as noted in the Notice to Bidders entitled "ITS General Requirements."

907-662.03.3--Submittals. The submittal requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with submittals shall be included in the overall contract price; no separate payment will be made for any documenting and submitting.

907-662.03.4--Quality Assurance. The quality assurance requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with the quality assurance requirements shall be included in the overall contract price.

907-662.03.5--Warranty. At a minimum, the warranty requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with the warranty requirements shall be included in the overall contract price.

907-662.03.6--Training. The minimum training requirements shall be as defined in the Notice to Bidders entitled "ITS General Requirements."

907-662.04--Method of Measurement. In subparagraph 2) in Subsection 622.04 on page 675, change "Additional" to "additional."

At the end of Subsection 662.04 on page 675, add the following.

Radio Interconnect Training shall be measured as a lump sum which shall include all coordination, materials, labor, training location costs, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."

907-662.05--Basis of Payment. Delete the first paragraph of Subsection 662.05 on pages 675 and 676, and substitute the following.

The radio interconnect system components, measured as prescribed above, will be paid for at the contract unit price per each, which price shall be full compensation for furnishing all labor, tools, equipment, warranties, connecting, testing, materials inclusive of radio, software, base stations, power supply, antennas, cables and connectors, lightning suppressors, mounting and grounding hardware, enclosures, receivers, and transceivers, all documentation, submittals, and system documentation including shop drawings, operations and maintenance manuals, wiring diagrams, and block diagrams, and all incidentals necessary to complete the work and quality assurance.

After the third paragraph of Subsection 662.05 on page 676, add the following.

Radio Interconnect Training, measured as prescribed above, will be paid for at the contract unit lump sum price, which price shall be full compensation for all training costs including coordination, materials, labor, training location costs, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."Delete the list of pay items on page 676, and substitute the following.

907-662-A:	Radio Interconnect, Signal Control, Installed in New Controller Cabinet	- per each
907-662-B:	Radio Interconnect, Signal Control, Installed in Existing Controller Cabinet	- per each
907-662-C:	Radio Interconnect, Signal Control Repeater	- per each

907-662-D: Radio Interconnect, Broadband, * - per each

907-662-E: Radio Interconnect, TVBR, * - per each

907-662-F: Radio Interconnect, Spare Parts, Furnish Only - per each

907-662-G: Radio Interconnect Training - lump sum

* Type – Long Range or Short Range

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-663-6 **CODE: (IS)**

DATE: 12/15/2023

SUBJECT: Networking Equipment

Section 907-663, Networking Equipment, is hereby added to and made part of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as follows.

SECTION 907-663 -- NETWORKING EQUIPMENT

907-663.01--Description. This section specifies the minimum requirements for providing networking communication equipment, including network switches, terminal servers, fiber optic modems, SD-WAN routers, and associated cabling, furnished and installed.

Network Switches are divided into three (3) categories; Layer 2 hardened, Layer 3 hardened, and Layer 3 non-hardened. There can be multiple types per category such as Type A, B, C etc. Types will be defined by options based on versions and numbers of ports, and/or additional modules such as built in fiber modems, wireless components, and terminal servers. The number of specific port versions will also be defined by plan requirements, NTBs, and Special Provisions.

Field and core hardened category switches shall be environmentally hardened devices.. These switches support Intelligent Transportation Elements deployed on arterial streets and the highway system where network switches are required for communications but HVAC systems are not available for environmental control. Elements include but are not limited to traffic signals, dynamic message signs, surveillance cameras, and vehicle detection systems. Field and core non-hardened category switches will support the Intelligent Transportation System and be installed in the Traffic Management Center and Communications Huts which are environmentally controlled.

This section also specifies the minimum requirements for standalone and network switch module terminal servers, standalone and network switch modules, SD-WAN Routers, and Ethernet Network cable. The terminal servers shall be hardened. The terminal server device, also commonly referred to as a port server device, will be used to communicate bi-directionally between IP-based Ethernet network systems and existing field devices that communicate or are controlled via a full-duplex serial interface. SD-WAN Routers shall be used to provide data network connectivity via a cellular network bi-directionally to remote sites such as portable traffic signal sites, portable CMS, smart work zones, ITS site locations, or devices that need serial or Ethernet communication that can be provided over cellular service.

The Ethernet network cable will be installed in conduit and cabinets between elements that are within 300 feet of each other to eliminate the need for two hardened switches. The work shall consist of providing all labor, materials, equipment, and incidentals necessary to furnish, install, and test the networking equipment.

907-663.02--Materials. Network switches, terminal servers, cell modems, and associated cabling will be placed in the field device cabinets and shall meet the following requirements.

907-663.02.1--Network Switch Requirements. All network switches shall adhere to the following minimum requirements.

1) Field switch optical ports shall meet the following:
   a. The minimum optical budget between transmit and received ports shall be 18dB.
   b. Shall include LC connector types.
   c. Optical receiver maximum input power level shall not be exceeded.
   d. Optical attenuators shall be added as needed; fiber optic attenuator patch cords shall be in accordance with Section 657 of the Standard Specifications. It is the Contractor's responsibility to determine where attenuators are needed and shall be included in the cost of the switch.
   e. The Contractor shall be required to measure the optical power on each optical port to ensure that power entering the receiver is within the acceptable power budget of the optical port.
   f. Optical interface equipment shall operate at 1310 nm.
2) Operate from 100 VAC to 200 VAC.
3) Meet the IEEE 802.3 (10Mbps Ethernet) standard.
4) Meet the IEEE 802.3u (Fast Ethernet 100 Mbps) standard.
5) Meet the IEEE 802.3x (Full Duplex with Flow Control) standard.
6) Meet the IEEE 802.1p (Priority Queuing) standard.
7) Meet the IEEE 802.1Q (VLAN) standard per port for up to four VLAN's.
8) Meet the IEEE 802.1w (Rapid Spanning Tree Protocol) standard.
9) Meet the IEEE 802.3ad (Port Trunking) standard for a minimum of two groups of four ports.
10) The field switches shall meet IEEE 802.3D (Spanning Tree Protocol) standard.
11) Capable of mirroring any port to any other port within the switch.
12) Password manageable through:
   a. SNMP
   b. Telnet/CLI
   c. HTTP (Embedded Web Server) with Secure Sockets Layer (SSL)
13) Full implementation of SNMPv1 and SNMPv2c.
14) Full implementation of GVRP (Generic VLAN Registration Protocol).
15) Full implementation of IGMP and IGMP snooping.
16) Minimum MTBF of 100,000 hrs using Bellcore TS-332 standard.
17) Full implementation of RFC 783 (TFTP) to allow remote firmware upgrades.
18) UL approved.
19) The field switch shall provide LED status indicators as follows:
   1) power on and off
   2) network status per port (transmit, receive, link, speed)
20) Unused ports (copper and optical) shall be covered with rubber or plastic dust caps/covers.
21) Switches Types that are required to be Environmentally Hardened shall meet the following environmental requirements:
   a. The field switches [this excludes Types C, E and F] shall operate between -34° to +74°C, including power supply.

b. The field switches [this excludes Types C, E and F] shall operate from 10% to 90% non-condensing humidity.

907-663.02.1.1–Layer 2 Network Switch. Layer 2 network switches shall be provided in locations where only Layer 2 network functionality is required. These locations will generally be field site locations. Layer 2 network switches shall adhere to the following minimum requirements.

1) Shall be environmental hardened
2) Rack, shelf or DIN rail mountable. If shelf mounted, the Contractor must furnish and install a shelf if shelf space is not available in the facility. Any shelf used shall be ventilated as per the Network Switch manufacturer recommendation.
3) All power transformers provided shall be "fastening mechanism" type. No plug-in types shall be permitted. All corded transformers shall be mountable with the ability to neatly secure power cords.

907-663.02.1.1.1--Type A Network Switch. Type A network switches shall be a layer 2 network switch at minimum and shall be environmentally hardened. The Type A shall be provided in situations where a minimal number of interface ports are required. The Type A switch shall adhere to the following minimum requirements in addition to the Layer 2 network switch requirements.

1) Minimum of six 10/100/1000 Base-TX ports. Each port shall connect via RJ-45 connector.
2) Minimum of two 1000 Base Long Reach optical ports.

907-663.02.1.1.2--Type B Network Switch. Type B network switches shall be a Layer 2 network switch at minimum and shall be environmentally hardened. The Type B shall be provided in situation where minimal number of interface ports are required. The Type B switch shall adhere to the following minimum requirements in addition to the Layer 2 network switch requirements.

1) Minimum of twelve (12) 10/100/1000 Base-TX ports. Each port shall connect via RJ-45 connector.
2) Minimum of two (2) 1000 Base Long Reach optical ports.

907-663.02.1.2–Layer 3 Network Switch. Layer 3 network switches shall be provided in locations where Layer 2 and Layer 3 network functionality is required. These locations will generally be Environmental Controlled Field HUBs, TMC equipment rooms, and control rooms. Where Layer 3 Network Switching is required but Environmental Control is not available, Environmentally Hardened Type Layer 3 switches shall be provided. In addition to meeting the general network Requirements, Layer 3 Switches have the following additional Requirements:

1) Each switch shall provide Layer 2 and Layer 3 switching and routing services.
2) Each switch shall meet the IEEE 802.1d (Virtual Bridge) standard.
3) Each switch shall meet the IEEE 802.1x (authentication) standard.
4) Access Control Lists (ACLs)
5) IPv4 and IPv6 multicast
6) IP Service-Level Agreement (IP SLA)
7) Open Shortest Path First (OSPFv2 and OSPFv3)
8) Border Gateway Protocol (BGP)

9) Enhanced Interior Gateway Routing Protocol (EIGRP)

907-663.02.1.2.1--Type C Network Switch Requirements. The Type C network switch, which is a base core switch, will be installed in the communication hubs and shall meet the following requirements:

1) Each switch shall be populated with modules including the following features and capabilities:
   a. Minimum of 64Gbps/48Mpps module Bandwidth
   b. Minimum of 8-GE uplink ports available per network switch assembly. The Contractor shall provide an uplink SFP optical module compatible with the interface for the uplink as indicated in the Location & Configuration of Communication Nodes notice to bidders for each uplink
   c. In one (or more) modules: 24 Ethernet 10/100/1000 RJ-45 ports
2) Optical receiver maximum input power level shall not be exceeded.
3) Optical attenuators shall be added as needed; fiber optic attenuator patch cords shall be in accordance with Section 657 of the Standard Specifications. It is the Contractor's responsibility to determine where attenuators are needed and shall be included in the cost of the switch.
4) 19" rack mountable.
5) Supports 10 gigabit ethernet of SFP optics.
6) NEBS Level 3 compliant.
7) Meet the requirements of :
   a. IEEE 802.3z
   b. IEEE 802.3ab
   c. IEEE 802.1Q
   d. GR-20-CORE: Generic requirements for Optical Fiber and Optical Fiber Cable
   e. GR-326-CORE: Generic Requirements for Singlemode
8) Full implementation of BGPv4 protocol as outlined by RFCs: 4271, 6286, 6608, 6793, 7606, 7705, 8212
9) Full implementation of OSPF protocol as outlined by RFCs: 2178, 1583, 1587, 1745, 1765, 1850, 2154, 2328, 1850, 1997, 2385, 2439, 2842, 2918, 2370.
10) Capable of mirroring any port to any other port within the switch.
11) Password manageable through:
   a. SSH (Secure Shell)
12) Full implementation of MLD (Multicast Listener Discovery).
13) Full implementation of IGMPv2.
14) Full implementation of PIM-SM and PIM-DM.
15) Comply with FCC 47 CRF Part 15 Class A emissions.
16) Bandwidth flow rate limiting policing support per port.
17) Full security implementation of
   a. Support SSH, 802.1x (rel 2)
   b. Access Control Lists (ACL's)
   c. RADIUS authentication
   d. TACACS+ authentication
18) The power supply units shall be hot swappable.

907-663.02.1.2.1.1--Type C1 Network Switch Requirements. The Type C1 network switch will be installed in communication hubs where a maximum total of 4 pair/(8 strands) of fiber optic cable will be actively in use or in environmentally controlled wireless towers and shall meet the following requirements:

1) Each switch shall be populated with an 4-port SFP gigabit ethernet module and also include the following features and capabilities:
   a. Minimum of 88Gbps Switching Capacity and 480Gbps Stacking Bandwidth
   b. In one (or more) Fiber SFP-based module(s): a minimum of 8 1000Base-X (SFP-based) compatible access ports which may also be used as uplink ports. The Contractor shall provide whichever is greater between a minimum number of SFP optic modules to interface to the fiber as indicated in the plans and NTBs, or a minimum of eight (8) and shall meet the following minimum requirements:
      i. Optical budget of 18dB
      ii. Switch shall be stackable and contain dual power supplies
      iii. Same optical wavelength as Type A & B switches
      iv. Same optical transmitter power as Type A & B switches
2) Non-Chassis based switch
3) Operate from 23° to 113°F.
4) RIPng, OSPFv6, and EIGRPv6 support
5) Full implementation of GMRP (Generic Multicast Registration Protocol).
6) Have redundant power supplies installed.

907-663.02.1.2.1.2--Type C2 Network Switch Requirements. The Type C2 network switch will be installed in the Communication Hubs where a minimum total of 5 pair/ (10 strands) of fiber optic cable will be actively in use. This type switch may also be installed in environmentally controlled wireless towers if the minimum total of 5 pair/(10 strands) fiber optic cable in-use rule applies. This type switch shall also meet the following requirements:

1) Each switch shall be populated with three (3) modules including the following features and capabilities:
   a. In one (or more) Fiber SFP-based module(s): a minimum of 48 1000Base-X (SFP-based) compatible access ports and a minimum of 8 1000Base-X (SFP-based) uplink ports. The Contractor shall provide whichever is greater between a minimum number of SFP optic modules to interface to the fiber as indicated in the plans and NTBs, or a minimum of 14 and shall meet the following minimum requirements:
      i. Optical budget of 18dB
      ii. Hot-swappable network modules
      iii. Same optical wavelength as Type A & B switches
      iv. Same optical transmitter power as Type A & B switches
2) Operate from 10 to 90% non-condensing humidity
3) Operate from 32° to 104°F.
4) Designed as a chassis with easy to remove modules.
5) Chassis backplane shall be passive.
6) All modules shall be hot-swappable.
7) Must have installed redundant power supplies in which each supports a minimum of 4200 watts.

8) Switch assembly shall have a minimum of three (3) module slots.
9) Blank covers for all remaining slots.

907-663.02.1.2.1.3--Type C3 Network Switch Requirements. The Type C3 network switch will be installed in the communication hubs where a minimum total of 5 pair/(10 strands) of fiber optic cable will be actively in use. This type switch may also be installed in environmentally controlled wireless towers if the minimum total of 5 pair/(10 strands) fiber optic cable in-use rule applies. This type switch shall also meet the following requirements:

1) Each switch shall be populated with modules including the following features and capabilities:
    a. Redundant Layer 2/3 switching and routing services
    b. In one (or more) Fiber SFP-based module(s): a minimum of 48 1000Base-X (SFP-based) compatible access ports and a minimum of 8 1000Base-X (SFP-based) uplink ports. The Contractor shall provide whichever is greater between a minimum number of SFP optic modules to interface to the fiber as indicated in the plans and NTBs, or a minimum of 14 and shall meet the following minimum requirements:
        i. Optical budget of 18dB
        ii. Hot-swappable network modules
        iii. Same optical wavelength as Type A & B switches
        iv. Same optical transmitter power as Type A & B switches
2) Operate from 32° to 104°F.
3) Operate from 10 to 90% non-condensing humidity
4) Designed as a chassis with easy to remove modules.
5) Chassis backplane shall be passive.
6) All modules shall be hot-swappable.
7) Must have installed redundant power supplies in which each supports a minimum of 4200 watts.
8) Switch assembly shall have a minimum of 6 module slots.
9) Blank covers for all remaining slots.

907-663.02.1.2.1.4--Type C4 Network Switch Requirements. The Type C4 network switch will be installed in the communication hubs where no less than 21 pairs/(42 strands) of fiber optic cables will be active and in use and shall meet the following requirements:

1) Each switch shall be populated with modules including the following features and capabilities:
    a. Redundant Layer 2/3 switching and routing services
    b. The switch chassis shall be capable of accommodating up to 440 Gbps per slot.
    c. In one (or more) Fiber SFP-based module(s): a minimum of 48 1000Base-X (SFP-based) compatible access ports and a minimum of 8 1000Base-X (SFP-based) uplink ports. The Contractor shall provide whichever is greater between a minimum number of SFP optic modules to interface to the fiber as indicated in the plans and NTBs, or a minimum of 14 and shall meet the following minimum requirements:
        i. Optical budget of 18dB
        ii. Hot-swappable network modules
        iii. Same optical wavelength as Type A & B switches

iv. Same optical transmitter power as Type A & B switches

2) Operate from 32° to 104°F.
3) Supports relative humidity - Ambient (noncondensing) operating: 5% to 90%
4) Designed as a chassis with easy to remove modules.
5) Chassis backplane shall be passive.
6) All modules shall be hot-swappable.
7) Must have installed dual-redundant (4) power supplies in which each supports a minimum of 3000 watts.
8) Switch assembly shall have a minimum of seven (7) module slots.
9) Blank covers for all remaining slots.

907-663.02.1.2.2--Type D Network Switch Requirements. The Type D network switch shall be of chassis design. The switch shall be able to accept a minimum of four (4) different types of modular cards. The Type D network switch shall meet the minimum requirements specified below:

1) The switch shall be chassis designed with a minimum of four (4) module slots.
2) Each switch shall be able to accept the following type modules:
   a. Ethernet module:
      i. A minimum number of six (6) 10/100Base-TX compatible RJ45 ports.
      ii. The Contractor shall provide the minimum number of modules necessary to meet or exceed the required number of ports as indicated in the plans and NTBs.
      iii. Total required bandwidth per chassis shall not exceed 10 Gbps
   b. Fiber based modules:
      i. The module shall accept SFP type fiber modules.
      ii. The Contractor shall supply any necessary fiber modules that meet the requirements of speed, type of fiber, and link budget connection.
      iii. The Contractor shall provide the minimum number of modules necessary to meet or exceed the required number of ports as indicated in the plans and NTBs.
   c. WAN module:
      i. T1, DS3 or Metro Ethernet Interface (as per NTB or project plans)
         1) The Interface shall be T1, DS3 or Metro Ethernet
         2) The ports shall connect via RJ45 connector.
      ii. Cellular Interface
         1) Contractor shall provide information to the Project Engineer to enable activation of the modem.
         2) Contractor shall get prior approval from the Project Engineer on selection of cellular radio type (HSPA/EVDO)
   d. Terminal Server module:
      i. Module that meets terminal server requirements Subsection 663.02.6
   e. Power Supply module:
      i. The power module provided shall be "screw terminal block" type. No pluggable terminal block.
      ii. Input power: Same as Type A and Type B switches.
      iii. Power module shall be hot-swappable.
      iv. The Contractor shall supply the necessary amount of power supplies to meet power requirements for all cards installed and the chassis itself

3) Software license shall be provided to match functionality of installed modules.
4) Shall be DIN or Panel mountable.
5) Password manageable through:
    a. SSHv2 (Secure Shell)
6) Full implementation of VRRP.
7) Comply with FCC 47 CRF Part 15 Class A emissions.
8) Bandwidth flow rate limiting policing support per port.
9) Full security implementation of
    a. Support SSH2, 802.1x (rel 2)
    b. Access Control Lists (ACL's)
    c. RADIUS
10) Blank covers for all remaining slots.
11) Electronic surfaces shall be covered with conformal coating for additional environmental protection.

907-663.02.1.2.3--Type E Network Switch Requirements. The Type E network switch will be installed in locations where multiple backbone fibers converge or high concentration of ports are needed for a field location but need a hardened switch and shall meet the following requirements:

1) Each switch shall be populated with redundant switch fabric modules that meet the following minimum requirements:
    a. Minimum of 2-GE uplinks available per card with a minimum capability to expand to eight (8). The Contractor shall provide an uplink SFP optical module compatible with the interface for the uplink as indicated in the Notice to Bidders entitled "Location & Configuration of Communication Nodes" for each uplink.
2) The Contractor will need to determine port count configuration based on the project plans for the Type E switch. Optical interfaces shall include 1000 Base-X (SFP-based module(s)) with a minimum of four (4) ports. The Contractor shall provide whichever is greater between a minimum number of SFP optic modules to interface to the fiber as indicated in the plans and NTBs, or a minimum of six (6) and shall have a minimum Optical budget of 18dB and be the same optical wavelength as Type A & B switches.
    a. Optical receiver maximum input power level shall not be exceeded.
    b. Optical attenuators shall be added as needed; fiber optic attenuator patch cords shall be in accordance with Section 657 of the Standard Specifications. It is the Contractor's responsibility to determine where attenuators are needed and shall be included in the cost of the switch.
3) Include a minimum of eight (8) Ethernet 10/100/1000 ports
4) Include a minimum of four (4) SFP ports must support 1000-Base-X/10 gigabit-ethernet-optics.
5) 19" rack mountable.
6) Chassis backplane shall be passive.
7) Meet the requirements of :
    a. IEEE 802.3z
    b. IEEE 802.3ah
    c. IEEE 802.1Q
    d. GR-20-CORE: Generic requirements for Optical Fiber and Optical Fiber Cable
    e. GR-326-CORE: Generic Requirements for Singlemode

8) Full implementation of BGPv4 protocol as outlined by RFCs: 4271, 6286, 6608, 6793, 7606, 7705, 8212
9) Full implementation of OSPF protocol as outlined by RFCs: 2178, 1583, 1587, 1745, 1765, 1850, 2154, 2328, 1850, 1997, 2385, 2439, 2842, 2918, 2370.
10) Capable of mirroring any port to any other port within the switch.
11) Password manageable through:
    a. SSHv2 (Secure Shell)
12) Full implementation of GMRP (Generic Multicast Registration Protocol).
13) Full implementation of IGMPv2.
14) Full implementation of PIM-SM and PIM-DM.
15) Full implementation of DVMRPv3.
16) Full implementation of VRRP.
17) Comply with FCC 47 CRF Part 15 Class A emissions.
18) Bandwidth flow rate limiting policing support per port.
19) Full security implementation of
    a. Support SSH2, 802.1x (rel 2)
    b. Access Control Lists (ACL's)
    c. RADIUS
    d. TACACS
20) Have redundant power supplies installed.
21) Blank covers for all remaining slots.
22) Have options or modules to add a terminal server as specified in Subsection 663.02.2
23) Have options or modules to add a cellular interface as specified in Subsection 663.02.3

907-663.02.1.2.3.1--Type E1 Network Switch Requirements. The Type E1 network switch will be installed in locations where multiple backbone fibers converge or a high concentration of ports are needed for a field location and a hardened switch is required and shall meet the following requirements:

1) Each switch shall be populated with redundant switch fabric modules that meet the following minimum requirements:
    a. 56 to 64Gbps switching bandwidth/41.67 mpps with 64byte packets
2) Based from the project plans, the Contractor must determine the appropriate configuration of port types and count by selecting one of the options below:
    a. Include a minimum of 12 10/100/1000 ethernet ports and a minimum of 16 optical 1000Base-X(SFP-Based).
    b. Include a minimum of 24 10/100/1000 ethernet ports and a minimum of 4 optical 1000 base-X (SFP-Based).
3) Operate from -45° to +75°C.
4) Operate relative humidity of 5% to 95% noncondensing

907-663.02.1.2.3.2--Type E2 Network Switch Requirements. The Type E2 network switch will be installed in locations where multiple backbone fibers converge or a high concentration of ports are needed for a field location, a hardened switch and larger bandwidth are needed, and shall meet the following requirements:

1) Each switch shall be populated with redundant switch fabric modules that meet the following minimum requirements:
   a. 128Gbps switching bandwidth/41.67 mpps with 64byte forwarding rate
2) Based from the project plans, the Contractor must determine the appropriate configuration of port types and count by selecting one of the options below:
   A. Include a minimum of 12 10/100/1000 ethernet ports and a minimum of 12 optical 1000Base-X(SFP-Based).
   B. Include a minimum of 12 10/100/1000 ethernet ports and a minimum of 16 optical 1000 base-X (SFP-Based).
3) Supports 10 gigabit ethernet of SFP optics.
4) Operate from -40° to +85°C.
5) Operate relative humidity of 0% to 95% noncondensing

907-663.02.1.2.4--Type F Network Switch Requirements. The Type F network switch will be Layer 3 switches installed in field locations with wireless communications or access points and shall meet the following requirements:

1) Each switch shall be populated with switch modules that meet the following minimum requirements:

   a. 20Gbps Aggregate Bandwidth
   b. Minimum of 4-GE uplinks available per switch with a minimum of 2 being fiber ports. The Contractor shall provide an uplink SFP optical module compatible with the interface for the uplink as indicated in the Notice to Bidders entitled "Location & Configuration of Communication Nodes" for each uplink.
   c. SD flash port for swappable Management Card configuration
   d. Supports High Density Power over Ethernet (PoE) for up to 8 devices
   e. Supports Cisco Common Industrial Protocol (CIP)
   f. Support of SCADA (Supervisory Control And Data Acquisition) connectivity.
   g. Can be supported with IP services.

2) In addition to the uplink ports, interfaces ports shall include:
   a. 8 PoE 10/100/1000
   b. 4 SFP ports
      i. Optical receiver maximum input power level shall not be exceeded.
      ii. Optical attenuators shall be added as needed; fiber optic attenuator patch cords shall be in accordance with Section 657 of the Standard Specifications. It is the Contractor's responsibility to determine where attenuators are needed and shall be included in the cost of the switch.
3) DIN Rail Mountable.
4) Operate from -40° to +70°C.
5) Operate from 5% to 95% non-condensing humidity
6) Supports IEEE 802.1AE MACsec, Security Group Access Control Lists (SGACL)
7) RIPng, OSPFv6, and EIGRPv6 support
8) Full implementation of IGMPv2.
9) Full implementation of PIM-SM and PIM-DM.
10) Supports Redundant DC input voltage

11) Power supplies with PoE support and 6' minimum power cord(s).

907-663.02.2--Terminal Server. Terminal server shall adhere to the following minimum requirements.

1) 10/100 Base-T Ethernet port connection
2) RJ-45/DB9 Serial port connection
3) RS-232/422/485 selectable serial connections
4) Baud rates up to 230 Kbps
5) Full Modem and hardware flow control
6) TCP/UDP Socket Services
7) UDP Multicast
8) Telnet and Reverse Telnet
9) Modem emulation
10) SNMP (Read/Write)
11) PPP
12) Port buffering
13) HTTP
14) Remote management
15) DHCP/RARP/ARP-Ping for IP address assignment
16) LED status for link and power
17) The terminal server shall support a minimum of four (4) bi-directional serial communications over Ethernet 10/100 Base-TX.
18) Each terminal server shall have a minimum of four (4) EIA-232/422/485 serial interface ports. These ports shall be individually and independently configurable, directly or over the network, to EIA-232/422/485 mode of operation as defined by the EIA for data format, data rate and data structure (e.g., the number of bits, parity, stop bits, etc.). Each serial port shall support up to 230 Kbps.
19) Each serial port shall support IP addressing and socket number selection.
20) The equipment shall provide the capability to establish an IP connection directly from a workstation to any encoder IP address and socket number transport serial data.
21) Each terminal server shall have an Ethernet Interface (10/100Base-TX protocol, Full/Half-Duplex, Auto Sense (802.3), RJ-45).

907-663.02.3--SD-WAN Router. The SD-WAN (Software Defined Wide Area Network) router supports next generation wide area networking leveraging multiple internet connection types. The SD-WAN router shall be the alternative selection instead of cellular modem communications to provide network communications to very small data networks to connect to the traffic management centers.

907-663.02.3.1--Functional Requirements. SD-WAN Router, antenna, wiring assemble, configuration software, and installation necessary shall be provided and furnished for a working cellular wireless communication connection in accordance with plans and specifications and compatible with the requirements of the MDOT system, and the wireless service carrier used by MDOT. Unless otherwise indicated on the plans, all items that are required to complete the installation and ensure an operational system shall be supplied by the Contractor whether listed above or not. Items required but not listed above shall be at no direct pay. All components supplied

by the Contractor are the responsibility of the Contractor. It shall be the responsibility of the Contractor to properly configure and deliver a working SD-WAN cellular communications system. It shall be the responsibility of the Contractor to determine the final configuration of all electrical connections. Cellular account setup shall be coordinated with MDOT Information Systems Division. Warranty and cellular carrier account shall be transferred into MDOT's name upon acceptance of the project.

907-663.02.3.2--SD-WAN Router System. The SD-WAN shall adhere to the following minimum requirements.

1) Each router shall meet the following minimum requirements:
   a. Layer 2/3 switching and routing services.
   b. Minimum of 250 Mbps bidirectional Throughput
   c. Minimum of Four 10/100BASE-T Fast Ethernet ports or better
   d. Minimum of 2 x GE RJ45 LAN ports
   e. Supports Cisco Common Industrial Protocol (CIP)
   f. Support of SCADA, DNP3, T101-104, Raw Socket TCP, and UDP.
   g. Provides LTE QoS with support for up to 8 concurrent bearers on each cellular WAN interface for traffic classification and prioritization.
   h. 1-year warranty, maintenance, and support.
   i. Dual active LTE backhaul with expansion module.
   j. Virtual Router Redundancy Protocol (VRRP) (RFC 2338)
   k. Hot Standby Router Protocol (HSRP)
   l. Dual SIM support on the LTE module for cellular failover
   m. IPv6 unicast and multicast forwarding.
   n. IPv6 ACLs
   o. IPv6 over cellular
   p. IPv6 routing

2) WAN Interfaces
   a. Combo 10/100/1000 Gigabit Ethernet port (RJ45 and SFP) on the base platform and additional 10/100/1000 Gigabit Ethernet SFP on the expansion module and include supported SFPs - *The Contractor shall provide an uplink SFP optical module compatible with the interface for the uplink as indicated in the Location & Configuration of communication Nodes notice to bidders for each uplink.*
   b. LTE: Modular with options for single and dual active LTE and LTE-Advanced
   c. LTE in United States supports 3 cellular companies AT&T, cSpire and Verizon.
   d. LTE bands 1-5, 7, 8, 12, 13, 20, 25, 26, 29, 30, and 41
   e. FDD LTE 700 MHz (band 12), 700 MHz (band 29), 800 MHz (band 20), 850 MHz (band 5 CLR), 850 MHz (band 26 Low), 900 MHz (band 8), 1800 MHz (band 3), 1900 MHz (band 2), 1900 MHz (PCS band 25), 1700 MHz and 2100 MHz (band 4 AWS), 2100 MHz (band 1), 2300 MHz (band 30), or 2600 MHz (band 7)
   f. TDD LTE 2500 MHz (band 41)
   g. Carrier aggregation band combinations: 1+8; 2+(2,5,12,13,29); 3+(7,20); 4+(4,5,12,13,29); 7+(7,20); 12+30, 5+30, and 41+41
   h. Theoretical download and upload speeds: 300 and 50 Mbps.

3) IPv4 and IPv6 services features
   a. Routing Information Protocol Versions 1 and 2 (RIPv1 and RIPv2)
   b. Generic Routing Encapsulation (GRE) and Multipoint GRE (MGRE)
   c. Standard 802.1d Spanning Tree Protocol (STP)
   d. Network Address Translation (NAT)
   e. Dynamic Host Configuration Protocol (DHCP) server, relay, and client
   f. Dynamic DNS (DDNS)
   g. DNS proxy
   h. DNS spoofing
   i. Access Control Lists (ACLs)
   j. IPv4 and IPv6 multicast
   k. IP Service-Level Agreement (IP SLA)
   l. Open Shortest Path First (OSPFv2 and OSPFv3)
   m. Border Gateway Protocol (BGP)
   n. Enhanced Interior Gateway Routing Protocol (EIGRP)
   o. Virtual Route Forwarding (VRF) Lite
   p. Next-Hop Resolution Protocol (NHRP)
   q. Serial data encapsulation and relay
   r. L2TPv3 over sub-interfaces and VLAN

907-663.02.3.3--Environmental Characteristic. Environmental operating temperature ranges shall be as follows.

a. Operate from –40 to 140°F (–40 to 60°C) in a sealed NEMA cabinet with no airflow.
b. Operate from –40 to 158°F (–40 to 70°C) in a vented cabinet with 40 Linear Feet per Minute (LFM) of air
c. Operate from –40 to 167°F (–40 to 75°C) in a forced air enclosure with 200 LFM of air type tested at 85°C for 16 hours
d. Optical receiver maximum input power level shall not be exceeded.
e. Optical attenuators shall be added as needed.
f. Fiber optic attenuator patch cords shall be in accordance with Section 657 of the Mississippi Standard Specifications for Road and Bridge Construction. It is the Contractor's responsibility to determine where attenuators are needed and shall be included in the cost of the switch

907-663.02.4--Ethernet Network Cable. Ethernet network cables shall adhere to the following minimum requirements.

1) 4 Pair #24 AWG STP Category 6, Category 5e, or other ethernet cable (generally meeting Category 6 Specifications, the applicable requirements of Subsection 722.03 and approved by MDOT) as per manufacturer's recommendations.
2) These items are paid for as ethernet network cable installed between cabinets and does not apply to other patch cords installed inside cabinets or huts.
3) Supplied ethernet network cable shall be suitable for use outdoors in ducts and as a minimum meet the following requirements:
   a. Fully water blocked
   b. Conforms to the National Electrical Code Article 800

c. UL 1581 certified
d. Voltage Rating 300 Volts or greater
e. Operating and installation temperature (-4°F to 140°F)
f. The allowable bend radius must be 10 times the Cable's Outside Diameter or smaller
g. Recommended for 1000Base-T applications for a distance of 100 meters.

907-663.02.4.1--Ethernet Patch Cords. The ethernet patch cords shall be furnished and installed as needed to connect the network switches with other equipment. Ethernet patch cords shall be considered an incidental component for this project and furnished and installed as needed to provide a functional system. Ethernet patch cords shall meet the following minimum requirements:

1) All patch cords shall be from the same manufacturer.
2) Shall incorporate four (4) pair 24 AWG stranded PVC Category 6, Category 5e, or other Ethernet cable (generally meeting Category 6 Specifications and approved by MDOT) as required by the manufacturer.
3) Shall be factory made; Contractor or vendor assembled patch cords are not permitted.
4) Shall be TIA/EIA 568-B.2-1 compliant. Patch Cords shall be compliant to T568B pin configuration (which ever is used).
5) Certified by the manufacturer for Category 5e or Category 6 performance criteria.
6) Length as needed. Excessive slack is not permitted.

907-663.02.5--Submittals. The submittal requirements defined in the Notice to Bidders entitled "ITS General Requirements", along with the requirements below and throughout this specification, shall be met. All costs associated with submittals shall be included in the overall contract price; no separate payment will be made for any documenting and submitting.

The Contractor shall provide project submittals for network switches including scheduling requirements. The project submittals for network switches, terminal servers, cellular modems, and fiber optic modems shall include but are not limited to the specific requirements in this subsection.

1) The Contractor shall submit detailed cut sheets which document compliance with all parameters required in this section. If a parameter is not covered in the cut sheet a signed statement from the manufacturer on letterhead shall be submitted as an attachment. Failure to address all requirements will result in rejection of the submittal.
2) The Contractor shall submit documentation and proof of manufacturer-recommended training and certification for the installation and configuration of network switches.
3) The Contractor shall submit technical specifications for the minimum transmitter port to receiver port optical attenuation required for the switches to function in accordance with this specification for the optical links shown on the plans.

907-663.03--Construction Requirements. All networking equipment shall be installed according to the manufacturer's recommendations, the Plans and as follows:

1) Network switches shall only be configured and installed by the switch manufacturer trained personnel.

2) Network switches shall be installed in accordance with manufacturer's guidelines and requirements.
3) The Contractor shall request from the Department, switch configuration information (such as IP address, VLAN Tag values, etc.) not more than 30 days after the switch submittals have been approved.
4) The Contractor shall provide as needed the necessary Ethernet patch cords and fiber optic patch cords for a complete and functional installation.
5) Ethernet network cable installed in conduit shall be installed and terminated per the manufacturers recommended procedures. Slack Ethernet network cable shall be provided in pullboxes as indicated in the plans.
6) The Contractor shall provide training for proper management of the equipment installed. This training should cover daily operation as well as maintenance and configuration of the switching equipment installed as part of this project and meet the requirements of Subsection 663.03.4 of this document.
7) The Contractor shall provide the MDOT with a written inventory of items received and the condition in which they were received. Inventory shall be inclusive of make, model, and serial numbers, MAC address, and installation GPS coordinates. All equipment shall be installed according to the manufacturer's recommendations or as directed by the MDOT.
8) Any new, additional or updated drivers required for the existing ATMS software to communicate and control new networking equipment installed by the Contractor shall be the responsibility of the Contractor.

907-663.03.1--Switch Configuration Requirements. The Contractor shall configure network switches as follows:

1) All 100 Base-TX ports shall be configured as follows:
   a. RSTP/STP – Off.
   b. Unused TX ports shall be disabled.
   c. Operating TX ports shall be programmed to filter only for the MAC address of the connected device.
2) All 1000 Base-FX ports shall be configured as follows:
   a. RSTP/STP – On.
   b. IGMP Snooping – On.
3) The Type D switch configuration shall be as outline in the Project plans and details.
4) All network switches shall be installed and configured with the same firmware configuration. The optimum settings shall be used consistently system-wide. Any locations that require different settings for optimum performance shall be approved by the Engineer.
5) The Switches shall be configured to enable multicasting and turn on multicast protocols.
6) The Contractor may submit an alternate switch configuration to the ITS Engineer for review and approval. The ITS Engineer will review alternate switch configuration documentation. The goal of the switch configuration is to reduce the network delay, as well as provide network redundancy.
7) The Contractor shall submit an electronic copy of all final and approved configurations of all switches to the Project Engineer and to the ITS Engineer.

907-663.03.2--Testing. All networking equipment shall undergo testing to verify conformance to requirements of the plans and these special provisions. The Contractor shall conduct a Project

Testing Program as required in the Notice to Bidders entitled "ITS General Requirements." All costs associated with the Project Testing Program shall be included in the overall contract price; no separate payment will be made for any testing.

907-663.03.3--Documentation. As-built Plans showing switch configuration and connections shall be provided to the Project Engineer and ITS Engineer in electronic format.

The Contractor shall submit documentation and proof of measured optical power budgets to all optical links of all type switches. All equipment and software must be fully functional and pass a Final Inspection by the ITS Manager and Project Engineer before being accepted by the MDOT

907-663.03.4--Warranty At a minimum, the warranty requirements defined in the Notice to Bidders entitled "ITS General Requirements" or this specification, whichever is longer, shall be met. All costs associated with the warranty requirements shall be included in the overall contract price.

907-663.03.5--Training. The minimum training requirements shall be as defined in the Notice to Bidders entitled "ITS General Requirements."

907-663.03.6--Quality Assurance. The quality assurance requirements defined in the Notice to Bidders entitled "ITS General Requirements" shall be met. All costs associated with the quality assurance requirements shall be included in the overall contract price.

907-663.04--Method of Measurement. Network switches of the type specified will be measured per each installation as specified in the Project plans. Such measurement shall be inclusive of furnishing, installing, system integration and testing of a network switch including all chassis, modules, power cables, power supplies, software, license, fiber optic patch cords, fiber optic attenuator patch cords, Ethernet patch cords and all incidental components, attachment hardware, mounting shelf and hardware, testing requirements, warranties and all work, equipment and appurtenances as required to provide a fully functional switch ready for use. Type C, Type D, and Type E network switch module cards shall be specified per Project plans or NTBs for each site location. It shall also include all system documentation including: shop drawings, operations and maintenance manuals, wiring diagrams, block diagrams, and other material necessary to document the operation of the switch and network.

Terminal server will be measured per each installation. Such measurement shall be inclusive of furnishing, installing, system integration and testing of a Terminal Server including all incidental components, attachment hardware, mounting shelf and hardware, testing requirements, warranties, and all work, equipment and appurtenances as required to provide a fully functional Terminal Server ready for use.

SD-WAN Routers shall be measured per each and will include the, router, antenna, reset timers, cabling, factory and manufacturing inspection, testing, storage, packaging, shipping, warranty, and all work, equipment, and appurtenances as required to effect the full operation and control of the SD-WAN Router complete in place and ready for use.

Ethernet network cable, installed in conduit, will be measured by the linear foot, and shall be obtained by accurate measurement of the runs including horizontally, vertically, aerially along the messenger cable, from the device to the device cabinet, and with liberal allowances made for slack in boxes, as indicated in the plans.

Network equipment training shall be measured as a lump sum which shall include all coordination, materials, labor, training location costs, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."

907-663.05--Basis of Payment. Network Switches, Terminal Servers, SD-WAN Routers and Fiber Optic Modems, measured as prescribed above, will be paid for at the contract unit price bid per each. The price shall be full compensation for documentation and submittals, warranties, testing, all labor, tools, materials, equipment, quality assurance, and all incidentals necessary to complete the work.

Ethernet network cable installed between cabinets will be paid for by linear foot measured horizontally.

Network equipment training, measured as prescribed above, will be paid for at the contract unit lump sum price, which price shall be full compensation for all training costs including coordination, materials, labor, training location costs, submittals, and all incidentals required to complete the training as described in the Notice to Bidders entitled "ITS General Requirements."

Payment will be made under:

907-663-A:	Network Switch, Type __	- per each
907-663-B:	Terminal Server	- per each
907-663-C	SD-WAN Router	- per each
907-663-D:	Ethernet Network Cable, Installed in Conduit	- per linear foot
907-663-E:	Network Equipment Training	- lump sum

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-700-3 **CODE: (IS)**

DATE: 4/20/2026

SUBJECT: Materials and Tests

Section 700, Materials and Tests, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete fourth, fifth, sixth, and seventh paragraph of Subsection 700.01 on page 713, and add the following.

907-700.01.1--Buy America/Build America. Buy America (BABA) Requirements.

Iron or Steel Products. Iron or steel or wire products (including prestressed cables and strands) are products that consist wholly or predominantly of iron or steel or a combination of both.

Predominantly of iron or steel or a combination of both means that the cost of the iron and steel content exceeds 50 percent of the total cost of all components. The cost of iron and steel is the cost of the iron or steel mill products (such as bar, billet, slab, wire, plate, or sheet), castings, or forgings utilized in the manufacture of the product and a good faith estimate of the cost of the iron and steel components.

Iron or steel or wire products, as described above, that are permanently incorporated into a construction project must be produced domestically. All manufacturing processes for iron or steel or wire products, from the initial melting stage through the application of coatings, that are permanently incorporated into a construction project, must occur domestically. However, pig iron and processed, pelletized, and reduced iron ore manufactured outside of the United States may be used in the domestic manufacturing process for iron and/or steel and/or wire products. Coating includes all processes that protect or enhance the value of the material to which the coating is applied.

Construction Materials. Construction materials are articles, materials, or supplies that consist of only one of the items listed (non-ferrous metals, plastic and polymer-based products, glass, fiber-optic cables (including drop cables), optical fibers, lumber, drywall, and engineered woods). Minor additions of articles, materials, supplies, or binding agents to a construction material do not change the categorization of the construction material. All manufacturing processes for the listed construction materials, from the initial processes as described within 2 CFR 184.6 to the final processes as described within 2 CFR 184.6, that are permanently incorporated into a construction project, must occur domestically.

Manufactured Products. Manufactured products are articles, materials, or supplies that have been processed into a specific form or shape; or when combined with other articles, materials, or supplies create a product with different properties than the individual articles, materials, or supplies. An item that is classified as an iron or steel product, a construction material, or an excluded material is not a manufactured product. However, an article, material, or supply classified as a manufactured product

may include components that are iron or steel products, excluded materials, or other product categories as specified by law or in 2 CFR part 184. Mixtures of excluded materials delivered to a work site without final form for incorporation into a project are not a manufactured product. For construction projects obligated on or after October 1, 2025, the manufactured product must be manufactured domestically. For construction projects obligated on or after October 1, 2026, the manufactured product must be manufactured domestically and the cost of the components of the manufactured product that are mined, produced, or manufactured domestically is greater than 55 percent of the total cost of all components of the manufactured product.

Excluded Materials. Excluded materials, as listed in Section 70917(c) of the Build America, Buy America (BABA) Act, are cement and cementitious materials; aggregates such as stone, sand, or gravel; or aggregate binding agents or additives. However, an article, material, or supply classified as a manufactured product may include components that are iron or steel products, excluded materials, or other product categories as specified by law or in 2 CFR part 184. Mixtures of excluded materials delivered to a work site without final form for incorporation into a project are not a manufactured product.

Domestically shall be understood to mean all States of the United States, District of Columbia, Puerto Rico, American Samoa, Guam, and Virgin Islands and any other place subject to the jurisdiction of the United States.

907-700.01.2—Certificate of Compliance Requirements. Prior to incorporation into the work, the Contractor shall furnish the Project Engineer with a Domestic Materials Self-Certification Form documenting conformance to the requirements of Subsection 907-106.14. Attached hereto is the Domestic Materials Self-Certification Form that shall be furnished by the Contractor to the Project Engineer.

Domestic Materials
Self-Certification Form

This certification is for a manufacturer/supplier to certify the below articles, materials, or supplies are in compliance with the applicable domestic material content procurement preferences found in the Buy America Act requirements (23 CFR 635.410) and the Build America, Buy America Act (BABA) requirements (2 CFR part 184). The individual completing this form takes full responsibility for the information included in the form. State agencies have the authority to request additional details related to the information provided in the form. All forms shall be submitted via AASHTO DataMine for delivery to authorized governmental users through the Industry Document Repository. The manufacturer/supplier is required to include updates to process changes within 10 days of the change occurring via uploading a revised form into DataMine.

PART 1: COMPANY CONTACT INFORMATION

Company/Producer/Manufacturer Name:

Supplier Representative Name:

Contact Email Address: Contact Phone Number:

Date Form is Being Submitted: mm/dd/yyyy

PART 2: DETAILS OF THE ARTICLE, MATERIAL, OR SUPPLY:

Using Table 1 below, provide the classification of the article, material, or supply as one of the following: (1) iron or steel product; (2) construction material (3) manufactured product; or (4) excluded materials including Section 70917(c) materials.

Classification	
Producer of the Article, Material, or Supply:	
Product/Model/Part/Material:	
Manufacturing Address:	
Manufacturing City:	
Manufacturing State:	
Manufacturing Zip Code:	
DataMine # (if applicable):	
Federal/State/Local Project number(s):	
Pay Code Number (PCN):	
Project Item code:	
Project Item Description:	
Quantity Certified:	

TABLE 1: Material Classifications

(1) Iron or Steel Product	
Wholly or predominantly Iron or Steel, or a combination of both (23 CFR 635.410(b)(1)(ii))	Certification requires predominantly of iron or steel or a combination of both means that the cost of the iron and steel content exceeds 50 percent of the total cost of all its components. The cost of iron and steel is the cost of the iron or steel mill products (such as bar, billet, slab, wire, plate, or sheet), castings, or forgings utilized in the manufacture of the product and a good faith estimate of the cost of iron or steel components.
(2) Construction Material	
Non-Ferrous Metals (2 CFR 184.6(a)(1))	Certification requires all manufacturing processes, from initial smelting or melting through final shaping, coating, and assembly, occurred in the United States.
Plastic and Polymer based products (including polyvinyl chloride, composite building materials, and polymers used in fiber optic cables) (2 CFR 184.6(a)(2))	Certification requires all manufacturing processes, from initial combination of constituent plastic or polymer-based inputs, or where applicable, constituent composite materials, until the item is in its final form, occurred in the United States.
Glass (including optic glass) (2 CFR 184.6(a)(3))	Certification requires all manufacturing processes, from initial batching and melting of raw materials through annealing, cooling, and cutting, occurred in the United States.
Fiber Optic Cable (including drop cable) (2 CFR 184.6(a)(4))	Certification requires all manufacturing processes, from the initial ribboning (if applicable), through buffering, fiber stranding and jacking, occurred in the United States. All manufacturing processes also include the standards for glass and optical fiber, but not for non-ferrous metals, plastics and polymer-based products, or any others.
Optical Fiber (2 CFR 184.6(a)(5))	Certification requires all manufacturing processes, from the initial preform fabrication stage through the completion of the draw, occurred in the United States
Lumber (2 CFR 184.6(a)(6))	Certification requires all manufacturing processes, from initial debarking through treatment and planing, occurred in the United States.
Drywall (2 CFR 184.6(a)(7))	Certification requires all manufacturing processes, from initial blending of mined or synthetic gypsum plaster and additives through cutting and drying of sandwiched panels, occurred in the United States.
Engineered Wood (2 CFR 184.6(a)(8))	Certification requires all manufacturing processes, from initial combination of constituent materials until the wood product is in its final form, occurred in the United States.
(3) Manufactured Product	
Manufactured Products other than Precast Concrete Products and Intelligent Transportation Systems and Other Electronic Hardware Systems Installed on the Highway ROW or Other Real Property (23 CFR 635.410(c)(1)(vii)) and 23 CFR 635.410(c)(1)(iv)	• Certification requires for projects obligated before October 1, 2025, no certification is required (excludes EV chargers). • Certification requires for projects obligated on or after October 1, 2025, certification requires the final manufacturing process occurred in the United States (excludes EV chargers). • Certification requires for projects obligated on or after October 1, 2026, and all EV chargers , certification requires the final manufacturing process occurred in the United States and the cost of the components that are mined,

	produced, or manufactured in the United States is greater than 55 percent of the total cost of all components of the manufactured product.
Precast Concrete Products (23 CFR 635.410(c)(2)(i))	Classified as a manufactured product must comply with both the wholly or predominantly iron or steel or a combination of both product and manufactured product certification requirements as stated above.
Intelligent Transportation Systems and Other Electronic Hardware Systems Installed on the Highway ROW or Other Real Property (23 CFR 635.410(c)(2)(ii))	Classified as a manufactured product must comply with both the wholly or predominantly iron or steel or a combination of both product certification requirements for any iron or steel enclosures as well as the manufacturing certification requirements as stated above.
(4) Excluded Materials	
Excluded Materials Including Section 70917(c) Materials (23 CFR 635.410(c)(1)(ii))	No certification is required for excluded materials including Section 70917(c) materials. Section 70917(c) materials means cement and cementitious materials; aggregates such as stone, sand, or gravel; or aggregate binding agents or additives.

PART 3: DECLARATION OF SUBMITTAL

Do the articles, materials, or supplies submitted in this form comply with applicable domestic materials content procurement preferences found in the Buy America Act requirements (23 CFR 635.410) and the Build America, Buy America Act requirements (2 CFR part 184) (Y/N)? _____

PART 4: CERTIFICATION (Read and check all boxes before signing)
Note: State Departments of Transportation may have different language requirements for this section.

☐ I certify that the description above is a true and accurate description of the article, material, or supply provided, and that the undersigned is in a position to legally bind the Company/Organization represented in this form.

☐ I certify that the iron or steel product, construction material, or manufactured product complies with the applicable Buy America or BABA requirements.

Signature: Date: mm/dd/yyyy

Printed Name:
Title:
Company/Organization:
Company/Organization address:

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO SPECIAL PROVISION NO. 907-701-4

DATE: 11/05/2024

SUBJECT: Hydraulic Cement

907-701.04--Blended Hydraulic Cement.

907-701.04.1--Types of Blended Hydraulic Cement. After the last paragraph of Subsection 907-701.04.1 on page 1, add the following.

Blended cement Types IL meeting the "HE" high early strength requirement listed in AASHTO M 240, Table 3 shall have the "(HE)" suffix added to the type designation.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-701-4 **CODE: (IS)**

DATE: 11/21/2023

SUBJECT: Hydraulic Cement

Section 701, Hydraulic Cement, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-701.01--General. In the first sentence of the second paragraph of Subsection 701.01 on page 718, change "mills" to "plants."

In the second sentence of the sixth paragraph of Subsection 701.01 on pages 718 and 719, change "shall" to "will."

907-701.02--Portland Cement.

907-701.02.1-General. Delete Subsections 701.02.1.1, 701.02.1.2, 701.02.2, 701.02.2.1, and 701.02.2.2 on pages 719 and 720, and substitute the following.

907-701.02.1.1--Types of Portland Cement. Portland cement shall be either Type I, Type II, or Type III conforming to AASHTO M85 or Type III (MS). Type III (MS) is defined as a Type III cement conforming to AASHTO M85 having a maximum tricalcium aluminate (C_3A) content of 8%.

907-701.02.2--Blank.

907-701.02.2.1--Blank.

907-701.02.2.2--Blank.

Delete Subsection 701.04 on pages 720 and 721, and substitute the following.

907-701.04--Blended Hydraulic Cement.

907-701.04.1--Types of Blended Hydraulic Cement. Blended hydraulic cements (blended cements) shall be of the following types and conform to AASHTO M 240:

Type IL – Portland-limestone cement
Type IP – Portland-pozzolan cement
Type IS – Portland blast-furnace slag cement

Blended cement Types IL, IP, and IS meeting the "MS" sulfate resistance requirement listed in AASHTO M 240, Table 3 shall have the "(MS)" suffix added to the type designation.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-702-4 **CODE: (IS)**

DATE: 09/11/2018

SUBJECT: Bituminous Materials

Section 702, Bituminous Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-702.04--Sampling. Delete the sentence in Subsection 702.04 on page 722, and substitute the following.

Sampling of bituminous materials shall be as set out in AASHTO R 66.

907-702.07--Emulsified Asphalt. Delete the last sentence in Subsection 702.07 on page 724, and substitute the following.

Asphalt for fog seal shall conform to the requirements of Subsection 907-702.12, Table V.

907-702.12--Tables. Delete Table V in Subsection 702.12 on page 729, and substitute the following.

TABLE V
SPECIFICATION FOR FOG SEAL

	LD-7		CHPF-1		
Test Requirements	**Min.**	**Max.**	**Min.**	**Max.**	**Test Method**
Viscosity, Saybolt Furol, @ 25°C, Sec.	10	100	-	100	AASHTO T 72
Storage Stability Test, 24 hr, %	-	1	-	1	AASHTO T 59
Settlement, 5 day, %	-	5	-	-	AASHTO T 59
Oil Distillate, %	-	1	-	-	AASHTO T 59
Sieve Test, % *	-	0.3	-	0.1	AASHTO T 59
Residue by Distillation, %	40	-	40	-	AASHTO T 59
Test on Residue from Distillation					
Penetration @ 25°C, 100g, 5 sec	-	20	40	90	AASHTO T 49
Softening Point, °C	65	-	-	-	ASTM D 36
Solubility in trichloroethylene, %	97.5	-	-	-	AASHTO T 44
Elastic Recovery @ 25°C, %	-	-	40	-	AASHTO T 301
Original DSR @ 82° (G*/Sinδ, 10 rad/sec)	1	-	-	-	AASHTO T 111

* The Sieve Test result is tested for reporting purposes only and may be waived if no application problems are present in the field.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-703-2 **CODE: (SP)**

DATE: **11/29/2022**

SUBJECT: **Gradation**

Section 703, Aggregates, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-703.03--Coarse Aggregates for Hydraulic Cement Concrete.

907-703.03.2--Detail Requirements.

907-703.03.2.4--Gradation. In the table in Subsection 703.03.2.4 on page 734, add 100 for the percent passing by weight on the 1½-inch sieve for Size No. 67 aggregates.

Delete Note 2 under the table in Subsection 703.03.2.4 on page 734, and substitute the following.

Note [2] – 100 percent shall pass the 1-inch sieve for Size 67 used in Class F and Class FX concrete.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-705-1 **CODE: (IS)**

DATE: 06/13/2018

SUBJECT: Stone Riprap

Section 705, Stone Blanket Protection and Filter Blanket Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-705.04--Stone Riprap. Delete the last sentence of the first paragraph of Subsection 705.04 on page 750, and substitute the following.

Quality requirements for rock to be furnished under these specifications will come from a pre-approved source and be visually approved prior to use.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-707-3 **CODE: (IS)**

DATE: 10/27/2021

SUBJECT: Joint Materials

Section 707, Joint Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-707.02--Joint Filler.

907-707.02.2--Preformed Sponge, Rubber, Cork and Closed-Cell Polypropylene Foam Joint Fillers for concrete Paving and Structural Constructions. Delete the two paragraphs of Subsection 707.02.2 on page 755, and substitute the following.

Preformed joint filler shall conform to AASHTO M 153 for sponge, rubber, and cork and tested according to ASTM D545. The type required will be indicated on the plans.

Closed-cell polypropylene foam shall conform to the requirements in ASTM D8139 and tested in accordance with ASTM D545.

907-707.02.3--Wood. Delete paragraph (b) of Subsection 707.02.3 on page 755, and substitute the following:

(b) Dimensions shall be as shown on the plans Dimensions shown on the plans are "dressed" sizes in accordance with Table 3 of the American Softwood Lumber Standard, SP-20. At the discretion of the Engineer, a 3/4-inch dressed board may be used in lieu of a 1-inch dressed board. A tolerance of plus or minus 1/16 inch thickness and plus or minus 1/8 inch width will be permitted. For slip-form paving a tolerance of minus 1/4 inch on each end in length will be permitted.

907-707.06--Flexible Plastic Gasket for Joining Conduit. Delete the third paragraph of Subsection 707.06 on page 756, and substitute the following.

The Department may require the performance test described in ASTM C 990.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-708-4 **CODE: (IS)**

DATE: **09/21/2021**

SUBJECT: **Concrete Pipe**

Section 708, Non-Metal Structures and Cattlepasses, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-708.02--Concrete Pipe.

907-708.02.1--Materials for Use in Concrete Pipe.

907-708.02.1.2--Fly Ash. Delete Subsection 708.02.1.2 on page 758, and substitute the following.

Fly ash conforming to the requirements of Subsection 714.05 may be used to replace hydraulic cement on a one to one replacement rate. If a type IL cement conforming to the requirements of Subsection 701.04 is used, the fly ash replacement shall not exceed 35% by weight of the cement. For all other Types of cement, the fly ash replacement rate shall not exceed 25% by weight of hydraulic cement.

907-708.02.3--Exceptions to AASHTO Standard Specifications. After Subsection 708.02.3.7 on page 760, add the following.

907-708.02.3.8--Lifting Device. In lieu of lift holes, the producer may cast an approved lifting device in the pipe during the manufacturing process. Should a lifting device be included with the pipe, the Contractor shall cut off or grind down the lifting device flush with the pipe surface after placement of the pipe. The area around the lifting device shall be coated with a sealer approved by the Engineer.

907-708.02.5--Reinforced Concrete Pipe. Delete the second paragraph in Subsection 708.02.5 on page 760, and substitute the following.

907-708.02.5.1--Class V Pipe With Diameter 54 Inches and Greater. Class V pipe with diameters of 54 inches and larger shall meet the requirements of AASHTO M 170 or M 242 as modified by Subsection 708.02 and herein.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-711-2 **CODE: (IS)**

DATE: 09/11/2018

SUBJECT: Plain Steel Wire

Section 711, Reinforcement and Wire Rope, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-711.02--Deformed and Plain Carbon-Steel Bars for Concrete Reinforcing.

907-711.02.3--Steel Welded and Non-Welded Wire Reinforcement, Plain and Deformed, for Concrete.

907-711.02.3.1--Plain Steel Wire. Delete the sentence in Subsection 711.02.3.1 on pages 780 and 781, and substitute the following.

Plain steel wire and plain steel welded wire shall conform to the requirements of AASHTO M 336.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-712-1 **CODE: (SP)**

DATE: 12/07/2021

SUBJECT: Fence and Guardrail

Section 712, Fence and Guardrail, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-712.01--General. After the sentence in Subsection 712.01 on page 785, add the following.

All materials' inspection, testing, and certification will be performed in accordance with the requirements of the current version of the Department's *Materials Division Inspection, Testing, and Certification Manual*.

Delete Subsections 712.02 and 712.03 on page 785, and substitute the following.

907-712.02--Barbed Wire. Barbed wire shall conform to the requirements of AASHTO M 280. In the coastal counties of Hancock, Harrison, and Jackson, either Coating Type Z Class 3 or Coating Type A shall be furnished. In all other areas of the State, either Coating Type Z Class 1, Coating Type Z Class 3, Coating Type ZA Class 60, or Coating Type A shall be furnished.

907-712.03--Metallic-Coated, Steel Woven Wire Fence Fabric. Woven wire fencing (i.e., "hog wire") shall conform to the requirements of AASHTO M 279. In the coastal counties of Hancock, Harrison, and Jackson, either Coating Type Z Class 3 or Coating Type A shall be furnished. In all other areas of the State, either Coating Type Z Class 1, Coating Type Z Class 3, Coating Type ZA Class 60, or Coating Type A shall be furnished.

907-712.04--Chain Link Fence. Delete Subsections 712.04.1 thru 712.04.7 on pages 785 & 786, and substitute the following.

907-712.04.1--Fabric. In the coastal counties of Hancock, Harrison, and Jackson, either Type I Class D, Type II, Type III, or Type IV fabrics shall be furnished. In all other areas of the State, either Type I Class C, Type I Class D, Type II, Type III, or Type IV fabrics shall be furnished.

907-712.04.2--Tie Wire. Tie wire shall be of the same material as the fencing wire being used, shall be of good commercial quality, and shall meet the requirements of AASHTO M 181. Either Type I, Type II, Type III, or Type IV tie wire shall be furnished.

907-712.04.3--Tension Wire. Tension wire shall be of the same material as the fencing wire being used, shall be of good commercial quality, and shall meet the requirements of AASHTO M 181. In the coastal counties of Hancock, Harrison, and Jackson, either Type I Class 3, Type II, Type III, or Type IV tension shall be furnished. In all other areas of the State, either Type II, Type III, Type IV, or Type I Classes 1, 2, or 3 tension wires shall be furnished.

907-712.04.4--Posts Rails, Gate Frames, and Expansion Sleeves. Posts, rails, gate frames, and expansion sleeves shall conform to the requirements for posts in Subsection 712.05.2, unless otherwise designated in the contract.

907-712.04.5--Miscellaneous Fittings and Hardware. Miscellaneous fittings and hardware shall conform to the requirements of Subsection 712.16.

907-712.05--Fence Posts and Braces.

907-712.05.1--Treated Timber Posts and Braces.

907-712.05.1.1--General. Delete the third, fourth, fifth, and sixth paragraphs of Subsection 712.05.1.1 on page 787, and substitute the following.

All wood posts and braces shall be treated in accordance with Subsections 718.03 and 718.04.

907-712.05.1.2--Round Posts. Delete the last sentence of the last paragraph of Subsection 712.05.1.2 on page 788.

907-712.05.1.3--Sawed Posts. Delete the last sentence of the paragraph of Subsection 712.05.1.3 on page 788.

907-712.05.1.4--Sawed Braces. Delete the last sentence of the paragraph of Subsection 712.05.1.4 on page 788.

Delete Subsection 712.05.2 on page 788, and substitute the following.

907-712.05.2--Metal Posts.

907-712.05.2.1--Round Steel Pipe. Round steel pipe shall meet the requirements of AASHTO M 181, either Grade 1 (i.e., meeting the requirements in ASTM F 1083) or Grade 2 (i.e., meeting the requirements of ASTM F 1043).

Round steel pipe shall be sized in accordance with NPS (nominal pipe size) designations as shown on Plans, and not according to the outer or inner pipe diameter.

907-712.05.2.2--Steel Fence Post and Assemblies, Hot-Wrought. Steel posts with the following section shapes, Tee, channel or U, and Y-Bar shall meet the requirements of AASHTO M 281, galvanized in accordance with the requirements of AASHTO M 111, unless otherwise specified in the contract. Acceptance of these steel posts shall be by certification from the manufacturer, producer, supplier, or fabricator, as applicable.

907-712.05.2.3--Blank.

907-712.05.2.4--Steel H-Beam Posts. Steel H-Beam posts shall be produced from structural quality weldable steel having a minimum yield strength of 45,000 psi and shall be galvanized in accordance with ASTM A 123. Steel H-Beam line posts shall be 2.250 inches by 1.625 inches and shall weigh 3.43 pounds per foot. A tolerance of plus or minus 5.0 percent is allowed for

weight per foot. A tolerance of plus or minus 1.0 percent is allowed for dimensions.

907-712.05.2.5--Aluminum-Alloy Posts and Assemblies. Round aluminum-alloy posts shall meet the requirements of ASTM B 241, Alloy 6061, T6. Aluminum-Alloy H-Beam posts shall meet the requirements of ASTM B 221, Alloy 6061, T6.

907-712.05.2.6--Formed Steel Section Posts. Formed steel section posts, "C" sections, shall be formed from sheet steel conforming to ASTM A 1011, Grade 45, and shall be galvanized in accordance with ASTM A 123.

907-712.06--Guard and Guardrail Posts.

907-712.06.2--Treated Wood Posts.

907-712.06.2.1--Square Posts. Delete the paragraph in Subsection 712.06.2.1 on page 789, and substitute the following.

All square posts shall be inspected for conformance with Section 712.05, except that the posts may be rough and shall be within ±3/8" of the dimensions shown on the plans.

907-712.06.2.2--Round Posts. Delete the paragraph in Subsection 712.06.2.2 on page 789, and substitute the following.

All round posts shall be inspected for conformance with Section 712.05, except that the posts shall be of the shape and dimensions shown on the plans.

907-712.06.5--Treated Wood Blocks for Use with Metal Guardrail Posts. Delete the paragraphs of Subsection 712.06.5 on pages 789 & 790, and substitute the following.

Treated wood blocks for use with metal guardrail posts shall be within ±3/8" of the size and dimensions shown on the plans, except that a minus tolerance shall not be allowed for the slotted width in which the metal post must fit.

Delete Subsection 712.16 on page 791, and substitute the following.

907-712.16--Hardware. All ferrous metal hardware for fencing such as bolts, nuts, washers, and metal straps shall be as specified on the plans and galvanizing shall not be less than 1.0 ounce per square foot of uncoated area. Aluminum coated hardware shall be coated with aluminum meeting the requirements of AASHTO M 181 for aluminum coating and at the rate of not less than 0.4 ounces per square foot of uncoated area.

Aluminum alloy hardware shall conform to the requirements of ASTM B 221 for extruded aluminum alloy 6063, T6. The finished members shall be of uniform quality.

Aluminum-zinc coated hardware shall be coated with an aluminum-zinc alloy meeting the chemical requirements and weight of coating specified for aluminum-zinc alloy coated metal gates.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-714-4 **CODE: (SP)**

DATE: **07/28/2025**

SUBJECT: **Miscellaneous Materials**

Section 714, Miscellaneous Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-714.01--Water.

907-714.01.1--General. Delete the last sentence of the second paragraph in Subsection 714.01.1 on page 794.

907-714.01.2--Water for Use in Concrete. Delete Subsection 714.01.2 on page 794, and substitute the following:

Water from municipal sources is permitted be used as mixing water in concrete, mortar, and grout without Department testing. Water from non-municipal water sources used in mixing of concrete, mortar, and grout which does not meet the requirements in Subsection 714.01.1 shall be tested for conformance as required in AASHTO M157, Table 1 and Table 2.

907-714.01.3--Water for Use in Chemically Stabilized Based. Delete the first sentence of first paragraph in Subsection 714.01.3 on page 794, and substitute the following:

Water used in the construction of bases that contain cement, lime, or other chemical additive shall be as set out in Subsection 714.01.1. Water from municipal sources is permitted to be used without testing for conformance to the requirements below. If water is not from a municipal source, it shall not contain impurities in excess of the following limits:

Delete Subsection 714.01.6 on page 795, and substitute the following.

907-714.01.6--Blank.

907-714.05--Fly Ash.

907-714.05.1--General. Delete the first sentence of the fifth paragraph in Subsection 714.05.1 on page 797.

Delete Subsection 714.06 on page 798, and substitute the following.

907-714.06--Slag Cement.

907-714.06.1--General. The slag cement source must be approved for listing in the Department's

APL prior to use. The acceptance of slag cement shall be based on certified test reports, certification of shipment from the supplier, and tests performed on samples obtained after delivery in accordance with the Department's *Materials Division Inspection, Testing, and Certification Manual* and Department SOP.

The Contractor shall provide suitable means for storing and protecting the slag cement against dampness and contamination. Separate storage silos, bins, or containers shall be provided for slag cement. Slag cement that is partially set, caked or contains lumps shall not be used.

The State Materials Engineer shall be notified in writing of the nature, amount and identity of any processing or other additions made to the slag cement during production.

Slag cement from different mills shall not be mixed or used alternately in any one class of construction or structure without written permission from the Engineer; except that this requirement will not be applicable to cement treatment of design soils or bases.

No additional cementitious materials, such as blended hydraulic cement, fly ash, metakaolin, or others, shall be added to or as a replacement for hydraulic cement when used with slag cement in the production of concrete. The replacement of hydraulic cement with slag cement shall be in accordance with the applicable replacement content specified in Subsection 701.02.2.

907-714.06.2--Specific Requirements. Slag cement shall meet the requirements of AASHTO M 302, Grade 100 or 120. Slag cement shall contain no chlorides.

907-714.13--Geotextiles.

907-714.13.11--Tables. Delete Table 1 in Subsection 714.13.11 on page 813, and substitute the following.

Table 1 - Geotextiles

Type Designation	I[1]	II[1]	III	IV	V	VI		VII		VIII	IX	
	Sediment Control		Drainage	Paving	Separation & Drainage	Separation, Stabilization & Reinforcement				High Strength		
Physical Property[2]						Woven	Non-Woven	Woven	Non-Woven			**Test Method**
Grab Strength (lb)	50	90	110	90	200	280	180	450	280	----	----	ASTM D 4632
Elongation (%)	----	50% max @ 45 lb	20% min	50% min @ break	50% min	50% max	50% Min	50% max	50% Min	----	----	ASTM D 4632
Seam Strength (lb)	----	----	70	----	180	240	160	400	240	----	----	ASTM D 4632
Puncture Strength (lb)	----	----	40	----	80	110	75	180	115	----	----	ASTM D 6241
Trapezoidal Tear (lb)	----	----	40	----	80	100	70	150	100	----	----	ASTM D 4533
Asphalt Retention (gal/yd^2)	----	----	----	0.2	----	----	----	----	----	----	----	ASTM D 6140
Permittivity (sec^{-1}) min	0.05	0.05	0.5	----	0.2	0.2	0.2	0.2	0.2	----	----	ASTM D 4491
AOS Woven (mm) max	0.60	0.60	0.6	----	0.6	0.43	----	0.43	----	----	----	ASTM D 4751
AOS Non-Woven (mm) max	0.84	0.84	0.43	----	0.43	----	0.43	----	0.43	----	----	
Tensile Strength after UV (% Retained)	70% @ 500 hr	70% @ 500 hr	50% @ 500 hr	----	50% @ 500 hr	50% @ 500 hr	50% @ 500 hr	50% @ 500 hr	50% @ 500 hr	----	----	ASTM D 4355
Melting Point °(F)	----	----	----	325	----	----	----	----	----	----	----	ASTM D 276
Minimum Ultimate Tensile Strength[3] (lb/in)	----	----	----	----	----	----	----	----	----	660	2000	ASTM D 4595

Notes: 1 - All property values, with the exception of apparent opening size (AOS), represent minimum average roll values in the weakest principal direction. Values for AOS represent the maximum average roll values, 2 - Values not identified in this table should meet manufacturer certification for the use and application, 3- Machine direction

Delete Subsec

907-714.15--Geogrids.

907-714.15.1–General. A geogrid is defined as a geosynthetic formed by a regular network of connected elements with apertures greater than 0.25 inch to allow interlocking with surrounding soil, rock, and other surrounding materials to function primarily as reinforcement.

Geogrid shall be manufactured from an expanded strain hardened monolithic polymer sheet composed of one or more synthetic polymers and shall be mildew resistant and inert to biological degradation and naturally encountered chemicals, alkalis and acids. The geogrid shall contain stabilizers and/or inhibitors, or a resistance finish or covering to make it resistant to deterioration from direct sunlight, ultraviolet rays, and heat.

Geogrid manufacturers shall participate in and be in compliance with the American Association of State Highway Transportation Officials (AASHTO) National Transportation Product Evaluation Program's (NTPEP) Geosynthetics audit program. Geogrid shall meet the requirements of Table II for the application and type shown on the plans and shall be selected from the Department's Approved Lists.

907-714.15.1.1--Geogrid for Retaining Walls and Reinforced Soil Slopes. Geogrid for retaining walls and reinforced soil slopes shall be creep tested in accordance with AASHTO R69 and meet Long Term Design Load, Minimum Ultimate Tensile Strength, and open area criteria listed in Table II. Manufacturers shall perform at least one long-term creep test for no less than 10,000 hours in accordance to ASTM D 5262 for each polymer or composition of polymers from which the geogrid is produced. The long-term design load that shall be reported for design use, shall be that load at which no more than 10% strain occurs over a 100-year design life of the geogrid, as calculated in accordance with AASHTO R69. Long-term design loads shall be reported unfactored, and the AASHTO strength reduction factors (Durability and Installation, and safety factors) will be considered by the Department's Geotechnical Branch on a site specific design basis.

907-714.15.1.2--Geogrid for Subgrade Stabilization. Geogrid for subgrade stabilization shall meet Minimum Ultimate Tensile Strength and open area criteria listed in Table II.

907-714.15.2--Marking, Shipment, and Storage. Each roll or container of geogrid shall be visibly labeled with the name of the manufacturer, trade name of the product, lot number, and quantity of material. In addition, each roll or container shall be clearly tagged to show the type designation that corresponds to that required by the plans. During shipment and storage the geogrid shall be protected from direct sunlight, and temperatures above 120°F or below 0°F. The geogrid shall either be wrapped and maintained in a heavy duty protective covering or stored in a safe enclosed area to protect from damage during prolonged storage.

907-714.15.3--Manufacturer Certification. The Contractor shall furnish the Engineer three copies of the manufacturer's certified test reports indicating that the geogrid furnished conforms to the requirements of the specifications and is of the same composition as the originally approved by the Department.

907-714.15.4--Acceptance Sampling and Testing. Final acceptance of each shipment will be

based upon results of tests performed by the Department on verification samples submitted from the project, as compared to the manufacturer's certified test reports. The Engineer will select one roll or container at random from each shipment for sampling. As sample extending full width of the randomly selected roll or container and being at least five (5) square yards in area will be obtained and submitted by the Engineer. All material samples shall be provided at no cost to the State.

TABLE II
GEOGRIDS

Physical Properties	Type Designation						Test Method
	I	II	III	IV	V	VI	
Long Term Design Load[1], pounds per foot, Machine Direction	250	500	750	1500	2500	3500	AASHTO R69, ASTM D5262
Minimum Ultimate Tensile Strength[2], pounds per foot, Machine Direction	500	1000	1500	3000	5000	7000	ASTM D6637
Open Area, percent	70	70	50	50	50	50	Direct Measurement

[1] Minimum design criteria requirement.
[2] Minimum Average Roll Value (MARV).

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-718-1 **CODE: (SP)**

DATE: 12/07/2021

SUBJECT: Timber and Dimension Lumber

Section 718, Timber and Dimension Lumber, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete the Subsections in Section 718 on pages 836 thru 838, and substitute the following.

907-718.01--General. All timber and dimension lumber shall be Southern pine and shall conform in all respects to applicable requirements of AASHTO M 168. The Department reserves the right to sample and to test all materials at any time; all inspection, testing, and certification of materials will be performed in accordance with the requirements of the current version of the Department's *Materials Division Inspection, Testing, and Certification Manual*.

Timber and dimension lumber shall be furnished in the sizes shown on the plans or as specified. Unless otherwise specified, timber and dimension lumber shall be No. 1, or better, graded according to the latest American Lumber Standards.

Only one type of preservative shall be used for the treatment of materials for any one class of construction on a project, unless otherwise specified.

Where treated timber and dimensional lumber is to be used in non-highway construction or use, such as decking, handrails in walking trails, or in any manner where general public exposure by touch is possible, the treatment requirements will be as per project plans and/or approved by the State Materials Engineer.

907-718.02--Untreated Timber and Dimension Lumber. Untreated timber and dimension lumber shall conform to the requirements of AASHTO M 168.

907-718.03--Treated Timber and Dimension Lumber. Timber and dimension lumber to be treated shall meet the requirements herein specified and shall be treated as specified. Treated timber or dimensional lumber will not be accepted for use unless it has been inspected by an authorized representative of the Department and found to be satisfactory after treatment.

907-718.03.1--Blank.

907-718.03.2--Treatment.

907-718.03.2.1--General. All materials shall be treated in accordance with AASHTO M 133 unless otherwise directed by the Environmental Protection Agency (EPA).

907-718.03.2.2--Blank.

907-718.03.2.3--Inspection. Treated timber and dimension lumber shall be inspected by an authorized representative of the Department before being incorporated into the work. Treatment reports shall be provided to the Department for each lot of material supplied.

907-718.03.3--Blank.

907-718.03.4--Storage of Treated Material. All material treated for stock shall be stacked as compactly as possible on a well-drained surface. Material shall be supported on sills spaced as necessary, not to exceed 10 foot intervals and shall have at least one foot of air space beneath the stacks.

All materials treated with preservatives for use in buildings and applications where painting is required shall be dried after treatment. The treated wood shall be dried in accordance with American Lumber Standards.

907-718.04--Preservative. Preservatives shall be as specified in AASHTO M 133 unless otherwise directed by the Environmental Protection Agency (EPA).

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-720-4 **CODE: (IS)**

DATE: **06/17/2025**

SUBJECT: **Pavement Marking Materials**

Section 720, Pavement Marking Materials, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

Delete Section 720 on pages 840 thru 854, and substitute the following.

SECTION 720 - PAVEMENT MARKING MATERIALS

907-720.01--General. The Department reserves the right to perform sampling and testing of any materials at any time. Upon request of the Engineer, samples of the material shall be furnished.

907-720.02--Color Requirements. All pavement markings except raised pavement markers are required to meet the color requirements of ASTM D6628.

907-720.03--Optics. Optics used in thermoplastic pavement markings shall consist of a double-drop system of glass beads or advanced optics.

907-720.03.1--Glass Beads. The manufacturer shall furnish the Engineer with a certified test report indicating that the glass beads meet AASHTO M 247. AASHTO Type 4 beads shall be applied to the newly placed stripe first, followed by the application of AASHTO Type 1 or Type 2 beads. Type 1, 2, and 4 glass beads shall be transparent, clean, colorless glass, smooth and spherically shaped, free from milkiness, pits, or excessive air bubbles. Type 1, 2, and 4 glass beads shall be coated with a bead coating that is compatible with the traffic marking material to which the glass beads will be applied and will provide adequate moisture proofing, increased adhesion, and optimum embedment of the glass beads.

907-720.03.1.1—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

Acceptance sampling and testing will be in accordance with the Materials Division Inspection, Testing, and Certification Manual (Materials Manual).

907-720.03.2--Advanced Optics. Advanced optics are materials that do not meet the specific requirements of AASHTO M 247 but produce a final drop-on optics system that meets or exceeds the reflectivity requirements in Special Provision 907-626. Advanced optics shall be a double-

drop system that is pre-approved and listed on the Department's Approved Products List.

907-720.03.2.1—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

Acceptance sampling and testing may be conducted at the request of the Engineer.

907-720.04--Thermoplastic Marking Material. Thermoplastic marking material shall meet the color requirements of Subsection 907-720.02.

There shall be no obvious change in the color of the material if held at its plastic temperature for a period of four (4) hours nor by reason of four (4) re-heatings to its plastic temperature.

The pavement markings shall maintain its original dimension and placement. The material shall not be slippery when wet and it shall not lift from the pavement in freezing weather.

907-720.04.1--Extruded Thermoplastic Material. Extruded thermoplastic pavement marking material shall meet the requirements of AASHTO M 249, and shall meet the requirements of 907-720.04 with the following exceptions:

- Blue - ADA thermoplastic marking material shall meet the requirements of Subsection 907-720.04.2 with the exception that the color shall be Blue – ADA, and the Contractor may use hot applied thermoplastic materials meeting the satisfaction of the Engineer.

907-720.04.2--Spray-Applied Thermoplastic Material. Spray-applied thermoplastic pavement marking material shall meet the requirements of AASHTO M 249 and shall meet the requirements of 907-720.04.

907-720.04.3--Pre-formed Thermoplastic Material. Heat-fused, pre-formed thermoplastic pavement marking material shall meet the color requirements of 907-720.02.

907-720.04.4—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

907-720.05--Pavement Marking Tape. Pavement marking tape shall be listed on the Department's Approved Lists.

907-720.05.1—Cold Plastic Pavement Markings (Permanent Pavement Marking Tape). Pavement marking tape for use in roadway applications shall be designated on the Department's Approved Lists as permanent.

The prefabricated markings described shall consist of white or yellow pigmented plastic films with reflective optics uniformly distributed throughout their entire cross-sectional area, and be capable of being affixed by either a pressure sensitive pre-coated adhesive or a liquid contact cement. The markings shall be provided complete in a form that will facilitate rapid application and protect the markings in shipment and storage. The manufacturer shall identify proper solvents and/or adhesives to be applied at the time of application, all equipment necessary for proper application, and recommendations for application that will assure an effective performance life.

Prefabricated legends and symbols shall conform to the applicable shapes and sizes as outlined in the current "Manual on Uniform Traffic Control Devices."

907-720.05.1.1--Specific Requirements. Unless otherwise indicated on the plans, the patterned material without adhesive shall have a minimum caliper of 0.065 inch at the thickest portion of the patterned cross-section and a minimum caliper of 0.020 inch at the thinnest portion of the cross-section. The material shall be a pliant polymer film with 50±15% of the surface are raised and presenting a near vertical face angle of 0° to 60° to traffic from any direction. The channels between the raised areas shall be substantially free of exposed optics or particles.

The size and quality of the optics will be such that performance requirements of Subsection 907-720.02 for the retroreflective pliant polymer film shall be met. The pigments shall be selected and blended to provide a marking film that is white or yellow conforming to the performance requirements of Subsection 907-720.02 through the expected life of the film.

907-720.05.1.2--Conformability and Resealing. The marking shall be capable of conforming to pavement contours, breaks, faults, etc. through the action of traffic at normal pavement temperatures.

The marking shall have resealing characteristics that allows it to be capable of fusing with itself and previously applied marking of the same composition under normal conditions of use. The marking shall be capable of use for patching worn areas of the same type in accordance with manufacturer's instructions.

907-720.05.1.3--Tensile Strength and Elongation. The material shall have a minimum tensile strength of 40 pounds per square inch of cross section when tested according to ASTM D 638. A 6-inch x 1-inch x 0.06-inch sample shall be tested at a temperature between 70°F and 80°F using a jaw speed of 12 inches per minute.

The material shall have a minimum elongation of 75% at break when tested according to ASTM D 638 using a jaw speed of 12 inches per minute.

907-720.05.1.4--Skid Resistance. The surface of the material shall provide a minimum skid resistance value of 45 BPN when tested according to ASTM E 303 except values will be taken at

downweb and at a 45-degree angle from downweb. These two values will then be averaged to find the skid resistance of the patterned surface.

907-720.05.1.5--Effective Performance Life and Warranty. When applied according to the recommendations of the manufacturer the pavement marking tape shall provide a neat and durable marking that will not flow or distort due to temperature if the pavement surface remains stable. The film shall be weather resistant and through normal traffic wear shall show no appreciable fading, lifting, or shrinkage throughout the useful life of the marking, nor shall it show significant tearing, roll back, or other signs of poor adhesion.

All manufacturer's standard warranties and guarantees on pavement marking tape, which are provided as customary trade practice, shall be delivered to the Engineer at the final inspection. All warranties and guarantees shall be made out to the Department.

907-720.05.1.6—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

Acceptance sampling and testing will be in accordance with the Materials Division Inspection, Testing, and Certification Manual (Materials Manual). Samples of the material shall be furnished and shall be provided at no cost to the State.

907-720.05.2--Preformed Pavement Markings for Construction Zones. Preformed pavement markings for construction zones shall be designated Department's Approved Lists as temporary. Retroreflective preformed pavement markings for construction zones shall be as specified on the plans or in the contract documents.

The markings shall be provided in specified widths and shapes. Preformed words and symbols shall conform to the applicable shapes and sizes as outlined in the current "Manual on Uniform Traffic Control Devices for Streets and Highways," or as modified.

The materials shall be packaged in accordance with accepted commercial standards and when stored indoors in a cool dry place, shall be suitable for use one year after date of purchase.

907-720.05.2.1--Specific Requirements. Preformed markings shall consist of retroreflective materials on a conformable backing and shall meet the performance requirements of Subsection 907-720.02. The markings shall consist of a mixture of high-quality polymeric materials, pigments, and optics with a reflective layer of optics bonded to the top surface. The markings shall be pre-coated with a pressure sensitive adhesive capable of adhering to pavement in accordance with the manufacturer's instructions without the use of heat, solvents, or other additional adhesives. The markings and/or adhesive shall not require any curing time after application. A coated non-metallic medium shall be incorporated with the pressure sensitive adhesive to facilitate removal.

907-720.05.2.2—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

907-720.06--Raised Pavement Markers. Pavement markers shall be listed on the Department's Approved Lists and shall conform to ASTM D 4280.

907-720.06.1--Packaging. Shipments shall be made in containers acceptable to common carriers and packaged in such a manner as to ensure delivery in perfect condition. All damaged shipments shall be replaced by the Contractor. Each package shall be clearly marked as to the name of the manufacturer, type, quantity enclosed, lot number, and date of manufacture.

907-720.06.2--Non-Reflective Pavement Markers. Non-reflective pavement markers are occasionally referred to as "jiggle markers". Non-reflective markers consisting of a heat-fired, vitreous, ceramic base, and a heat-fired, opaque, glazed surface are permitted for use; the bottom of the marker shall not be glazed. Ceramic markers shall be produced from any suitable combination of intimately mixed clays, shales, talcs, flints, feldspars, or other inorganic material. Ceramic markers shall be thoroughly and evenly matured, and all non-reflective pavement markers shall be free from defects which affect appearance or serviceability.

Ceramic non-reflective markers shall conform to the following finish and testing requirements in Table 2 below.

Table 2

Ceramic Non-Reflective Marker Requirements	
Glaze Thickness	0.005 inch, minimum
Mohs Hardness	6, minimum
Autoclave	Glaze shall not spall, craze, or peel.
Compressive Strength	750 psi, minimum
Water Absorption	2.0%, maximum

907-720.06.3—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

907-720.07--Adhesive for Pavement Markers. The adhesive shall be listed on the Department's Approved Lists and shall be an asphaltic material suitable for bonding pavement markers to surfaces when the road surface and marker temperatures are in the range of 50°F to 160°F. The composition of the adhesive must be such that its properties will not deteriorate when heated to and applied at temperatures up to 425°F. Samples may be submitted in the form of an adhesive

testing package from each batch or material obtained from a package shipped to the project.

907-720.07.1--Packaging and Labeling. The adhesive shall be packaged in self-releasing cardboard containers that will stack properly. The label shall show the manufacturer, quantity, and lot or batch number. "Adhesive for Pavement Markers" or "Adhesive for Traffic Markers" shall be printed in bold lettering on the label.

907-720.07.2--Bituminous Adhesive. The asphaltic adhesive material shall be flexible type.

907-720.07.2.1--Flexible Bituminous Adhesive. Flexible bituminous adhesive shall be designated on the Department's Approved Lists as flexible and shall comply with requirements of Table 3 below.

Table 3

Flexible Bituminous Adhesive Properties			
	Min	Max	Test Method
Penetration @ 77°F	-	25	ASTM D 5
Softening Point, °F	200	-	ASTM D 36
Brookfield Viscosity @ 400°F, cp.	-	10,000	ASTM D 3236
Ductility @ 77°F, 5 cm/min	15	-	ASTM D 113
Ductility @ 39.2°F, 1 cm/min	5	-	ASTM D 113
Asphalt Compatibility	Pass		ASTM D 5329
Flexibility @ 20°F	Pass		Per Subsection

907-720.07.3—Acceptance Procedure. The Contractor shall furnish the Engineer with a copy of the manufacturer's certified test reports for the lot(s) of materials from which the shipment originated. The test report shall show all the test results for the material properties and characteristics as specified herein. The test report shall state that the material represented by the test results meets all the requirements of the contract. It shall be the Contractor's responsibility to furnish the manufacturer's test report to the Engineer for each shipment of material to the project.

Acceptance sampling and testing will be in accordance with the Materials Division Inspection, Testing, and Certification Manual (Materials Manual). Samples of the material shall be furnished and shall be provided at no cost to the State.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-721-4 **CODE: (IS)**

DATE: **04/19/2022**

SUBJECT: **Materials for Signing**

Section 721, Materials for Signing, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follows.

907-721.06--Reflective Sheeting.

907-721.06.2--Performance Requirements. Delete Table 4 and Table 5 in Subsection 721.06.2 on pages 860 & 861, and substitute the following.

MINIMUM COEFFICIENTS OF RETROREFLECTION
Candela per foot candle per square foot (cd/fc/ft^2)
Per ASTM Designation D4956

TABLE 4
Type IX Sheeting

Observation Angle	Entrance Angle	White	Yellow	Green	Red	Blue	Fluorescent Yellow/Green	Fluorescent Yellow	Fluorescent Orange
0.2°	-4.0°	380	285	38	76	17	300	230	115
0.2°	+30.0°	215	162	22	43	10	170	130	65
0.5°	-4.0°	240	180	24	48	11	190	145	72
0.5°	+30.0°	135	100	14	27	6.0	110	81	41
1.0°	-4.0°	80	60	8.0	16	3.6	64	48	24
1.0°	+30.0°	45	34	4.5	9.0	2.0	36	27	14

TABLE 5
Type XI Sheeting

Observation Angle	Entrance Angle	White	Yellow	Green	Red	Blue	Brown	Fluorescent Yellow/Green	Fluorescent Yellow	Fluorescent Orange
0.2°	-4.0°	580	435	58	87	26	17	460	350	175
0.2°	+30.0°	220	165	22	33	10	7.0	180	130	66
0.5°	-4.0°	420	315	42	63	19	13	340	250	125
0.5°	+30.0°	150	110	15	23	7.0	5.0	120	90	45
1.0°	-4.0°	120	90	12	18	5.0	4.0	96	72	36
1.0°	+30.0°	45	34	5.0	7.0	2.0	1.0	36	27	14

After Subsection 721.10 on page 864, add the following.

907-721.11--Digital Applied Printing. The following addresses the requirements for digitally printed finished retroreflective traffic control signs on flat sheet aluminum and digitally printed traffic sign faces intended to be applied to a sign substrate.

907-721.11.1--Digitally Printed Ink Systems. Traffic signs must be produced using components, and processes that comply with the retroreflective sheeting manufacturer's recommendations.

Digital printed ink systems used to print traffic signs must meet and comply with daytime and nighttime chromaticity (color standards) as recognized in ASTM D4956 "Standard Specification for Retroreflective Sheeting for Traffic Control."

Digital printed ink systems must meet 70% of the initial retroreflectivity specifications of each respective reflective film color as found in ASTM D4956 "Standard Specification for Retroreflective Sheeting for Traffic Control."

Prior to fabrication and preferably at the preconstruction meeting, the Contractor shall advise the Project Engineer in writing as to which signs on the project will be digitally printed and which ones will be screen printed. The Contractor shall submit to the Project Engineer certifications for all digitally printed signs, which will be forwarded to the State Traffic Engineer for review.

907-721.11.2--Protective Overlay Film. Permanent traffic signs printed with digital ink systems will be fabricated with a full sign protective overlay film designed to provide a smooth surface needed for retroreflectivity, and to protect the sign from fading and UV degradation. The overlaminate shall comply with the retroreflective sheeting manufacturer's recommendations to ensure proper adhesion and transparency and will also meet the reflective film durability as identified in Table 1.

Table 1
Retroreflective Film Minimum Durability Requirements

ASTM D4956 Type	Full Sign Replacement Term (years)	Sheeting Replacement Term (years)
IV	7	10
VIII	7	10
IX	7	12
XI	7	12

Temporary signs used in work zones printed with black ink only will not require a protective overlay film as long as the finished sign is warranted for a minimum outdoor durability of three years by the sheeting manufacturer.

907-721.11.3--Inspection. During fabrication, the Contractor shall provide sufficient testing and quality control throughout fabrication to insure good workmanship. Once the material has been received, it may be subject to random testing to ensure compliance with all requirements. If any test samples do not conform to the requirements, the entire order may be returned at the vendor's expense.

907-721.11.4--Traffic Sign Performance Warranty Provisions. Based on the ASTM Type of sheeting specified, traffic control signs shall be warranted for the duration shown in Table 1. The Contractor shall supply a copy of the warranty document with complete details of terms and conditions upon request of the Department.

907-721.11.5--Certified Digital Sign Fabricator. Sign fabricators using digital imaging methods to produce regulated traffic signs must be certified by the reflective sheeting manufacturer whose materials are used to produce the delivered signs.

Certified sign fabricators must undergo an audit process by the sheeting manufacturer to ensure they have the proper equipment, manufacturing capabilities, manufacturing application processes and the materials required to fulfill the sheeting manufacturer's warranty obligations. Sign fabricators must recertify annually with reflective sheeting manufacturers or utilize a 3rd party certifier approved by the reflective sheeting manufacturer.

The Contractor shall submit proof of Sign Fabricator Certification as issued by the retroreflective sign sheeting manufacturer to the Project Engineer upon delivery of the signs, or with the Shop Drawings.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-722-1 **CODE: (IS)**

DATE: 11/15/2017

SUBJECT: Materials for Traffic Signal Installation

Section 722, Materials for Traffic Signal Installation, of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction is hereby amended as follow.

907-722.02.3--Design Strength Requirements. Delete Subsection 722.02.3 on pages 864 thru 866, and substitute the following.

Unless specified otherwise in the plans, poles shall meet the requirements of the AASHTO *Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals,* as specified in the plans with all interim supplements. All components of the assemblies shall be designed to the following:

- Importance Factor: 1.0; 50 year mean recurrence interval
- Basic Wind Speed (3 second gust): As shown on the project plans
- Minimum Gust Effect Factor: 1.14
- Fatigue Category: II
- Ice Loading: As shown on the project plans
- Natural Wind Gust Pressure Loads: Included
- Truck Induced Gust Pressure Loads: Not included
- Galloping: Not included

907-722.02.5--Mast Arms for Traffic Signal and Equipment Poles. Delete the first four sentences of the third paragraph of Subsection 722.02.5 on page 867, and substitute the following.

Anchor base plates must meet the minimum requirements of ASTM A36 or ASTM A709 Grade 36 or ASTM A572 Grade 50 and must be welded to the shaft by either telescoped with two continuous arc welds or by back up ring using full penetration welds.. Flange plate shall telescope the large end of the arm and be welded by either two (2) continuous arc welds, one (1) being on the outside of the plate, adjacent to the shaft, and the other one (1) on the inside at the end of the tubular cross section or by back up ring using full penetration welds. The thru-bolt flange plate or tapped flange plate supporting the mast arm shall be welded to the pole near the top and supported side plate tangent to the pole and gusset plates both top and bottom. The thru-bolt or tapped flange plate must be sufficient to develop the full capacity of the connecting bolts.

907-722.03--Electric Cable. Delete the paragraphs for Loop Detector Wire and Loop Detector Lead-in Cable in Subsection 722.03 on page 869.

Delete the first sentence of "Communication Cable" in Subsection 722.03 on page 870, and substitute the following.

Communication cables shall be as per the manufacturer's recommendation.

907-722.05.4--Type III or Type IV Rigid Non-Metallic Conduit. After the last sentence of Subsection 722.05.4 on page 871, add the following.

Schedule 40 conduit shall be used unless otherwise noted in the plans.

Delete the title of Subsection 722.13.3 on page 876, and substitute the following.

907-722.13.3--Power Service Pedestal.

Delete the first paragraph of Subsection 722.13.3 on page 876, and substitute the following.

The pedestal shall be of NEMA Type 3R rainproof construction and shall be UL Listed as "Enclosed Industrial Control Equipment" (UL 508A). External construction shall comply with UL50 requirements and shall be unpainted aluminum.

Nominal size of the pedestal shall be 48"H x 16"W x 16"D.

Pedestal shall have a voltage rating or 120v/240v single phase with an Amperage rating of 800A.

After the first sentence of the seventh paragraph of Subsection 722.13.3 on page 876, add the following.

An outdoor rated heavy duty combination lock shall be provided to lock the customer compartment door.

907-722.14.1.3--Optical System. Delete the sixteenth paragraph of Subsection 722.14.1.3 on page 879, and substitute the following.

The signal module on-board circuitry shall include voltage surge protection to withstand high-repetition noise transients and low-repetition high-energy transients as stated in Section 2.1.6, NEMA Standard TS 2, 1992.

Delete the last sentence of the seventeenth paragraph of Subsection 722.14.1.3 on page 879, and substitute the following.

Load switches shall be compatible with NEMA TS 1 or later, or Model 170-1989 or later.

Delete Subsection 722.14.5 on page 882, and substitute the following.

907-722.14.5--Blank.

Delete Subsections 722.14.7 and 722.14.8 on page 882.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SUPPLEMENT TO SPECIAL PROVISION NO. 907-799-1

DATE: 07/28/2025

SUBJECT: Hydraulic Cement Concrete Mixtures

907-799.01.1--Materials. Delete *Ground Granulated Blast Furnace Slag (GGBFS)* from the list in Subsection 907-799.01.1 on page 1, and substitute the following.

Slag Cement 714.06

Delete the title for Subsection 907-799.02 on page 1, and substitute the following.

907-799.01.2--Classification and Uses of Concrete.

Delete numbers 9 through 15 in the classes and general use list on pages 1 & 2, and substitute the following.

9) Class F (SCC) – Self Consolidating Concrete for prestressed members.
10) Class DS – Concrete for drilled shafts.
11) Class FX – Extra Strength concrete for prestressed members, as shown on plans.
12) Class FX (SCC) – Extra Strength Self Consolidating concrete for prestressed members, as shown on plans.
13) Class PA – Concrete paving.
14) Class PO – Concrete for repair of concrete paving.
15) Class PP – Concrete for special design requirements.
16) Class S – For all seal concrete deposited under water.
17) Class WT – Fiber-reinforced concrete pavement.

907-799.02--Hydraulic Cement Concrete Mixture Design. Add the following to Table 1 on page 3.

F[8] (SCC)	67	0.40	5000	28[-4][12]	See Note[4]
FX[8] (SCC)	67	As per mixture design	As shown on plans	28[-4][12]	See Note[4]

Delete Note 8 of Table 1 on page 4, and substitute the following.

[8] Type III, Type IL (HE), or Type III (MS) cement may be used in these Classes of concrete.
[12] Refers to slump flow in inches. It shall be acquired by ASTM C1611.

907-799.02.1.1--Portland Cement. Delete the paragraph in Subsection 907-799.02.1.1 on page 4, and substitute the following.

Portland cement (cement) shall be either Type I or Type II. Type III, Type IL (HE), or Type III (MS), may be used for the production of precast or precast-prestressed concrete members or Classes of concrete with Note 8 in Table 1.

907-799.02.2--Replacement of Portland Cement or Blended Cement. Delete Table X on page 5, and substitute the following.

Table X
Replacement Ranges of Portland Cements and Blended Cements by Fly Ash or Slag Cement

Portland Cement or Blended Cement Type	Fly Ash Replacement Range (%)	Slag Cement Replacement Range (%)
Types I, II, III, and III (MS)	20 – 25	45 – 50
Types IL, IL (MS), and IL (HE)	20 – 35	35 – 40
Types IS and IS (MS)	20 – 25	20 - 25
Types IP and IP (MS)	No replacement combination allowed	

907-799.02.4--Exposure to Soluble Sulfates or Seawater. Delete Table R on page 6, and substitute the following.

Table R
Cementitious Materials Combinations for Soluble Sulfate Conditions or Seawater

	Exposure to Moderate Sulfates or Exposure to Seawater	**Exposure to Severe Sulfates**
Water-soluble sulfate (SO4) in soil, % by mass	0.10 – 0.20	0.20 – 2.00
Sulfate (SO4) in water, ppm	150 – 1,500	1,500 – 10,000
Portland Cement or Blended Cement Types	**Replacement Ranges by SCMs (%)**	
Type I or Type III	24.5 – 25.0% Class F fly ash, or 49.5 – 50.0% Slag cement, or 19.5 – 20.0% Metakaolin	49.5 – 50.0% Slag cement
Type II or Type III (MS)	See Note 1	24.5 – 25.0% Class F fly ash, or 49.5 – 50.0% Slag cement, or 19.5 – 20.0% Metakaolin
Type IL or IL (HE)	24.5 – 35.0% Class F fly ash, or 49.5 – 50.0% Slag cement, or 19.5 – 20.0% Metakaolin	49.5 – 50.0% Slag cement

Type IL (MS)	See Note 1	24.5 – 35.0% Class F fly ash, or 49.5 – 50.0% Slag cement, or 19.5 – 20.0% Metakaolin
Type IS	24.5 – 25.0% Class F fly ash, or 24.5 – 25.0% Slag cement, or 19.5 – 20.0% Metakaolin	24.5 – 25.0% Class F fly ash, or 24.5 – 25.0% Slag cement, or 19.5 – 20.0% Metakaolin
Type IS (MS)	See Note 1	24.5 – 25.0% Class F fly ash, or 24.5 – 25.0% Slag cement, or 19.5 – 20.0% Metakaolin
Type IP (MS)	No replacement combination allowed	Type not allowed

[1] Class F fly ash or slag cement may be added as a replacement for cement as allowed in Subsection 907-799.02.2.

907-799.03--Proportioning of Hydraulic Cement Concrete Mixture Design.

907-799.03.1--Proportioning on the Basis of Previous Field Experience of Trial Mixtures. Delete subparagraph (c) on page 7, and substitute the following.

(c) Consists of 10 consecutive tests, an average of three cylinders per test, tested at 28 days. For concrete categorized as a self-consolidating concrete (SCC) mixture, the test data for the plastic concrete shall include the slump flow data, instead of the slump data, and at least one test to determine the static segregation. For all mixture designs, for each of these tests on the plastic concrete the test data shall meet the acceptance criteria of Subsection 907-804.02.13.1.

907-799.03.2--Proportioning on the Basis of Laboratory Trial Mixtures. Add the following to the list of restrictions on page 8.

(g) For concrete categorized as a SCC mixture, the mixture shall be designed to produce a slump flow within ±2 inches of the maximum permitted and a maximum static segregation of 15.0 percent. The concrete shall not be rodded or vibrated during casting the test specimens.

(h) For concrete categorized as a SCC mixture, test specimens shall be made in accordance with the above listed specifications with the exception that the concrete shall not be rodded or vibrated during casting the test specimens.

907-799.05--Field Verification of Concrete Mixture Design. Delete the second and third paragraphs on page 9, and substitute with the following.

The Contractor's Certified Quality Control Technicians shall test each concrete mixture design upon the first placement of the mix. Aggregates and concrete tests during the first placement shall be as follows.

Aggregates	Concrete
Bulk Specific Gravity	Water Content
Moisture	Slump or Slump Flow
Gradation	Air Content
	Unit Weight
	Yield
	Static Segregation

For all Classes of concrete, the mixture shall be verified to yield within 2.0% of the correct volume when all the mix water is added to the batch, either by the batch plant or as ice used to control mixture acceptance temperature. For concrete categorized as a SCC mixture, the mixture shall produce a slump flow within minus four inches (4") of the maximum permitted and a static segregation less than 15.0%.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-799-1 **CODE: (IS)**

DATE: 11/21/2023

SUBJECT: Hydraulic Cement Concrete Mixtures

Section 907-799, Hydraulic Cement Concrete Mixtures, is hereby added to and made part of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as follows.

SECTION 907-799 - HYDRAULIC CEMENT CONCRETE MIXTURES

907-799.01--General.

907-799.01.1--Materials. The materials for hydraulic cement concrete mixtures shall meet the requirements of the following Subsections:

Portland Cement	701.01 and 701.02
Blended Cement	701.01 and 701.04
Fine Aggregate	703.02
Coarse Aggregate	703.03
Lightweight Aggregate	703.19.02
Synthetic Structural Fiber	711.04
Admixtures	713.02
Water	714.01.1 and 714.01.2
Fly Ash	714.05
Ground Granulated Blast Furnace Slag (GGBFS)	714.06
Metakaolin	907-714.09.01

907-799.02--Classification and Uses of Concrete. The classes and general uses of hydraulic cement concrete (concrete) mixtures are as follows:

1) Class AA - Concrete for bridge construction and concrete exposed to seawater.
2) Class B - General use, heavily reinforced sections, cast-in-place concrete piles, and conventional concrete piles.
3) Class BD - Concrete for bridge decks.
4) Class BDX - Extra strength concrete for bridge decks.
5) Class BDO - Concrete for bridge deck overlay.
6) Class C - Massive sections or lightly reinforced sections.
7) Class D - Massive unreinforced sections and riprap.
8) Class F - Concrete for prestressed members.
9) Class DS - Concrete for drilled shafts.
10) Class FX - Extra strength concrete for prestressed members, as shown on plans.
11) Class PA - Concrete paving.

12) Class PO - Concrete for repair of concrete paving.
13) Class PP - Concrete for special design requirements.
14) Class S - For all seal concrete deposited under water.
15) Class WT - Fiber-reinforced concrete pavement.

907-799.02--Hydraulic Cement Concrete Mixture Design. At least 10 working days prior to production of concrete, the Contractor shall submit to the Engineer proposed concrete mixture designs complying with the Department's *Concrete Manual*. Materials shall be from approved sources meeting the requirements of the Standard Specifications. Proportions for the mixture designs shall be for the class concrete required by the plans and shall meet the requirements of the "Master Proportion Table for Hydraulic Cement Concrete Designs" listed in Table 1. The concrete producer shall assign a permanent unique mixture number to each mixture design. Each mixture design shall be field verified as required in Subsection 907-799.03.3. Acceptable field verification data shall be required for final approval of a mixture design.

All concrete mixture designs will be reviewed by the Materials Division prior to use. Concrete mixture designs disapproved will be returned to the Contractor with a statement explaining the disapproval.

If the maturity method is used to estimate the compressive strength for applications such as early opening to traffic or form removal, the Contractor shall also submit compressive strength/maturity documentation developed in accordance with Subsection 804.03.15 for the mixture prior to production of concrete.

If the Contractor chooses to cure the concrete in accordance with the requirements listed under **Length of Time Defined by Development of Compressive Strength** in Subsection 804.03.17, the compressive strength/maturity relationship shall be developed for the mixture design for a minimum of 28 days following the requirements of Subsection 804.03.15. The compressive strength/maturity relationship information shall be submitted with the mixture design information.

Table 1
MASTER PROPORTION TABLE FOR HYDRAULIC CEMENT CONCRETE DESIGNS

Class	Required Coarse Aggregate Size No.[7]	Maximum w/cm Ratio	Specified Compressive Strength (f'_c) psi	Maximum Permitted Slump inches[5]	Total Air Content (%)
AA	57 or 67	0.45	4000	8	3.0-6.0
B	57 or 67	0.50	3500	8	3.0-6.0
BD[2, 3]	57 or 67	0.45[1]	4000	5	3.0-6.0 5.0 8.0
BDX[2, 3]	57 or 67	0.45[1]	4500	5	3.0-6.0 5.0 8.0
BDO[3, 6, 8, 11]	7, 8, or 78	As per mixture design	2500	6	3.0-6.0
C	57 or 67	0.55	3000	8	3.0-6.0
D	57 or 67	0.70	2000	8	3.0-6.0
DS	67	0.45	4000	8±1	See Note[4]
F[8]	67	0.40	5000	8	See Note[4]
FX[8]	67	As per mixture design	As shown on plans	8	See Note[4]
PA	467 or 57[9]	0.48	3500	3	3.0-6.0
PO[8, 11]	57 or 67	As per mixture design	3500	8	3.0-6.0
PP	57 or 67	0.45	Per Plans	8	3.0-6.0
S	57 or 67	0.45	3000	8	3.0-6.0
WT[3, 8, 10, 11]	57 or 67	0.40	3500	4	3.0-6.0

[1] For Class BD concrete for bridge decks, the minimum water/cementitious material ratio shall be 0.43 and the maximum cementitious material content shall be 550 pounds per cubic yard.
For Class BDX concrete for bridge decks, the minimum water/cementitious material ratio shall be 0.42 and the maximum cementitious material content shall be 564 pounds per cubic yard.

[2] For bridge decks constructed following the requirements of Subsection 804.03.19.7.3, Subsection 804.03.14.2, and Subsection 804.03.17.2, then the Class BD or Class BDX mixture design shall contain lightweight aggregate (LWA) and have an internal curing water content of 8.0 lbs per 100 lbs of total cementitious materials in the mixture design; mixture designs not containing LWA and the required minimum internal curing water content shall not be used.

[3] An approved synthetic structural fiber shall be incorporated into the mixture at 1.25 times the approved dosage rate. For each additional pound of fibers per cubic yard added in excess

of the requirement stated above, an additional inch of slump will be allowed up to a maximum permitted slump of eight (8) inches.

[4] Entrained air is not required for Class F, FX, and DS concrete unless exposed to seawater. For concrete not exposed to seawater, the total air content shall not exceed 6.0%. For concrete exposed to seawater, the total air content shall be 3.0-6.0%.

[5] Except as noted for Class DS concrete, the design slump selected by the Contractor for the mixture design may be less than the maximum permitted slump. The design slump is the maximum acceptance slump for field acceptance in accordance with Subsection 907-804.02.13.1.2. Except as noted for Class DS concrete, minus slump requirements shall meet those set forth in Table 3 of AASHTO M157.

[6] For Class BDO the mixture design shall include a minimum 564 pounds per cubic yard of cementitious material with a minimum 15 percent fly ash replacement. The specified strength shall be achieved prior to Opening To Traffic.

[7] Other small coarse aggregate sizes meeting the requirements of Subsection 703.03.2.4 may be used in conjunction with the coarse aggregate sizes listed. Lightweight aggregate (LWA) meeting the requirements of Subsection 703.19.2 may also be used as a partial replacement for fine aggregate.

[8] Type III or Type III (MS) portland cement may be used in these Classes of concrete.

[9] The oven-dry coarse aggregate volume per cubic yard of concrete shall be a minimum of 72%.

[10] The coarse aggregate size requirements shall meet the requirements of Subsection 907-799.02.4.2.

[11] Non-chloride based accelerating admixtures may be used in these Classes of concrete.

907-799.02.1--Allowable Hydraulic Cement Types.

907-799.02.1.1--Portland Cement. Portland cement (cement) shall be either Type I or Type II. Type III or Type III (MS) may be used for the production of precast or precast-prestressed concrete members or Classes of concrete with Note 8 in Table 1.

907-799.02.1.2--Blended Cement. Blended hydraulic cements (blended cements) shall be of the following types and conform to Subsection 701.04:

Type IL – Portland-limestone cement
Type IP – Portland-pozzolan cement
Type IS – Portland blast-furnace slag cement

Blended cement Types IL, IP, and IS meeting the "MS" sulfate resistance requirements listed in AASHTO M 240, Table 3 may also be used.

907-799.02.2--Replacement of Portland Cement or Blended Cement. Replacement of portland cement or blended cement shall be on a weight basis. At least 50% by weight of total cementitious material per cubic yard shall be portland cement.

Except as noted for concrete exposed to soluble sulfates or sea water in Subsection 907-799.02.4, the maximum replacement limits of portland cement or blended cement by weight by fly ash and

slag cement shall be in accordance with Table X provided the 50% by weight of total cementitious material per cubic yard of portland cement is maintained.

Table X
Replacement Ranges of Portland cements and Blended cements by Fly Ash or Slag Cement

Portland cement or Blended cement type	Fly ash replacement range (%)	Slag cement replacement range (%)
Types I, II, III, and III (MS)	20 - 25	45 - 50
Types IL and IL (MS)	20 - 35	35 - 40
Types IS and IS (MS)	20 - 25	20 - 25
Types IP and IP (MS)	No replacement combination allowed	

Replacement contents below the range minimum in Table X may be used in concrete, but the concrete does not qualify for any special considerations, such as the maximum acceptance temperature for concrete in Subsection 804.02.13.1.5. Special considerations shall only apply for replacement of both portland cement and blended cement by either fly ash or slag cement.

907-799.02.3--Alkali Content. The total alkali content for all classes of concrete shall not exceed 4.0 lb per cubic yard based on the alkali contribution from the portland cement. The maximum cement alkali content reported on the cement mill certificate shall be used in this determination. An example calculation can be found in the Department's *Concrete Manual*.

907-799.02.4--Exposure to Soluble Sulfates or Seawater. When portland cement or blended cement concrete is exposed to moderate or severe soluble sulfate conditions or to seawater listed, cement types and replacement of cement by Class F fly ash, slag cement, or metakaolin shall be as follows in Table R.

Class C fly ash shall not be used as a replacement for cement in any of the sulfate exposure conditions listed below. Type IP blended cement shall not be used in any of the sulfate exposure conditions listed below.

Table R
Cementitious Materials Combinations for Soluble Sulfate Conditions or Seawater

	Exposure to Moderate Sulfates or Exposure to Seawater	**Exposure to Severe Sulfates**
Water-soluble sulfate (SO_4) in soil, % by mass	0.10 - 0.20	0.20 - 2.00
Sulfate (SO_4) in water, ppm	150 - 1,500	1,500 - 10,000
Portland cement or Blended cement types	**Replacement Ranges by SCMs (%)**	
Type I or Type III	24.5 - 25.0% Class F fly ash, or 49.5 - 50.0% Slag cement, or 19.5 - 20.0% Metakaolin	49.5 - 50.0% Slag cement
Type II or Type III (MS)	See Note 1	24.5 - 25.0% Class F fly ash, or 49.5 - 50.0% Slag cement, or 19.5 - 20.0% Metakaolin
Type IL	24.5 - 35.0% Class F fly ash, or 49.5 - 50.0% Slag cement, or 19.5 – 20.0% Metakaolin	49.5 - 50.0% Slag cement
Type IL (MS)	See Note 1	24.5 - 35.0% Class F fly ash, or 49.5 - 50.0% Slag cement, or 19.5 - 20.0% Metakaolin
Type IS	24.5 - 25.0% Class F fly ash, or 24.5 - 25.0% Slag cement, or 19.5 - 20.0% Metakaolin	24.5 - 25.0% Class F fly ash, or 24.5 - 25.0% Slag cement, or 19.5 - 20.0% Metakaolin
Type IS (MS)	See Note 1	24.5 - 25.0% Class F fly ash, or 24.5 - 25.0% Slag cement, or 19.5 - 20.0% Metakaolin
Type IP (MS)	No replacement combination allowed	Type not allowed

[1] Class F fly ash or slag cement may be added as a replacement for cement as allowed in Subsection 907-799.02.2.

907-799.02.5--Chemical Admixtures. At least one water-reducing admixture or water-reducing/set-retarding admixture shall be used in all classes of concrete in accordance with the manufacturer's recommended dosage range. Admixtures providing a specific performance characteristic other than those of water reduction or set retardation may be used in accordance with the manufacturer's recommended dosage range. Accelerating admixtures shall not be used unless approved by the State Materials Engineer and as applied to Classes by Note 11 in Table 1. Any combinations of admixtures shall be approved by the Engineer before their use.

907-799.02.6--Aggregates.

907-799.02.6.1--Lightweight Aggregate Requirements for Bridge Decks. For bridge decks constructed following the requirements of Subsection 804.03.19.7.3, Subsection 804.03.14.2 and Subsection 804.03.17.2, then the Class BD or Class BDX mixture design shall contain LWA meeting the requirements of Subsection 703.19.2 and have an internal curing water content of 8.0 lbs. per 100 lbs. of total cementitious materials in the mixture design; mixture designs not containing LWA and the required minimum internal curing water content shall not be used.

907-799.02.6.2--Class WT Concrete. Class WT concrete used in fiber-reinforced concrete pavements with a design thickness greater than or equal to 4 inches, size 57 coarse aggregate shall be used. Class WT concrete used in fiber-reinforced concrete pavements with a design thickness less than 4 inches, size 67 coarse aggregate shall be used.

907-799.03--Proportioning of Hydraulic Cement Concrete Mixture Design. Proportioning of hydraulic cement concrete shall be based on an existing mixture of which the producer has field experience and documentation or based on a recently batched laboratory mixture tested according to the required specifications.

907-799.03.1--Proportioning on the Basis of Previous Field Experience of Trial Mixtures. Where a concrete production facility has a record, based on at least 10 consecutive strength tests from at least 10 different batches within the past 12 months from a mixture not previously used on Department projects, the standard deviation shall be calculated. The record of tests from which the standard deviation is calculated shall:

(a) Represent similar materials and conditions to those expected. Changes in materials and proportions within the test record shall not have been more closely restricted than those for the proposed work.
(b) Represent concrete produced to meet a specified strength.
(c) Consist of 10 consecutive tests, average of three cylinders per test, tested at 28 days. For all mixture designs, for each of these tests on the plastic concrete the test data shall meet the acceptance criteria of Subsection 804.02.13.1.

The standard deviation, *s,* shall be calculated as:

$$s = \left[\sum (X_i - \bar{X})^2 \div (N - 1)\right]^{1/2}$$

where:

X_i = the strength result of an individual test
$\bar{X}$ = the average of individual tests in the series
N = number of tests in the series

When the concrete production facility does not have a record of tests for calculation of standard deviation, as required in the above formula, the requirements of Subsection 907-799.03.2 shall govern.

The required average compressive strength (f'_{cr}) used as the basis for selection of concrete proportions shall conform to the inequality listed below, while using a standard deviation, s, calculated as shown above.

$$\overline{X} \geq f'_{cr}$$

where:

$$f'_{cr} = f'_c + 1.43s$$

where:

f'_c = specified compressive strength of concrete, psi
f'_{cr} = required average compressive strength of concrete, psi
s = standard deviation, psi

1.43 represents the Lower Quality Index necessary to assure that 93% of compressive strength tests are above f'_c.

907-799.03.2--Proportioning on the Basis of Laboratory Trial Mixtures. When an acceptable record of field test results is not available, concrete proportions shall be established based on laboratory trial mixtures meeting the following restrictions:

(a) The combination of materials shall be those intended for use in the proposed work.
(b) Trial mixtures having proportions and consistencies suitable for the proposed work shall be made using the ACI 211.1 as a guide to proportion the mixture design.
(c) Trial mixtures shall be designed to produce a slump within ±¾ inch of the design slump allowed, and for air-entrained concrete, ±0.5 percent of the maximum permitted air content in Table 1 in Subsection 907-799.02. The temperature of freshly mixed concrete in trial mixtures shall be reported.
(d) For each proposed mixture, at least three compressive test cylinders shall be made and cured in accordance with AASHTO R 39. Each change of water-cement ratio shall be considered a new mixture. The cylinders shall be tested for strength in accordance with AASHTO T 22 and shall be tested at 28 days.
(e) The required average strength of laboratory trial mixes shall exceed f'_c by 1200 psi for concrete mixture designs less than 5000 psi and by 1400 psi for concrete mixture designs of 5000 psi or more.
(f) The laboratory trial batch mixtures shall have been made within the previous 12 months before being submitted for approval and shall not have been previously used on Department projects.

907-799.04--Documentation of Average Strength. Documentation that the proposed concrete proportions will produce an average strength equal to or greater than the required average shall consist of the strength test records from field tests or results from laboratory trial mixtures.

907-799.05--Field Verification of Concrete Mixture Design. Unless otherwise noted within this Subsection, and except for Class PO, concrete mixture designs will only be tentatively approved pending field verification submission. All concrete placed using a mixture design which has not been acceptably field verified will not be paid for by the Department until field verification is submitted and approved as having been found to meet the requirements in this Subsection and those in the Department's *Concrete Manual*. The requirements for yield, slump, or total air content shall be successfully met within the first three (3) production days. Mixture designs may be transferred to other projects without additional field verification testing if the most recent field verification testing was conducted within the past twelve (12) months. All concrete mixtures will have a complete field verification performed and submitted to the Department's Materials Division every 12 months.

The Contractor's Certified Quality Control Technicians shall test each concrete mixture design upon the first placement of the mixture. Aggregates and concrete tests during the first placement shall be as follows.

Aggregates	Concrete
Bulk Specific Gravity	Water Content
Moisture	Slump
Gradation	Air Content
	Unit Weight
	Yield

For all Classes of concrete, the mixture shall be verified to yield within 2.0% of the correct volume when all the mix water is added to the batch, either by the batch plant or as ice used to control mixture acceptance temperature.

For all Classes of concrete other than DS, F, and FX, the mixture shall produce a slump within a minus 1½-inch tolerance of the design for mixtures with a design slump of three inches (3") or less or within a minus 2½-inch tolerance of the design for mixtures with a design slump of greater than three inches (3"), and producing a total air content within the allowable air content range in Table 3.

For Class DS, the slump range shall be 8 inches ±1 inch. For Class DS exposed to seawater, the total air content shall be within the allowable air content range in Table 3. For Class DS not exposed to seawater the total air content shall be within the requirements in Table 3.

For Classes F and FX, the slump shall be within a minus 1½-inch tolerance of the design for mixtures with a design slump of three inches (3") or less or within a minus 2½-inch tolerance of the design for mixtures with a design slump of greater than three inches (3"). For Classes F and FX exposed to seawater, the total air content shall be within the allowable air content range in Table 3. For Classes F and FX not exposed to seawater the total air content shall be within the requirements in Table 3.

The mixture shall be adjusted and retested, if necessary, on subsequent placements until the above-mentioned properties are met.

If the requirements for yield, slump, or total air content are not met within the first three (3) production days, subsequent field verification testing shall not be permitted on Department projects, and the mixture design shall not be used until the requirements listed above are met. Any mixture design adjustments, changes in the mixture proportions, are to be made by a Class III Certified Technician representing the Contractor. After the mixture design has been verified and adjustments made, verification test results will be reviewed by the Engineer.

907-799.05.1--Field Verification and Slump Loss of Class DS Concrete Mixture Designs. Prior to placement of Class DS concrete mixture, the Contractor shall provide test results of a slump loss test using approved methods to demonstrate that the mixture meets the four-hour requirement in Subsection 803.03.2.7.1. The Contractor shall notify the Department 48 hours prior to performing the slump loss test. These tests shall be conducted successfully by an approved testing laboratory during the installation of the trial shaft, with personnel from the Department present. As an alternative, the slump loss test can be performed prior to the installation of the trial shaft.

The slump loss test shall be conducted at temperatures and conditions similar to those expected at the job site at the time of the installation of the trial shaft. The sample for the slump loss test shall be from a minimum batch size of four (4) cubic yards of concrete. If the temperature between a successful slump loss test and the installation of the production shaft exceeds 10ºF above the concrete temperature, another successful slump loss test shall be performed on the first truckload of concrete as part of the installation of the trial shaft. The requirement to limit the time between the previous slump loss test and an installation of the trial shaft also applies to Class DS concrete mixture designs being transferred from another project. During any shaft installation a slump loss test shall be conducted by the Contractor at the direction of the Engineer from the concrete at the site for verification of slump loss requirements using a sample from a minimum batch size of four cubic yards of concrete.

907-799.05.2--Field Verification of Class BDO and Class WT Concrete Mixture Designs. Prior to mixture design submittal, the Contractor shall perform a field verification on Class BDO and Class WT concrete mixture designs and submit the field verification data and batch ticket information as part of the mixture submittal.

In addition to the requirements in Subsection 907-799.03.3, this documentation must indicate that the mixture achieves the requirements in Table 1 for:

- the compressive strengths required for acceptance within 28 days;
- the compressive strengths required for early opening to traffic within the time specified by the Engineer; and
- if the maturity method is to be used to estimate the compressive strength for early opening to traffic, the strength/maturity relationship shall be verified within 10% of the predicted compressive strength value determined by the maturity curve following the requirements of AASHTO T325 during the field verification.

907-799.06--Adjustments of Mixtures. The mixture design may be adjusted by the Class III Certified Technician representing the Contractor in accordance with the allowable revisions listed in paragraph 5.7 of the Department's *Concrete Manual*. Written notification shall be submitted to the Engineer a minimum of seven (7) days prior to any source or brand of material change, aggregate size change, allowable material type change, or decrease in any cementitious material content. Any adjustments of the concrete mixture design shall necessitate repeat of field verification procedure as described in Subsection 907-799.05 and approval by the Engineer.

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISION NO. 907-899-1 **CODE: (SP)**

DATE: 01/17/2017

SUBJECT: Railway-Highway Provisions

Section 907-899, Railway-Highway Provisions, is hereby added to and made part of the 2017 Edition of the Mississippi Standard Specifications for Road and Bridge Construction as follows:

SECTION 907-899--RAILWAY-HIGHWAY PROVISIONS

907-899.01--Description. This special provision addresses the Contractor's involvement with railroad flagging, Contractor Safety Orientation, Contractor Background Investigation, Contractor Roadway Worker on Track Safety Program and Safety Action Plan, and any other requirements set forth by the Railroad and any attached Exhibits.

Prior to bidding, the Contractor shall read and comply with the requirements of the Railroad and any attached Exhibits. The Contractor shall contact the Railroad concerning insurance coverage requirements, Railroad flagging costs, Contractor Safety Orientation, Contractor Background Investigation, Contractor Roadway Worker on Track Safety Program and Safety Action Plan, and any other requirements set forth by the Railroad and any attached Exhibits. In case the railroad requires coverage over and above that required by the Standard Specifications, the railroad requirements shall be met.

If in the opinion of the RAILROAD, the presence of an authorized representative of the RAILROAD is required to supervise the same, the RAILROAD shall render bills to the Contractor for all expenses incurred by it for such supervision. This includes all labor costs for flagmen or cable locate supplied by the RAILROAD to protect RAILROAD operation, and for the full cost of furnishing, installation and later removal of any temporary supports for said tracks, as the RAILROAD's Chief Engineer's Office may deem necessary.

It will be the Contractor's responsibility to pay all bills associated with the Railroad requirements and any attached Exhibits.

A cable locate of RAILROAD owned facilities may be required to identify and protect Signal & Communication cables that have been installed to provide power, signal control, wayside communications. These cables are vital to a safe and reliable railway operation. The cable locate will be performed by a qualified RAILROAD employee.

Outside Contractors are prohibited from driving on, along, or across any track that does not have a RAILROAD installed crossing. They may utilize an existing public crossing. The practice of allowing rubber tired equipment to operate over track with no crossing has been banned.

The Contractor shall complete and process any required forms addressed by the Railroad or any attached Exhibits. The Contractor shall not commence or carry on any form of work on, under, above or within the designated distance from the Railroad track prior to getting approval from the Railroad.

907-899.02--Blank.

907-899.03--Construction Requirements. The Contractor shall read and comply with the requirements of the Railroad and any attached Exhibits.

907-899.04--Method of Measurement. Railway-highway provisions will be measured as a unit lump sum quantity. Measurement for payment will be in accordance with the following schedule:

a) On the first estimate, twenty five percent (25%) of the amount bid for Railway Highway Provision will be paid.
b) When twenty five percent (25%) of the original contract amount is earned from all direct pay items, fifty percent (50%) of the amount bid for Railway Highway Provision will be paid.
c) When fifty percent (50%) of the original contract amount is earned from all direct pay items, one hundred percent (100%) of the amount bid for Railway Highway Provision will be paid.

907-899.05--Basis of Payment. Railway-highway provisions, measured a prescribed above, will be paid for at the contract lump sum price, which price shall be payment in full for all insurance coverage requirements, railroad flagging costs, Contractor safety orientation, Contractor background investigation, Contractor safety programs and plans, and any other requirements set forth by the Railroad and any attached Exhibits, and other incidentals necessary to complete the requirements of this work.

Payment will be made under:

907-899-A: Railway-Highway Provisions - lump sum

S E C T I O N 9 0 5 - P R O P O S A L

Date _____

Mississippi Transportation Commission
Jackson, Mississippi

Sirs: The following proposal is made on behalf of _____
_____ of _____
_____
for constructing the following designated project(s) within the time(s) hereinafter specified.

The plans are composed of drawings and blue prints on file in the offices of the Mississippi Department of Transportation, Jackson, Mississippi.

The Specifications are the current Standard Specifications of the Mississippi Department of Transportation approved by the Federal Highway Administration, except where superseded or amended by the plans, Special Provisions and Notice(s) to Bidders attached hereto and made a part thereof.

I (We) certify that I (we) possess a copy of said Standard and any Supplemental Specifications.

Evidence of my (our) authority to submit the Proposal is hereby furnished. The proposal is made without collusion on the part of any person, firm or corporation. I (We) certify that I (we) have carefully examined the Plans, the Specifications, including the Special Provisions and Notice(s) to Bidders, herein, and have personally examined the site of the work. On the basis of the Specifications, Special Provisions, Notice(s) to Bidders, and Plans, I (we) propose to furnish all necessary machinery, tools, apparatus and other means of construction and do all the work and furnish all the materials in the manner specified. I (We) understand that the quantities mentioned herein are approximate only and are subject to either increase or decrease, and hereby propose to perform any increased or decreased quantities of work at the unit prices bid, in accordance with the above.

I (We) acknowledge that this proposal will be found irregular and/or non-responsive unless a certified check, cashier's check, or Proposal Guaranty Bond in the amount as required in the Advertisement (or, by law) is submitted electronically with the proposal or is delivered to the Contract Administration Engineer prior to the bid opening time specified in the advertisement.

INSTRUCTION TO BIDDERS: Alternate and Optional Items on Bid Schedule.

1. Two or more items entered opposite a single unit quantity WITHOUT DEFINITE DESIGNATION AS "ALTERNATE ITEMS" are considered as "OPTIONAL ITEMS". Bidders may or may not indicate on bids the Optional Item proposed to be furnished or performed WITHOUT PREJUDICE IN REGARD TO IRREGULARITY OF BIDS.
2. Items classified on the bid schedule as "ALTERNATE ITEMS" and/or "ALTERNATE TYPES OF CONSTRUCTION" must be preselected and indicated on bids. However, "Alternate Types of Construction" may include Optional Items to be treated as set out in Paragraph 1, above.
3. Optional items not preselected and indicated on the bid schedule MUST be designated in accordance with Subsection 102.06 prior to or at the time of execution of the contract.
4. Optional and Alternate items designated must be used throughout the project.

I (We) further propose to perform all "force account or extra work" that may be required of me (us) on the basis provided in the Specifications and to give such work my (our) personal attention in order to see that it is economically performed.

I (We) further propose to execute the attached contract agreement (Section 902) as soon as the work is awarded to me (us), and to begin and complete the work within the time limit(s) provided for in the Specifications and Advertisement. I (We) also propose to execute the attached contract bond (Section 903) in an amount not less than one hundred (100) percent of the total of my (our) part, but also to guarantee the excellence of both workmanship and materials until the work is finally accepted.

I (We) shall submit electronically with our proposal or deliver prior to the bid opening time a certified check, cashier's check or bid bond for **five percent (5%) of total bid** and hereby agree that in case of my (our) failure to execute the contract and furnish bond within Ten (10) days after notice of award, the amount of this check (bid bond) will be forfeited to the State of Mississippi as liquidated damages arising out of my (our) failure to execute the contract as proposed. It is understood that in case I am (we are) not awarded the work, the check will be returned as provided in the Specifications.

For Informational Purposes Only

SECTION 905 -- PROPOSAL (CONTINUED)

I (We) hereby certify by digital signature and electronic submission via Bid Express of the Section 905 proposal below, that all certifications, disclosures and affidavits incorporated herein are deemed to be duly executed in the aggregate, fully enforceable and binding upon delivery of the bid proposal. I (We) further acknowledge that this certification shall not extend to the bid bond or alternate security which must be separately executed for the benefit of the Commission. This signature does not cure deficiencies in any required certifications, disclosures and/or affidavits. I (We) also acknowledge the right of the Commission to require full and final execution on any certification, disclosure or affidavit contained in the proposal at the Commission's election upon award. Failure to so execute at the Commission's request within the time allowed in the Standard Specifications for execution of all contract documents will result in forfeiture of the bid bond or alternate security.

Respectfully Submitted,

DATE _____

_____
Contractor

BY _____
Signature

TITLE _____

ADDRESS _____

CITY, STATE, ZIP _____

PHONE _____

FAX _____

E-MAIL _____

(To be filled in if a corporation)

Our corporation is chartered under the Laws of the State of _____ and the names, titles and business addresses of the executives are as follows:

_____
President Address

_____
Secretary Address

_____
Treasurer Address

The following is my (our) itemized proposal.

For Informational Purposes Only

Mill & Overlay approximately 11 miles of US 61 from 0.5 miles North of US 80/SR27 Intersection to 0.36 miles North of SR 465 at Redwood & Reconstruction of Retaining Wall on US 61 South of Redwood, known as Federal Aid Project Nos. NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301 in Warren County.

Line no.	Item Code	Adj Code	Quantity	Units	Description[Fixed Unit Price]
				Roadway Items	
0010	202-B007		984	Square Yard	Removal of Asphalt Pavement, All Depths
0020	202-B073		452	Square Yard	Removal of Concrete Pavement, All Depths
0030	202-B093		3,000	Linear Feet	Removal of Debris
0040	202-B114		1,512	Linear Feet	Removal of Debris and Sand From Pipe, All Sizes
0050	202-B136		3,021	Linear Feet	Removal of Guard Rail
0060	202-B191		32	Linear Feet	Removal of Pipe, 8" And Above
0070	202-B240		21,000	Linear Feet	Removal of Traffic Stripe
0080	202-B263		15	Each	Removal of Debris and Sand From Inlet and Junction Box, All Types & Sizes
0090	203-G001	(E)	48	Cubic Yard	Excess Excavation, FM, AH
0100	206-A001	(S)	25	Cubic Yard	Structure Excavation
0110	209-A005		1,100	Square Yard	Geotextile Stabilization, Type V, Non-Woven
0120	237-A002		200	Linear Feet	Wattles, 20"
0130	304-D002	(GT)	5,500	Ton	Granular Material, Crushed Stone
0140	406-D003		38,000	Ton	Fine Milling of Bituminous Pavement, All Depths
0150	423-A001		25	Mile	Rumble Strips, Ground In
0160	503-C010		2,829	Linear Feet	Saw Cut, Full Depth
0170	503-E002		551	Each	Tie Bars, No. 5 Deformed Drilled and Epoxied or Grouted
0180	603-CA026	(S)	32	Linear Feet	24" Reinforced Concrete Pipe, Class III
0190	603-CB004	(S)	2	Each	24" Reinforced Concrete End Section
0200	606-B001		3,819	Linear Feet	Guard Rail, Class A, Type 1
0210	606-C003		3	Each	Guard Rail, Cable Anchor, Type 1
0220	606-D019		6	Each	Guard Rail, Bridge End Section, Type H
0230	606-D022		4	Each	Guard Rail, Bridge End Section, Type I
0240	606-E005		13	Each	Guard Rail, Terminal End Section, Flared
0250	612-B001		32	Cubic Yard	Flowable Fill, Non-Excavatable
0260	618-B001		2	Square Feet	Additional Construction Signs ($10.00)
0270	619-A1001		42	Mile	Temporary Traffic Stripe, Continuous White
0280	619-A2001		33	Mile	Temporary Traffic Stripe, Continuous Yellow
0290	619-A3001		37	Mile	Temporary Traffic Stripe, Skip White
0300	619-A5001		45,000	Linear Feet	Temporary Traffic Stripe, Detail
0310	619-A6001		500	Square Feet	Temporary Traffic Stripe, Legend
0320	619-A6002		4,000	Linear Feet	Temporary Traffic Stripe, Legend
0330	619-F1002		630	Linear Feet	Portable Median Barrier
0340	619-G5001		29	Each	Free Standing Plastic Drums

For Informational Purposes Only

Line no.	Item Code	Adj Code	Quantity	Units	Description[Fixed Unit Price]
0350	619-G7001		20	Each	Warning Lights, Type "B"
0360	619-J1004		1	Each	Impact Attenuator, 60 MPH
0370	620-A001		1	Lump Sum	Mobilization
0380	630-F006		108	Each	Delineators, Guard Rail, White
0390	630-F007		17	Each	Delineators, Guard Rail, Yellow
0400	630-G005		10	Each	Type 3 Object Markers, OM-3R or OM-3L, Post Mounted
0410	699-A001		1	Lump Sum	Roadway Construction Stakes
0420	803-D006	(S)	6,840	Linear Feet	HP 14 x 73 Steel Piling
0430	815-A007	(S)	40	Ton	Loose Riprap, Size 300
0440	907-234-A001		402	Linear Feet	Temporary Silt Fence
0450	907-403-A013	(BA1)	29,000	Ton	9.5-mm, HT, Asphalt Pavement
0460	907-403-A015	(BA1)	11,300	Ton	9.5-mm, ST, Asphalt Pavement
0470	907-403-B006	(BA1)	204	Ton	19-mm, ST, Asphalt Pavement, Leveling
0480	907-403-B012	(BA1)	300	Ton	9.5-mm, ST, Asphalt Pavement, Leveling
0490	907-407-A001	(A2)	37,800	Gallon	Asphalt for Tack Coat
0500	907-413-E001		17,500	Linear Feet	Sawing and Sealing Transverse Joints in Asphalt Pavement
0510	907-420-A001		24,000	Pounds	Undersealing
0520	907-503-A001	(C)	351	Square Yard	8" and Variable Continuously Reinforced Concrete Pavement, Broom Finish
0530	907-503-D001		19	Cubic Yard	Concrete for Base Repair
0540	907-603-D003	(S)	236	Linear Feet	24" Cured-In-Place Pipe
0550	907-618-A001		1	Lump Sum	Maintenance of Traffic
0560	907-619-B001		66	Linear Feet	Temporary Portable Rumble Strips
0570	907-619-E3001		6	Each	Changeable Message Sign
0580	907-626-A010		18	Mile	6" Thermoplastic Traffic Stripe, Skip White
0590	907-626-B006		21	Mile	6" Thermoplastic Traffic Stripe, Continuous White
0600	907-626-E005		17	Mile	6" Thermoplastic Traffic Stripe, Continuous Yellow
0610	907-626-G004		48,000	Linear Feet	Thermoplastic Detail Stripe, White
0620	907-626-G005		46,000	Linear Feet	Thermoplastic Detail Stripe, Yellow
0630	907-626-H009		900	Square Feet	Thermoplastic Legend, White
0640	907-626-H010		6,000	Linear Feet	Thermoplastic Legend, White
0650	907-627-J001		1,000	Each	Two-Way Clear Reflective High Performance Raised Markers
0660	907-627-K001		3,250	Each	Red-Clear Reflective High Performance Raised Markers
0670	907-627-L001		600	Each	Two-Way Yellow Reflective High Performance Raised Markers
0680	907-632-D001		3	Each	Solid State Traffic Actuated Controller, Type 1
0690	907-632-G001		3	Each	Malfunction Management Unit
0700	907-643-A004		3	Each	Video Vehicle Detection Sensor, Type 1A
0710	907-643-A005		2	Each	Video Vehicle Detection Sensor, Type 1B

For Informational Purposes Only

Line no.	Item Code	Adj Code	Quantity	Units	Description[Fixed Unit Price]
0720	907-643-B001		1,190	Linear Feet	Video Vehicle Detection Cable
0730	907-643-C002		3	Each	Video Vehicle Detection Processor, Type 1
0740	907-650-A004		3	Each	On Street Video Equipment, PTZ Type, Signal Monitoring
0750	907-662-D002		4	Each	Radio Interconnect, Broadband, Short Range
0760	907-663-A001		3	Each	Network Switch, Type A
0770	907-899-A001		1	Lump Sum	Railway-Highway Provisions

For Informational Purposes Only

CONDITIONS FOR COMBINATION BID

If a bidder elects to submit a combined bid for two or more of the contracts listed for this month's letting, the bidder must complete and execute these sheets of the proposal in each of the individual proposals to constitute a combination bid. In addition to this requirement, each individual contract shall be completed, executed and submitted in the usual specified manner.

Failure to execute this Combination Bid Proposal in each of the contracts combined will be just cause for each proposal to be received and evaluated as a separate bid.

It is understood that the Mississippi Transportation Commission not only reserves the right to reject any and all proposals, but also the right to award contracts upon the basis of lowest separate bids or combination bids most advantageous to the State.

It is further understood and agreed that the Combination Bid Proposal is for comparison of bids only and that each contract shall operate in every respect as a separate contract in accordance with its proposal and contract documents.

I (We) agree to complete each contract on or before its specified completion date.

* * * *

SECTION 905 - COMBINATION BID PROPOSAL (Continued)

Project Number	Pay Item Number	Unit	Unit Price Reduction	Total Item Reduction	Total Contract Reduction
1. _____	_____	_____	_____	_____	
2. _____	_____	_____	_____	_____	
3. _____	_____	_____	_____	_____	
4. _____	_____	_____	_____	_____	
5. _____	_____	_____	_____	_____	
6. _____	_____	_____	_____	_____	
7. _____	_____	_____	_____	_____	
8. _____	_____	_____	_____	_____	

For Informational Purposes Only

Project Number	Pay Item Number	Unit	Unit Price Reduction	Total Item Reduction	Total Contract Reduction
9. _____	_____ _____	_____ _____	_____ _____	_____ _____	
10. _____	_____ _____	_____ _____	_____ _____	_____ _____	

(c) If Combination C has been selected, then initial and complete ONE of the following.

_____ I (We) desire to be awarded work not to exceed a total monetary value of $ _____.

_____ I (We) desire to be awarded work not to exceed _____ number of contracts.

For Informational Purposes Only

Certification with regard to the Performance of Previous Contracts or Subcontracts subject to the Equal Opportunity Clause and the filing of Required Reports

The Bidder hereby certifies that he has ____, has not ____, participated in a previous contract or subcontract subject to the Equal Opportunity Clause, as required by Executive Orders 10925, 11114, or 11246, and that he has ____, has not ____, filed with the Joint Reporting Committee, the Director of the Office of Federal Contract Compliance, a Federal Government contracting or administering agency, or the former President's Committee on Equal Employment Opportunity, all reports due under the applicable filing requirements.

_____
(COMPANY)

DATE: _____

NOTE: The above certification is required by the Equal Employment Opportunity Regulations of the Secretary of Labor (41 CFR 60-1.7 (b) (1)), and must be submitted by bidders and proposed subcontractors only in connection with contracts and subcontracts which are subject to the Equal Opportunity Clause. Contracts and Subcontracts which are exempt from the Equal Opportunity Clause are set forth in 41 CFR 60-1.5. (Generally only contracts or subcontracts of $10,000 or under are exempt.)

Currently, Standard Form 100 (EEO-1) is the only report required by the Executive Orders or their implementing regulations.

Proposed prime Contractors and Subcontractors who have participated in a previous contract or subcontract subject to the Executive orders and have not filed the required reports should note that 41 CFR 60-1.7 (b) (1) prevents the award of contracts and subcontracts unless such Contractors submit a report covering the delinquent period or such other period specified by the Federal Highway Administration or by the Director, Office of Federal Contract Compliance, U. S. Department of Labor.

For Informational Purposes Only

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

CERTIFICATION

I,_____,
(Name of person signing bid)

individually, and in my capacity as_____ of
(Title of person signing bid)

_____do hereby certify under
(Name of Firm, partnership, or Corporation)

penalty of perjury under the laws of the United States and the State of Mississippi that_____

_____, Bidder
(Name of Firm, Partnership, or Corporation)

on Project No. **NHPP-0009-02(086)/ 108212301000 & STBG-0009-02(094)/ 109575301000**

in **Warren** County(ies), Mississippi, has not either

directly or indirectly entered into any agreement, participated in any collusion; or otherwise taken any action in restraint of free competitive bidding in connection with this contract; nor have any of its corporate officers or principal owners.

Except as noted hereafter, it is further certified that said legal entity and its corporate officers, principal owners, managers, auditors and others in a position of administering federal funds:

a) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;

b) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;

c) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in (b) above; and

d) Have not within a three-year period preceding this application/ proposal had one or more public transactions (Federal, State or local) terminated for cause or default.

Do exceptions exist and are made a part thereof? Yes / No

Any exceptions shall address to whom it applies, initiating agency and dates of such action.

For Informational Purposes Only

Note: Exceptions will not necessarily result in denial of award but will be considered in determining bidder responsibility. Providing false information may result in criminal prosecution or administrative sanctions.

The bidder further certifies that the certification requirements contained in Section XI of Form FHWA 1273, will be or have been included in all subcontracts, material supply agreements, purchase orders, etc. except those procurement contracts for goods or services that are expected to be less than the Federal procurement small purchase threshold fixed at 10 U.S.C. 2304(g) and 41 U.S.C. 253(g) (currently $25,000) which are excluded from the certification requirements.

The bidder further certifies, to the best of his or her knowledge and belief, that:

1) No Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

2) If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this contract, Standard Form-LLL, Disclosure Form to Report Lobbying, in accordance with its instructions will be completed and submitted.

The certification contained in (1) and (2) above is a material representation of fact upon which reliance is placed and a prerequisite imposed by Section 1352, Title 31, U.S. Code prior to entering into this contract. Failure to comply shall be subject to a civil penalty of not less than $10,000 and not more than $100,000. The bidder shall include the language of the certification in all subcontracts exceeding $100,000 and all subcontractors shall certify and disclose accordingly.

All of the foregoing is true and correct.

Executed on _____ _____

Signature

(01/2016 F)

For Information Purposes Only

MISSISSIPPI DEPARTMENT OF TRANSPORTATION

SAM.GOV Registration and Unique Entity ID

Bidders are advised that the Prime Contractor must register and maintain a current registration in the **System for Award Management** (http://sam.gov) at all times during the project. Upon registration, the Contractor will be assigned a SAM Unique Entity ID.

Bidders are advised that prior to the award of this contract, they MUST be registered in the System for Award Management.

I (We) acknowledge that this contract cannot be awarded if I (We) are not registered in the System for Award Management prior to the award of this contract. _____ (Yes / No)

I (We) have a SAM Unique Entity ID. _____ (Yes / No)

SAM Unique Entity ID: _____

Company Name: _____

Company e-mail address: _____

For Informational Purposes Only

SECTION 902

CONTRACT FOR _____
LOCATED IN THE COUNTY(IES) OF _____

STATE OF MISSISSIPPI
COUNTY OF HINDS

This Contract is entered into by and between the Mississippi Transportation Commission (the "Commission") and the undersigned contractor (the "Contractor"), as follows:

As consideration for this Contract, the Commission agrees to pay the Contractor the amount(s) set out in the Proposal attached hereto. Said payment will be made in the manner and at the time(s) specified in the Specifications and/or Special Provisions, if any. In exchange for said consideration, the Contractor hereby agrees to accept the prices stated in the Proposal as full compensation for the furnishing of all labor, materials and equipment, and the execution of the scope of work identified for this referenced Project as contemplated in this Contract, and as more fully outlined in the Contract Documents (the "Work"). The Contract Documents consist of the Advertisement, the Notice to Bidders, the Proposal, the Specifications, the Special Provisions, and the approved Plans, all of which are hereby made a part of this Contract and incorporated herein by reference.

The Contractor shall be responsible for all loss or damage arising out of, or in any way in connection with the Work, or from any unforeseen obstructions or difficulties that may be encountered in the prosecution of the Work, and for all risks of every description connected with the Work, with the exception of any items specifically excluded in the Contract Documents. The Contractor shall fully and faithfully complete the Work in a good and workmanlike manner, according to the Contract Documents and any Supplemental Agreements thereto.

The Contractor further agrees that the Work shall be done under the direct supervision of, and to the complete satisfaction of, the Executive Director of the Mississippi Department of Transportation, or his authorized representative(s), and, when federal funds are involved, subject to the inspection and approval of the Federal Highway Administration, or its agents, and/or the agents of any other state or federal agency whose funds are involved. Further, the Work shall be done in accordance with any applicable state and federal laws, and any such rules and regulations issued by the Commission and/or any relevant Federal Agency.

The Contractor agrees that all labor as outlined in the Contract Documents may be secured from a list furnished by the Manager of the Win Job Center nearest the project location, or any successor thereto.

It is agreed and understood that each and every provision of law and clause required by law to be inserted into this Contract shall be deemed to be inserted herein, and this Contract shall be read and enforced as though it were included herein. If through mere mistake or otherwise, any such provision is not inserted, then upon the application of either party hereto, the Contract shall be physically amended to make such insertion.

For Informational Purposes Only

The Contractor agrees that he has read each and every clause of the Contract Documents, and fully understands the meaning of same, and hereby acknowledges that he will comply with all terms, covenants and agreements therein.

Witness our signatures, this the _____ day of _____, 20___.

_____
Contractor

By: _____
Title: _____

_____
Signed and sealed in the presence of: (name and address of witness)

_____
_____

MISSISSIPPI TRANSPORTATION COMMISSION

_____
Executive Director

_____
Secretary to the Commission

Award authorized by the Mississippi Transportation Commission in session on the ____ day of _____, _____, Minute Book No._____, Page No. _____.

For Informational Purposes Only

SECTION 903
PERFORMANCE BOND

PERFORMANCE BOND FOR THE FOLLOWING CONTRACT:
Project No.: _____

For the construction of: _____

Contract date: _____ Contract Price: _____

FOR OWNER: MISSISSIPPI TRANSPORTATION COMMISSION, 401 N. WEST STREET, JACKSON, MISSISSIPPI 39201.

CONTRACTOR (full legal name, contact person, phone number and address):
_____
_____
_____
_____

SURETY (legal name, phone number, principal place of business and address ***for notice purposes***):
_____
_____
_____

Second Surety (if applicable):
_____
_____
_____

The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors and assigns, to the Owner for the performance of the Contract, which is incorporated herein by reference, and subject to the following terms:

1. If the Contractor fully and faithfully performs the Contract, the Surety and the Contractor shall have no obligation under this Bond.

2. The Surety's obligation under this Bond shall arise after:
   (a) the Owner first provides notice to the Contractor and the Surety that termination is imminent, pursuant to the current edition of the Mississippi Standard Specifications for Road and Bridge Construction, which is a part of the Contract; and
   (b) the Owner declares a Contractor Default, terminates the Contract, and notifies the Surety.

3. Within 20 calendar days as set forth in Section 108.08 of the current edition of the Mississippi Standard Specifications for Road and Bridge Construction, the Surety shall, after discussions with and consent from the Owner, and at the Surety's expense, elect to take one of the following actions:
   (a) Arrange for the Contractor, with the consent of the Owner, to perform and complete the Contract;
   (b) Undertake to perform and complete the Contract itself, through its agents or independent contractors;
   (c) Waive its right to perform and complete, arrange for completion, or obtain a new contractor, and after investigation, determine the amount for which it may be liable to the Owner (subject to the consent of the Owner) and as soon as practicable after the amount is determined, make payment to the Owner.

For Informational Purposes Only

4. If the Surety does not proceed, within a reasonable time frame, to enact and carry out the election made in Paragraph 3, then the Surety shall be deemed to be in default on this Bond, and the Owner shall be entitled to enforce any remedy available to it under the Contract and applicable law.

5. Subject to the commitment by the Owner to pay the Balance of the Contract Price, the Surety is obligated, without duplication, for
   (a) the responsibilities of the Contractor for correction of defective work and completion of the Contract;
   (b) additional legal, design professional and delay costs resulting from the Contractor's Default, and resulting from the actions or failure to act of the Surety under Paragraph 3; and
   (c) liquidated damages, or if no liquidated damages are specified in the Contract, actual damages caused by delayed performance or non-performance of the Contractor.

6. The Surety hereby waives notice of any change, including changes of time, to the Contract or to related subcontracts, purchase orders and other obligations.

7. The penal sum of the Bond shall be equal to the Contract Price; however, the penal sum may be increased or decreased as the result of any subsequent Supplemental Agreements and/or final contract quantities.

8. Notice to the Surety, the Owner or the Contractor shall be mailed or delivered to the address listed for notice purposes on the first page of this Bond.

CONTRACTOR AS PRINCIPAL
Company: _____

Signature: _____
Name: _____
Title: _____
Address: _____
_____

SURETY
Company: _____

Signature: _____ MS Insurance ID # _____
Name: _____
Title: _____
Address: _____
_____

SURETY (if applicable)
Company: _____

Signature: _____ MS Insurance ID # _____
Name: _____
Title: _____
Address: _____
_____

For Informational Purposes Only

SECTION 903
PAYMENT BOND

PAYMENT BOND FOR THE FOLLOWING CONTRACT:
Project No.: _____

For the construction of: _____

Contract date: _____ Contract Price: _____

FOR OWNER: MISSISSIPPI TRANSPORTATION COMMISSION, 401 N. WEST STREET, JACKSON, MISSISSIPPI 39201.

CONTRACTOR (full legal name, contact person, phone number and address):
_____
_____
_____

SURETY (legal name, phone number, principal place of business and address ***for notice purposes***):
_____
_____
_____
Second Surety (if applicable):
_____
_____
_____

The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors and assigns, to the Owner for payment of labor, materials and equipment furnished for use in the performance of the Contract, which is incorporated herein by reference, subject to the following terms:

1. If the Contractor promptly makes payment of all sums due to any and all subcontractors, sub-subcontractors, suppliers to the Contractor, suppliers to subcontractors and/or laborers who have performed work on the project site, and defends, indemnifies and holds harmless the Owner from claims, demands, liens or suits by any person or entity seeking payment for labor, materials or equipment furnished for use in the performance of the Contract, then the Surety and the Contractor shall have no obligation under this Bond.

2. The Owner shall provide notice to the Surety of any claims, demands, liens or suits against the Owner or the Owner's property that it receives from any person or entity ("Claimants") seeking payment for labor, materials or equipment furnished for use in the performance of the Contract.

3. Upon notice of any claims, demands, liens or suits provided by the Owner or Contractor or given to the Surety by a Claimant, the Surety shall promptly and at the Surety's expense, defend, indemnify and hold harmless the Owner against said claim, demand, lien or suit and shall take the following additional actions:
    (a) Send an answer to the Claimant, with a copy to the Owner, within sixty (60) days after receipt of the Claim, stating the amounts that are undisputed and the basis for challenging any amounts that are disputed; and
    (b) Pay or arrange for payment of any undisputed amounts.

For Informational Purposes Only

4. The Surety shall not be liable to the Owner, Claimants or others for obligations of the Contractor that are unrelated to the Contract. The Owner shall not be liable for the payment of any costs or expenses of any Claimant under this Bond and shall have no obligation under this Bond to make payments to, or give notice on behalf of, Claimants, or otherwise have any obligations to Claimants under this Bond.

5. The Surety hereby waives notice of any change, including changes of time, to the Contract or to related subcontracts, purchase orders and other obligations.

6. The penal sum of the Bond shall be equal to the Contract Price; however, the penal sum may be increased or decreased as the result of any subsequent Supplemental Agreements and/or final contract quantities.

CONTRACTOR AS PRINCIPAL
Company: _____

Signature: _____
Name: _____
Title: _____
Address: _____
_____

SURETY
Company: _____

Signature: _____ MS Insurance ID # _____
Name: _____
Title: _____
Address: _____
_____

SURETY (if applicable)
Company: _____

Signature: _____ MS Insurance ID # _____
Name: _____
Title: _____
Address: _____
_____

For Informational Purposes Only

BID BOND

KNOW ALL MEN BY THESE PRESENTS, that we_____
Contractor

_____
Address

_____
City, State ZIP

As principal, hereinafter called the Principal, and _____
Surety

a corporation duly organized under the laws of the state of _____

as Surety, hereinafter called the Surety, are held and firmly bound unto **State of Mississippi, Jackson, Mississippi**

As Obligee, hereinafter called Obligee, in the sum of **Five Per Cent (5%) of Amount Bid**

Dollars($_____)

for the payment of which sum will and truly to be made, the said Principal and said Surety, bind ourselves, our heirs, executors, administrators, successors and assigns, jointly and severally, firmly by these presents.

WHEREAS, the Principal has submitted a bid for **Mill & Overlay approximately 11 miles of US 61 from 0.5 miles North of US 80/SR27 Intersection to 0.36 miles North of SR 465 at Redwood & Reconstruction of Retaining Wall on US 61 South of Redwood, known as Federal Aid Project Nos. NHPP-0009-02(086) / 108212301 & STBG-0009-02(094) / 109575301 in Warren County.**

NOW THEREFORE, the condition of this obligation is such that if the aforesaid Principal shall be awarded the contract, the said Principal will, within the time required, enter into a formal contract and give a good and sufficient bond to secure the performance of the terms and conditions of the contract, then this obligation to be void; otherwise the Principal and Surety will pay unto the Obligee the difference in money between the amount of the bid of the said Principal and the amount for which the Obligee legally contracts with another party to perform the work if the latter amount be in excess of the former, but in no event shall liability hereunder exceed the penal sum hereof.

Signed and sealed this _____day of _____, 20___

_____
(Principal) (Seal)

_____ By:_____
(Witness) (Name) (Title)

_____
(Surety) (Seal)

_____ By:_____
(Witness) (Attorney-in-Fact)

_____
(MS Agent)

_____
Mississippi Insurance ID Number

Rev. 04/18)

MISSISSIPPI DEPARTMENT OF TRANSPORTATION
PILE AND DRIVING EQUIPMENT DATA FORM

Project No.: _____ Bridge No.: _____
Contract No.: _____ Pile Driving Contractor: _____
Termini: _____ County: _____

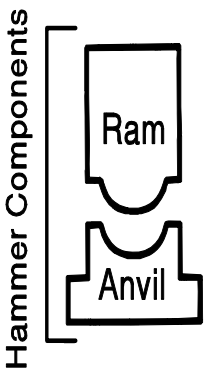

Hammer

Manufacturer: _____ Model No.: _____
Hammer Type: _____ Serial No.: _____
Manufacturer's Maximum Rated Energy: _____ ft·lbs
Stroke at Maximum Rated Energy: _____ ft
Range in Operating Energy: _____ to _____ ft·lbs
Range in Operating Stroke: _____ to _____ ft
Ram Weight: _____ kips
Modifications: _____

Striker Plate

Weight: _____ kips Diameter: _____ in.
Thickness: _____ in.

Hammer Cushion

	Material #1	Material #2 (for composite cushion)
Name:	_____	_____
Area:	_____ in.²	_____ in.²
Thickness/Plate:	_____ in.	_____ in.
No. of Plates:	_____	_____

Total Thickness of Hammer Cushion: _____ in.



Helmet (Drive Head)

Weight: _____ including inserts, kips

Pile Cushion

Pile Cushion Material: _____
Area: _____ in.² Thickness/Sheet: _____ in.
No. of Sheets:
Total Thickness of Pile Cushion: _____ in.



Pile

Pile Type: _____
Wall Thickness: _____ in. Taper: _____
Cross Sectional Area: _____ in.² Weight/ft: _____
Nominal Driving Resistance: _____ Kips
Driving Shoe/Closure Plate Description: _____
_____

Submitted By: _____ Date: _____
Telephone No.: _____ Fax No.: _____
Email Address: _____

FORM CSD-612
Rev. 1 / 2015

YEAR 2026 / 2028 PROGRESS SCHEDULE YEAR 2027 / 2029

PROJECT NUMBER NHPP-0009-02(086) / 108212301
STBG-0009-02(094) / 109575301
COUNTY Warren

WORK PHASE NO.	DESCRIPTION	LINE NUMBERS	JAN	FEB	MAR	APRIL	MAY	JUNE	JULY	AUGUST	SEPTEMBER	OCTOBER	NOV	DEC	JAN	FEB	MAR	APRIL	MAY	JUNE	JULY	AUGUST	SEPTEMBER	OCTOBER	NOV	DEC	
1	Miscellaneous	30-120, 180-440, 510, 540-570, 680-770										0												171			
2	Failed Area Repairs	10-20, 160-170, 470, 520-530										5		22		40		61									
3	Paving	140, 450-460, 480-500																61						138			
4	Shoulders	130, 150																				138		151			
5	Pavement Marking	580-670																					151		171		
	LET:	8/25/2026																									
	NOA:	9/8/2026																									
	NTP/BCT:	10/8/2026																									
	W.D.:	171																									
MONTH			JAN	FEB	MAR	APRIL	MAY	JUNE	JULY	AUGUST	SEPTEMBER	OCTOBER	NOV	DEC	JAN	FEB	MAR	APRIL	MAY	JUNE	JULY	AUGUST	SEPTEMBER	OCTOBER	NOV	DEC	172 WORKING DAYS PER YEAR
ANTICIPATED WORKING DAYS PER MONTH			6	7	11	15	19	20	21	21	20	16	11	5	6	7	11	15	19	20	21	21	20	16	11	5	

NOTE: THE ANTICIPATED WORKING DAYS SHOWN ON THIS SCHEDULE ARE FOR INFORMATIONAL PURPOSES ONLY.
THE ACTUAL WORKING DAY TOTAL AS ASSESSED BY THE PROJECT ENGINEER ON FORM CSD-765 SHALL GOVERN.